

THIS DRAWING IS PROPERTY OF KALA GENSET PVT. LTD. AND MUST BE RETURNED ON REQUEST. IT IS SUBMITTED AS CONFIDENTIAL INFORMATION WITH OUR ENQUIRY, TENDER, ORDER OR CONTRACT NO. IT IS NOT TO BE ISSUED FOR ANY OTHER PURPOSE OR ORDER NOR MAY BE COPIED OR LENT WITHOUT OUR AUTHORITY IN WRITING.

DO NOT SCALE THE DRAWING

IF IN DOUBT ASK

DEVIATION ON
NON TOLERANCED LINEAR
MACHINED DIMENSIONS,
IS: 2102 (Pt-1)-1993
MEDIUM CLASS

FROM UPTO
& INCLUDING
DEVIATION
mm

0.5 - 3	3 - 6	6 - 30	30 - 120	120 - 400	400 - 1000	1000-2000	2000-4000
±0.1	±0.1	±0.2	±0.3	±0.5	±0.8	±1.2	±2

STRAIGHTNESS
FLATNESS
ROUNDNESS
CYLINDRICITY
PROFILE OF A LINE
PROFILE OF A SURFACE
PARALLELISM
SQUARENESS

RUN OUT
ANGULARITY
POSITION
CONCENTRICITY
SYMMETRY
M.M.C.
TRUE POSITION
DATUM

PRODUCT IMPROVEMENT IS A
CONTINUOUS PROCESS. DIMENSION
SPECIFICATION MAY CHANGE WITH
IMPROVEMENT. KINDLY CONTACT
KOEL FOR LATEST INFORMATION

PRINTS OF PREVIOUS
REVISION NO SHOULD
BE SCRAPPED

Rev. No.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.



FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATION DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

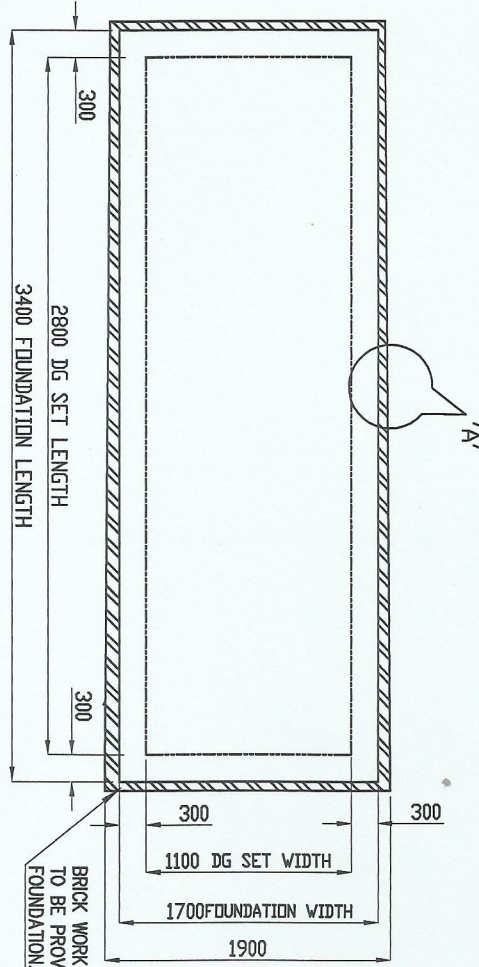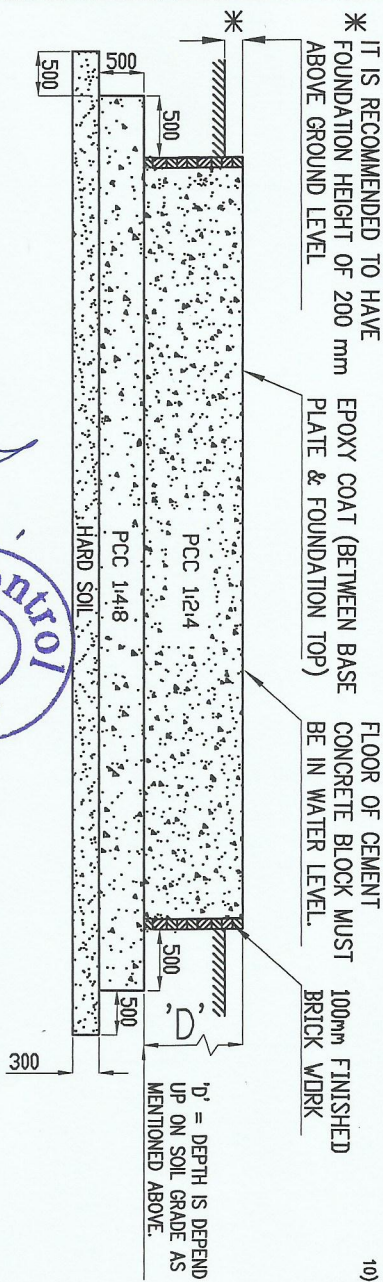


ENLARGED VIEW 'A'

100mm BRICK WALL

NOTES:-1) FOUNDATION TO BE MADE ON A GOOD PREPARED SURFACE WITH SOIL STRATA BEARING CAPACITY ADEQUATE TO SUPPORT THE WEIGHT OF GENSET & FOUNDATION. REFER CHART FOR SOIL STRENGTH.

DEPTH OF SETTING	SOIL STRENGTH
100mm	24,400 - 27,600
200mm	27,600 - 30,800
300mm	30,800 - 34,000
400mm	34,000 - 37,200
500mm	37,200 - 40,400
600mm	40,400 - 43,600
700mm	43,600 - 46,800
800mm	46,800 - 50,000
900mm	50,000 - 53,200
1000mm	53,200 - 56,400
1100mm	56,400 - 59,600
1200mm	59,600 - 62,800
1300mm	62,800 - 66,000
1400mm	66,000 - 69,200
1500mm	69,200 - 72,400
1600mm	72,400 - 75,600
1700mm	75,600 - 78,800
1800mm	78,800 - 82,000
1900mm	82,000 - 85,200
2000mm	85,200 - 88,400
2100mm	88,400 - 91,600
2200mm	91,600 - 94,800
2300mm	94,800 - 98,000
2400mm	98,000 - 101,200
2500mm	101,200 - 104,400
2600mm	104,400 - 107,600
2700mm	107,600 - 110,800
2800mm	110,800 - 114,000
2900mm	114,000 - 117,200
3000mm	117,200 - 120,400
3100mm	120,400 - 123,600
3200mm	123,600 - 126,800
3300mm	126,800 - 130,000
3400mm	130,000 - 133,200
3500mm	133,200 - 136,400
3600mm	136,400 - 139,600
3700mm	139,600 - 142,800
3800mm	142,800 - 146,000
3900mm	146,000 - 149,200
4000mm	149,200 - 152,400
4100mm	152,400 - 155,600
4200mm	155,600 - 158,800
4300mm	158,800 - 162,000
4400mm	162,000 - 165,200
4500mm	165,200 - 168,400
4600mm	168,400 - 171,600
4700mm	171,600 - 174,800
4800mm	174,800 - 178,000
4900mm	178,000 - 181,200
5000mm	181,200 - 184,400
5100mm	184,400 - 187,600
5200mm	187,600 - 190,800
5300mm	190,800 - 194,000
5400mm	194,000 - 197,200
5500mm	197,200 - 200,400
5600mm	200,400 - 203,600
5700mm	203,600 - 206,800
5800mm	206,800 - 210,000
5900mm	210,000 - 213,200
6000mm	213,200 - 216,400
6100mm	216,400 - 219,600
6200mm	219,600 - 222,800
6300mm	222,800 - 226,000
6400mm	226,000 - 229,200
6500mm	229,200 - 232,400
6600mm	232,400 - 235,600
6700mm	235,600 - 238,800
6800mm	238,800 - 242,000
6900mm	242,000 - 245,200
7000mm	245,200 - 248,400
7100mm	248,400 - 251,600
7200mm	251,600 - 254,800
7300mm	254,800 - 258,000
7400mm	258,000 - 261,200
7500mm	261,200 - 264,400
7600mm	264,400 - 267,600
7700mm	267,600 - 270,800
7800mm	270,800 - 274,000
7900mm	274,000 - 277,200
8000mm	277,200 - 280,400
8100mm	280,400 - 283,600
8200mm	283,600 - 286,800
8300mm	286,800 - 290,000
8400mm	290,000 - 293,200
8500mm	293,200 - 296,400
8600mm	296,400 - 299,600
8700mm	299,600 - 302,800
8800mm	302,800 - 306,000
8900mm	306,000 - 309,200
9000mm	309,200 - 312,400
9100mm	312,400 - 315,600
9200mm	315,600 - 318,800
9300mm	318,800 - 322,000
9400mm	322,000 - 325,200
9500mm	325,200 - 328,400
9600mm	328,400 - 331,600
9700mm	331,600 - 334,800
9800mm	334,800 - 338,000
9900mm	338,000 - 341,200
10000mm	341,200 - 344,400

- THE LENGTH & WIDTH OF FOUNDATION SHOULD BE AT LEAST 300 mm MORE ON EACH SIDE THAN GENSET LENGTH & WIDTH RESPECTIVELY.
- CHECK THE FOUNDATION LEVEL DIAGONALLY AS WELL AS ACROSS THE LENGTH & WIDTH FOR EVEN FLATNESS AND SAME SHOULD BE WITHIN ± 50 mm IN HORIZONTAL PLANE IN ANY ONE DIRECTION ONLY.
- ENSURE THAT THE CONCRETE IS COMPLETELY CURED BEFORE POSITIONING THE GENSET.
- ENSURE THAT THE FOUNDATION TO SUPPORT 1.5 TIMES (DYNAMIC LOAD) OF THE TOTAL WEIGHT OF THE SINGLE GENERATING SET INSTALLATION & 2 TIMES OF THE TOTAL WEIGHT FOR THE MULTIPLE GENERATING SET INSTALLATION.
- FOR ROOF TOP INSTALLATION, IT IS NECESSARY TO HAVE PLANNING AND STRUCTURAL DESIGN APPROVAL.
- DO NOT INSTALL GENSET ON LOOSE SAND OR CLAY.
- AVOID HARD/SHARP PROJECTIONS SUCH AS STONE OR STEEL PARTS ON FOUNDATION SURFACE, WHICH MAY DAMAGE FUEL TANK AT BOTTOM.
- AVOID UNEVEN FOUNDATION, WHICH MAY LEAD TO IMPROPER RESTING OF GENSET ON FOUNDATION, THERE BY LEADING TO LEAKAGE OF SOUND AND VIBRATION ON GENSET.
- IF GENSET IS TO BE MOUNTED ON FOUNDATION HAVING UNEVEN SURFACE UNDER UNAVOIDABLE CIRCUMSTANCES, USE APPROPRIATE THICKNESS OF RUBBER MATTING ABOVE FOUNDATION FOR POSITIVE SEALING OF GENSET WITH BASE.
- FOR CABLE TRENCH OPENING, OPTION ON FOUNDATION, REFER TO GENSET GENERAL ARRANGEMENT DRAWING.

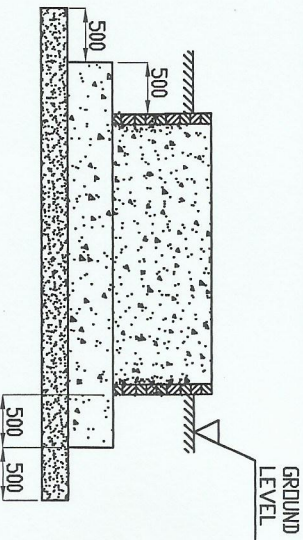

KALA GENSET PVT. LTD.
PUNE 410501 (INDIA)

FOUNDATION PLAN DRAWING
FTR 48807A GL 62.5 KVA

