




THIS DRAWING IS PROPERTY OF KALA GENSET PVT. LTD. AND MUST BE RETURNED ON REQUEST. IT IS SUBMITTED AS CONFIDENTIAL INFORMATION WITH OUR ENQUIRY, TENDER, ORDER OR CONTRACT NO. IT IS NOT TO BE ISSUED FOR ANY OTHER PURPOSE OR ORDER NOR MAY BE COPIED OR LENT WITHOUT OUR AUTHORITY IN WRITING.

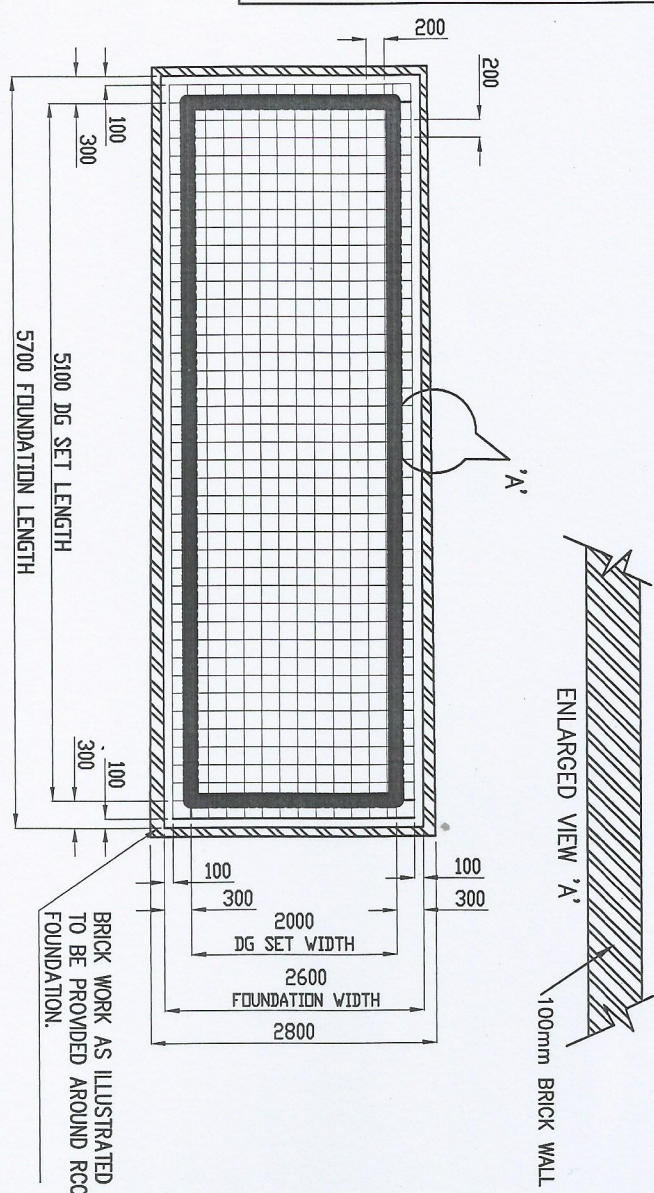

IT IS RECOMMENDED TO HAVE FOUNDATION HEIGHT OF 200 mm ABOVE GROUND LEVEL	EPOXY COAT (BETWEEN BASE PLATE & FOUNDATION TOP)	FLOOR OF CEMENT CONCRETE BLOCK MUST BE IN WATER LEVEL.	100mm FINISHED BRICK WORK
--	---	--	------------------------------

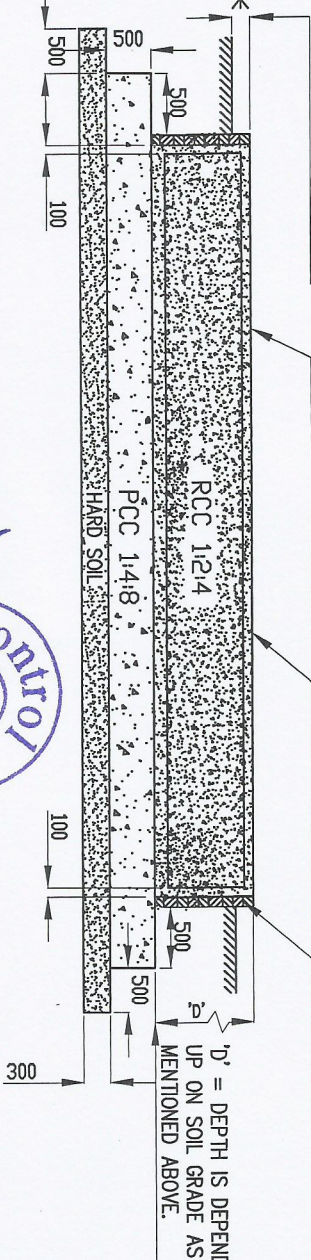

'D' = DEPTH IS DEPENDENT UP ON SOIL GRADE AS MENTIONED ABOVE.

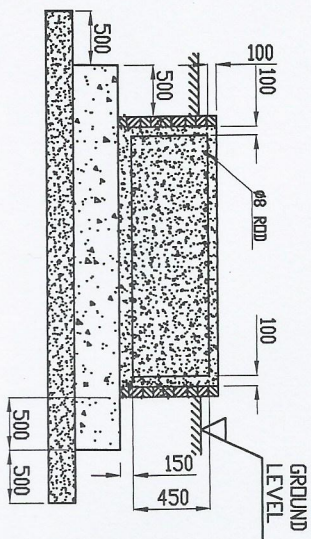

- 1) FOUNDATION TO BE MADE ON A GOOD PREPARED SURFACE WITH SOIL STRATA BEARING CAPACITY ADAPTED TO SUPPORT THE WEIGHT OF GENSET & FOUNDATION.
- REFER CHART FOR SOIL STRENGTH.
- | MATERIAL OF LOAD | SAFE BODING |
|------------------------|--------------------------------|
| BEARING CAPACITY | CAPACITY (KG/CM ²) |
| HARD ROCK GRANITE | 124,100 - 976,400 |
| MEDIUM ROCK SHELL | 97,000 - 1,46,400 |
| HARD PAN | 75,100 - 97,600 |
| SOFT ROCK | 46,800 - 56,600 |
| HARD CLAY | 35,000 - 46,800 |
| GRAVEL AND COARSE SAND | 29,300 - 39,000 |
| COMPACTED FINE SAND | 19,000 - 39,000 |
| MEDIUM CLAY | 9,700 - 29,000 |
| LOOSE FINE SAND | 9,700 - 29,000 |
| SOFT CLAY | 9,700 |
- 2) THE LENGTH & WIDTH OF FOUNDATION SHOULD BE AT LEAST 300 mm MORE ON EACH SIDE THAN ACOUSTIC ENCLOSURE LENGTH & WIDTH RESPECTIVELY.
- 3) THE FOUNDATION LEVEL DIAGONALLY AS WELL AS ACROSS THE LENGTH & WIDTH FOR EVEN FLATNESS AND SAME SHOULD BE WITHIN ±50mm IN HORIZONTAL PLANE IN ANY ONE DIRECTION ONLY.
- 4) ENSURE THAT THE CONCRETE IS COMPLETELY CURED BEFORE POSITIONING THE ENCLOSURE.
- 5) ENSURE THAT THE FOUNDATION TO SUPPORT 1.5 TIMES OF THE TOTAL NET WEIGHT OF THE SINGLE GENERATING SET INSTALLATION & 2 TIMES OF THE TOTAL NET WEIGHT FOR THE MULTIPLE GENERATING SET INSTALLATION.
- 6) FOR ROOFTOP INSTALLATION IT IS NECESSARY TO HAVE PLANNING AND STRUCTURAL DESIGN APPROVAL.
- 7) DO NOT INSTALL ACOUSTIC ENCLOSURE ON LOOSE SAND OR CLAY.
- 8) AVOID HARD/SHARP PROJECTIONS SUCH AS STONE OR STEEL PARTS ON FOUNDATION SURFACE WHICH CAN CAUSE DAMAGE TO THE PROPER SEALING OF GENSET ON FOUNDATION THERE BY LEADING TO LEAKAGE OF SOUND AND VIBRATION ON GENSET.
- 9) IF GENSET IS TO BE MOUNTED ON FOUNDATION HAVING UNLEVEL SURFACE UNDER UNFAVOURABLE CIRCUMSTANCES, USE APPROPRIATE THICKNESS OF ROBERT LAMINATE ABOVE FOUNDATION FOR POSITIVE SEALING OF GENSET WITH BASE.

	SAFETY BEYOND CRITICALITY
WATER OF LOW RADIATION LEVEL	2,441,100 - 9,746,000
HARD ROCK GRANITE	67,800 - 1,464,400
REDUX ROCK SHELL	78,100 - 97,600
HARD PM	48,800 - 56,600
SOFT ROCK	39,000 - 48,800
HARD CLAY	39,000 - 48,800
GRAVEL AND COARSE SAND	29,300 - 39,000
FINE GRAIN COARSE AND MEDIUM SAND	19,600 - 29,300
LOOSE FINE SAND	9,750 - 19,600
SILT CLAY	4,750

GEOMETRIC TOLERANCE SYMBOLS ISO: 8000 (Pt-1) - 1985.	STRAIGHTNESS
	FLATNESS
	ROUNDNESS
	CYLINDRICITY
	PROFILE OF A LINE
	PROFILE OF A SURFACE
	PARALLELISM
	SQUARENESS

PRODUCT IMPROVEMENT IS A
CONTINUOUS PROCESS. DIMENSION
SPECIFICATION MAY CHANGE WITH
IMPROVEMENT. KINDLY CONTACT
KOEL FOR LATEST INFORMATION

R02	FOUNDATION DRAINING REVISED AS PER KOEL EMAIL FROM THIRU ON DTD. 2.11.17	
R01	FOUNDATION DRAINING REVISED	
Rev. No.	REVISION	

LATEST RECOMMENDATIONS.				
	MRT	DCG	09.11.17	
	MRT	DCG	03.05.17	
	MODIFIED BY	APPROVED BY	REF. DATE	

UNLESS OTHERWISE SPECIFIED		PROJECT / CUSTOMER NAME
ALL DIMENSIONS ARE IN INCH. UNMENTIONED TOLERANCES AS PER ASTM D1190/1. * REMOVE ALL SWAP BUSHES AND SWAP BUSHES.		
UNMENTIONED		DWG NO. FILE
		MATERIAL
RADI	2001	RECALL
CHAMFER	3005	3005
UNDERCUT	APPL.	3005
	DATE	9/2/2006
		3

	KALA GENSET PVT. LTD. PUNE 410501 (INDIA)	
	TITLE	FIRST TABLE PROJECTION
DRAWING No-DWG/TA GL/320 KVA/FPD/01	FOUNDATION PLAN DRAWING FOR DWG/TA GL/320 KVA	 
SHEET - 1 OF 1		
SCALE - 1:1		

KALA GENSET PVT LTD,
PUNE 410501 (INDIA)



GENSET PVT LTD,
410501 (INDIA)