


THIS DRAWING IS PROPERTY OF KALA GENSET PVT. LTD. AND MUST BE RETURNED ON REQUEST. IT IS SUBMITTED AS CONFIDENTIAL INFORMATION WITH OUR ENQUIRY, TENDER, ORDER OR CONTRACT NO. IT IS NOT TO BE ISSUED FOR ANY OTHER PURPOSE OR ORDER NOR MAY BE COPIED OR LENT WITHOUT OUR AUTHORITY IN WRITING.

FROM UPTO & INCLUDING DEVIATION mm	0.5 - 3	3 - 6	6 - 30	30 - 120	120 - 400	400 - 1000	1000-2000	2000-4000
DEVIATION ON NON TOLERANCED LINEAR MACHINED DIMENSIONS. IS: 2102 (PL-1)-1993 MEDIUM CLASS	±0.1	±0.1	±0.2	±0.3	±0.5	±0.8	±1.2	±2

IF IN DOUBT ASK

DO NOT SCALE THE DRAWING

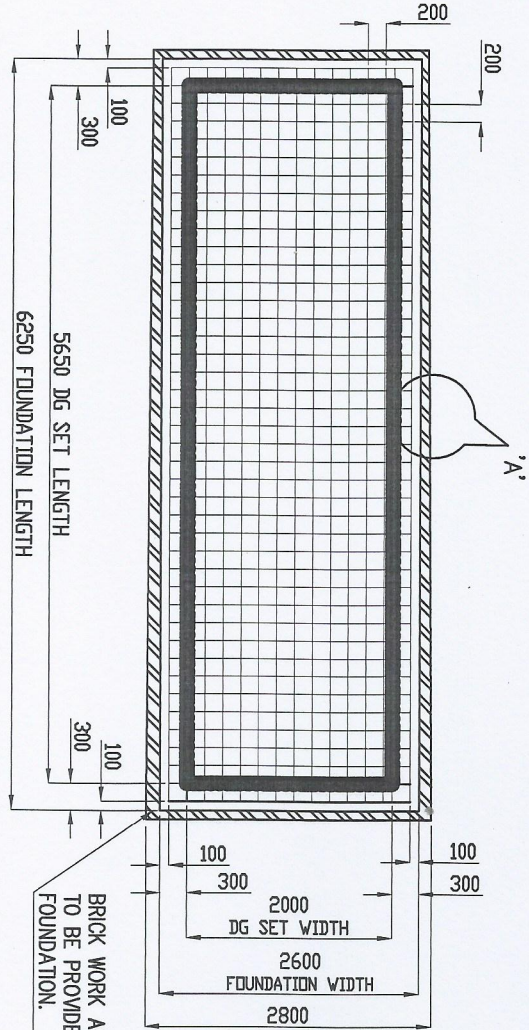

ENLARGED VIEW 'A'

100mm BRICK WALL

BRICK WORK AS ILLUSTRATED TO BE PROVIDED AROUND RCC FOUNDATION.



IT IS RECOMMENDED TO HAVE FOUNDATION HEIGHT OF 200 mm ABOVE GROUND LEVEL.

EPOXY COAT (BETWEEN BASE PLATE & FOUNDATION TOP)

FLOOR OF CEMENT CONCRETE BLOCK MUST BE IN WATER LEVEL.

100mm FINISHED BRICK WORK

'D' = DEPTH IS DEPEND UP ON SOIL GRADE AS MENTIONED ABOVE.

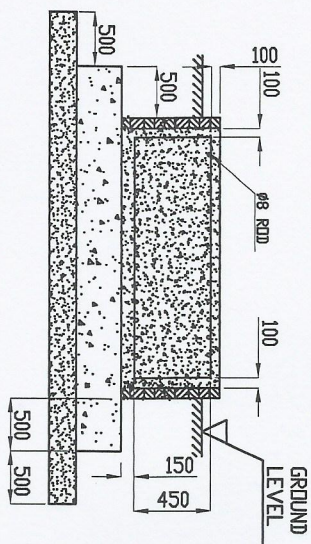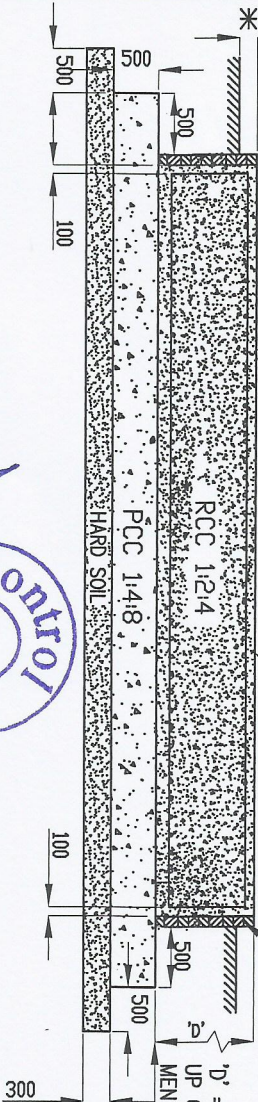

- NOTES:-1) FOUNDATION TO BE MADE ON A GOOD PREPARED SURFACE WITH SOIL STRAIN BEARING CAPACITY ADEQUATE TO SUPPORT THE WEIGHT OF GENSET & FOUNDATION. REFER CHART FOR SOIL STRENGTH.
- | NATURE OF SOIL | SOIL STRENGTH (KPa) | SOIL STRENGTH (KPa) |
|-------------------------|---------------------|---------------------|
| HARD ROCK | 124,100 - 1,241,000 | 124,100 - 1,241,000 |
| MEDIUM ROCK | 12,410 - 124,100 | 12,410 - 124,100 |
| SOFT ROCK | 1,241 - 12,410 | 1,241 - 12,410 |
| SOFT CLAY | 124.1 - 1,241 | 124.1 - 1,241 |
| SOFT MUD | 12.41 - 124.1 | 12.41 - 124.1 |
| LOOSE MEDIUM GRADE SAND | 12,410 - 124,100 | 12,410 - 124,100 |
| LOOSE MEDIUM GRADE SAND | 1,241 - 12,410 | 1,241 - 12,410 |
| LOOSE MEDIUM GRADE SAND | 124.1 - 1,241 | 124.1 - 1,241 |
| LOOSE FINE SAND | 12.41 - 124.1 | 12.41 - 124.1 |
- THE LENGTH & WIDTH OF FOUNDATION SHOULD BE AT LEAST 300 mm MORE ON EACH SIDE THAN ACUSTIC ENCLOSURE LENGTH & WIDTH RESPECTIVELY.
 - THE FOUNDATION LEVEL DIAGONALLY AS WELL AS ACROSS THE LENGTH & WIDTH FOR EVEN FLATNESS AND SAME SHOULD BE WITHIN 450mm IN HORIZONTAL PLANE IN ANY ONE DIRECTION ONLY.
 - ENSURE THAT THE CONCRETE IS COMPLETELY CURED BEFORE POSITIONING THE ENCLOSURE.
 - ENSURE THAT THE FOUNDATION TO SUPPORT 1.5 TIMES OF THE TOTAL WEIGHT OF THE SINGLE GENERATING SET INSTALLATION & 2 TIMES OF THE TOTAL WEIGHT FOR THE MULTIPLE GENERATING SET INSTALLATION.
 - FOR ROOFTOP INSTALLATION IT IS NECESSARY TO HAVE PLANNING AND STRUCTURAL DESIGN APPROVAL.
 - DO NOT INSTALL ACUSTIC ENCLOSURE ON LOOSE SAND OR CLAY. AVOID HARD/SHARP PROJECTIONS SUCH AS STONE OR STEEL PARTS ON FOUNDATION SURFACE WHICH MAY DAMAGE FUEL TANK AT BOTTOM OF GENSET ON FOUNDATION, THERE BY LEADING TO LEAKAGE OF SOUND AND VIBRATION ON GENSET.
 - IF GENSET IS TO BE MOUNTED ON FOUNDATION HAVING UNEVEN SURFACE UNDER UNFAVOURABLE CIRCUMSTANCES USE APPROPRIATE THICKNESS OF RUBBER LAMINATE ABOVE FOUNDATION FOR POSITIVE SEALING OF GENSET WITH BASE.

STRAIGHTNESS	—	RUN OUT
FLATNESS	—	ANGULARITY
ROUNDNESS	—	POSITION
CYLINDRICITY	—	CONCENTRICITY
PROFILE OF A LINE	—	SYMMETRY
PROFILE OF A SURFACE	—	M.M.C.
PARALLELISM	—	TRUE POSITION
SQUARENESS	—	DATUM

PRODUCT IMPROVEMENT IS A CONTINUOUS PROCESS. DIMENSION SPECIFICATION MAY CHANGE WITH IMPROVEMENT. KINDLY CONTACT KOEL FOR LATEST INFORMATION.

PRINTS OF PREVIOUS REVISION NO SHOULD BE SCRAPPED

FOUNDATIONS DRAWING REVISIONS AS PER KOEL LATEST RECOMMENDATIONS.

FOUNDATIONS DRAWING REVISIONS.

UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN mm.

UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN mm.

UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN mm.

UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN mm.

UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN mm.

KALA GENSET PVT. LTD. PUNE 410501 (INDIA)

FOUNDATION PLAN DRAWING FOR DAYVITA G. 500 KVA

FIRST ANGLE PROJECTION