


	THIS DRAWING IS PROPERTY OF KALA GENSET PVT. LTD. AND MUST BE RETURNED ON REQUEST. IT IS SUBMITTED AS CONFIDENTIAL INFORMATION WITH OUR ENQUIRY, TENDER, ORDER OR CONTRACT NO. IT IS NOT TO BE ISSUED FOR ANY OTHER PURPOSE OR ORDER NOR MAY BE COPIED OR LENT WITHOUT OUR AUTHORITY IN WRITING.
--	--

IF IN DOUBT ASK



100mm BRICK WALL

WITH SOIL STRATA BEARING CAPACITY ADEQUATE TO SUPPORT THE WEIGHT OF GENSET & FOUNDATION. REFER CHART FOR SOIL STRENGTH.

- 2) THE LENGTH & WIDTH OF FOUNDATION SHOULD BE AT LEAST 300 mm MORE ON EACH SIDE THAN ACUSTIC ENCLOSURE LENGTH & WIDTH RESPECTIVELY.
- 3) CHECK THE FOUNDATION LEVEL DIAGONALLY AS WELL AS ACROSS THE LENGTH & WIDTH FOR EVEN FLATNESS AND SAME SHOULD BE WITHIN ± 50 mm IN HORIZONTAL PLANE IN ANY ONE DIRECTION ONLY.
- 4) ENSURE THAT THE CONCRETE IS COMPLETELY CURED BEFORE POSITIONING THE ENCLOSURE.
- 5) ENSURE THAT THE FOUNDATION TO SUPPORT 1.5 TIMES OF THE TOTAL WET WEIGHT OF THE SINGLE GENERATING SET INSTALLATION & 2 TIMES OF THE TOTAL WET WEIGHT FOR THE MULTIPLE GENERATING SET INSTALLATION.
- 6) FOR ROOF TOP INSTALLATION, IT IS NECESSARY TO HAVE PLANNING AND STRUCTURAL DESIGN APPROVAL.
- 7) DO NOT INSTALL ACUSTIC ENCLOSURE ON LOOSE SAND OR CLAY. AVOID HARD/SHARP PROJECTIONS SUCH AS STONE OR STEEL PARTS ON FOUNDATION SURFACE WHICH MAY DAMAGE FLEXI-TANK AT BOTTOM.
- 8) AVOID UNEVEN FOUNDATION WHICH MAY LEAD TO LEAKAGE OF SOUND AND VIBRATION IN GENSET.
- 9) IF GENSET IS TO BE MOUNTED ON FOUNDATION HAVING UNEVEN SURFACE UNDER UNAVOIDABLE CIRCUMSTANCES, USE APPROPRIATE THICKNESS OF RUBBER MATTING ABOVE FOUNDATION FOR POSITIVE SEALING OF GENSET WITH BASE.


IT IS RECOMMENDED TO HAVE
FOUNDATION HEIGHT OF 200 mm
ABOVE GROUND LEVEL

EPOXY COAT (BETWEEN BASE PLATE & FOUNDATION TOP)

**FLOOR OF CEMENT
CONCRETE BLOCK MUST
BE IN WATER LEVEL.**

100mm FINISHED
BRICK WORK

'D' = DEPTH IS DEPEND UP ON SOIL GRADE AS MENTIONED ABOVE.

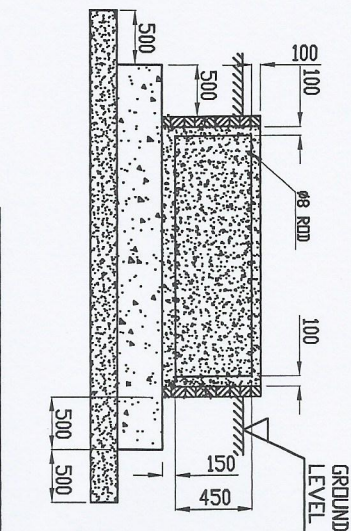

GENERAL TOLERANCE +50
ALL DIMENSIONS ARE IN mm

KALA GENSET PVT LTD
PUNE 410501 (INDIA)

PRODUCT IMPROVEMENT IS A CONTINUOUS PROCESS. DIMENSION SPECIFICATION MAY CHANGE WITH IMPROVEMENT. KINDLY CONTACT KOEL FOR LATEST INFORMATION

MBT	DCG	09.11.17

UNLESS OTHERWISE SPECIFIED	PROJECT/ CUSTOMER NAME
• ALL DIMENSIONS ARE IN mm. • UNINTENTIONED TO BENEFITS AS PER C.O.S.D.NO.11001. • REMOVE ALL SHARP BURNS AND SHARP EDGES.	CAD DRG FILE
	MATERIAL
1. ALL INFORMATION IS FOR YOUR INFORMATION ONLY.	DATE
	REVISIONS



KALA
PUNA

PRINTS OF PREVIOUS
REVISION NO SHOULD
BE SCRAPPED

Rev. No.	REVISION
R01	FOUNDATION DRAWING REVISED

2	0
---	---

MBT	DCG	0
MODIFIED BY	APPROVED BY	

REF.	DATE	UNIFORM (LUND)	
		IRON	WASH
		RADII	CHD, D05
		CHAFER	APPL, D05
		UNDERCUT	DATE E9042806

DRAWING No-DW/21A 62/625KV/FPD/01
SHEET- 1 OF 1
SCALE - 3d

FOUNDATION PLAN DRAWING
FOR DIVIETA G2_625 KVA