

DO NOT SCALE THE DRAWING

DO NOT SCALE THE DRAWING

IF IN DOUBT ASK

IT IS RECOMMENDED TO HAVE  
FOUNDATION HEIGHT OF 200 mm  
ABOVE GROUND LEVEL

EPOXY COAT (BETWEEN BASE  
PLATE & FOUNDATION TOP)

FLOOR OF CEMENT  
CONCRETE BLOCK MU  
BE IN WATER LEVEL.

**100mm FINISHED  
BRICK WORK**

BRICK WORK AS ILLUSTRATED  
TO BE PROVIDED AROUND RCC  
FOUNDATION.

6800 DG SET LENGTH

A diagram showing two vertical upward arrows. The left arrow is labeled '100' and the right arrow is labeled '300'.

BRICK WORK AS ILLUSTRATED  
TO BE PROVIDED AROUND RCC

ENLARGED VIEW 'A'


ENLARGED VIEW 'A'

100mm BRICK WALL

**NOTES:-1) FOUNDATION TO BE MADE ON A GOOD PREPARED SURFACE WITH SOIL STRATA BEARING CAPACITY ADEQUATE TO SUPPORT THE WEIGHT OF GENSET & FOUNDATION. REFER CHART FOR SOIL STRENGTH.**

| MAINTENANCE OF LIND<br>BEARING MATERIAL         | SAFE BEARING<br>CAPACITY (K/CSM) |
|-------------------------------------------------|----------------------------------|
| HARD ROCK GRANITE                               | 2,44,000 - 9,76,400              |
| MEDIUM ROCK SHELL                               | 97,600 - 1,46,400                |
| HARD PAN                                        | 70,000 - 97,600                  |
| SOFT ROCK                                       | 40,800 - 59,600                  |
| GRAVEL AND COARSE SAND                          | 39,000 - 49,600                  |
| LOOSE, MEDIUM COARSE AND<br>COMPACTED FINE SAND | 39,000 - 49,600                  |
| MEDIUM CLAY                                     | 29,500 - 39,000                  |
| LOOSE FINE SAND                                 | 19,500 - 39,000                  |
| SOFT CLAY                                       | 9,760 - 39,500                   |

- 2) THE LENGTH & WIDTH OF FOUNDATION SHOULD BE AT LEAST 300 mm MORE ON EACH SIDE THAN ACUSTIC ENCLOSURE LENGTH & WIDTH RESPECTIVELY.
- 3) CHECK THE FOUNDATION LEVEL DIAGONALLY AS WELL AS ACROSS THE LENGTH & WIDTH FOR EVEN FLATNESS AND SAME SHOULD BE WITHIN  $\pm 50\text{mm}$  IN HORIZONTAL PLANE IN ANY ONE DIRECTION ONLY.
- 4) ENSURE THAT THE CONCRETE IS COMPLETELY CURED BEFORE POSITIONING THE ENCLOSURE.
- 5) ENSURE THAT THE FOUNDATION TO SUPPORT 15 TIMES OF THE TOTAL VET WEIGHT OF THE SINGLE GENERATING SET INSTALLATION & 2 TIMES OF THE TOTAL VET WEIGHT FOR THE MULTIPLE GENERATING SET INSTALLATION.
- 6) FOR ROOF-TOP INSTALLATION, IT IS NECESSARY TO HAVE PLANNING AND STRUCTURAL DESIGN APPROVAL.
- 7) DO NOT INSTALL ACUSTIC ENCLOSURE ON LOOSE SAND OR CLAY. AVOID HARD/SHARP PROJECTIONS SUCH AS STONE OR STEEL PARTS ON FOUNDATION SURFACE WHICH MAY DAMAGE FUEL TANK AT BOTTOM.
- 8) AVOID UNEVEN FOUNDATION WHICH MAY LEAD TO IMPROPER RESTING OF GENSET ON FOUNDATION, THERE BY LEADING TO LEAKAGE OF SOUND AND VIBRATION ON GENSET.
- 9) IF GENSET IS TO BE MOUNTED ON FOUNDATION HAVING UNEVEN SURFACE UNDER UNAVOIDABLE CIRCUMSTANCES, USE APPROPRIATE THICKNESS OF RUBBER HATTING ABOVE FOUNDATION FOR POSITIVE SEALING OF GENSET WITH BASE.

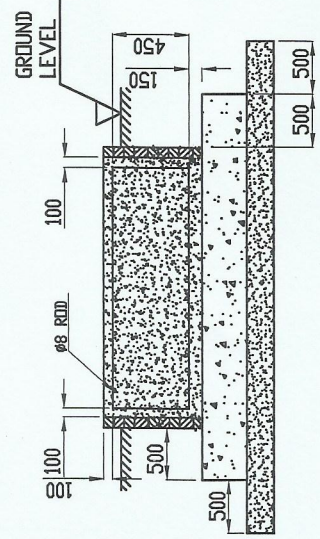

GENERAL TOLERANCE +50  
ALL DIMENSIONS ARE IN mm.



KALA GENSET PVT LTD,  
PUNE 410501 ( INDIA)

|    |       |                                                    |                                                                                     |                        |
|----|-------|----------------------------------------------------|-------------------------------------------------------------------------------------|------------------------|
| 01 | TITLE | FOUNDATION PLAN DRAWING<br>FOR DM12ETA G11 750 KVA |  | FIRST ANGLE PROJECTION |
|----|-------|----------------------------------------------------|-------------------------------------------------------------------------------------|------------------------|

TITLE FOUNDATION PLAN DRAWING FOR DV12ETA GU 750 kVA


 FIRST ANGLE PROJECTION

|                        |                                                                                                                                              |
|------------------------|----------------------------------------------------------------------------------------------------------------------------------------------|
| STRAIGHTNESS           | PRODUCT IMPROVEMENT IS A CONTINUOUS PROCESS. DIMENSION SPECIFICATION MAY CHANGE WITH IMPROVEMENT. KINDLY CONTACT KOEL FOR LATEST INFORMATION |
| FLATNESS               | PRINTS OF PREVIOUS                                                                                                                           |
| ROUNDNESS              | REVISION NO SHOULD                                                                                                                           |
| CIRCULARITY            | BE SCRAPPED                                                                                                                                  |
| PROFILE OF A LINE      |                                                                                                                                              |
| PROFILE OF A SURF.     |                                                                                                                                              |
| PARALLELISM            |                                                                                                                                              |
| PERPENDICULARITY       |                                                                                                                                              |
| TOLERANCE SYMBOLS      |                                                                                                                                              |
| IS: 8000 (Pt.-1)-1985. |                                                                                                                                              |

PRINTS OF PREVIOUS  
REVISION NO SHOULD  
BE SCRAPPED

|  |  |
|--|--|
|  |  |
|  |  |

FOUNDATION DRAWING RESET AS PER K

|  |  |
|--|--|
|  |  |
|  |  |

1111

PER CO.STD.NO.11001.



PUNE

410501 &lt; IN

IA)