

MODEL: -KG4-400WS11


NOTES:-1) FOUNDATION TO BE MADE ON A GOOD PREPARED SURFACE WITH SOIL STRATA BEARING CAPACITY ADEQUATE TO SUPPORT THE WEIGHT OF GENSET & FOUNDATION. REFER CHART FOR SOIL STRENGTH.

NATURE OF LOAD	SAFE BEARING CAPACITY (kg/cm ²)
HARD ROCK GRANITE	2,14,000 - 5,74,000
MEDIUM ROCK SHELL	97,000 - 1,46,000
HARD PM	78,100 - 97,000
SOFT ROCK	48,000 - 58,000
HARD CLAY	28,000 - 48,000
GRAVEL AND COARSE SAND	28,000 - 48,000
COARSE SAND AND MEDIUM SAND	28,000 - 38,000
COMPACTED FINE SAND	18,000 - 28,000
MEDIUM CLAY	18,000 - 28,000
LOOSE FINE SAND	8,700 - 28,000
SOFT CLAY	8,700

- 2) THE LENGTH & WIDTH OF FOUNDATION SHOULD BE AT LEAST 300 mm MORE ON EACH SIDE THAN ACOUSTIC ENCLOSURE LENGTH & WIDTH.
- 3) CHECK THE FOUNDATION LEVEL DIAGONALLY AS WELL AS ACROSS THE LENGTH & WIDTH FOR EVEN FLATNESS AND SAME SHOULD BE WITHIN ± 50 mm IN HORIZONTAL PLANE IN ANY ONE DIRECTION ONLY.
- 4) ENSURE THAT THE CONCRETE IS COMPLETELY CURED BEFORE POSITIONING THE ENCLOSURE.
- 5) ENSURE THAT THE FOUNDATION TO SUPPORT 1.5 TIMES OF THE TOTAL NET WEIGHT OF THE SINGLE GENERATING SET INSTALLATION & 2 TIMES OF THE TOTAL NET WEIGHT FOR THE MULTIPLE GENERATING SET INSTALLATION.
- 6) FOR ROOFTOP INSTALLATION IT IS NECESSARY TO HAVE PLANNING AND STRUCTURAL DESIGN APPROVAL.
- 7) DO NOT INSTALL ACOUSTIC ENCLOSURE ON LOOSE SAND OR CLAY.
- 8) AVOID HARD/SHARP PROJECTIONS SUCH AS STONE OR STEEL PARTS ON FOUNDATION SURFACE WHICH MAY DAMAGE RUBBER MATTING AT BOTTOM OF ACOUSTIC ENCLOSURE. WHICH MAY LEAD TO LEAKAGE OF SOUND AND VIBRATION ON GENSET.
- 9) IF GENSET IS TO BE MOUNTED ON FOUNDATION HAVING UNEVEN SURFACE UNDER UNAVOIDABLE CIRCUMSTANCES, USE APPROPRIATE THICKNESS OF RUBBER MATTING ABOVE FOUNDATION FOR POSITIVE SEALING OF GENSET WITH BASE.

ENLARGED VIEW 'A'

100mm BRICK WALL

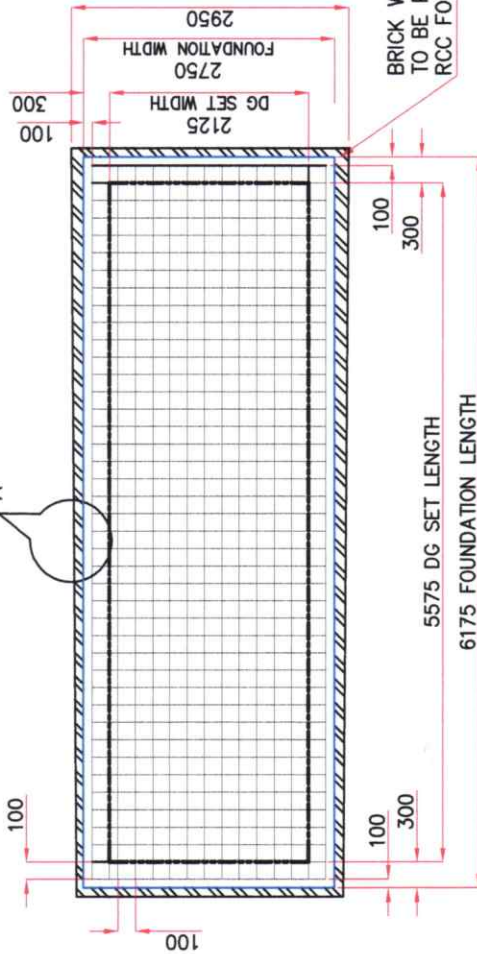

BRICK WORK AS ILLUSTRATED TO BE PROVIDED AROUND RCC FOUNDATION.

IT IS RECOMMENDED TO HAVE FOUNDATION HEIGHT OF 200 mm EPOXY COAT (BETWEEN BASE PLATE & FOUNDATION TOP) BE IN WATER LEVEL.

FLOOR OF CEMENT CONCRETE BLOCK MUST BE IN WATER LEVEL.

100mm FINISHED BRICK WORK



'D' = DEPTH IS DEPEND UP ON SOIL GRADE AS MENTIONED ABOVE.



GENERAL TOLERANCE ± 50 ALL DIMENSIONS ARE IN mm.

KALA GENSET PVT LTD.
PUNE 410501 (INDIA)



UNLESS OTHERWISE SPECIFIED
• ALL DIMENSIONS ARE IN mm.
• UNMENTIONED TOLERANCES AS PER IS: 2102 (PT-1)-1993.
• REMOVE ALL SHARP EDGES AND ROUNDS.

PROPERTY/CUSTOMER NAME
CNO DRA FILE
MATERIAL
UNMENTIONED
RADIO CHAMFER
UNDERCUT

APPROVED BY
MODIFIED BY
DATE

REV. NO.
DATE

REVISION

PRINTS OF PREVIOUS REVISION NO SHOULD BE SCRAPPED

TOUGHNESS
STRESS
STRAIN

ISO 9001:2015

DRAWING No: DVB/400WS11/PD/04/02 TITLE
REV. No: 00 FOUNDATION PLAN DRAWING
FOR DVB-400 KVA CPCB++
SHEET : 1 OF 1
SCALE : 1:1

PROPERTY/CUSTOMER NAME
CNO DRA FILE
MATERIAL
UNMENTIONED
RADIO CHAMFER
UNDERCUT

APPROVED BY
MODIFIED BY
DATE

REV. NO.
DATE

REVISION

PRINTS OF PREVIOUS REVISION NO SHOULD BE SCRAPPED

TOUGHNESS
STRESS
STRAIN

ISO 9001:2015