
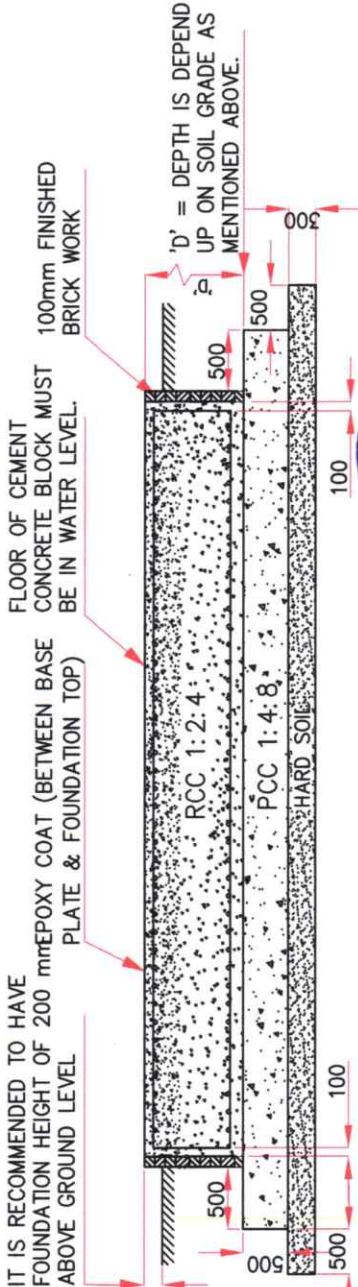
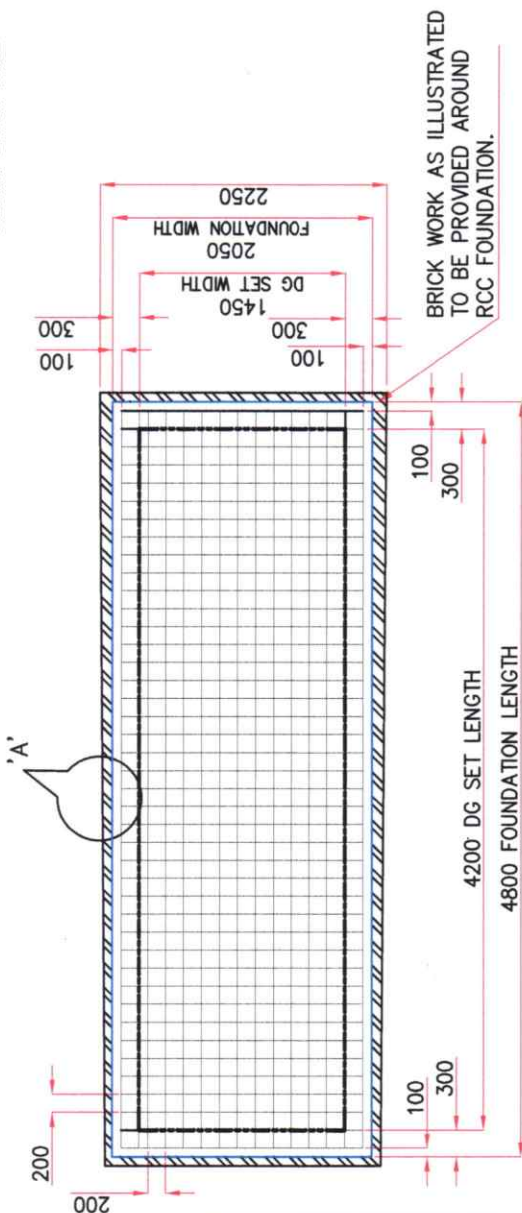


MODEL: -KG4-200WS1

NOTES:-1) FOUNDATION TO BE MADE ON A GOOD PREPARED SURFACE WITH SOIL STRATA BEARING CAPACITY ADEQUATE TO SUPPORT THE WEIGHT OF GENSET & FOUNDATION. REFER CHART FOR SOIL STRENGTH.

| SOIL TYPE                                  | SOIL BEARING CAPACITY (KG/CM <sup>2</sup> ) |
|--------------------------------------------|---------------------------------------------|
| HARD ROCK GRANITE                          | 2,41,000 - 8,76,400                         |
| MEDIUM ROCK SHELL                          | 87,600 - 1,48,400                           |
| HARD PAN                                   | 78,100 - 87,600                             |
| SOFT ROCK                                  | 48,000 - 58,600                             |
| HARD CLAY                                  | 28,000 - 48,000                             |
| GRAVEL AND COARSE SAND                     | 28,000 - 48,000                             |
| LOOSE MEDIUM GRADE AND COMPACTED FINE SAND | 28,000 - 38,000                             |
| MEDIUM CLAY                                | 18,000 - 28,000                             |
| LOOSE FINE SAND                            | 8,750 - 28,000                              |
| SOFT CLAY                                  | 8,750                                       |

- 2) THE LENGTH & WIDTH OF FOUNDATION SHOULD BE AT LEAST 300 mm MORE ON EACH SIDE THAN GENSET LENGTH & WIDTH RESPECTIVELY.
- 3) CHECK THE FOUNDATION LEVEL DIAGONALLY AS WELL AS ACROSS THE LENGTH & WIDTH FOR EVEN FLATNESS AND SAME SHOULD BE WITHIN 3.50mm IN HORIZONTAL PLANE IN ANY ONE DIRECTION ONLY.
- 4) ENSURE THAT THE CONCRETE IS COMPLETELY CURED BEFORE POSITIONING THE GENSET.
- 5) ENSURE THAT THE FOUNDATION TO SUPPORT 1.5 TIMES (DYNAMIC LOAD) OF THE TOTAL NET WEIGHT OF THE SINGLE GENERATING SET INSTALLATION & 2 TIMES OF THE TOTAL NET WEIGHT FOR THE MULTIPLE GENERATING SET INSTALLATION.
- 6) FOR ROOFTOP INSTALLATION IT IS NECESSARY TO HAVE PLANNING AND STRUCTURAL DESIGN APPROVAL.
- 7) DO NOT INSTALL GENSET ON LOOSE SAND OR CLAY.
- 8) AVOID HARD/SHARP PROJECTIONS SUCH AS STONE OR STEEL PARTS ON FOUNDATION SURFACE WHICH MAY DAMAGE FUEL TANK AT BOTTOM.
- 9) AVOID UNEVEN FOUNDATION WHICH MAY LEAD TO IMPROPER RESTING OF GENSET ON FOUNDATION, THERE BY LEADING TO LEAKAGE OF SOUND AND VIBRATION ON GENSET.
- 10) IF GENSET IS TO BE MOUNTED ON FOUNDATION HAVING UNEVEN SURFACE UNDER UNAVOIDABLE CIRCUMSTANCES, USE APPROPRIATE THICKNESS OF RUBBER MATTING ABOVE FOUNDATION FOR POSITIVE SEALING OF GENSET WITH BASE.
- 11) FOR CABLE TRENCH OPENING OPTION ON FOUNDATION, REFER TO GENSET GENERAL ARRANGEMENT DRAWING.

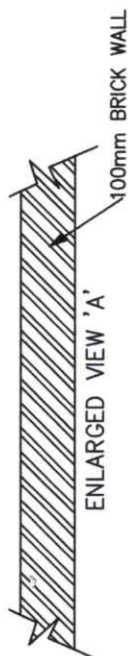

|                                                                                                                                                            |                                                   |
|------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------|
| KALA GENSET PVT LTD.<br>PUNE 410501 (INDIA)                                                                                                                |                                                   |
| DRAWING NO. - KGENSET/200WS1/PD/02                                                                                                                         |                                                   |
| REV. NO. 00                                                                                                                                                | FOUNDATION PLAN DRAWING                           |
| FOR 6K100BETA 4021_200 KVA                                                                                                                                 |                                                   |
| SCALE 1:1                                                                                                                                                  |                                                   |
| FIRST ANGLE PROJECTION                                                                                                                                     |                                                   |
| UNLESS OTHERWISE SPECIFIED<br>• ALL DIMENSIONS ARE IN mm.<br>• UNMENTIONED TOLERANCES AS PER IS:2002/ISO:1101.<br>• REINFORCE ALL SHARP EDGES AND CORNERS. |                                                   |
| PROJECT / CUSTOMER NAME                                                                                                                                    | DATE                                              |
| DESIGNER                                                                                                                                                   | APPROVED BY                                       |
| CHECKED                                                                                                                                                    | MODIFIED BY                                       |
| APPROVED                                                                                                                                                   | REVISION                                          |
| Rev. No.                                                                                                                                                   | PRINTS OF PREVIOUS REVISION NO SHOULD BE SCRAPPED |