


NOTES:-1) FOUNDATION TO BE MADE ON A GOOD PREPARED SURFACE WITH SOIL STRATA BEARING CAPACITY ADEQUATE TO SUPPORT THE WEIGHT OF GENSET & FOUNDATION. REFER CHART FOR SOIL STRENGTH.

NATURE OF LOAD	SAFE BEARING CAPACITY KG/RSQM
HARD ROCK GRANITE	2,44,100 - 9,76,400
MEDIUM ROCK SHELL	97,600 - 1,46,400
HARD PAN	78,100 - 97,600
SOFT ROCK	48,800 - 58,800
HARD CLAY	30,000 - 48,800
GRAVEL AND COARSE SAND	30,000 - 48,800
LOOSE/MEDIUM COARSE AND COMPACTED FINE SAND	28,300 - 38,000
MEDIUM CLAY	18,500 - 38,000
LOOSE FINE SAND	9,760 - 38,500
SOFT CLAY	9,760

- THE LENGTH & WIDTH OF FOUNDATION SHOULD BE AT LEAST 300 mm MORE ON EACH SIDE THAN GENSET LENGTH & WIDTH RESPECTIVELY.
- CHECK THE FOUNDATION LEVEL DIAGONALLY AS WELL AS ACROSS THE LENGTH & WIDTH FOR EVEN FLATNESS AND SAME SHOULD BE WITHIN ± 50 mm IN HORIZONTAL PLANE IN ANY ONE DIRECTION ONLY.
- ENSURE THAT THE CONCRETE IS COMPLETELY CURED BEFORE POSITIONING THE GENSET.
- ENSURE THAT THE FOUNDATION TO SUPPORT 1.5 TIMES (DYNAMIC LOAD) OF THE TOTAL WET WEIGHT OF THE SINGLE GENERATING SET INSTALLATION & 2 TIMES OF THE TOTAL WET WEIGHT FOR THE MULTIPLE GENERATING SET INSTALLATION.
- FOR ROOFTOP INSTALLATION IT IS NECESSARY TO HAVE PLANNING AND STRUCTURAL DESIGN APPROVAL.
- DO NOT INSTALL GENSET ON LOOSE SAND OR CLAY.
- AVOID HARD/SHARP PROJECTIONS SUCH AS STONE OR STEEL PARTS ON FOUNDATION SURFACE WHICH MAY DAMAGE FUEL TANK AT BOTTOM.
- AVOID UNEVEN FOUNDATION WHICH MAY LEAD TO IMPROPER RESTING OF GENSET ON FOUNDATION, THERE BY LEADING TO LEAKAGE OF SOUND AND VIBRATION ON GENSET.
- IF GENSET IS TO BE MOUNTED ON FOUNDATION HAVING UNEVEN SURFACE UNDER UNAVOIDABLE CIRCUMSTANCES USE APPROPRIATE THICKNESS OF RUBBER MATTING ABOVE FOUNDATION FOR POSITIVE SEALING OF GENSET WITH BASE.
- FOR CABLE TRENCH OPENING OPTION ON FOUNDATION. REFER TO GENSET GENERAL ARRANGEMENT DRAWING.

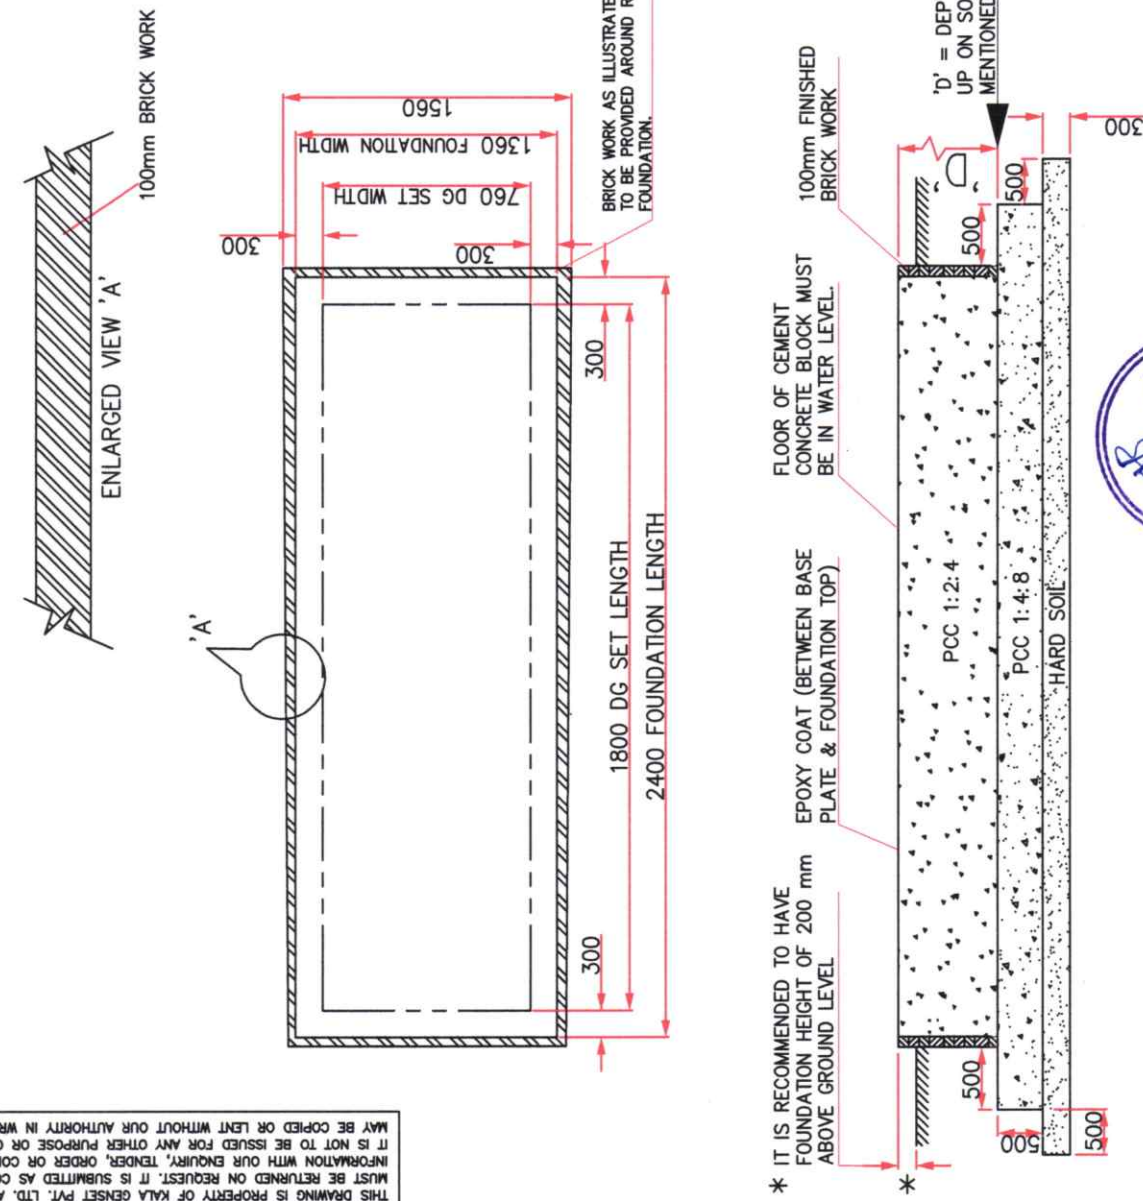

KALA GENSET PVT LTD.
PUNE 410501 (INDIA)

PROPERTY/CUSTOMER NAME	
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN mm.	
UNMENTIONED TOLERANCES AS PER IS 2768 PART 1, 1985.	
REMOVE ALL SHARP EDGES AND ROUNDS	
UNMENTIONED	
RADIO	
CHAMFER	
UNDERCUT	
DATE	01.02.2024
APPROVED BY	
MODIFIED BY	
REVISION	
Rev. No.	

PRODUCT IMPROVEMENT IS A CONTINUOUS PROCESS. DIMENSION SPECIFICATION MAY CHANGE WITH IMPROVEMENT. KINDLY CONTACT KOEL FOR LATEST INFORMATION.	
PRINTS OF PREVIOUS REVISION NO SHOULD BE SCRAPPED	

GEOMETRIC TOLERANCE SURFACE TEXTURE	
STRAIGHTNESS	
ROUNDNESS	
CONCENTRICITY	
SYMMETRY	
POSITION	
ANGULARITY	
RUN OUT	
DATE	
TRUE POSITION	
M.L.C.	
SYMMETRY	
CONCENTRICITY	
POSITION	
ANGULARITY	
RUN OUT	

DO NOT SCALE THE DRAWING

IF IN DOUBT ASK

DEVIATION ON NON TOLERANCED DIMENSIONS	DEVIATION	FROM UP TO
IS: 2102 (Pt-1)-1985	±0.1	0.5 - 3
IS: 2102 (Pt-1)-1985	±0.1	3 - 6
IS: 2102 (Pt-1)-1985	±0.2	6 - 30
IS: 2102 (Pt-1)-1985	±0.3	30 - 120
IS: 2102 (Pt-1)-1985	±0.5	120 - 400
IS: 2102 (Pt-1)-1985	±0.8	400 - 1000
IS: 2102 (Pt-1)-1985	±1.2	1000 - 2000
IS: 2102 (Pt-1)-1985	±2	2000 - 4000

THIS DRAWING IS PROPERTY OF KALA GENSET PVT. LTD. AND MAY BE COPIED OR LENT WITHOUT OUR AUTHORITY IN WRITING. IT IS NOT TO BE ISSUED FOR ANY OTHER PURPOSE OR ORDER NOR INFORMATION WITH OUR ENQUIRY, TENDER, ORDER OR CONTRACT NO. MUST BE RETURNED ON REQUEST. IT IS SUBMITTED AS CONFIDENTIAL.