
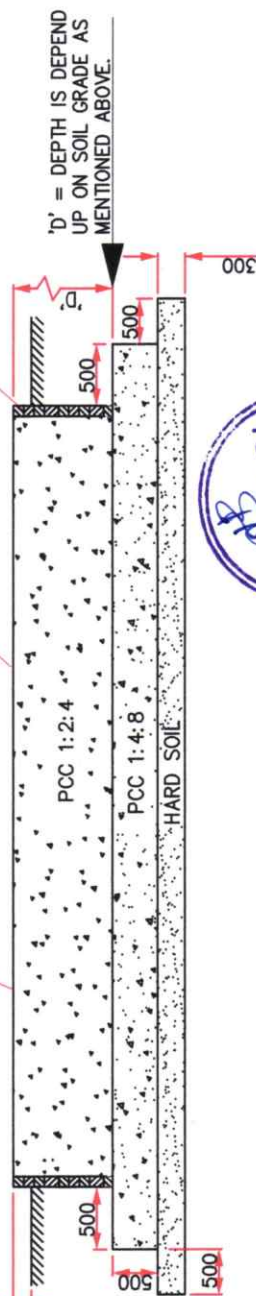
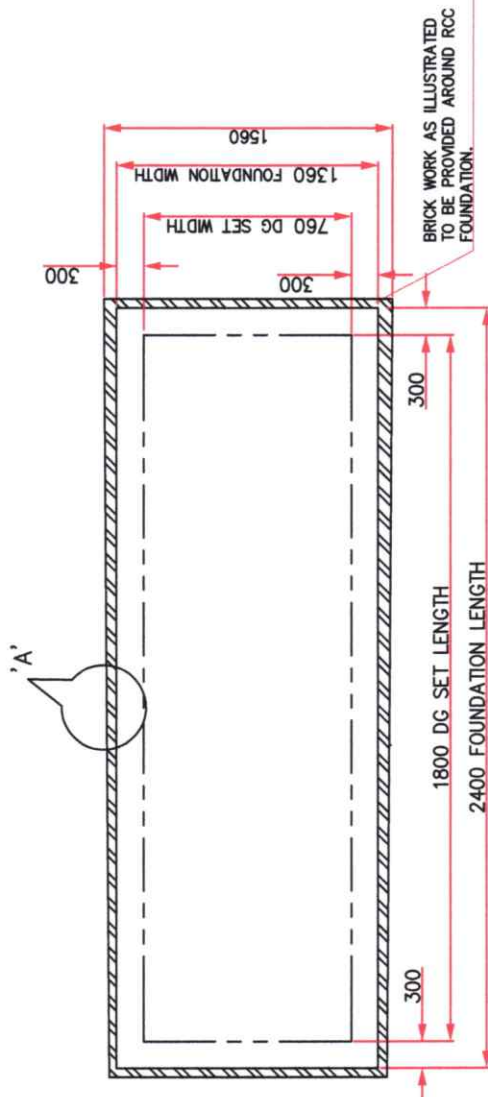


NOTES: -1) FOUNDATION TO BE MADE ON A GOOD PREPARED SURFACE WITH SOIL STRATA BEARING CAPACITY ADEQUATE TO SUPPORT THE WEIGHT OF GENSET & FOUNDATION. REFER CHART FOR SOIL STRENGTH.

SAFETY WARNING	CAPACITY KG/SQ.M
NATURE OF LOAD	2,441 - 100 = 2,341
BEARING MATERIAL	2,441 - 100 = 2,341
HARD ROCK GRANITE	2,441 - 100 = 2,341
MEDIUM ROCK SELL	2,441 - 100 = 2,341
HARD PAN	78,100 = 77,600
SOFT ROCK	48,800 = 58,600
HARD CLAY	36,000 = 48,800
GRAVEL AND COARSE SAND	36,000 = 48,800
LOOSE-MEDIUM COARSE AND	29,300 = 36,000
COMPACTED FINE SAND,	18,500 = 36,000
MEDIUM CLAY	9,750 = 36,500
LOOSE FINE SAND	9,750
SOFT CLAY	9,750

- 2) THE LENGTH & WIDTH OF FOUNDATION SHOULD BE AT LEAST 300 mm MORE ON EACH SIDE THAN GENSET LENGTH & WIDTH RESPECTIVELY.
- 3) CHECK THE FOUNDATION LEVEL DIAGONALLY AS WELL AS ACROSS THE LENGTH & WIDTH FOR EVEN FLATNESS AND SAME SHOULD BE WITHIN $\pm 50\text{mm}$ IN HORIZONTAL PLANE IN ANY ONE DIRECTION ONLY.
- 4) ENSURE THAT THE CONCRETE IS COMPLETELY CURED BEFORE POSITIONING THE GENSET.
- 5) ENSURE THAT THE FOUNDATION TO SUPPORT 1.5 TIMES (DYNAMIC LOAD) OF TOTAL NET WEIGHT OF THE SINGLE GENERATING SET INSTALLATION & 2 TIMES OF THE TOTAL NET WEIGHT FOR THE MULTIPLE GENERATING SET INSTALLATION.
- 6) FOR ROOFTOP INSTALLATION, IT IS NECESSARY TO HAVE PLANNING AND STRUCTURAL DESIGN APPROVAL.
- 7) DO NOT INSTALL GENSET ON LOOSE SAND OR CLAY.
- 8) AVOID HARD/SHARP PROJECTIONS SUCH AS STONE OR STEEL PARTS ON FOUNDATION SURFACE WHICH MAY DAMAGE FUEL TANK AT BOTTOM.
- 8) AVOID UNEVEN FOUNDATION WHICH MAY LEAD TO IMPROPER SETTING OF GENSET ON FOUNDATION, THERE BY LEADING TO LEAKAGE OF SOUND AND VIBRATION ON GENSET.
- 9) IF GENSET IS TO BE MOUNTED ON FOUNDATION HAVING UNEVEN SURFACE UNDER UNAVOIDABLE CIRCUMSTANCES, USE APPROPRIATE THICKNESS OF RUBBER MATTING ABOVE FOUNDATION FOR POSITIVE SEALING OF GENSET WITH BASE.
- 10) FOR CABLE TRENCH OPENING OPTION ON FOUNDATION, REFER TO GENSET GENERAL ARRANGEMENT DRAWING.

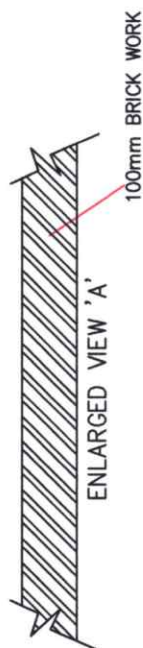

PRODUCT IMPROVEMENT IS A
CONTINUOUS PROCESS.DIMENSION
SPECIFICATION MAY CHANGE WITH
IMPROVEMENT. KINDLY CONTACT
KOEL FOR LATEST INFORMATION

PRINTS OF PREVIOUS
REVISION NO SHOULD
BE SCRAPPED

REVISION

	MODIFIED BY	A
PYH/c/b		

UNLESS OTHERWISE SPECIFIED	UNMENTIONED
• ALL DIMENSIONS ARE IN mm.	RADI
• UNMENTIONED TOLERANCES AS PER CO. STD. NO. 111001.	CHAMFER
• REMOVE ALL SHARP EDGES AND	
SHARP EDGES.	

PROJECT/CUSTOMER NAME	
AND DRG. FILE	
INTERNAL	
WORK	MOMAJ
NO.	MBT
PPD.	MBT



DRAWING No-385607/2019
SHEET- 1 OF 1
SCALE - 1:1

KALA GE	TITLE
PUNE 41	FOUND
	FO

ENSET PVT
110501 (IN
E
FOUNDATION PLAN DRAWING
FOR 3R550TA 4G1-20KVA

LTD.
(A)