


NOTES: -1) FOUNDATION TO BE MADE ON A GOOD PREPARED SURFACE WITH SOIL STRATA BEARING CAPACITY ADEQUATE TO SUPPORT THE WEIGHT OF GENSET & FOUNDATION. REFER CHART FOR SOIL STRENGTH.

SAFETY BEARING	SAFE BEARING
NATURE OF LOAD	2,441.00
BEARING MATERIAL	2,441.00
HARD ROCK GRANITE	2,441.00
MEDIUM ROCK SHELL	2,441.00
HARD PAN	2,441.00
SOFT ROCK	2,441.00
HARD CLAY	2,441.00
GRAVEL AND COARSE SAND	2,441.00
LOOSE MEDIUM COARSE AND	2,441.00
COMPACTED FINE SAND.	2,441.00
MEDIUM CLAY	2,441.00
LOOSE FINE SAND	2,441.00
SOFT CLAY	2,441.00

- 2) THE LENGTH & WIDTH OF FOUNDATION SHOULD BE AT LEAST 300 mm MORE ON EACH SIDE THAN GENSET LENGTH & WIDTH RESPECTIVELY.
- 3) CHECK THE FOUNDATION LEVEL DIAGONALLY AS WELL AS ACROSS THE LENGTH & WIDTH FOR EVEN FLATNESS AND SAME SHOULD BE WITHIN $\pm 50\text{mm}$ IN HORIZONTAL PLANE IN ANY ONE DIRECTION ONLY.
- 4) ENSURE THAT THE CONCRETE IS COMPLETELY CURED BEFORE POSITIONING THE GENSET.
- 5) ENSURE THAT THE FOUNDATION TO SUPPORT 1.5 TIMES (DYNAMIC LOAD) OF THE TOTAL NET WEIGHT OF THE SINGLE GENERATING SET INSTALLATION & 2 TIMES OF THE TOTAL NET WEIGHT FOR THE MULTIPLE GENERATING SET INSTALLATION.
- 6) FOR ROOFTOP INSTALLATION IT IS NECESSARY TO HAVE PLANNING AND STRUCTURAL DESIGN APPROVAL.
- 7) DO NOT INSTALL GENSET ON LOOSE SAND OR CLAY.
- 8) AVOID HARD/SHARP PROJECTIONS SUCH AS STONE OR STEEL PARTS ON FOUNDATION SURFACE WHICH MAY DAMAGE FUEL TANK AT BOTTOM.
- 9) AVOID UNEVEN FOUNDATION WHICH MAY LEAD TO IMPROPER RESTING OF GENSET ON FOUNDATION, THERE BY LEADING TO LEAKAGE OF SOUND AND VIBRATION ON GENSET.
- 9) IF GENSET IS TO BE MOUNTED ON FOUNDATION HAVING UNEVEN SURFACE UNDER UNAVOIDABLE CIRCUMSTANCES USE APPROPRIATE THICKNESS OF RUBBER MATTING ABOVE FOUNDATION FOR POSITIVE SEALING OF GENSET WITH BASE.
- 10) FOR CABLE TRENCH OPENING OPTION ON FOUNDATION, REFER TO GENSET GENERAL ARRANGEMENT DRAWING.

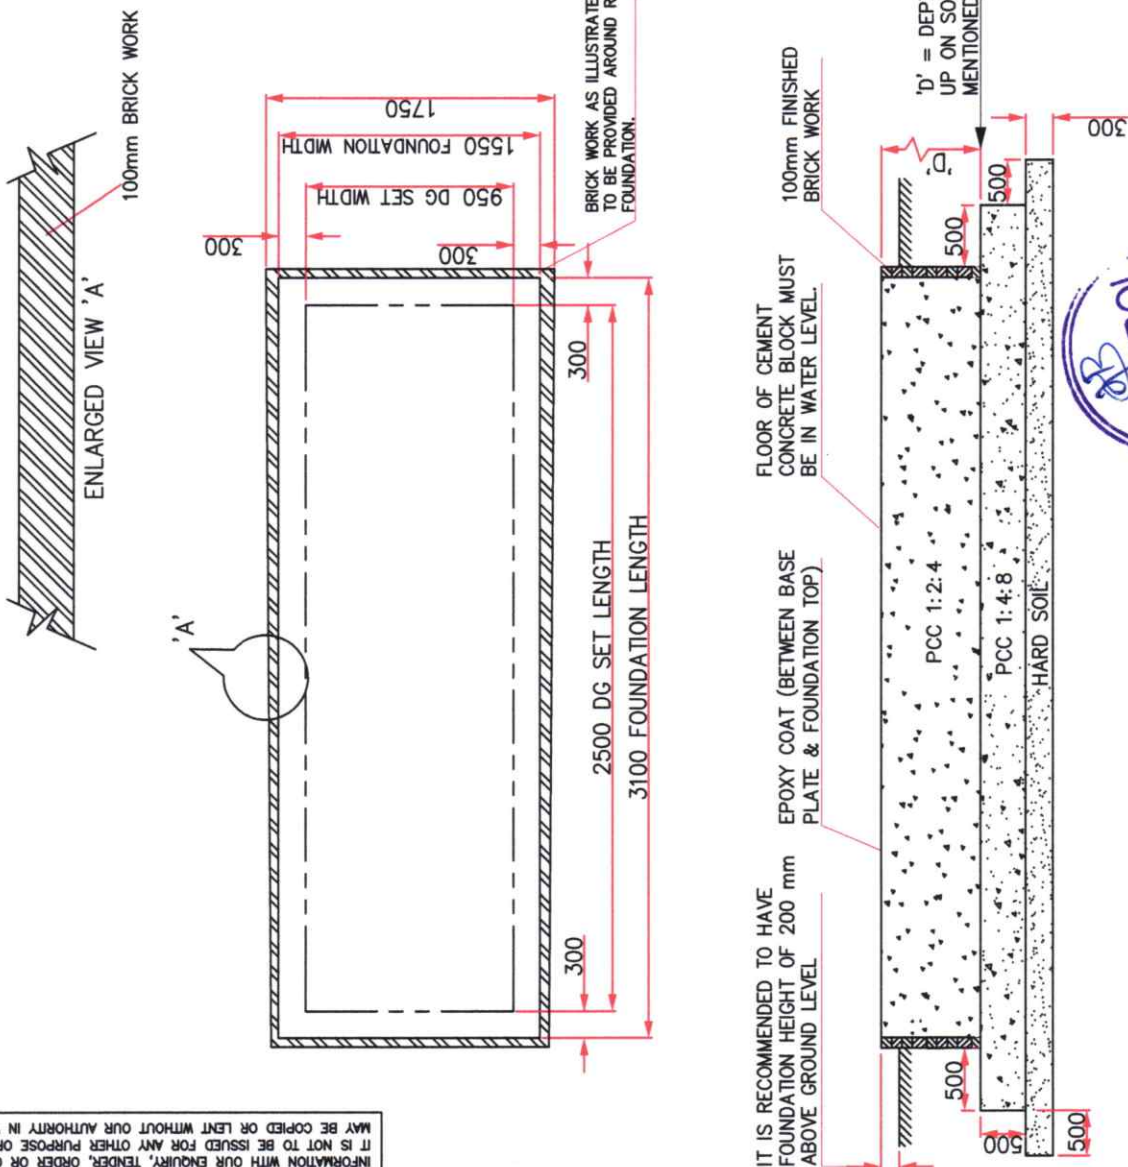

* IT IS RECOMMENDED TO HAVE FOUNDATION HEIGHT OF 200 mm ABOVE GROUND LEVEL

'D' = DEPTH IS DEPEND UP ON SOIL GRADE AS MENTIONED ABOVE.

FLOOR OF CEMENT
CONCRETE BLOCK MUST
BE IN WATER LEVEL.

EPOXY COAT (BETWEEN BASE PLATE & FOUNDATION TOP)

HARD SOIL



UNLESS OTHERWISE SPECIFIED	PROJECT / CUSTOMER NAME	
	CHD DRG. FILE	MATERIAL
• ALL DIMENSIONS ARE IN INCH. • UNMENTIONED TOLERANCES ARE PER CO. STANDARD. • REMOVE ALL SHARP EDGES AND SHARP ENDS.	UNMENTIONED RADIO CHAMFER UNDERCUT	DRN CHD. APPO. DATE
		MCHAL MBT MBT 01.02.2024

KALA GENSET PVT LTD.
PUNE 410501 (INDIA)

E
FOUNDATION PLAN DRAWING
FOR 3R1190ENVA 4G1_30kVA

PRODUCT IMPROVEMENT IS A CONTINUOUS PROCESS.DIMENSION SPECIFICATION MAY CHANGE WITH IMPROVEMENT. KINDLY CONTACT KOEL FOR LATEST INFORMATION

PRINTS OF PREVIOUS REVISION NO SHOULD BE SCRAPPED	Rev.
---	------

REVISION

ov.

1

BE SCRAPPED

TOLERANCE STIMULI

US