MODEL:-KG4-58.5WS

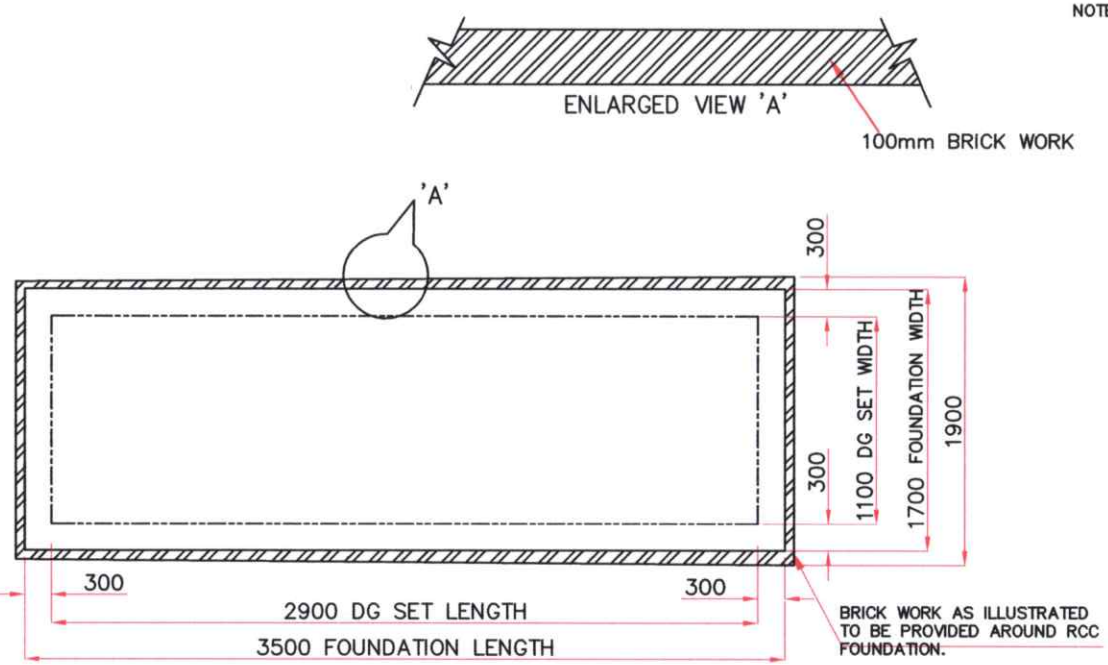

NOTES:-1) FOUNDATION TO BE MADE ON A GOOD PREPARED SURFACE WITH SOIL STRATA BEARING CAPACITY ADEQUATE TO SUPPORT THE WEIGHT OF GENSET & FOUNDATION. REFER CHART FOR SOIL STRENGTH.

NATURE OF LOAD BEARING MATERIAL	SAFE BEARING CAPACITY KG/SQ.M
HARD ROCK GRANITE	2,44,100 – 9,76,400
MEDIUM ROCK SHELL	97,600 – 1,46,400
HARD PAN	78,100 – 97,600
SOFT ROCK	48,800 – 58,600
HARD CLAY	39,000 – 48,800
GRAVEL AND COARSE SAND	39,000 – 48,800
LOOSE,MEDIUM COARSE AND COMPACTED FINE SAND.	29,300 – 39,000
MEDIUM CLAY	19,500 – 39,000
LOOSE FINE SAND	9,750 – 39,500
SOFT CLAY	9,750

2) THE LENGTH & WIDTH OF FOUNDATION SHOULD BE AT LEAST 300 mm MORE ON EACH SIDE THAN GENSET LENGTH & WIDTH RESPECTIVELY.

3) CHECK THE FOUNDATION LEVEL DIAGONALLY AS WELL AS ACROSS THE LENGTH & WIDTH FOR EVEN FLATNESS AND SAME SHOULD BE WITHIN ±50mm IN HORIZONTAL PLANE IN ANY ONE DIRECTION ONLY.

4) ENSURE THAT THE CONCRETE IS COMPLETELY CURED BEFORE POSITIONING THE GENSET.

5) ENSURE THAT THE FOUNDATION TO SUPPORT 1.5 TIMES (DYNAMIC LOAD) OF THE TOTAL WET WEIGHT OF THE SINGLE GENERATING SET INSTALLATION & 2 TIMES OF THE TOTAL WET WEIGHT FOR THE MULTIPLE GENERATING SET INSTALLTION.

6) FOR ROOFTOP INSTALLATION,IT IS NECESSARY TO HAVE PLANNING AND STRUCTURAL DESIGN APPROVAL.

MODEL:-KG4-58.5WS

7) DO NOT INSTALL GENSET ON LOOSE SAND OR CLAY. AVOID HARD/SHARP PROJECTIONS SUCH AS STONE OR STEEL PARTS ON FOUNDATION SURFACE,WHICH MAY DAMAGE FUEL TANK AT BOTTOM.

8) AVOID UNEVEN FOUNDATION WHICH MAY LEAD TO IMPROPER RESTING OF GENSET ON FOUNDATION,THERE BY LEADING TO LEAKAGE OF SOUND AND VIBRATION ON GENSET.

9) IF GENSET IS TO BE MOUNTED ON FOUNDATION HAVING UNEVEN SURFACE UNDER UNAVOIDABLE CIRCUMASTANCES,USE APPROPRIATE THICKNESS OF RUBBER MATTING ABOVE FOUNDATION FOR POSITIVE SEALING OF GENSET WITH BASE.

10) FOR CABLE TRENCH OPENING OPTION ON FOUNDATION, REFER TO GENSET GENERAL ARRANGEMENT DRAWING.

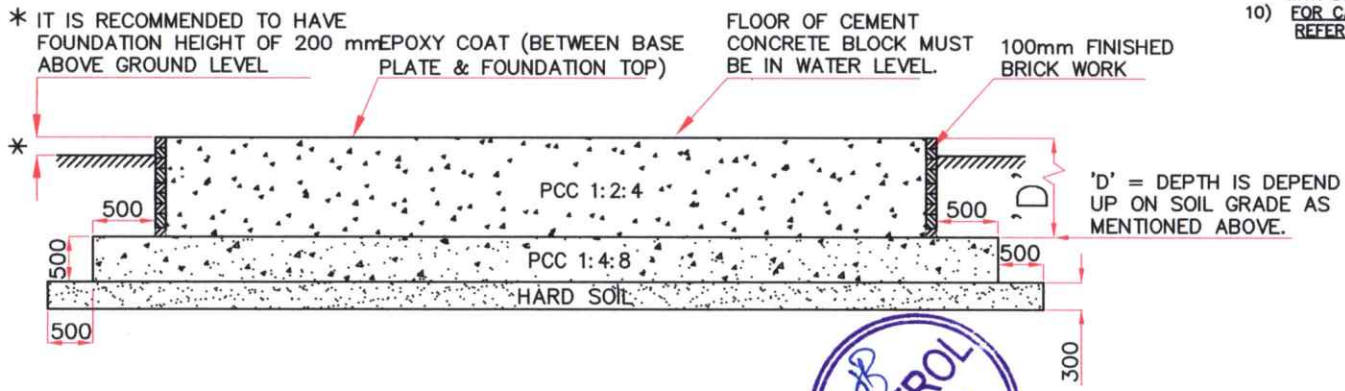

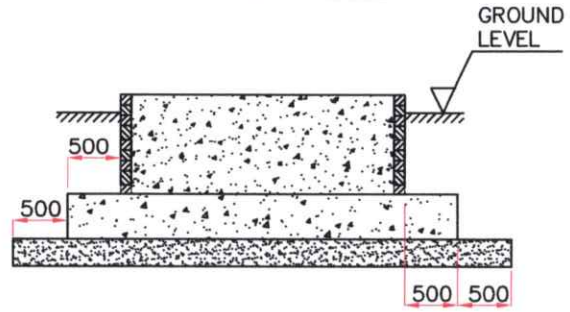

CONTROL COPY 13/24

THIS DRAWING IS PROPERTY OF KALA GENSET PVT. LTD. AND MUST BE RETURNED ON REQUEST. IT IS SUBMITTED AS CONFIDENTIAL INFORMATION WITH OUR ENQUIRY, TENDER, ORDER OR CONTRACT NO. IT IS NOT TO BE ISSUED FOR ANY OTHER PURPOSE OR ORDER NOR MAY BE COPIED OR LENT WITHOUT OUR AUTHORITY IN WRITING.

DO NOT SCALE THE DRAWING

IF IN DOUBT ASK

DEVIATION ON NON TOLERANCED LINEAR MACHINED DIMENSIONS. IS:2102 (PL-1)-1993 MEDIUM CLASS

FROM UPTO & INCLUDING	0.5 – 3	3 – 6	6 – 30	30 – 120	120 – 400	400 – 1000	1000–2000	2000–4000
DEVIATION mm	±0.1	±0.1	±0.2	±0.3	±0.5	±0.8	±1.2	±2

GEOMETRIC TOLERANCE SYMBOLS IS:8000 (PL-1)-1984.

STRAIGHTNESS	ANGULARITY	RUN OUT			
FLATNESS	POSITION	CONCENTRICITY			
ROUNDNESS	CONCENTRICITY	SYMMETRY			
CYLINDRICITY	PROFILE OF A LINE	M.M.C.			
PROFILE OF A SURFACE	PARALLELISM	TRUE POSITION			
	SQUARENESS	DATUM			

PRODUCT IMPROVEMENT IS A CONTINUOUS PROCESS.DIMENSION SPECIFICATION MAY CHANGE WITH IMPROVEMENT. KINDLY CONTACT KOEL FOR LATEST INFORMATION

PRINTS OF PREVIOUS REVISION NO SHOULD BE SCRAPPED

Rev. No.	REVISION	MODIFIED BY	APPROVED BY	REF. DATE

UNLESS OTHERWISE SPECIFIED
- ALL DIMENSIONS ARE IN mm.
- UNMENTIONED TOLERANCES AS PER CO.STD.NO.T1001.
- REMOVE ALL SHARP BURRS AND SHARP EDGES.

PROJECT/ CUSTOMER NAME

CAD DRG. FILE

MATERIAL

UNMENTIONED		DRN	MONALI
RADII		CHD.	MBT
CHAMFER		APPD.	MBT
UNDERCUT		DATE	01.02.2024

KALA GENSET PVT LTD.
PUNE 410501 (INDIA)

DRAWING No:-4R810TA/58.5kVA/FD/01

TITLE: FOUNDATION PLAN DRAWING FOR 4R810TA 4G1_58.5 kVA

SHEET- 1 OF 1

SCALE – 1:1

FIRST ANGLE PROJECTION