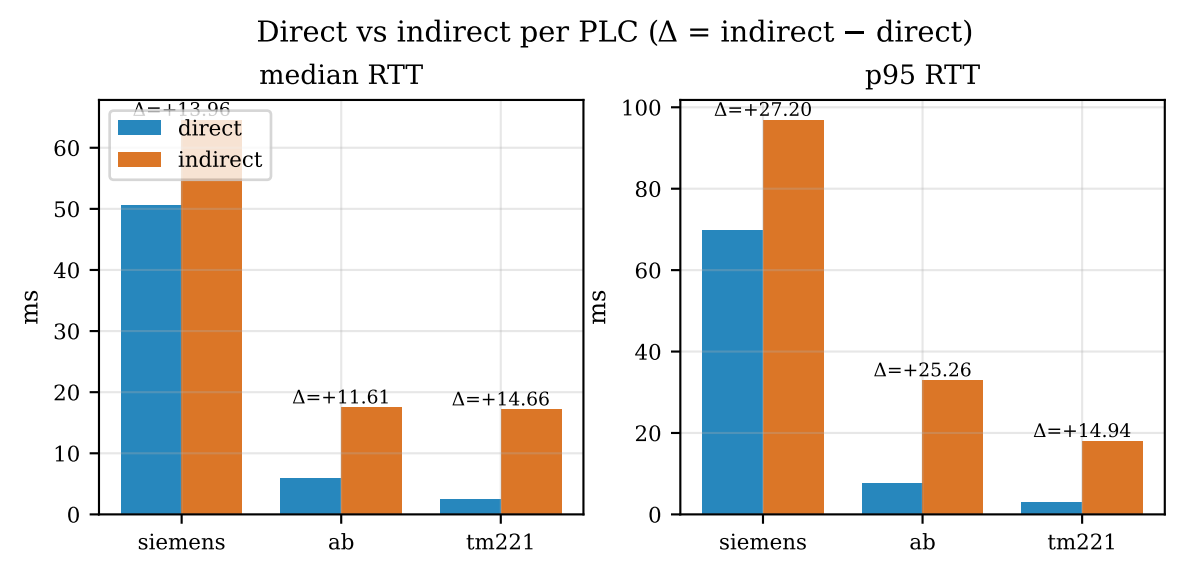
Direct vs indirect per PLC (Δ = indirect − direct)
median RTT
p95 RTT
direct
indirect
ms
Δ=+13.96
Δ=+11.61
Δ=+14.66
Δ=+27.20
Δ=+25.26
Δ=+14.94
siemens
ab
tm221