FRONT WALL — seen from the front

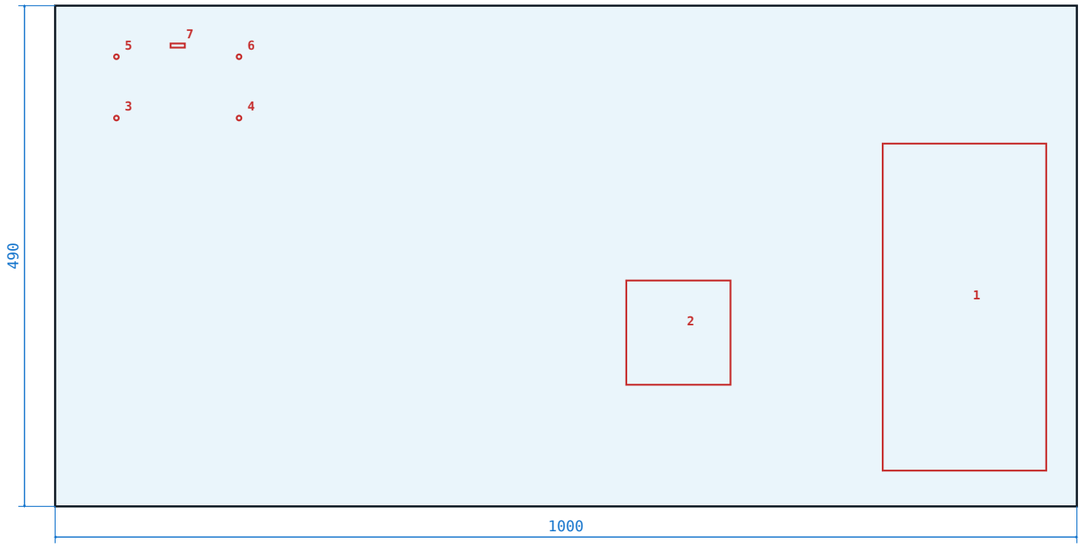

LEFT WALL — outdoor side

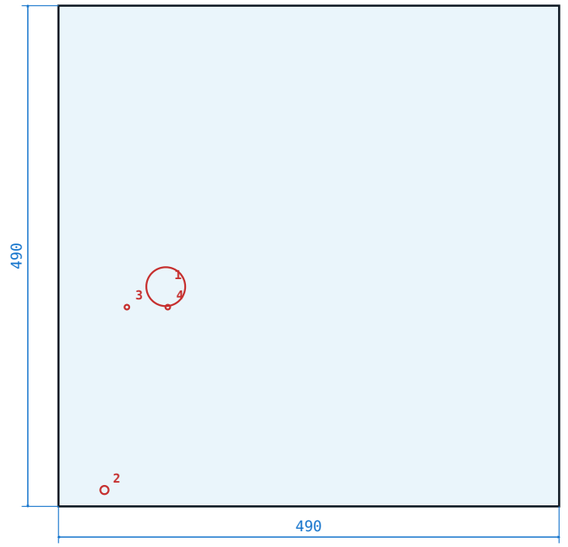

PARTITION — from the clean room

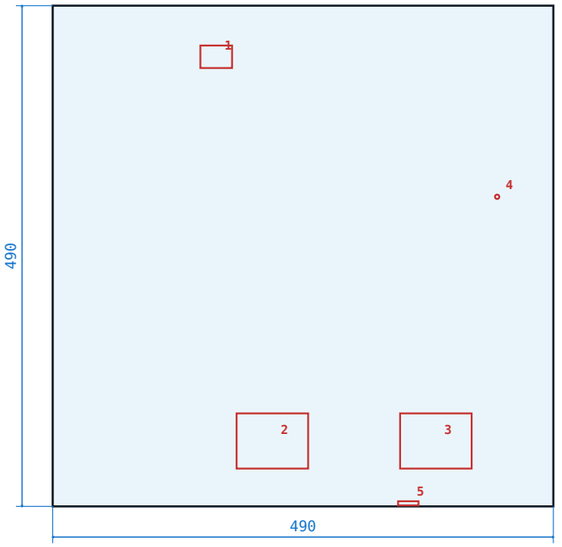

BACK WALL — seen from inside

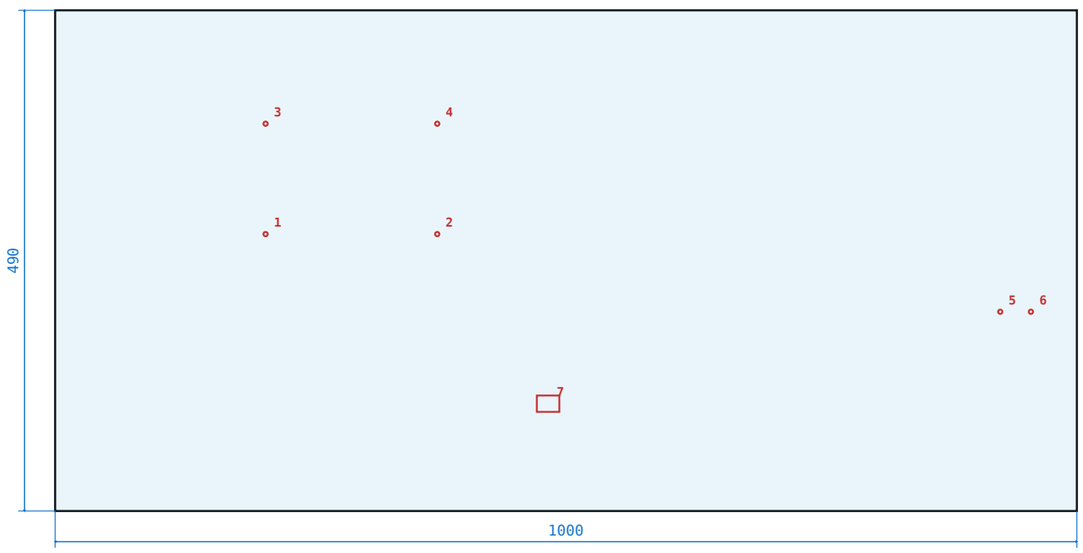

FALSE CEILING — from below

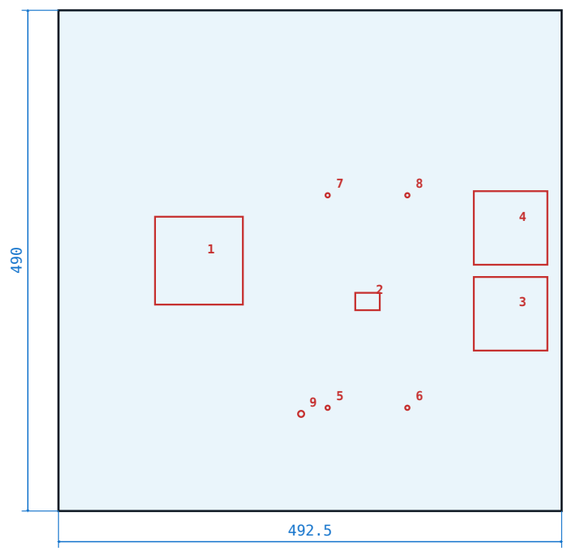

ACRYLIC CUT LIST — 5 mm cast PMMA

Panel	Qty	Size (mm)
Base plate	1	1000 × 500
Roof	1	1000 × 500
Front wall	1	1000 × 490
Back wall	1	1000 × 490
Left wall (outdoor side)	1	490 × 490
Right wall	1	490 × 490
Partition wall	1	490 × 490
Clean-room false ceiling	1	492.5 × 490
Clean-room door	1	220 × 340

Base and roof are full size; front and back sit between them; the two ends and the partition sit between front and back. Solvent-weld (or acrylic cement) all joints; seal duct sleeves with EPDM.

CUT-OUTS — centre positions in mm, measured in each view from its left and bottom edges

Front wall

1. door opening (door panel 180 × 340) @ 890 from left, 195 from bottom
2. pass box opening 102 × 102 @ 610 from left, 170 from bottom
3. HMI standoff M4 @ 60 from left, 380 from bottom
4. HMI standoff M4 (same) @ 180 from left, 380 from bottom
5. HMI standoff M4 (same) @ 60 from left, 440 from bottom
6. HMI standoff M4 (same) @ 180 from left, 440 from bottom
7. HMI ribbon slot @ 120 from left, 451 from bottom

Back wall

1. PCB standoff M3 @ 206 from left, 271 from bottom
2. PCB standoff M3 (same) @ 374 from left, 271 from bottom
3. PCB standoff M3 (same) @ 206 from left, 379 from bottom
4. PCB standoff M3 (same) @ 374 from left, 379 from bottom
5. MT-106 sensor M3 @ 925 from left, 195 from bottom
6. MT-106 sensor M3 (same) @ 955 from left, 195 from bottom
7. exhaust collector C into the plant room 22 × 16 @ 482.5 from left, 105 from bottom

Left wall (outdoor side)

1. fresh-air compressor intake Ø38 @ 105 from left, 215 from bottom
2. 24 V supply cable gland Ø8 @ 45 from left, 16 from bottom
3. compressor bracket M4 @ 67 from left, 195 from bottom
4. compressor bracket M4 (same) @ 107 from left, 195 from bottom

Clean-room false ceiling

1. ceiling H14 BIBO terminal 86 × 86 @ 137.5 from left, 245 from bottom
2. LAF supply drop 24 × 17 @ 302.5 from left, 205 from bottom
3. ceiling H14 BIBO terminal 2 72 × 72 @ 442.5 from left, 193 from bottom
4. ceiling H14 BIBO terminal 3 72 × 72 @ 442.5 from left, 277 from bottom
5. LAF hanger Ø4 @ 263.5 from left, 101 from bottom
6. LAF hanger Ø4 (same) @ 341.5 from left, 101 from bottom
7. LAF hanger Ø4 (same) @ 263.5 from left, 309 from bottom
8. LAF hanger Ø4 (same) @ 341.5 from left, 309 from bottom
9. luminaire cable Ø6 @ 237.5 from left, 95 from bottom

Partition wall

1. supply duct 31 × 22 @ 160 from left, 440 from bottom
2. exhaust terminal 1 (H14 BIBO) 70 × 54 @ 215 from left, 64 from bottom
3. exhaust terminal 2 (H14 BIBO) 70 × 54 @ 375 from left, 64 from bottom
4. PDT-101 reference tube Ø4 @ 435 from left, 303 from bottom
5. PCB harness slot (floor) @ 348 from left, 3 from bottom

CLEAN-ROOM HEAT-RECOVERY AIR-PUMP TEST RIG

Acrylic enclosure 1000 × 500 × 500 mm — general arrangement

Scale 1:6 on A3 · dimensions in mm · 3D model: cad/cleanroom-rig-assembly.step

Eng. Kariem Moussa · supervised by Dr. Eng. Ahmed Maher · GIU