

PUMPGURU — Pump Protection Report

2026-08-24 17:39 to 2026-08-31 17:39 | Granularity: Daily

Generated 2026-08-31 17:39:10

Total Data Points	Uptime	Active Fault Events	Voltage Imbalance	Current Imbalance
8657	81.16%	556	1.84%	278.86%



Measurement Analysis

Parameter	Min	Max	Average	Unit
Voltage R-Y	0.00	533.00	359.52	V
Voltage B-R	0.00	535.00	357.41	V
Voltage Y-B	0.00	535.00	352.97	V
Current R Phase	0.00	49.90	6.44	A
Current Y Phase	0.00	48.00	5.35	A
Current B Phase	0.00	49.90	6.18	A
Recent Run Minutes (Pump 1)	0.00	99.67	15.45	min
Recent Run Minutes (Pump 2)	0.00	98.73	18.32	min
Total Run Minutes (Pump 1)	0.00	600.00	212.74	min
Total Run Minutes (Pump 2)	0.00	600.00	239.17	min
Set ON Time	0.00	998.00	23.95	M
Set OFF Time	0.00	99.92	18.34	M
Set Current 1	4.60	180.00	12.41	A
Set Current 2	1.80	180.00	14.12	A
Set Dry-Run Current	0.00	400.00	48.64	%
Bottom Tank Low Sensor	0.00	1.00	0.79	
Bottom Tank High Sensor	0.00	250.00	1.44	
Top Tank Low Sensor	0.00	184.00	0.56	
Top Tank High Sensor	0.00	102.00	0.55	
Auto/Manual Mode	51.00	102.00	95.38	
Pump Run/Stop Control	0.00	1.00	0.11	
Pump Selection Mode	0.00	1.00	0.26	

Fault Frequency Breakdown

Fault Type	Times Triggered
dry_run	507
undervoltage	37
overvoltage	5
overload	3
stall_pump	2
phase_loss	2

Daily Trend — Voltage & Current (Average)

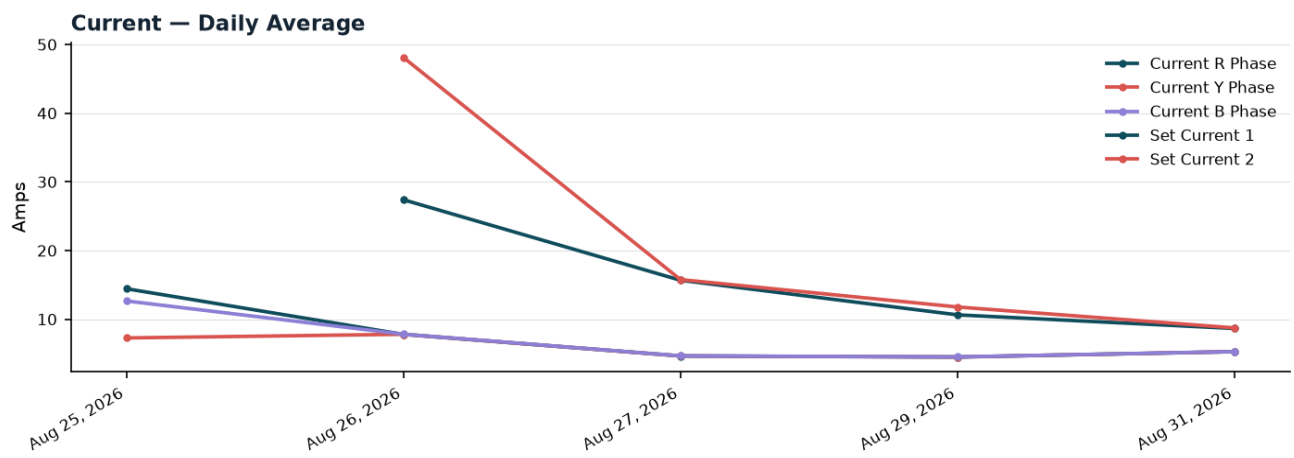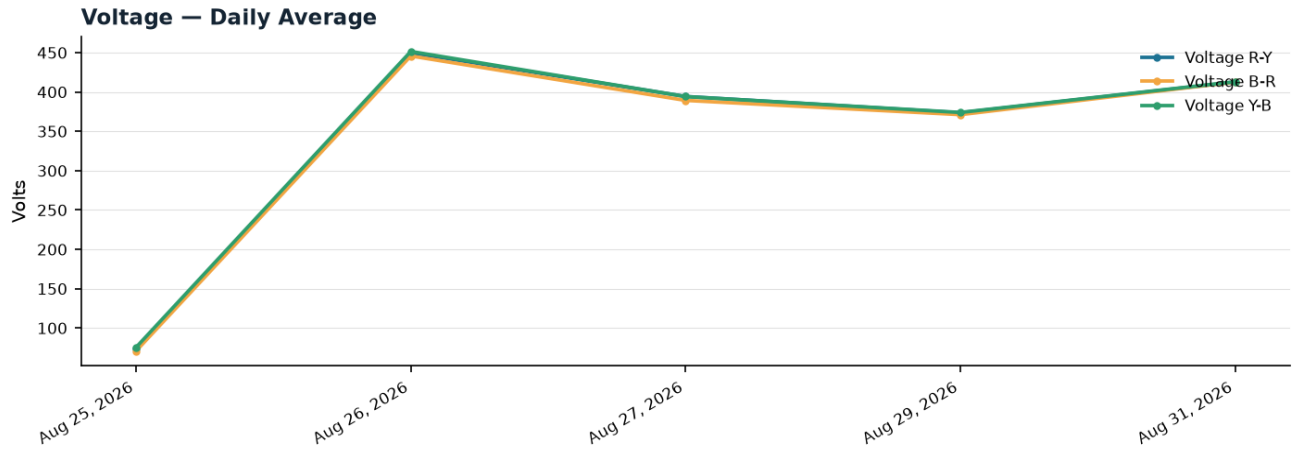

Daily Breakdown Table

All values shown are period averages.

Recent Run Minutes (Pump 1)	Recent Run Minutes (Pump 2)	Total Run Minutes (Pump 1)	Total Run Minutes (Pump 2)	Set ON Time	Set OFF Time	Set Current 1	Set Current 2	Set Dry-Run Current
--	--	--	--	--	--	--	--	--
8.6	9.9	56.9	58.2	10.1	8.6	27.4	48.1	68.2
6.4	13.3	94.4	149.6	23.8	13.4	15.7	15.8	46.3
17.1	20.5	240.0	277.6	26.6	22.3	10.6	11.8	45.4
22.1	22.1	307.4	311.2	24.8	21.3	8.6	8.7	48.9

Fault Event Log

Timestamp	Fault	State
2026-08-25T17:47:40	dry_run	CLEARED
2026-08-25T17:47:40	overvoltage	ACTIVE
2026-08-25T17:47:50	overvoltage	CLEARED
2026-08-25T17:47:55	undervoltage	ACTIVE
2026-08-25T17:48:11	undervoltage	CLEARED
2026-08-25T17:48:16	stall_pump	ACTIVE
2026-08-25T17:48:21	stall_pump	CLEARED
2026-08-25T17:48:40	overload	ACTIVE
2026-08-25T17:48:45	overload	CLEARED
2026-08-25T18:14:23	dry_run	ACTIVE
2026-08-25T18:19:20	dry_run	CLEARED
2026-08-25T18:19:41	dry_run	ACTIVE
2026-08-25T18:20:06	dry_run	CLEARED
2026-08-25T18:20:26	dry_run	ACTIVE
2026-08-25T18:20:42	dry_run	CLEARED
2026-08-25T18:28:06	undervoltage	ACTIVE
2026-08-25T18:28:52	undervoltage	CLEARED
2026-08-25T18:30:09	undervoltage	ACTIVE
2026-08-25T18:30:30	undervoltage	CLEARED
2026-08-25T18:30:46	overvoltage	ACTIVE
2026-08-25T18:30:56	overvoltage	CLEARED
2026-08-25T18:31:11	overload	ACTIVE
2026-08-25T18:31:16	overload	CLEARED
2026-08-25T18:33:51	undervoltage	ACTIVE
2026-08-26T16:43:32	dry_run	ACTIVE
2026-08-26T16:43:37	dry_run	CLEARED
2026-08-26T16:44:07	dry_run	ACTIVE
2026-08-26T16:44:12	dry_run	CLEARED
2026-08-26T16:44:42	dry_run	ACTIVE
2026-08-26T16:44:47	dry_run	CLEARED
2026-08-26T16:45:17	dry_run	ACTIVE
2026-08-26T16:45:22	dry_run	CLEARED

Timestamp	Fault	State
2026-08-26T16:46:28	dry_run	ACTIVE
2026-08-26T16:46:33	dry_run	CLEARED
2026-08-26T16:47:08	dry_run	ACTIVE
2026-08-26T16:47:13	dry_run	CLEARED
2026-08-26T16:47:23	dry_run	ACTIVE
2026-08-26T16:47:34	dry_run	CLEARED
2026-08-26T16:47:49	dry_run	ACTIVE
2026-08-26T16:47:59	dry_run	CLEARED
2026-08-26T16:49:54	dry_run	ACTIVE
2026-08-26T16:49:59	dry_run	CLEARED
2026-08-26T16:50:09	dry_run	ACTIVE
2026-08-26T16:50:14	dry_run	CLEARED
2026-08-26T16:50:24	dry_run	ACTIVE
2026-08-26T16:50:29	dry_run	CLEARED
2026-08-26T16:50:54	dry_run	ACTIVE
2026-08-26T16:50:59	dry_run	CLEARED
2026-08-26T16:51:09	dry_run	ACTIVE
2026-08-26T16:51:14	dry_run	CLEARED
2026-08-26T17:02:37	undervoltage	CLEARED
2026-08-27T12:20:31	undervoltage	CLEARED
2026-08-27T12:23:04	dry_run	ACTIVE
2026-08-27T12:27:20	dry_run	CLEARED
2026-08-27T12:43:19	overload	ACTIVE
2026-08-27T12:43:24	overload	CLEARED
2026-08-27T12:44:15	overvoltage	ACTIVE
2026-08-27T12:53:01	overvoltage	CLEARED
2026-08-27T13:00:35	undervoltage	ACTIVE
2026-08-27T13:00:45	undervoltage	CLEARED
2026-08-27T13:00:45	overvoltage	ACTIVE
2026-08-27T13:01:01	overvoltage	CLEARED
2026-08-27T13:01:12	phase_loss	ACTIVE
2026-08-27T13:01:23	undervoltage	ACTIVE
2026-08-27T13:01:23	phase_loss	CLEARED

Timestamp	Fault	State
2026-08-27T13:01:28	undervoltage	CLEARED
2026-08-27T15:26:10	undervoltage	CLEARED
2026-08-27T15:27:16	undervoltage	ACTIVE
2026-08-27T15:29:17	undervoltage	CLEARED
2026-08-27T15:31:31	undervoltage	ACTIVE
2026-08-27T15:32:48	undervoltage	CLEARED
2026-08-27T15:38:08	undervoltage	ACTIVE
2026-08-27T15:38:23	undervoltage	CLEARED
2026-08-27T15:47:57	undervoltage	CLEARED
2026-08-27T15:59:37	undervoltage	ACTIVE
2026-08-27T15:59:59	undervoltage	CLEARED
2026-08-27T16:01:03	phase_loss	ACTIVE
2026-08-27T16:03:17	phase_loss	CLEARED
2026-08-27T16:03:43	stall_pump	ACTIVE
2026-08-27T16:03:49	stall_pump	CLEARED
2026-08-27T17:08:31	overvoltage	CLEARED
2026-08-27T17:08:54	dry_run	ACTIVE
2026-08-27T17:09:10	dry_run	CLEARED
2026-08-27T17:21:52	dry_run	ACTIVE
2026-08-27T17:37:21	dry_run	CLEARED
2026-08-27T17:37:38	dry_run	ACTIVE
2026-08-27T17:42:38	dry_run	CLEARED
2026-08-27T17:42:58	dry_run	ACTIVE
2026-08-27T17:47:52	dry_run	CLEARED
2026-08-27T17:47:52	undervoltage	ACTIVE
2026-08-27T17:55:42	undervoltage	CLEARED
2026-08-27T17:55:58	dry_run	ACTIVE
2026-08-27T17:56:13	dry_run	CLEARED
2026-08-27T17:56:41	dry_run	ACTIVE
2026-08-27T18:01:36	dry_run	CLEARED
2026-08-27T18:01:36	undervoltage	ACTIVE
2026-08-27T18:02:24	undervoltage	CLEARED
2026-08-27T18:02:55	dry_run	ACTIVE

Timestamp	Fault	State
2026-08-27T18:07:55	dry_run	ACTIVE
2026-08-27T18:08:00	dry_run	CLEARED
2026-08-27T18:09:31	dry_run	ACTIVE
2026-08-27T18:09:36	dry_run	CLEARED
2026-08-27T18:09:46	dry_run	ACTIVE
2026-08-27T18:09:51	dry_run	CLEARED
2026-08-27T18:10:11	dry_run	ACTIVE
2026-08-27T18:10:16	dry_run	CLEARED
2026-08-27T18:10:21	dry_run	ACTIVE
2026-08-27T18:10:31	dry_run	CLEARED
2026-08-27T18:11:28	dry_run	ACTIVE
2026-08-27T18:11:33	dry_run	CLEARED
2026-08-27T18:13:38	dry_run	ACTIVE
2026-08-27T18:13:43	dry_run	CLEARED
2026-08-27T18:13:53	dry_run	ACTIVE
2026-08-27T18:13:58	dry_run	CLEARED
2026-08-27T18:14:08	dry_run	ACTIVE
2026-08-27T18:14:13	dry_run	CLEARED
2026-08-27T18:14:43	dry_run	ACTIVE
2026-08-27T18:14:48	dry_run	CLEARED
2026-08-27T18:16:09	dry_run	ACTIVE
2026-08-27T18:16:14	dry_run	CLEARED
2026-08-27T18:16:44	dry_run	ACTIVE
2026-08-27T18:16:49	dry_run	CLEARED
2026-08-27T18:17:35	dry_run	CLEARED
2026-08-27T18:18:20	dry_run	ACTIVE
2026-08-27T18:19:53	dry_run	ACTIVE
2026-08-27T18:19:58	dry_run	CLEARED
2026-08-27T18:21:18	dry_run	ACTIVE
2026-08-27T18:21:23	dry_run	CLEARED
2026-08-27T18:21:48	dry_run	ACTIVE
2026-08-27T18:21:53	dry_run	CLEARED
2026-08-27T18:21:58	dry_run	ACTIVE

Timestamp	Fault	State
2026-08-27T18:22:03	dry_run	CLEARED
2026-08-27T18:25:34	dry_run	ACTIVE
2026-08-27T18:25:38	dry_run	ACTIVE
2026-08-27T18:25:39	dry_run	CLEARED
2026-08-27T18:25:43	dry_run	CLEARED
2026-08-27T18:25:58	dry_run	ACTIVE
2026-08-27T18:26:03	dry_run	CLEARED
2026-08-27T18:26:09	dry_run	ACTIVE
2026-08-27T18:26:13	dry_run	ACTIVE
2026-08-27T18:26:14	dry_run	CLEARED
2026-08-27T18:26:18	dry_run	CLEARED
2026-08-27T18:26:38	dry_run	ACTIVE
2026-08-27T18:26:43	dry_run	CLEARED
2026-08-27T18:26:53	dry_run	ACTIVE
2026-08-27T18:26:58	dry_run	CLEARED
2026-08-27T18:27:48	dry_run	ACTIVE
2026-08-27T18:27:53	dry_run	CLEARED
2026-08-27T18:27:54	dry_run	ACTIVE
2026-08-27T18:27:59	dry_run	CLEARED
2026-08-27T18:28:28	dry_run	ACTIVE
2026-08-27T18:28:33	dry_run	CLEARED
2026-08-27T18:29:23	dry_run	ACTIVE
2026-08-27T18:29:24	dry_run	ACTIVE
2026-08-27T18:29:28	dry_run	CLEARED
2026-08-27T18:29:29	dry_run	CLEARED
2026-08-27T18:29:54	dry_run	ACTIVE
2026-08-27T18:29:59	dry_run	CLEARED
2026-08-27T18:31:29	dry_run	ACTIVE
2026-08-27T18:31:34	dry_run	CLEARED
2026-08-27T18:31:59	dry_run	ACTIVE
2026-08-27T18:32:03	dry_run	ACTIVE
2026-08-27T18:32:04	dry_run	CLEARED
2026-08-27T18:32:08	dry_run	CLEARED

Timestamp	Fault	State
2026-08-27T18:32:54	dry_run	ACTIVE
2026-08-27T18:32:59	dry_run	ACTIVE
2026-08-27T18:32:59	dry_run	CLEARED
2026-08-27T18:33:04	dry_run	CLEARED
2026-08-27T18:33:39	dry_run	ACTIVE
2026-08-27T18:33:44	dry_run	CLEARED
2026-08-27T18:33:59	dry_run	ACTIVE
2026-08-27T18:34:04	dry_run	CLEARED
2026-08-27T18:34:39	dry_run	ACTIVE
2026-08-27T18:34:44	dry_run	CLEARED
2026-08-27T18:35:04	dry_run	ACTIVE
2026-08-27T18:35:09	dry_run	ACTIVE
2026-08-27T18:35:09	dry_run	CLEARED
2026-08-27T18:35:14	dry_run	CLEARED
2026-08-27T18:35:44	dry_run	ACTIVE
2026-08-27T18:35:49	dry_run	CLEARED
2026-08-27T18:35:49	dry_run	ACTIVE
2026-08-27T18:35:54	dry_run	ACTIVE
2026-08-27T18:35:54	dry_run	CLEARED
2026-08-27T18:35:59	dry_run	CLEARED
2026-08-27T18:36:04	dry_run	ACTIVE
2026-08-27T18:36:09	dry_run	CLEARED
2026-08-27T18:36:24	dry_run	ACTIVE
2026-08-27T18:36:24	dry_run	ACTIVE
2026-08-27T18:36:29	dry_run	CLEARED
2026-08-27T18:36:29	dry_run	CLEARED
2026-08-27T18:37:25	dry_run	ACTIVE
2026-08-27T18:37:35	dry_run	CLEARED
2026-08-27T18:37:39	dry_run	ACTIVE
2026-08-27T18:37:44	dry_run	CLEARED
2026-08-27T18:38:39	dry_run	ACTIVE
2026-08-27T18:38:44	dry_run	CLEARED
2026-08-27T18:38:49	dry_run	ACTIVE

Timestamp	Fault	State
2026-08-27T18:38:50	dry_run	ACTIVE
2026-08-27T18:38:54	dry_run	CLEARED
2026-08-27T18:38:55	dry_run	CLEARED
2026-08-27T18:39:10	dry_run	ACTIVE
2026-08-27T18:39:15	dry_run	CLEARED
2026-08-27T18:39:19	dry_run	ACTIVE
2026-08-27T18:39:24	dry_run	CLEARED
2026-08-27T18:39:35	dry_run	ACTIVE
2026-08-27T18:39:39	dry_run	ACTIVE
2026-08-27T18:39:45	dry_run	CLEARED
2026-08-27T18:39:49	dry_run	CLEARED
2026-08-29T10:38:05	dry_run	ACTIVE
2026-08-29T10:47:00	dry_run	ACTIVE
2026-08-29T10:47:05	dry_run	CLEARED
2026-08-29T10:47:50	dry_run	ACTIVE
2026-08-29T10:47:55	dry_run	CLEARED
2026-08-29T10:48:10	dry_run	ACTIVE
2026-08-29T10:48:15	dry_run	CLEARED
2026-08-29T10:48:20	dry_run	ACTIVE
2026-08-29T10:48:25	dry_run	CLEARED
2026-08-29T10:48:30	dry_run	ACTIVE
2026-08-29T10:48:35	dry_run	CLEARED
2026-08-29T10:48:50	dry_run	ACTIVE
2026-08-29T10:48:55	dry_run	CLEARED
2026-08-29T10:49:50	dry_run	ACTIVE
2026-08-29T10:49:55	dry_run	CLEARED
2026-08-29T10:50:10	dry_run	ACTIVE
2026-08-29T10:50:15	dry_run	CLEARED
2026-08-29T10:50:25	dry_run	ACTIVE
2026-08-29T10:50:30	dry_run	CLEARED
2026-08-29T10:50:50	dry_run	ACTIVE
2026-08-29T10:50:50	dry_run	ACTIVE
2026-08-29T10:50:55	dry_run	CLEARED

Timestamp	Fault	State
2026-08-29T10:50:55	dry_run	CLEARED
2026-08-29T10:51:05	dry_run	ACTIVE
2026-08-29T10:51:10	dry_run	CLEARED
2026-08-29T10:52:26	dry_run	ACTIVE
2026-08-29T10:52:30	dry_run	ACTIVE
2026-08-29T10:52:31	dry_run	CLEARED
2026-08-29T10:52:35	dry_run	CLEARED
2026-08-29T10:52:55	dry_run	ACTIVE
2026-08-29T10:52:56	dry_run	ACTIVE
2026-08-29T10:53:00	dry_run	CLEARED
2026-08-29T10:53:01	dry_run	CLEARED
2026-08-29T10:53:35	dry_run	ACTIVE
2026-08-29T10:53:36	dry_run	ACTIVE
2026-08-29T10:53:40	dry_run	CLEARED
2026-08-29T10:53:41	dry_run	CLEARED
2026-08-29T10:53:45	dry_run	ACTIVE
2026-08-29T10:53:55	dry_run	CLEARED
2026-08-29T10:54:20	dry_run	ACTIVE
2026-08-29T10:54:25	dry_run	CLEARED
2026-08-29T10:54:45	dry_run	ACTIVE
2026-08-29T10:54:50	dry_run	CLEARED
2026-08-29T10:55:00	dry_run	ACTIVE
2026-08-29T10:55:05	dry_run	CLEARED
2026-08-29T10:55:06	dry_run	ACTIVE
2026-08-29T10:55:11	dry_run	CLEARED
2026-08-29T10:55:30	dry_run	ACTIVE
2026-08-29T10:55:31	dry_run	ACTIVE
2026-08-29T10:55:35	dry_run	CLEARED
2026-08-29T10:55:36	dry_run	CLEARED
2026-08-29T10:57:26	dry_run	ACTIVE
2026-08-29T10:57:31	dry_run	CLEARED
2026-08-29T10:57:46	dry_run	ACTIVE
2026-08-29T10:57:51	dry_run	CLEARED

Timestamp	Fault	State
2026-08-29T10:57:55	dry_run	ACTIVE
2026-08-29T10:58:00	dry_run	CLEARED
2026-08-29T10:58:21	dry_run	ACTIVE
2026-08-29T10:58:26	dry_run	ACTIVE
2026-08-29T10:58:26	dry_run	CLEARED
2026-08-29T10:58:36	dry_run	CLEARED
2026-08-29T10:58:46	dry_run	ACTIVE
2026-08-29T10:58:51	dry_run	CLEARED
2026-08-29T10:59:07	dry_run	ACTIVE
2026-08-29T10:59:11	dry_run	ACTIVE
2026-08-29T10:59:12	dry_run	CLEARED
2026-08-29T10:59:16	dry_run	CLEARED
2026-08-29T11:00:33	dry_run	ACTIVE
2026-08-29T11:00:36	dry_run	ACTIVE
2026-08-29T11:00:38	dry_run	CLEARED
2026-08-29T11:00:41	dry_run	CLEARED
2026-08-29T11:00:56	dry_run	ACTIVE
2026-08-29T11:01:01	dry_run	CLEARED
2026-08-29T11:02:11	dry_run	ACTIVE
2026-08-29T11:02:16	dry_run	CLEARED
2026-08-29T11:02:21	dry_run	ACTIVE
2026-08-29T11:02:26	dry_run	CLEARED
2026-08-29T11:03:03	dry_run	ACTIVE
2026-08-29T11:03:08	dry_run	CLEARED
2026-08-29T11:04:02	dry_run	ACTIVE
2026-08-29T11:04:07	dry_run	CLEARED
2026-08-29T11:04:12	dry_run	ACTIVE
2026-08-29T11:04:17	dry_run	CLEARED
2026-08-29T11:04:47	dry_run	ACTIVE
2026-08-29T11:04:52	dry_run	ACTIVE
2026-08-29T11:04:52	dry_run	CLEARED
2026-08-29T11:04:57	dry_run	CLEARED
2026-08-29T11:05:52	dry_run	ACTIVE

Timestamp	Fault	State
2026-08-29T11:05:52	dry_run	ACTIVE
2026-08-29T11:05:57	dry_run	CLEARED
2026-08-29T11:05:57	dry_run	CLEARED
2026-08-29T11:06:37	dry_run	ACTIVE
2026-08-29T11:06:42	dry_run	CLEARED
2026-08-29T11:06:57	dry_run	ACTIVE
2026-08-29T11:07:02	dry_run	CLEARED
2026-08-29T11:07:12	dry_run	ACTIVE
2026-08-29T11:07:17	dry_run	CLEARED
2026-08-29T11:07:17	dry_run	ACTIVE
2026-08-29T11:07:27	dry_run	ACTIVE
2026-08-29T11:07:27	dry_run	CLEARED
2026-08-29T11:07:32	dry_run	CLEARED
2026-08-29T11:07:32	dry_run	ACTIVE
2026-08-29T11:07:42	dry_run	CLEARED
2026-08-29T11:07:57	dry_run	ACTIVE
2026-08-29T11:08:02	dry_run	CLEARED
2026-08-29T11:08:07	dry_run	ACTIVE
2026-08-29T11:08:12	dry_run	CLEARED
2026-08-29T11:08:18	dry_run	ACTIVE
2026-08-29T11:08:23	dry_run	CLEARED
2026-08-29T11:08:52	dry_run	ACTIVE
2026-08-29T11:08:57	dry_run	CLEARED
2026-08-29T11:09:03	dry_run	ACTIVE
2026-08-29T11:09:08	dry_run	CLEARED
2026-08-29T11:09:27	dry_run	ACTIVE
2026-08-29T11:09:39	dry_run	CLEARED
2026-08-29T11:09:49	dry_run	ACTIVE
2026-08-29T11:09:54	dry_run	CLEARED
2026-08-29T11:10:24	dry_run	ACTIVE
2026-08-29T11:10:34	dry_run	CLEARED
2026-08-29T11:11:07	dry_run	CLEARED
2026-08-29T11:11:08	dry_run	CLEARED

Timestamp	Fault	State
2026-08-29T11:11:13	dry_run	ACTIVE
2026-08-29T11:11:18	dry_run	CLEARED
2026-08-29T11:11:22	dry_run	ACTIVE
2026-08-29T11:11:27	dry_run	CLEARED
2026-08-29T11:11:38	dry_run	ACTIVE
2026-08-29T11:11:43	dry_run	CLEARED
2026-08-29T11:11:52	dry_run	ACTIVE
2026-08-29T11:11:53	dry_run	ACTIVE
2026-08-29T11:11:57	dry_run	CLEARED
2026-08-29T11:11:58	dry_run	CLEARED
2026-08-29T11:12:03	dry_run	ACTIVE
2026-08-29T11:12:08	dry_run	CLEARED
2026-08-29T11:12:17	dry_run	ACTIVE
2026-08-29T11:12:22	dry_run	CLEARED
2026-08-29T11:12:38	dry_run	ACTIVE
2026-08-29T11:12:43	dry_run	CLEARED
2026-08-29T11:13:13	dry_run	ACTIVE
2026-08-29T11:13:17	dry_run	ACTIVE
2026-08-29T11:13:18	dry_run	CLEARED
2026-08-29T11:13:22	dry_run	CLEARED
2026-08-29T11:13:33	dry_run	ACTIVE
2026-08-29T11:13:38	dry_run	CLEARED
2026-08-29T11:14:12	dry_run	ACTIVE
2026-08-29T11:14:13	dry_run	ACTIVE
2026-08-29T11:14:17	dry_run	CLEARED
2026-08-29T11:14:18	dry_run	CLEARED
2026-08-29T11:14:22	dry_run	ACTIVE
2026-08-29T11:14:27	dry_run	CLEARED
2026-08-29T11:14:37	dry_run	ACTIVE
2026-08-29T11:14:42	dry_run	CLEARED
2026-08-29T11:15:08	dry_run	ACTIVE
2026-08-29T11:15:13	dry_run	CLEARED
2026-08-29T11:15:28	dry_run	ACTIVE

Timestamp	Fault	State
2026-08-29T11:15:33	dry_run	CLEARED
2026-08-29T11:15:37	dry_run	ACTIVE
2026-08-29T11:15:47	dry_run	CLEARED
2026-08-29T11:16:23	dry_run	ACTIVE
2026-08-29T11:16:28	dry_run	CLEARED
2026-08-29T11:16:58	dry_run	ACTIVE
2026-08-29T11:17:03	dry_run	ACTIVE
2026-08-29T11:17:03	dry_run	CLEARED
2026-08-29T11:17:08	dry_run	CLEARED
2026-08-29T11:17:33	dry_run	ACTIVE
2026-08-29T11:17:38	dry_run	CLEARED
2026-08-29T11:18:18	dry_run	ACTIVE
2026-08-29T11:18:23	dry_run	CLEARED
2026-08-29T11:18:28	dry_run	ACTIVE
2026-08-29T11:18:33	dry_run	CLEARED
2026-08-29T11:19:48	dry_run	ACTIVE
2026-08-29T11:19:53	dry_run	CLEARED
2026-08-29T11:20:13	dry_run	ACTIVE
2026-08-29T11:20:18	dry_run	CLEARED
2026-08-29T11:21:03	dry_run	ACTIVE
2026-08-29T11:21:08	dry_run	CLEARED
2026-08-29T11:21:19	dry_run	ACTIVE
2026-08-29T11:21:24	dry_run	CLEARED
2026-08-29T11:21:39	dry_run	ACTIVE
2026-08-29T11:21:44	dry_run	CLEARED
2026-08-29T11:22:04	dry_run	ACTIVE
2026-08-29T11:22:09	dry_run	CLEARED
2026-08-29T11:22:14	dry_run	ACTIVE
2026-08-29T11:22:19	dry_run	CLEARED
2026-08-29T11:22:28	dry_run	ACTIVE
2026-08-29T11:22:38	dry_run	CLEARED
2026-08-29T11:22:49	dry_run	ACTIVE
2026-08-29T11:22:54	dry_run	CLEARED

Timestamp	Fault	State
2026-08-29T11:22:59	dry_run	ACTIVE
2026-08-29T11:23:04	dry_run	CLEARED
2026-08-29T11:23:19	dry_run	ACTIVE
2026-08-29T11:23:24	dry_run	CLEARED
2026-08-29T11:23:45	undervoltage	ACTIVE
2026-08-29T11:23:59	undervoltage	CLEARED
2026-08-29T11:24:09	dry_run	ACTIVE
2026-08-29T11:25:24	dry_run	CLEARED
2026-08-29T11:25:30	dry_run	ACTIVE
2026-08-29T11:25:48	dry_run	CLEARED
2026-08-29T11:25:53	dry_run	ACTIVE
2026-08-29T11:27:53	dry_run	CLEARED
2026-08-29T11:28:13	dry_run	ACTIVE
2026-08-29T11:28:37	dry_run	CLEARED
2026-08-29T11:28:43	dry_run	ACTIVE
2026-08-29T11:29:02	dry_run	CLEARED
2026-08-29T11:35:12	undervoltage	CLEARED
2026-08-29T11:35:19	undervoltage	ACTIVE
2026-08-29T11:35:29	undervoltage	ACTIVE
2026-08-29T11:41:32	dry_run	ACTIVE
2026-08-29T11:41:38	dry_run	CLEARED
2026-08-29T11:41:44	dry_run	ACTIVE
2026-08-29T11:41:50	dry_run	CLEARED
2026-08-29T11:41:58	dry_run	ACTIVE
2026-08-29T11:42:09	dry_run	CLEARED
2026-08-29T11:42:22	dry_run	CLEARED
2026-08-29T11:42:33	dry_run	ACTIVE
2026-08-29T11:43:34	dry_run	CLEARED
2026-08-29T11:43:34	undervoltage	ACTIVE
2026-08-29T11:44:10	dry_run	CLEARED
2026-08-29T11:44:10	undervoltage	ACTIVE
2026-08-29T11:44:24	dry_run	ACTIVE
2026-08-29T11:44:24	undervoltage	CLEARED

Timestamp	Fault	State
2026-08-29T11:44:30	dry_run	CLEARED
2026-08-29T11:44:30	undervoltage	ACTIVE
2026-08-29T11:44:48	dry_run	ACTIVE
2026-08-29T11:44:48	undervoltage	CLEARED
2026-08-29T11:44:55	dry_run	CLEARED
2026-08-29T11:44:55	undervoltage	ACTIVE
2026-08-29T11:45:26	dry_run	ACTIVE
2026-08-29T11:45:31	dry_run	CLEARED
2026-08-29T11:45:32	dry_run	ACTIVE
2026-08-29T11:45:37	dry_run	CLEARED
2026-08-29T11:45:41	dry_run	ACTIVE
2026-08-29T11:45:46	dry_run	CLEARED
2026-08-29T11:45:52	dry_run	ACTIVE
2026-08-29T11:45:57	dry_run	CLEARED
2026-08-29T11:46:07	dry_run	ACTIVE
2026-08-29T11:46:12	dry_run	CLEARED
2026-08-29T11:46:31	dry_run	ACTIVE
2026-08-29T11:46:36	dry_run	CLEARED
2026-08-29T11:47:07	dry_run	ACTIVE
2026-08-29T11:47:12	dry_run	CLEARED
2026-08-29T11:47:17	dry_run	ACTIVE
2026-08-29T11:47:22	dry_run	CLEARED
2026-08-29T11:47:47	dry_run	ACTIVE
2026-08-29T11:47:52	dry_run	CLEARED
2026-08-29T11:48:07	dry_run	ACTIVE
2026-08-29T11:48:12	dry_run	CLEARED
2026-08-29T11:48:21	dry_run	ACTIVE
2026-08-29T11:48:26	dry_run	CLEARED
2026-08-29T11:48:37	dry_run	ACTIVE
2026-08-29T11:48:52	dry_run	CLEARED
2026-08-29T11:49:02	dry_run	ACTIVE
2026-08-29T11:49:07	dry_run	CLEARED
2026-08-29T11:49:17	dry_run	ACTIVE

Timestamp	Fault	State
2026-08-29T11:49:22	dry_run	CLEARED
2026-08-29T11:49:31	dry_run	ACTIVE
2026-08-29T11:49:36	dry_run	CLEARED
2026-08-29T11:50:07	dry_run	ACTIVE
2026-08-29T11:50:12	dry_run	CLEARED
2026-08-29T11:50:52	dry_run	ACTIVE
2026-08-29T11:50:57	dry_run	CLEARED
2026-08-29T11:51:07	dry_run	ACTIVE
2026-08-29T11:51:07	dry_run	ACTIVE
2026-08-29T11:51:12	dry_run	CLEARED
2026-08-29T11:51:12	dry_run	CLEARED
2026-08-29T11:51:27	dry_run	ACTIVE
2026-08-29T11:51:32	dry_run	CLEARED
2026-08-29T11:51:37	dry_run	ACTIVE
2026-08-29T11:51:42	dry_run	CLEARED
2026-08-29T11:52:07	dry_run	ACTIVE
2026-08-29T11:52:17	dry_run	CLEARED
2026-08-29T11:52:27	dry_run	ACTIVE
2026-08-29T11:52:32	dry_run	CLEARED
2026-08-29T11:52:42	dry_run	ACTIVE
2026-08-29T11:52:47	dry_run	CLEARED
2026-08-29T11:52:52	dry_run	ACTIVE
2026-08-29T11:52:57	dry_run	CLEARED
2026-08-29T11:58:46	undervoltage	CLEARED
2026-08-29T11:59:02	dry_run	ACTIVE
2026-08-29T11:59:07	dry_run	CLEARED
2026-08-29T12:08:49	undervoltage	ACTIVE
2026-08-29T12:09:05	undervoltage	CLEARED
2026-08-29T12:09:11	undervoltage	ACTIVE
2026-08-29T12:09:35	undervoltage	CLEARED
2026-08-29T12:09:42	undervoltage	ACTIVE
2026-08-29T12:10:10	undervoltage	CLEARED
2026-08-29T12:10:15	undervoltage	ACTIVE

Timestamp	Fault	State
2026-08-29T12:10:20	undervoltage	CLEARED
2026-08-29T12:10:26	undervoltage	ACTIVE
2026-08-29T12:10:43	undervoltage	CLEARED
2026-08-29T12:10:49	undervoltage	ACTIVE
2026-08-29T12:11:00	undervoltage	CLEARED
2026-08-29T12:11:07	undervoltage	ACTIVE
2026-08-29T12:11:16	undervoltage	CLEARED
2026-08-29T12:11:22	undervoltage	ACTIVE
2026-08-29T12:11:27	undervoltage	CLEARED
2026-08-29T12:11:39	undervoltage	ACTIVE
2026-08-29T12:12:02	undervoltage	CLEARED
2026-08-29T12:12:09	undervoltage	ACTIVE
2026-08-29T12:12:14	undervoltage	CLEARED
2026-08-29T12:14:04	undervoltage	ACTIVE
2026-08-31T12:51:00	dry_run	ACTIVE
2026-08-31T12:51:05	dry_run	CLEARED
2026-08-31T12:51:30	dry_run	ACTIVE
2026-08-31T12:51:35	dry_run	CLEARED
2026-08-31T12:52:06	dry_run	ACTIVE
2026-08-31T12:52:11	dry_run	CLEARED
2026-08-31T12:52:21	dry_run	ACTIVE
2026-08-31T12:52:26	dry_run	CLEARED
2026-08-31T12:52:31	dry_run	ACTIVE
2026-08-31T12:52:36	dry_run	CLEARED
2026-08-31T12:52:44	dry_run	ACTIVE
2026-08-31T12:52:49	dry_run	CLEARED
2026-08-31T12:52:56	dry_run	ACTIVE
2026-08-31T12:53:06	dry_run	CLEARED
2026-08-31T12:53:24	dry_run	ACTIVE
2026-08-31T12:53:26	dry_run	ACTIVE
2026-08-31T12:53:29	dry_run	CLEARED
2026-08-31T12:53:31	dry_run	CLEARED
2026-08-31T12:53:54	dry_run	ACTIVE

Timestamp	Fault	State
2026-08-31T12:53:59	dry_run	CLEARED
2026-08-31T12:54:06	dry_run	ACTIVE
2026-08-31T12:54:11	dry_run	CLEARED
2026-08-31T12:54:25	dry_run	ACTIVE
2026-08-31T12:54:35	dry_run	CLEARED
2026-08-31T12:55:20	dry_run	ACTIVE
2026-08-31T12:55:30	dry_run	CLEARED
2026-08-31T12:55:41	dry_run	ACTIVE
2026-08-31T12:55:46	dry_run	CLEARED
2026-08-31T12:56:00	dry_run	ACTIVE
2026-08-31T12:56:06	dry_run	ACTIVE
2026-08-31T12:56:10	dry_run	CLEARED
2026-08-31T12:56:11	dry_run	CLEARED
2026-08-31T12:56:40	dry_run	ACTIVE
2026-08-31T12:56:41	dry_run	ACTIVE
2026-08-31T12:56:46	dry_run	CLEARED
2026-08-31T12:56:55	dry_run	CLEARED
2026-08-31T12:57:00	dry_run	ACTIVE
2026-08-31T12:57:05	dry_run	CLEARED
2026-08-31T12:57:10	dry_run	ACTIVE
2026-08-31T12:57:20	dry_run	CLEARED
2026-08-31T12:57:46	dry_run	ACTIVE
2026-08-31T12:57:51	dry_run	CLEARED
2026-08-31T12:58:01	dry_run	ACTIVE
2026-08-31T12:58:06	dry_run	CLEARED
2026-08-31T12:59:30	dry_run	ACTIVE
2026-08-31T12:59:40	dry_run	CLEARED
2026-08-31T12:59:46	dry_run	ACTIVE
2026-08-31T12:59:51	dry_run	CLEARED
2026-08-31T13:00:40	dry_run	ACTIVE
2026-08-31T13:00:45	dry_run	CLEARED
2026-08-31T13:00:50	dry_run	ACTIVE
2026-08-31T13:01:00	dry_run	CLEARED

Timestamp	Fault	State
2026-08-31T13:02:01	dry_run	ACTIVE
2026-08-31T13:02:06	dry_run	CLEARED
2026-08-31T13:02:25	dry_run	ACTIVE
2026-08-31T13:02:30	dry_run	CLEARED
2026-08-31T13:02:42	dry_run	ACTIVE
2026-08-31T13:02:45	dry_run	ACTIVE
2026-08-31T13:02:47	dry_run	CLEARED
2026-08-31T13:02:50	dry_run	CLEARED
2026-08-31T13:02:52	dry_run	ACTIVE
2026-08-31T13:02:57	dry_run	CLEARED
2026-08-31T13:03:05	dry_run	ACTIVE
2026-08-31T13:03:10	dry_run	CLEARED
2026-08-31T13:03:35	dry_run	ACTIVE
2026-08-31T13:03:40	dry_run	CLEARED
2026-08-31T13:03:57	dry_run	ACTIVE
2026-08-31T13:04:02	dry_run	CLEARED
2026-08-31T13:04:27	dry_run	ACTIVE
2026-08-31T13:04:32	dry_run	CLEARED
2026-08-31T13:04:35	dry_run	ACTIVE
2026-08-31T13:04:40	dry_run	CLEARED
2026-08-31T13:05:32	dry_run	ACTIVE
2026-08-31T13:05:37	dry_run	CLEARED
2026-08-31T13:05:47	dry_run	ACTIVE
2026-08-31T13:05:52	dry_run	CLEARED
2026-08-31T13:05:56	dry_run	ACTIVE
2026-08-31T13:06:01	dry_run	CLEARED
2026-08-31T13:07:41	dry_run	ACTIVE
2026-08-31T13:07:42	dry_run	ACTIVE
2026-08-31T13:07:46	dry_run	CLEARED
2026-08-31T13:07:52	dry_run	CLEARED
2026-08-31T13:08:11	dry_run	ACTIVE
2026-08-31T13:08:16	dry_run	CLEARED
2026-08-31T13:09:02	dry_run	ACTIVE

Timestamp	Fault	State
2026-08-31T13:09:12	dry_run	CLEARED
2026-08-31T13:09:22	dry_run	ACTIVE
2026-08-31T13:09:27	dry_run	CLEARED
2026-08-31T13:09:51	dry_run	ACTIVE
2026-08-31T13:09:57	dry_run	CLEARED
2026-08-31T13:09:58	dry_run	ACTIVE
2026-08-31T13:10:03	dry_run	CLEARED
2026-08-31T13:10:18	dry_run	ACTIVE
2026-08-31T13:10:22	dry_run	ACTIVE
2026-08-31T13:10:23	dry_run	CLEARED
2026-08-31T13:10:27	dry_run	CLEARED
2026-08-31T13:10:52	dry_run	ACTIVE
2026-08-31T13:10:57	dry_run	CLEARED
2026-08-31T13:11:12	dry_run	ACTIVE
2026-08-31T13:11:22	dry_run	CLEARED
2026-08-31T13:12:03	dry_run	ACTIVE
2026-08-31T13:12:08	dry_run	CLEARED
2026-08-31T13:12:48	dry_run	ACTIVE
2026-08-31T13:12:53	dry_run	CLEARED
2026-08-31T13:12:58	dry_run	ACTIVE
2026-08-31T13:13:03	dry_run	CLEARED
2026-08-31T13:13:13	dry_run	ACTIVE
2026-08-31T13:13:18	dry_run	CLEARED
2026-08-31T13:13:38	dry_run	ACTIVE
2026-08-31T13:13:43	dry_run	CLEARED
2026-08-31T13:14:14	dry_run	ACTIVE
2026-08-31T13:14:19	dry_run	CLEARED
2026-08-31T13:14:29	dry_run	ACTIVE
2026-08-31T13:14:34	dry_run	CLEARED
2026-08-31T13:14:43	dry_run	ACTIVE
2026-08-31T13:14:48	dry_run	CLEARED
2026-08-31T13:16:09	dry_run	ACTIVE
2026-08-31T13:16:14	dry_run	CLEARED

Timestamp	Fault	State
2026-08-31T13:16:15	dry_run	ACTIVE
2026-08-31T13:16:20	dry_run	CLEARED
2026-08-31T13:16:30	dry_run	ACTIVE
2026-08-31T13:16:35	dry_run	CLEARED
2026-08-31T13:16:50	dry_run	ACTIVE
2026-08-31T13:16:55	dry_run	CLEARED
2026-08-31T13:17:40	dry_run	ACTIVE
2026-08-31T13:17:50	dry_run	CLEARED
2026-08-31T13:18:16	dry_run	ACTIVE
2026-08-31T13:18:21	dry_run	CLEARED
2026-08-31T13:18:36	dry_run	ACTIVE
2026-08-31T13:18:41	dry_run	CLEARED
2026-08-31T13:18:56	dry_run	ACTIVE
2026-08-31T13:19:06	dry_run	CLEARED
2026-08-31T13:19:11	dry_run	ACTIVE
2026-08-31T13:19:16	dry_run	CLEARED
2026-08-31T13:19:56	dry_run	ACTIVE
2026-08-31T13:20:01	dry_run	CLEARED
2026-08-31T13:20:26	dry_run	ACTIVE
2026-08-31T13:20:32	dry_run	CLEARED
2026-08-31T13:20:37	dry_run	ACTIVE
2026-08-31T13:20:42	dry_run	CLEARED
2026-08-31T13:20:52	dry_run	ACTIVE
2026-08-31T13:20:56	dry_run	ACTIVE
2026-08-31T13:20:57	dry_run	CLEARED
2026-08-31T13:21:01	dry_run	CLEARED
2026-08-31T13:21:21	dry_run	ACTIVE
2026-08-31T13:21:26	dry_run	CLEARED
2026-08-31T13:21:46	dry_run	ACTIVE
2026-08-31T13:21:51	dry_run	CLEARED
2026-08-31T14:33:34	dry_run	ACTIVE
2026-08-31T14:33:39	dry_run	CLEARED
2026-08-31T14:33:54	dry_run	ACTIVE

Timestamp	Fault	State
2026-08-31T14:33:59	dry_run	CLEARED
2026-08-31T14:34:04	dry_run	ACTIVE
2026-08-31T14:34:09	dry_run	CLEARED
2026-08-31T14:34:19	dry_run	ACTIVE
2026-08-31T14:34:24	dry_run	CLEARED
2026-08-31T14:34:54	dry_run	ACTIVE
2026-08-31T14:34:59	dry_run	CLEARED
2026-08-31T14:35:19	dry_run	ACTIVE
2026-08-31T14:35:24	dry_run	CLEARED
2026-08-31T14:35:39	dry_run	ACTIVE
2026-08-31T14:35:44	dry_run	CLEARED
2026-08-31T14:36:09	dry_run	ACTIVE
2026-08-31T14:36:14	dry_run	CLEARED
2026-08-31T14:36:19	dry_run	ACTIVE
2026-08-31T14:36:24	dry_run	CLEARED
2026-08-31T14:36:44	dry_run	ACTIVE
2026-08-31T14:36:49	dry_run	ACTIVE
2026-08-31T14:36:49	dry_run	CLEARED
2026-08-31T14:36:54	dry_run	CLEARED
2026-08-31T14:37:09	dry_run	ACTIVE
2026-08-31T14:37:14	dry_run	CLEARED
2026-08-31T14:37:24	dry_run	ACTIVE
2026-08-31T14:37:29	dry_run	CLEARED
2026-08-31T14:37:34	dry_run	ACTIVE
2026-08-31T14:37:39	dry_run	CLEARED
2026-08-31T14:38:05	dry_run	ACTIVE
2026-08-31T14:38:10	dry_run	CLEARED
2026-08-31T14:38:35	dry_run	ACTIVE
2026-08-31T14:38:40	dry_run	CLEARED
2026-08-31T14:39:15	dry_run	ACTIVE
2026-08-31T14:39:20	dry_run	CLEARED
2026-08-31T14:39:35	dry_run	ACTIVE
2026-08-31T14:39:40	dry_run	CLEARED

Timestamp	Fault	State
2026-08-31T14:39:55	dry_run	ACTIVE
2026-08-31T14:40:00	dry_run	CLEARED
2026-08-31T14:40:10	dry_run	ACTIVE
2026-08-31T14:40:15	dry_run	CLEARED
2026-08-31T14:40:25	dry_run	ACTIVE
2026-08-31T14:40:30	dry_run	ACTIVE
2026-08-31T14:40:30	dry_run	CLEARED
2026-08-31T14:40:35	dry_run	CLEARED
2026-08-31T14:41:00	dry_run	ACTIVE
2026-08-31T14:41:05	dry_run	CLEARED
2026-08-31T14:41:20	dry_run	ACTIVE
2026-08-31T14:41:25	dry_run	CLEARED
2026-08-31T14:41:35	dry_run	ACTIVE
2026-08-31T14:41:40	dry_run	ACTIVE
2026-08-31T14:41:40	dry_run	CLEARED
2026-08-31T14:41:45	dry_run	CLEARED
2026-08-31T14:42:00	dry_run	ACTIVE
2026-08-31T14:42:05	dry_run	CLEARED
2026-08-31T14:42:10	dry_run	ACTIVE
2026-08-31T14:42:15	dry_run	CLEARED
2026-08-31T14:42:20	dry_run	ACTIVE
2026-08-31T14:42:25	dry_run	CLEARED
2026-08-31T14:42:35	dry_run	ACTIVE
2026-08-31T14:42:40	dry_run	CLEARED
2026-08-31T14:42:50	dry_run	ACTIVE
2026-08-31T14:42:55	dry_run	CLEARED
2026-08-31T14:44:10	dry_run	ACTIVE
2026-08-31T14:44:15	dry_run	CLEARED
2026-08-31T14:44:20	dry_run	ACTIVE
2026-08-31T14:44:25	dry_run	CLEARED
2026-08-31T14:45:00	dry_run	ACTIVE
2026-08-31T14:45:05	dry_run	CLEARED
2026-08-31T14:45:11	dry_run	ACTIVE

Timestamp	Fault	State
2026-08-31T14:45:11	dry_run	ACTIVE
2026-08-31T14:45:16	dry_run	CLEARED
2026-08-31T14:45:21	dry_run	CLEARED
2026-08-31T14:45:31	dry_run	ACTIVE
2026-08-31T14:45:36	dry_run	CLEARED
2026-08-31T14:45:41	dry_run	ACTIVE
2026-08-31T14:45:51	dry_run	CLEARED
2026-08-31T14:46:06	dry_run	ACTIVE
2026-08-31T14:46:11	dry_run	CLEARED
2026-08-31T14:46:56	dry_run	ACTIVE
2026-08-31T14:47:01	dry_run	CLEARED
2026-08-31T14:47:31	dry_run	ACTIVE
2026-08-31T14:47:41	dry_run	CLEARED
2026-08-31T14:48:46	dry_run	ACTIVE
2026-08-31T14:48:51	dry_run	CLEARED
2026-08-31T14:49:16	dry_run	ACTIVE
2026-08-31T14:49:21	dry_run	CLEARED
2026-08-31T14:49:46	dry_run	ACTIVE
2026-08-31T14:49:51	dry_run	CLEARED
2026-08-31T14:49:56	dry_run	ACTIVE
2026-08-31T14:50:01	dry_run	CLEARED
2026-08-31T14:50:11	dry_run	ACTIVE
2026-08-31T14:50:16	dry_run	CLEARED
2026-08-31T14:50:21	dry_run	ACTIVE
2026-08-31T14:50:26	dry_run	CLEARED
2026-08-31T14:51:41	dry_run	ACTIVE
2026-08-31T14:51:46	dry_run	ACTIVE
2026-08-31T14:51:51	dry_run	CLEARED
2026-08-31T14:51:56	dry_run	CLEARED
2026-08-31T14:52:11	dry_run	ACTIVE
2026-08-31T14:52:16	dry_run	CLEARED
2026-08-31T14:52:16	dry_run	ACTIVE
2026-08-31T14:52:21	dry_run	CLEARED

Timestamp	Fault	State
2026-08-31T14:53:03	dry_run	ACTIVE
2026-08-31T14:53:08	dry_run	CLEARED
2026-08-31T14:53:18	dry_run	ACTIVE
2026-08-31T14:53:23	dry_run	CLEARED
2026-08-31T14:53:23	dry_run	ACTIVE
2026-08-31T14:53:28	dry_run	CLEARED
2026-08-31T14:53:33	dry_run	ACTIVE
2026-08-31T14:53:38	dry_run	ACTIVE
2026-08-31T14:53:38	dry_run	CLEARED
2026-08-31T14:53:43	dry_run	ACTIVE
2026-08-31T14:53:48	dry_run	CLEARED
2026-08-31T14:53:48	dry_run	CLEARED
2026-08-31T14:54:13	dry_run	ACTIVE
2026-08-31T14:54:23	dry_run	CLEARED
2026-08-31T14:54:49	dry_run	ACTIVE
2026-08-31T14:54:54	dry_run	CLEARED
2026-08-31T14:55:39	dry_run	ACTIVE
2026-08-31T14:55:44	dry_run	CLEARED
2026-08-31T14:55:49	dry_run	ACTIVE
2026-08-31T14:55:54	dry_run	CLEARED
2026-08-31T14:56:29	dry_run	ACTIVE
2026-08-31T14:56:34	dry_run	CLEARED
2026-08-31T14:56:39	dry_run	ACTIVE
2026-08-31T14:56:44	dry_run	CLEARED
2026-08-31T14:56:59	dry_run	ACTIVE
2026-08-31T14:56:59	dry_run	ACTIVE
2026-08-31T14:57:04	dry_run	CLEARED
2026-08-31T14:57:09	dry_run	CLEARED
2026-08-31T14:57:19	dry_run	ACTIVE
2026-08-31T14:57:29	dry_run	CLEARED
2026-08-31T14:57:44	dry_run	ACTIVE
2026-08-31T14:57:54	dry_run	CLEARED
2026-08-31T14:58:04	dry_run	ACTIVE

Timestamp	Fault	State
2026-08-31T14:58:09	dry_run	CLEARED
2026-08-31T14:58:19	dry_run	ACTIVE
2026-08-31T14:58:24	dry_run	CLEARED
2026-08-31T14:58:34	dry_run	ACTIVE
2026-08-31T14:58:39	dry_run	CLEARED
2026-08-31T14:58:39	dry_run	ACTIVE
2026-08-31T14:58:44	dry_run	CLEARED
2026-08-31T14:58:54	dry_run	ACTIVE
2026-08-31T14:58:59	dry_run	ACTIVE
2026-08-31T14:58:59	dry_run	CLEARED
2026-08-31T14:59:04	dry_run	CLEARED
2026-08-31T14:59:19	dry_run	ACTIVE
2026-08-31T14:59:24	dry_run	CLEARED
2026-08-31T14:59:34	dry_run	ACTIVE
2026-08-31T14:59:39	dry_run	CLEARED
2026-08-31T14:59:39	dry_run	ACTIVE
2026-08-31T14:59:44	dry_run	CLEARED
2026-08-31T14:59:49	dry_run	ACTIVE
2026-08-31T14:59:54	dry_run	CLEARED
2026-08-31T14:59:54	dry_run	ACTIVE
2026-08-31T14:59:59	dry_run	CLEARED
2026-08-31T15:00:29	dry_run	ACTIVE
2026-08-31T15:00:34	dry_run	CLEARED
2026-08-31T15:00:49	dry_run	ACTIVE
2026-08-31T15:01:04	dry_run	CLEARED
2026-08-31T15:01:19	dry_run	ACTIVE
2026-08-31T15:01:24	dry_run	CLEARED
2026-08-31T15:01:59	dry_run	ACTIVE
2026-08-31T15:02:09	dry_run	CLEARED
2026-08-31T15:02:29	dry_run	ACTIVE
2026-08-31T15:02:34	dry_run	CLEARED
2026-08-31T15:02:39	dry_run	ACTIVE
2026-08-31T15:02:44	dry_run	CLEARED

Timestamp	Fault	State
2026-08-31T15:02:54	dry_run	ACTIVE
2026-08-31T15:02:59	dry_run	CLEARED
2026-08-31T15:03:30	dry_run	ACTIVE
2026-08-31T15:03:35	dry_run	ACTIVE
2026-08-31T15:03:35	dry_run	CLEARED
2026-08-31T15:03:40	dry_run	CLEARED
2026-08-31T15:03:45	dry_run	ACTIVE
2026-08-31T15:03:50	dry_run	CLEARED
2026-08-31T15:04:05	dry_run	ACTIVE
2026-08-31T15:04:10	dry_run	CLEARED
2026-08-31T15:04:15	dry_run	ACTIVE
2026-08-31T15:04:15	dry_run	ACTIVE
2026-08-31T15:04:20	dry_run	CLEARED
2026-08-31T15:04:20	dry_run	CLEARED
2026-08-31T15:04:25	dry_run	ACTIVE
2026-08-31T15:04:30	dry_run	CLEARED
2026-08-31T15:04:35	dry_run	ACTIVE
2026-08-31T15:04:35	dry_run	ACTIVE
2026-08-31T15:04:40	dry_run	CLEARED
2026-08-31T15:04:40	dry_run	CLEARED
2026-08-31T15:04:45	dry_run	ACTIVE
2026-08-31T15:04:50	dry_run	CLEARED
2026-08-31T15:05:10	dry_run	ACTIVE
2026-08-31T15:05:20	dry_run	CLEARED
2026-08-31T15:05:30	dry_run	ACTIVE
2026-08-31T15:05:35	dry_run	CLEARED
2026-08-31T15:06:10	dry_run	ACTIVE
2026-08-31T15:06:15	dry_run	CLEARED
2026-08-31T15:06:25	dry_run	ACTIVE
2026-08-31T15:06:30	dry_run	CLEARED
2026-08-31T15:07:10	dry_run	ACTIVE
2026-08-31T15:07:20	dry_run	CLEARED
2026-08-31T15:07:25	dry_run	ACTIVE

Timestamp	Fault	State
2026-08-31T15:07:30	dry_run	CLEARED
2026-08-31T15:07:45	dry_run	ACTIVE
2026-08-31T15:07:50	dry_run	CLEARED
2026-08-31T15:07:50	dry_run	ACTIVE
2026-08-31T15:08:00	dry_run	CLEARED
2026-08-31T15:08:10	dry_run	ACTIVE
2026-08-31T15:08:10	dry_run	ACTIVE
2026-08-31T15:08:15	dry_run	CLEARED
2026-08-31T15:08:20	dry_run	CLEARED
2026-08-31T15:08:45	dry_run	ACTIVE
2026-08-31T15:08:50	dry_run	CLEARED
2026-08-31T15:09:00	dry_run	ACTIVE
2026-08-31T15:09:10	dry_run	CLEARED
2026-08-31T15:09:55	dry_run	ACTIVE
2026-08-31T15:10:00	dry_run	CLEARED
2026-08-31T15:10:30	dry_run	ACTIVE
2026-08-31T15:10:35	dry_run	CLEARED
2026-08-31T15:10:40	dry_run	ACTIVE
2026-08-31T15:10:45	dry_run	CLEARED
2026-08-31T15:10:50	dry_run	ACTIVE
2026-08-31T15:10:55	dry_run	CLEARED
2026-08-31T15:10:55	dry_run	ACTIVE
2026-08-31T15:11:00	dry_run	ACTIVE
2026-08-31T15:11:00	dry_run	CLEARED
2026-08-31T15:11:05	dry_run	CLEARED
2026-08-31T15:11:10	dry_run	ACTIVE
2026-08-31T15:11:15	dry_run	CLEARED
2026-08-31T15:11:15	dry_run	ACTIVE
2026-08-31T15:11:20	dry_run	CLEARED
2026-08-31T15:12:15	dry_run	ACTIVE
2026-08-31T15:12:20	dry_run	CLEARED
2026-08-31T15:12:30	dry_run	ACTIVE
2026-08-31T15:12:35	dry_run	CLEARED

Timestamp	Fault	State
2026-08-31T15:12:50	dry_run	ACTIVE
2026-08-31T15:12:55	dry_run	CLEARED
2026-08-31T15:13:05	dry_run	ACTIVE
2026-08-31T15:13:11	dry_run	CLEARED
2026-08-31T15:13:11	dry_run	ACTIVE
2026-08-31T15:13:16	dry_run	ACTIVE
2026-08-31T15:13:26	dry_run	CLEARED
2026-08-31T15:13:26	dry_run	CLEARED
2026-08-31T15:13:31	dry_run	ACTIVE
2026-08-31T15:13:36	dry_run	ACTIVE
2026-08-31T15:13:36	dry_run	CLEARED
2026-08-31T15:13:41	dry_run	CLEARED
2026-08-31T15:13:41	dry_run	ACTIVE
2026-08-31T15:13:46	dry_run	CLEARED
2026-08-31T15:14:06	dry_run	ACTIVE
2026-08-31T15:14:11	dry_run	CLEARED
2026-08-31T15:14:51	dry_run	ACTIVE
2026-08-31T15:14:56	dry_run	CLEARED
2026-08-31T15:15:21	dry_run	ACTIVE
2026-08-31T15:18:40	undervoltage	CLEARED
2026-08-31T15:22:42	dry_run	ACTIVE
2026-08-31T15:23:56	dry_run	CLEARED
2026-08-31T15:24:14	undervoltage	ACTIVE
2026-08-31T15:28:45	undervoltage	CLEARED
2026-08-31T15:29:10	undervoltage	CLEARED
2026-08-31T15:32:09	undervoltage	ACTIVE
2026-08-31T15:33:06	undervoltage	CLEARED
2026-08-31T15:33:06	overvoltage	ACTIVE
2026-08-31T15:44:16	dry_run	ACTIVE
2026-08-31T15:44:21	dry_run	CLEARED
2026-08-31T15:44:22	dry_run	ACTIVE
2026-08-31T15:44:26	dry_run	ACTIVE
2026-08-31T15:44:27	dry_run	CLEARED

Timestamp	Fault	State
2026-08-31T15:44:31	dry_run	CLEARED
2026-08-31T15:44:51	dry_run	ACTIVE
2026-08-31T15:44:52	dry_run	ACTIVE
2026-08-31T15:44:56	dry_run	CLEARED
2026-08-31T15:45:02	dry_run	CLEARED
2026-08-31T15:45:26	dry_run	ACTIVE
2026-08-31T15:45:28	dry_run	ACTIVE
2026-08-31T15:45:31	dry_run	CLEARED
2026-08-31T15:45:33	dry_run	CLEARED
2026-08-31T15:45:38	dry_run	ACTIVE
2026-08-31T15:45:43	dry_run	CLEARED
2026-08-31T15:46:21	dry_run	ACTIVE
2026-08-31T15:46:26	dry_run	CLEARED
2026-08-31T15:46:28	dry_run	ACTIVE
2026-08-31T15:46:33	dry_run	CLEARED
2026-08-31T15:47:11	dry_run	ACTIVE
2026-08-31T15:47:16	dry_run	CLEARED
2026-08-31T15:47:21	dry_run	ACTIVE
2026-08-31T15:47:27	dry_run	CLEARED
2026-08-31T15:47:42	dry_run	ACTIVE
2026-08-31T15:47:47	dry_run	CLEARED
2026-08-31T15:47:53	dry_run	ACTIVE
2026-08-31T15:47:57	dry_run	ACTIVE
2026-08-31T15:47:58	dry_run	CLEARED
2026-08-31T15:48:02	dry_run	CLEARED
2026-08-31T15:48:22	dry_run	ACTIVE
2026-08-31T15:48:42	dry_run	CLEARED
2026-08-31T15:48:54	dry_run	ACTIVE
2026-08-31T15:49:04	dry_run	CLEARED
2026-08-31T15:49:12	dry_run	ACTIVE
2026-08-31T15:49:17	dry_run	CLEARED
2026-08-31T15:49:27	dry_run	ACTIVE
2026-08-31T15:49:32	dry_run	CLEARED

Timestamp	Fault	State
2026-08-31T15:49:42	dry_run	ACTIVE
2026-08-31T15:49:47	dry_run	CLEARED
2026-08-31T15:49:52	dry_run	ACTIVE
2026-08-31T15:49:54	dry_run	ACTIVE
2026-08-31T15:49:57	dry_run	CLEARED
2026-08-31T15:50:04	dry_run	CLEARED
2026-08-31T15:50:29	dry_run	ACTIVE
2026-08-31T15:50:33	dry_run	ACTIVE
2026-08-31T15:50:34	dry_run	CLEARED
2026-08-31T15:50:43	dry_run	CLEARED
2026-08-31T15:50:48	dry_run	ACTIVE
2026-08-31T15:50:53	dry_run	CLEARED
2026-08-31T15:51:14	dry_run	ACTIVE
2026-08-31T15:51:18	dry_run	ACTIVE
2026-08-31T15:51:19	dry_run	CLEARED
2026-08-31T15:51:23	dry_run	CLEARED
2026-08-31T15:51:33	dry_run	ACTIVE
2026-08-31T15:51:38	dry_run	CLEARED
2026-08-31T15:52:00	dry_run	ACTIVE
2026-08-31T15:52:05	dry_run	CLEARED
2026-08-31T15:52:28	dry_run	ACTIVE
2026-08-31T15:52:33	dry_run	CLEARED
2026-08-31T15:52:38	dry_run	ACTIVE
2026-08-31T15:52:43	dry_run	CLEARED
2026-08-31T15:53:18	dry_run	ACTIVE
2026-08-31T15:53:23	dry_run	CLEARED
2026-08-31T15:53:50	dry_run	ACTIVE
2026-08-31T15:53:55	dry_run	CLEARED
2026-08-31T15:54:44	dry_run	ACTIVE
2026-08-31T15:54:49	dry_run	CLEARED
2026-08-31T15:55:05	dry_run	ACTIVE
2026-08-31T15:55:09	dry_run	ACTIVE
2026-08-31T15:55:14	dry_run	CLEARED

Timestamp	Fault	State
2026-08-31T15:55:15	dry_run	CLEARED
2026-08-31T16:15:44	dry_run	ACTIVE
2026-08-31T16:15:49	dry_run	CLEARED
2026-08-31T16:15:54	dry_run	ACTIVE
2026-08-31T16:15:55	dry_run	ACTIVE
2026-08-31T16:15:59	dry_run	CLEARED
2026-08-31T16:16:00	dry_run	CLEARED
2026-08-31T16:16:14	dry_run	ACTIVE
2026-08-31T16:16:19	dry_run	CLEARED
2026-08-31T16:16:39	dry_run	ACTIVE
2026-08-31T16:16:45	dry_run	ACTIVE
2026-08-31T16:16:49	dry_run	CLEARED
2026-08-31T16:16:50	dry_run	CLEARED
2026-08-31T16:39:23	undervoltage	ACTIVE
2026-08-31T16:41:05	undervoltage	ACTIVE
2026-08-31T16:41:25	undervoltage	ACTIVE
2026-08-31T16:41:58	undervoltage	CLEARED
2026-08-31T16:42:39	undervoltage	CLEARED
2026-08-31T16:42:44	undervoltage	ACTIVE
2026-08-31T16:42:50	undervoltage	CLEARED
2026-08-31T16:43:08	undervoltage	ACTIVE
2026-08-31T16:43:33	undervoltage	CLEARED
2026-08-31T17:21:59	dry_run	ACTIVE
2026-08-31T17:22:04	dry_run	CLEARED
2026-08-31T17:22:23	dry_run	ACTIVE
2026-08-31T17:22:25	dry_run	ACTIVE
2026-08-31T17:22:47	dry_run	ACTIVE
2026-08-31T17:22:52	dry_run	CLEARED
2026-08-31T17:24:06	dry_run	ACTIVE
2026-08-31T17:24:11	dry_run	CLEARED
2026-08-31T17:25:01	dry_run	ACTIVE
2026-08-31T17:25:06	dry_run	CLEARED
2026-08-31T17:25:34	dry_run	ACTIVE

Timestamp	Fault	State
2026-08-31T17:25:47	dry_run	ACTIVE
2026-08-31T17:25:49	dry_run	CLEARED
2026-08-31T17:25:52	dry_run	CLEARED
2026-08-31T17:26:07	dry_run	ACTIVE
2026-08-31T17:26:12	dry_run	CLEARED
2026-08-31T17:26:17	dry_run	ACTIVE
2026-08-31T17:26:27	dry_run	CLEARED
2026-08-31T17:26:32	dry_run	ACTIVE
2026-08-31T17:26:37	dry_run	CLEARED
2026-08-31T17:26:45	dry_run	ACTIVE
2026-08-31T17:26:50	dry_run	CLEARED
2026-08-31T17:27:25	dry_run	ACTIVE
2026-08-31T17:27:27	dry_run	ACTIVE
2026-08-31T17:27:30	dry_run	CLEARED
2026-08-31T17:27:32	dry_run	CLEARED
2026-08-31T17:27:42	dry_run	ACTIVE
2026-08-31T17:27:47	dry_run	CLEARED
2026-08-31T17:27:50	dry_run	ACTIVE
2026-08-31T17:27:52	dry_run	ACTIVE
2026-08-31T17:27:55	dry_run	CLEARED
2026-08-31T17:27:57	dry_run	CLEARED
2026-08-31T17:28:02	dry_run	ACTIVE
2026-08-31T17:28:05	dry_run	ACTIVE
2026-08-31T17:28:07	dry_run	CLEARED
2026-08-31T17:28:10	dry_run	CLEARED
2026-08-31T17:28:12	dry_run	ACTIVE
2026-08-31T17:28:17	dry_run	CLEARED
2026-08-31T17:28:25	dry_run	ACTIVE
2026-08-31T17:28:30	dry_run	CLEARED
2026-08-31T17:28:43	dry_run	ACTIVE
2026-08-31T17:28:48	dry_run	CLEARED
2026-08-31T17:28:55	dry_run	ACTIVE
2026-08-31T17:28:58	dry_run	ACTIVE

Timestamp	Fault	State
2026-08-31T17:29:03	dry_run	CLEARED
2026-08-31T17:29:05	dry_run	CLEARED
2026-08-31T17:29:13	dry_run	ACTIVE
2026-08-31T17:29:23	dry_run	CLEARED
2026-08-31T17:29:36	dry_run	ACTIVE
2026-08-31T17:29:41	dry_run	CLEARED
2026-08-31T17:29:53	dry_run	ACTIVE
2026-08-31T17:29:56	dry_run	ACTIVE
2026-08-31T17:29:58	dry_run	CLEARED
2026-08-31T17:30:03	dry_run	ACTIVE
2026-08-31T17:30:06	dry_run	CLEARED
2026-08-31T17:30:08	dry_run	CLEARED
2026-08-31T17:30:11	dry_run	ACTIVE
2026-08-31T17:30:16	dry_run	CLEARED
2026-08-31T17:30:31	dry_run	ACTIVE
2026-08-31T17:30:36	dry_run	CLEARED
2026-08-31T17:31:56	dry_run	ACTIVE
2026-08-31T17:32:01	dry_run	CLEARED
2026-08-31T17:32:16	dry_run	ACTIVE
2026-08-31T17:32:21	dry_run	CLEARED
2026-08-31T17:32:44	dry_run	ACTIVE
2026-08-31T17:32:49	dry_run	CLEARED
2026-08-31T17:32:59	dry_run	ACTIVE
2026-08-31T17:33:04	dry_run	CLEARED
2026-08-31T17:33:12	dry_run	ACTIVE
2026-08-31T17:33:17	dry_run	CLEARED
2026-08-31T17:33:24	dry_run	ACTIVE
2026-08-31T17:33:29	dry_run	CLEARED
2026-08-31T17:34:02	dry_run	ACTIVE
2026-08-31T17:34:07	dry_run	CLEARED
2026-08-31T17:34:32	dry_run	ACTIVE
2026-08-31T17:34:37	dry_run	CLEARED
2026-08-31T17:35:12	dry_run	ACTIVE

Timestamp	Fault	State
2026-08-31T17:35:17	dry_run	CLEARED
2026-08-31T17:35:20	dry_run	ACTIVE
2026-08-31T17:35:25	dry_run	CLEARED
2026-08-31T17:35:30	dry_run	ACTIVE
2026-08-31T17:35:35	dry_run	CLEARED
2026-08-31T17:35:37	dry_run	CLEARED
2026-08-31T17:35:42	dry_run	ACTIVE
2026-08-31T17:35:47	dry_run	CLEARED
2026-08-31T17:36:00	dry_run	ACTIVE
2026-08-31T17:36:05	dry_run	CLEARED
2026-08-31T17:36:15	dry_run	ACTIVE
2026-08-31T17:36:18	dry_run	CLEARED
2026-08-31T17:36:20	dry_run	CLEARED
2026-08-31T17:36:25	dry_run	ACTIVE
2026-08-31T17:36:30	dry_run	CLEARED
2026-08-31T17:36:45	dry_run	ACTIVE
2026-08-31T17:36:50	dry_run	CLEARED
2026-08-31T17:36:51	dry_run	ACTIVE
2026-08-31T17:36:55	dry_run	ACTIVE
2026-08-31T17:36:56	dry_run	CLEARED
2026-08-31T17:37:00	dry_run	CLEARED
2026-08-31T17:37:21	dry_run	ACTIVE
2026-08-31T17:37:26	dry_run	CLEARED
2026-08-31T17:37:56	dry_run	ACTIVE
2026-08-31T17:38:01	dry_run	CLEARED
2026-08-31T17:38:30	dry_run	ACTIVE
2026-08-31T17:38:45	dry_run	CLEARED

— End of Report —