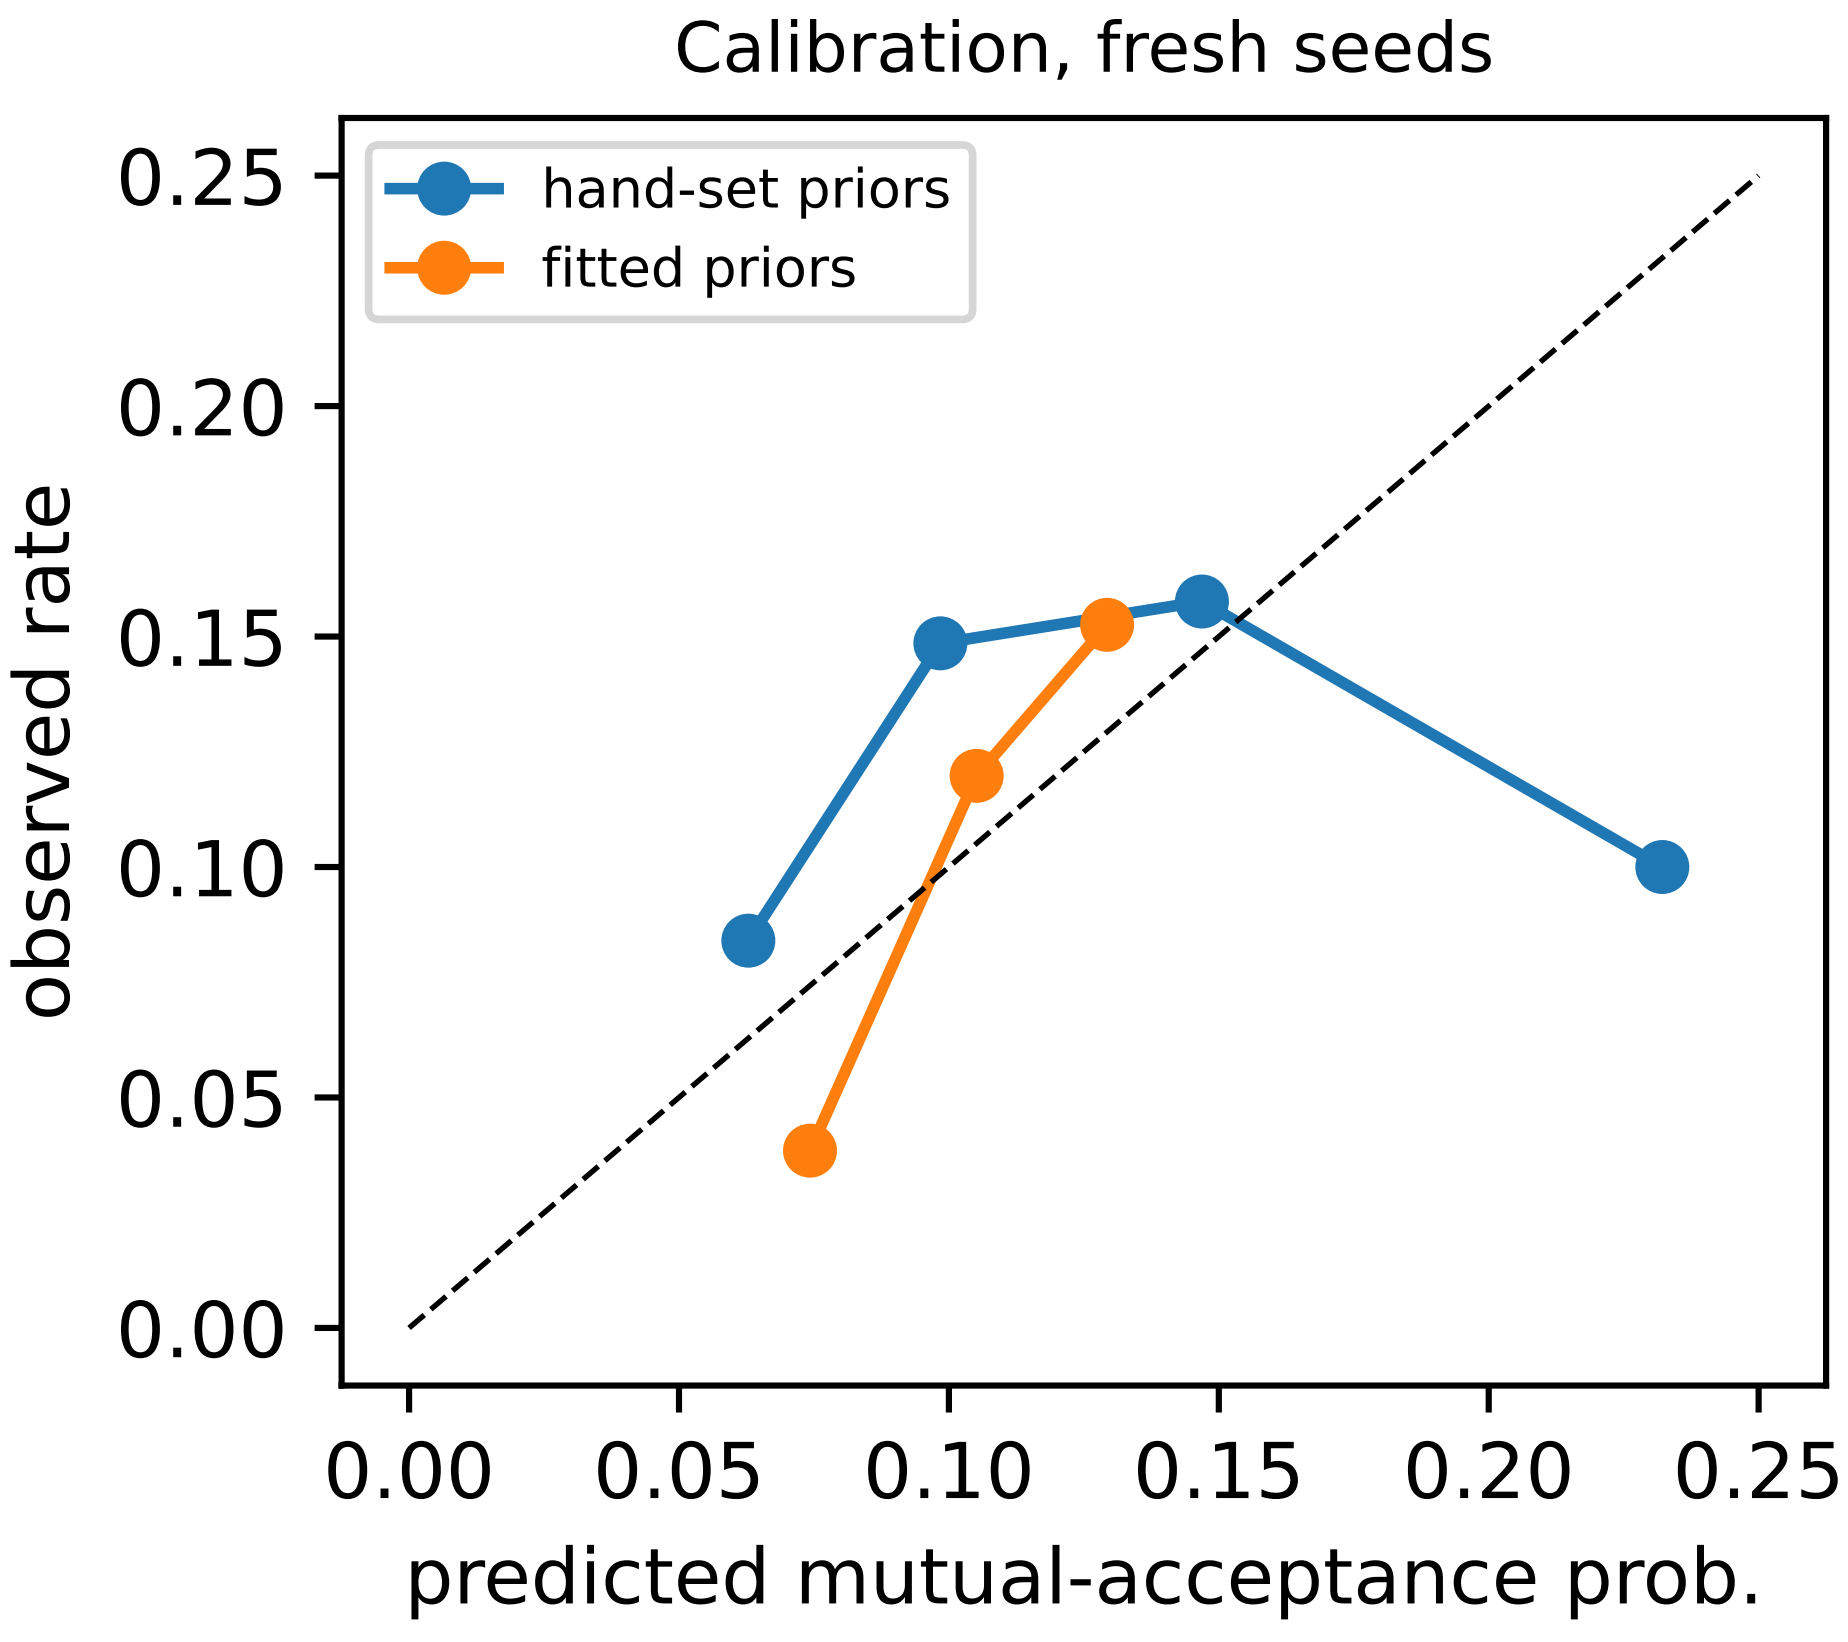
Calibration, fresh seeds
hand-set priors
fitted priors
observed rate
predicted mutual-acceptance prob.
0.00
0.05
0.10
0.15
0.20
0.25