FRA Diagnostic Report

Generated: 2026-03-28 15:07:13

Field	Value
Fault assessment	Healthy
Confidence (0–100)	74.2
Severity	Medium
Anomaly score (0–100)	91.73876346431618
Correlation (vs ref)	0.9777
Max deviation	0.86 dB

Single FRA (test)

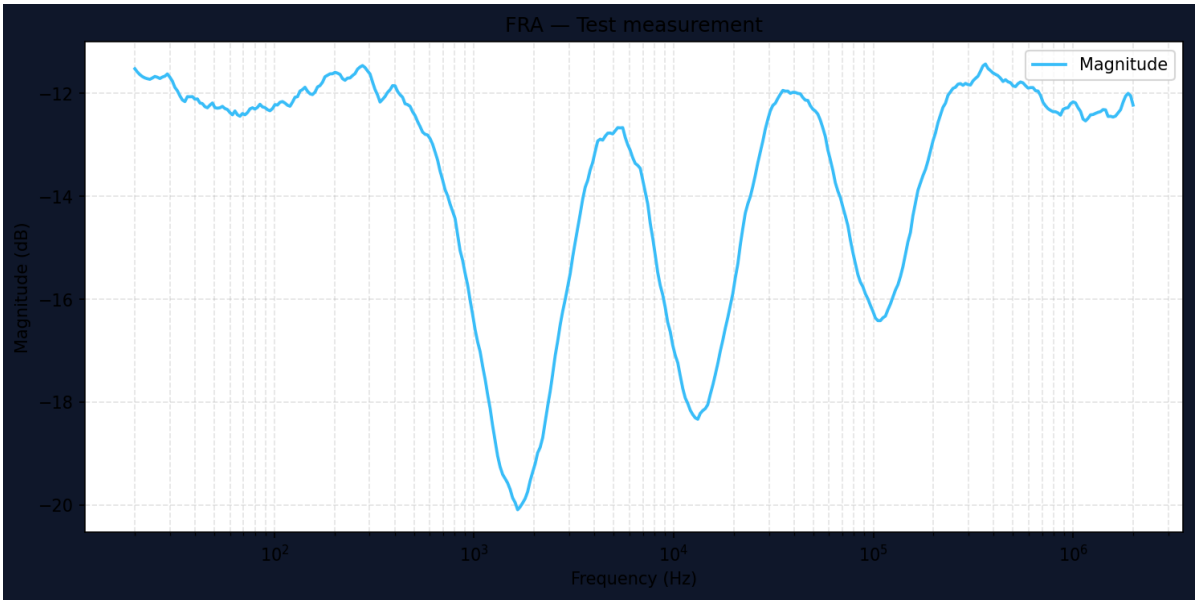

Comparison

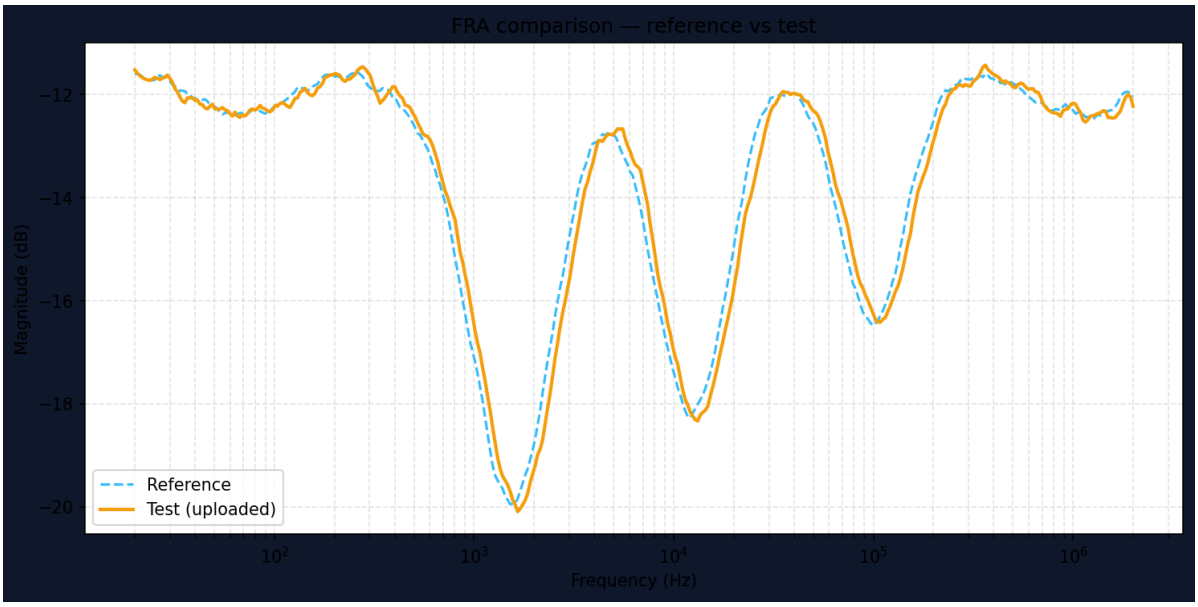

Difference map

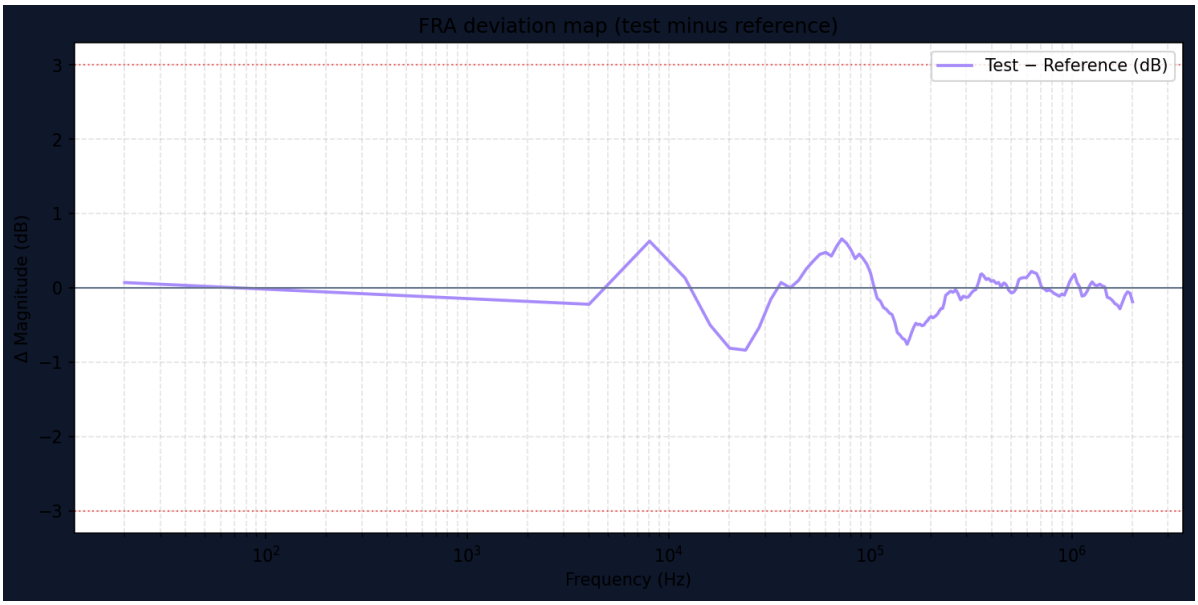

Recommendation

Signature matches reference baseline within 98% correlation. No mechanical or electrical anomalies detected. Resume standard annual monitoring. Expert notes: No strong rule-based triggers; compare with ML and anomaly outputs

Explanation

ML classifier: Healthy (58% estimated class confidence). Statistical correlation vs reference: 0.986. IsolationForest anomaly score (0–100, higher=worse): 91.7. Rules: No strong rule-based triggers; compare with ML and anomaly outputs