


linker1 - linker1-paa-1000nm.spm - NanoScope Analy...
 $k_1=0.403$ N/m, $k_3=0.00e+00$ N/m³, $R^2=-0.179$
(k_3 not reliable - linear fit only)



Linearized: F/D vs D^2 (insufficient data)

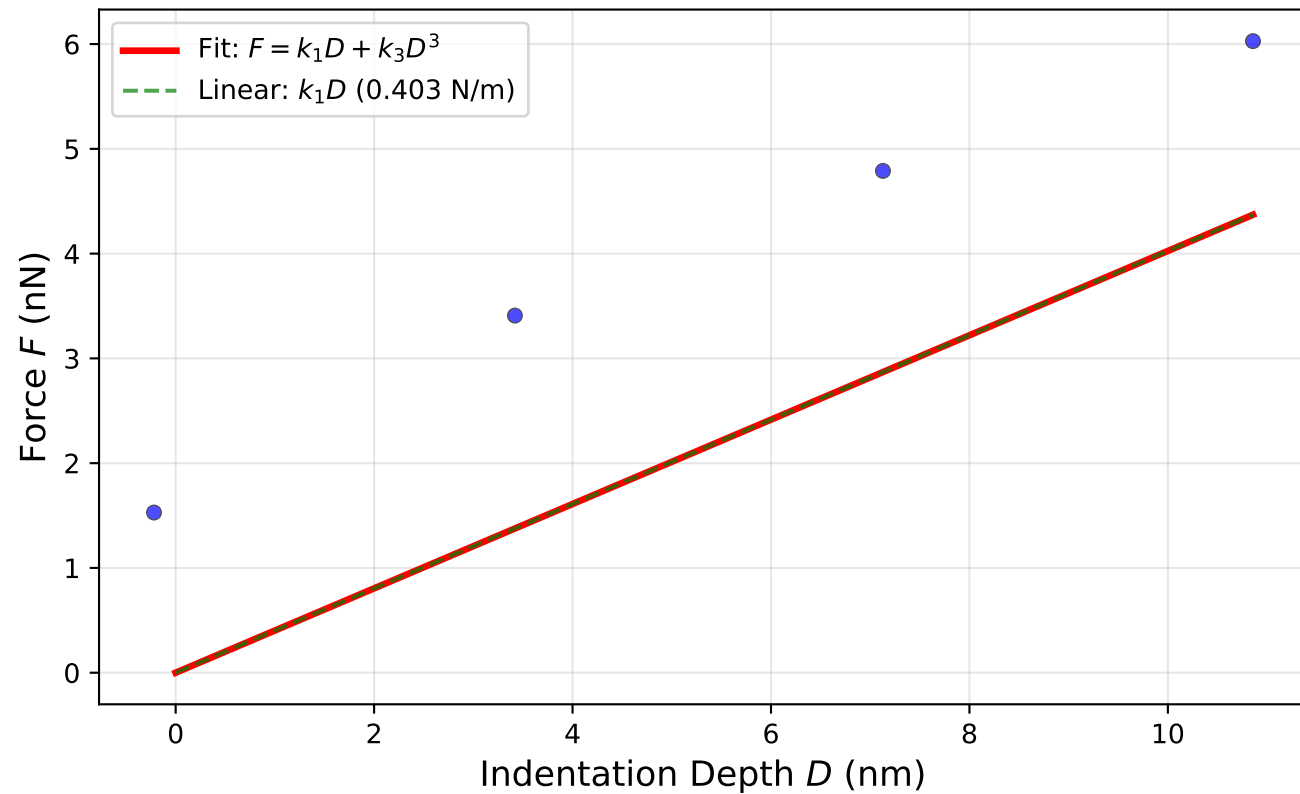