




Frank2017 NFA Mean Firing Rate AUC by Plate

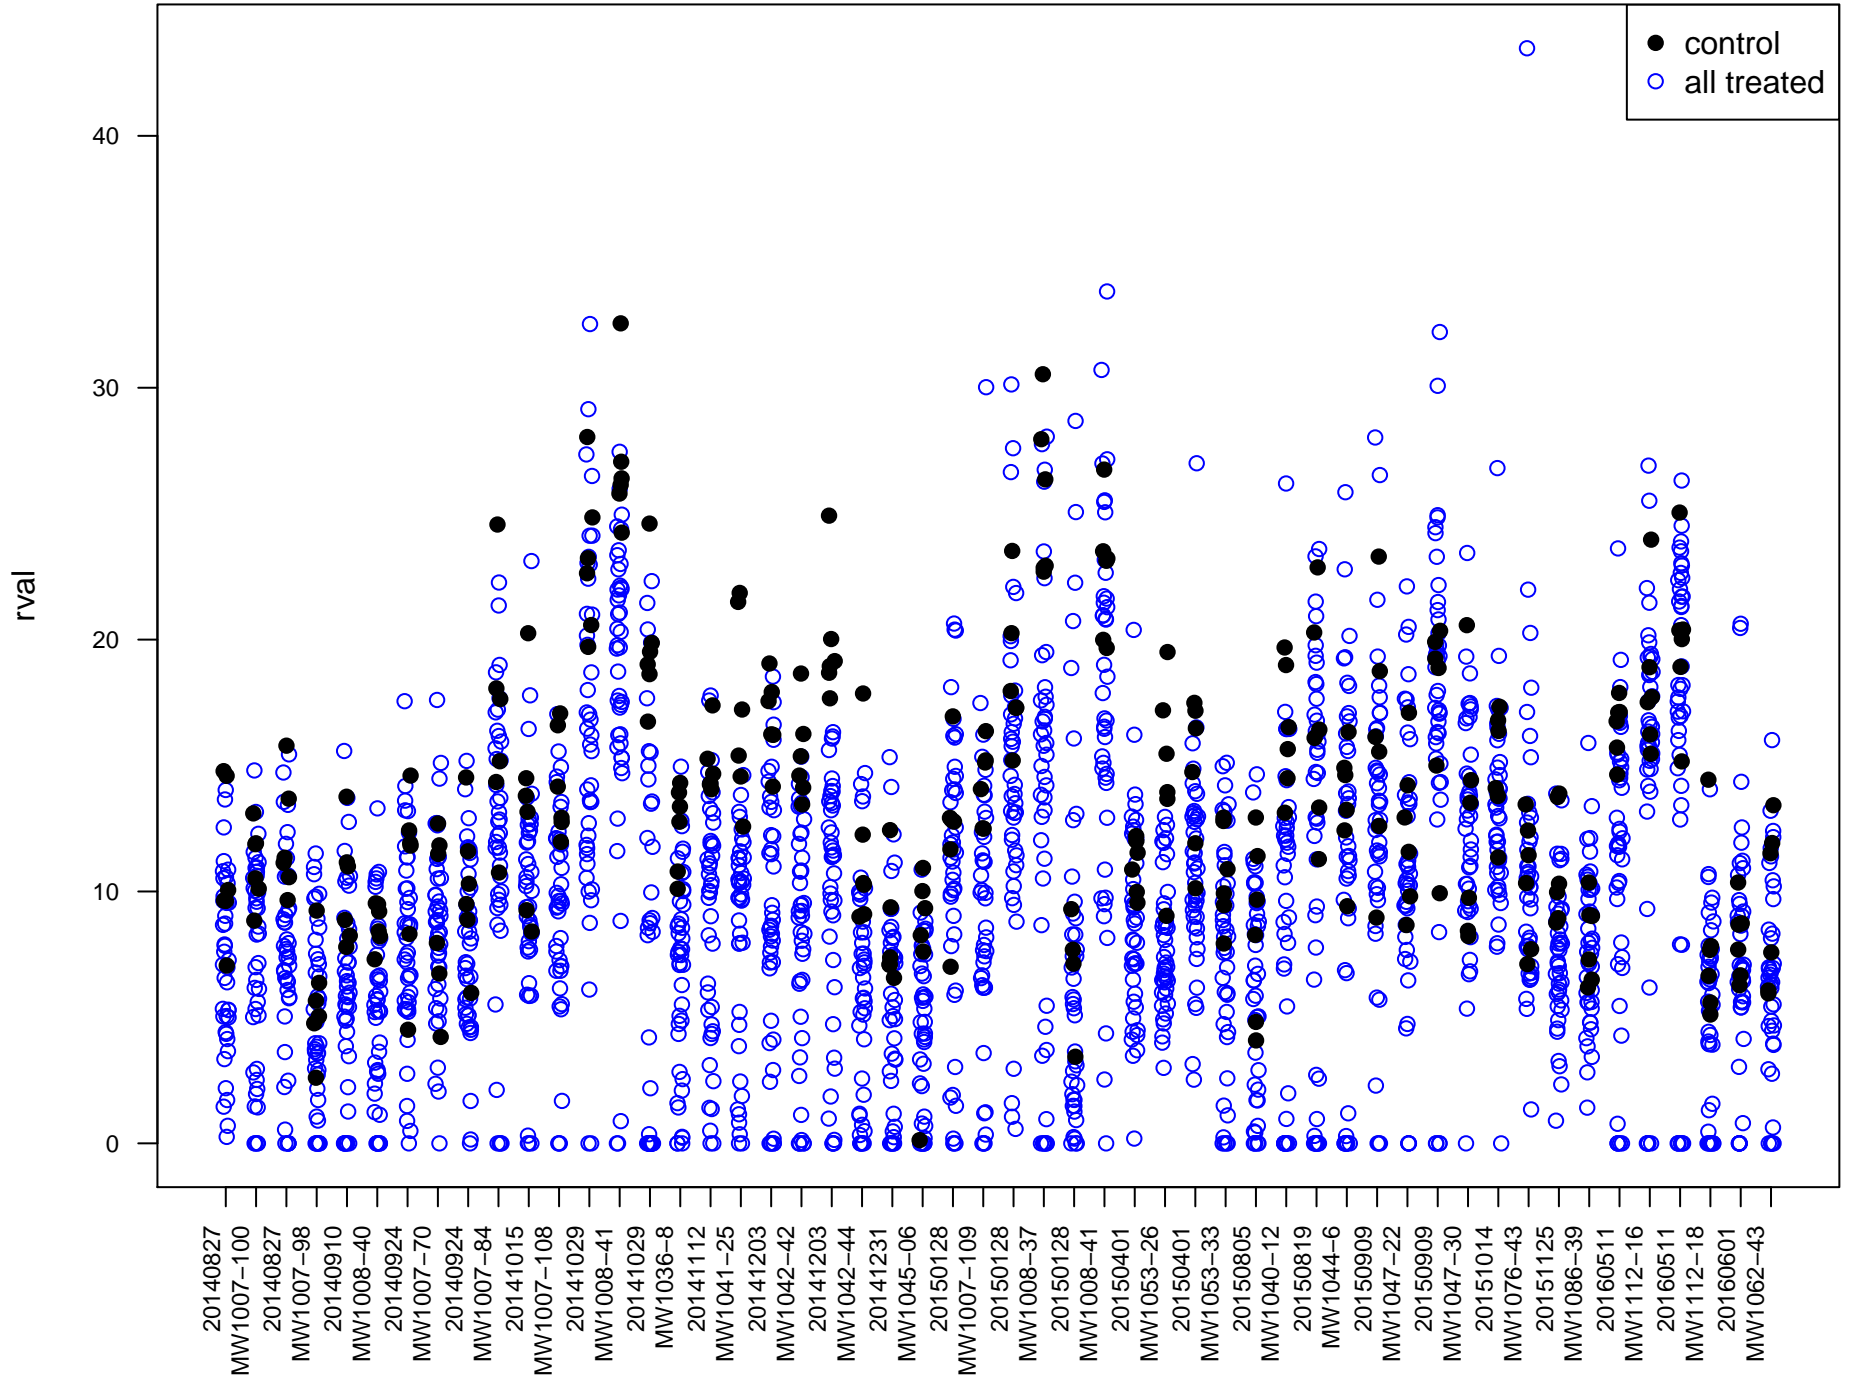


Frank2017 NFA # Active Electrodes AUC by Plate

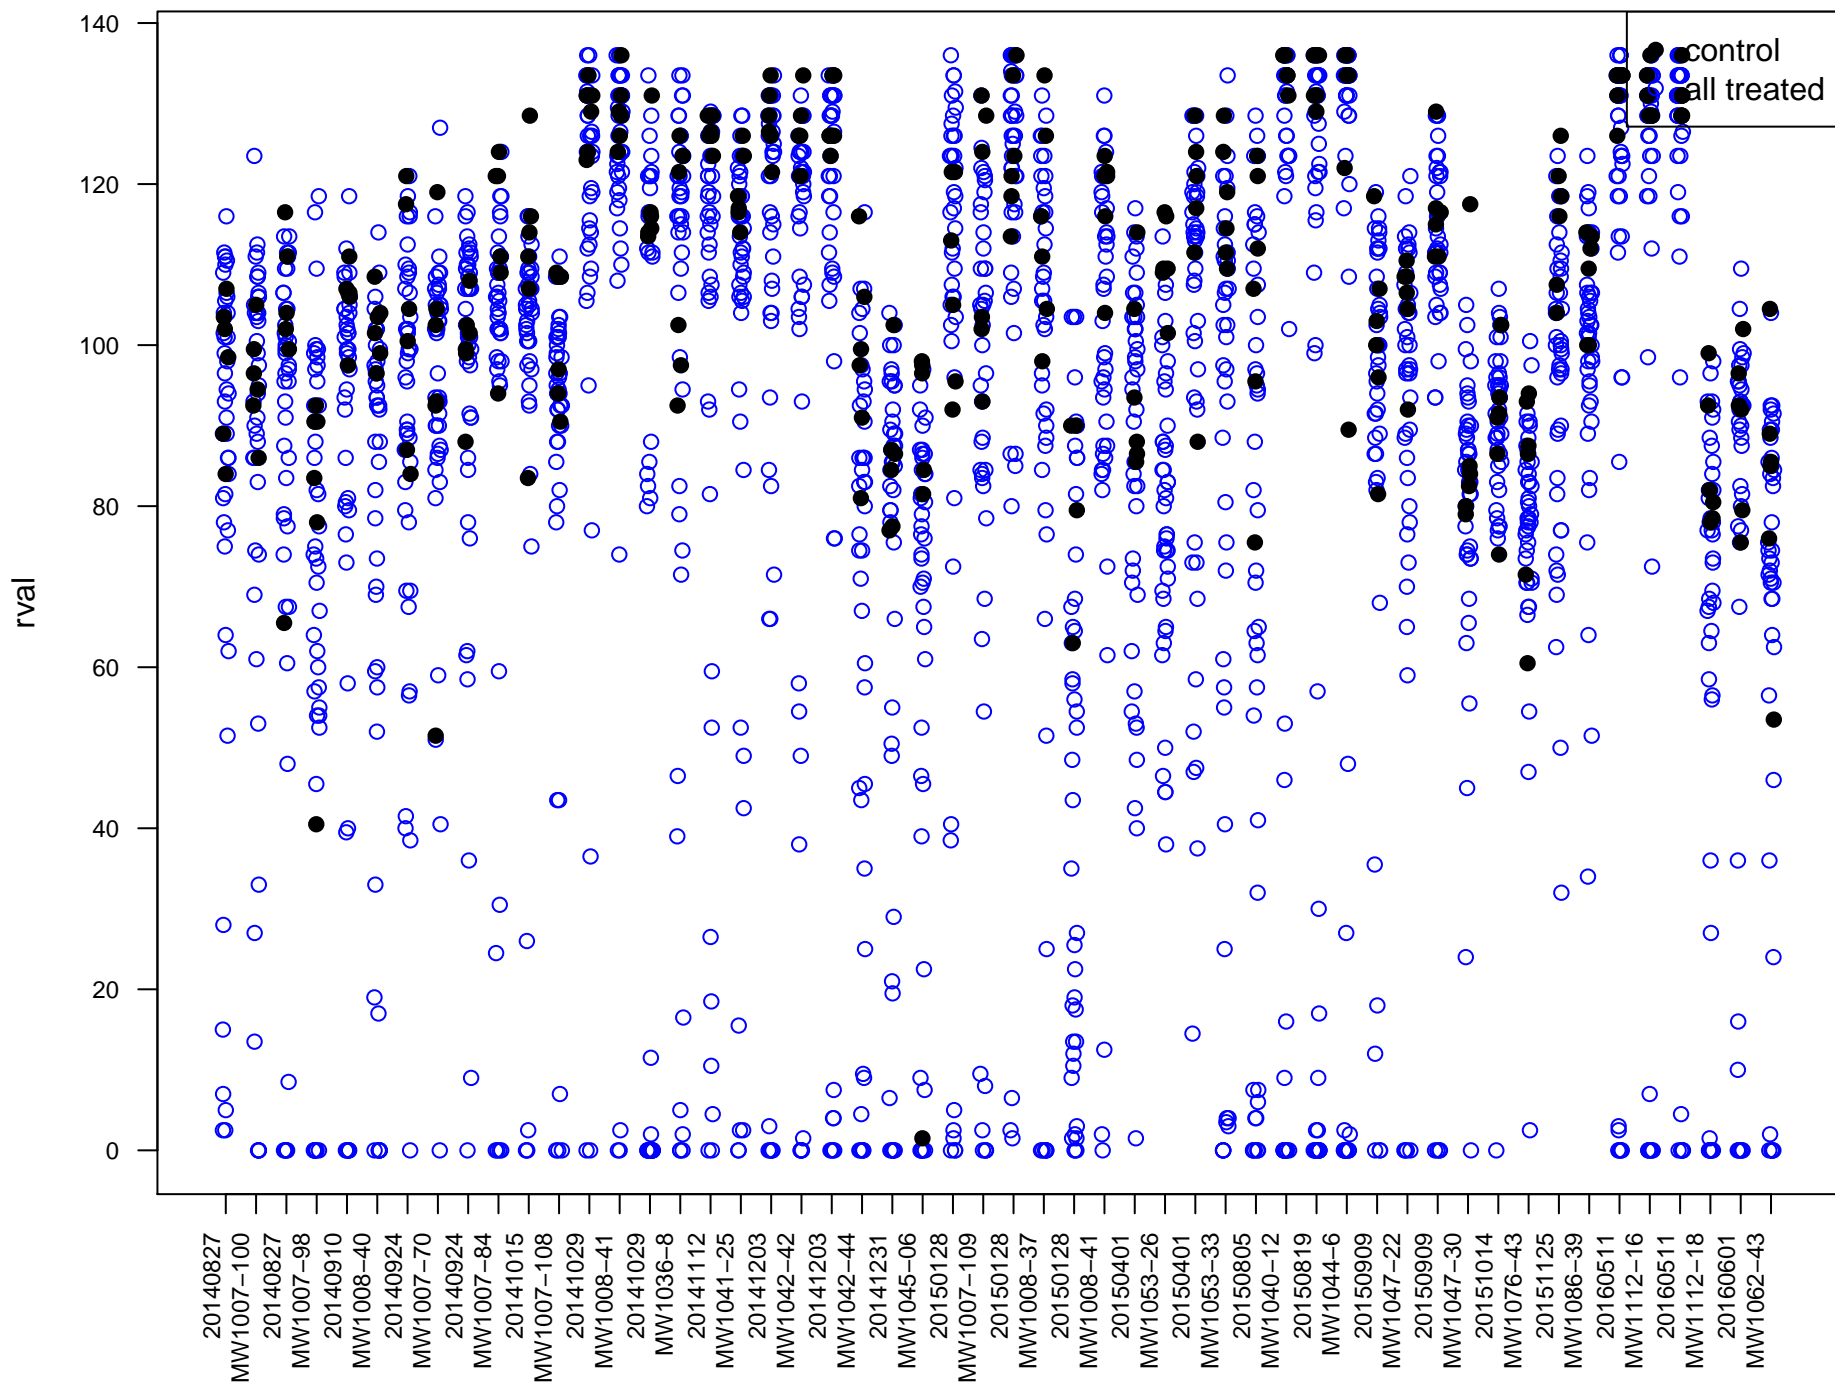


Mean Firing Rate AUC by dose for all compounds in Frank2017

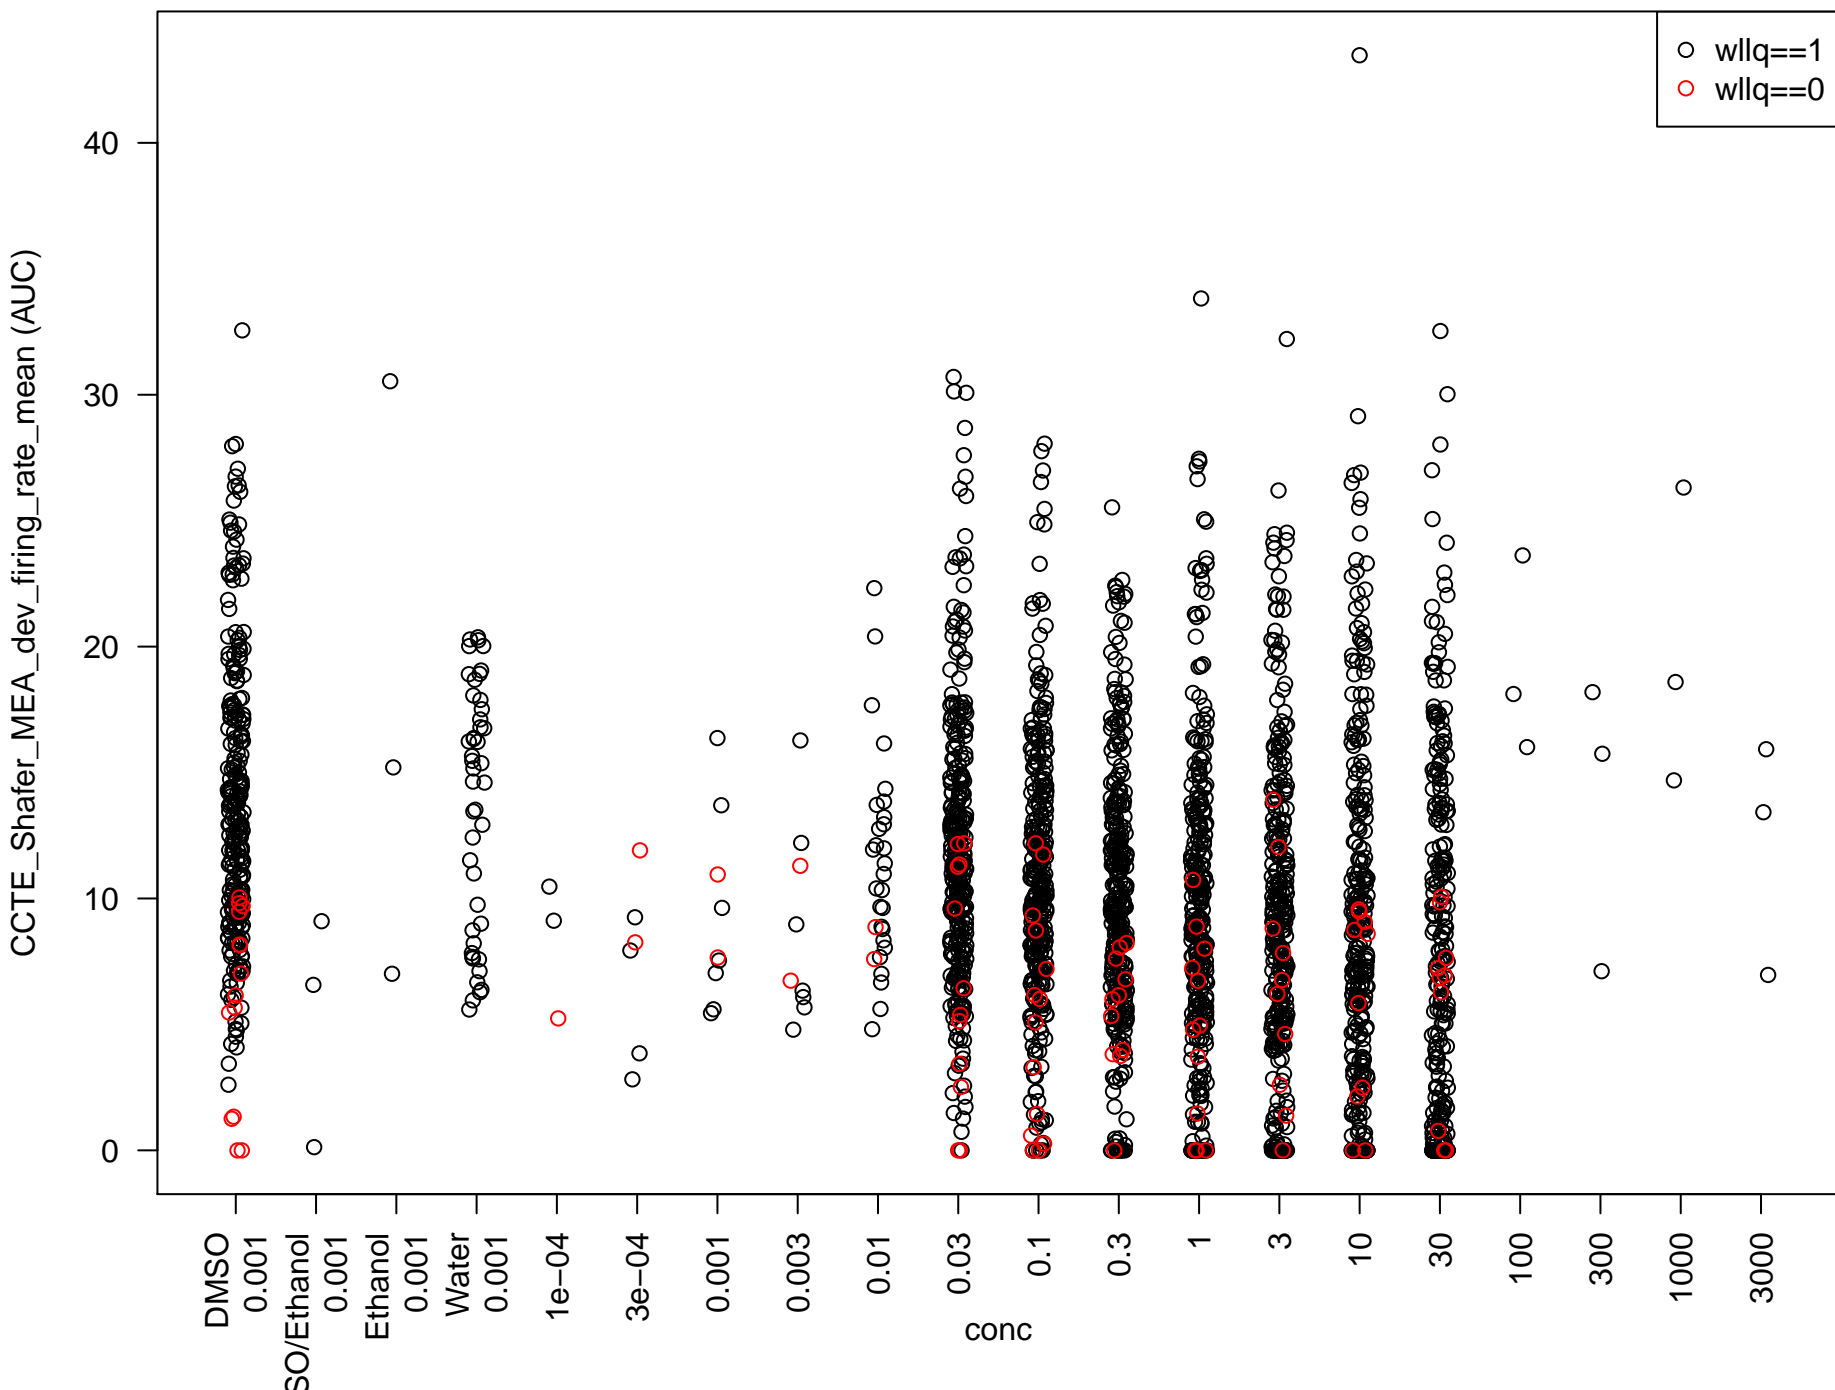


Valproic acid Mean Firing Rate AUC Dose Response

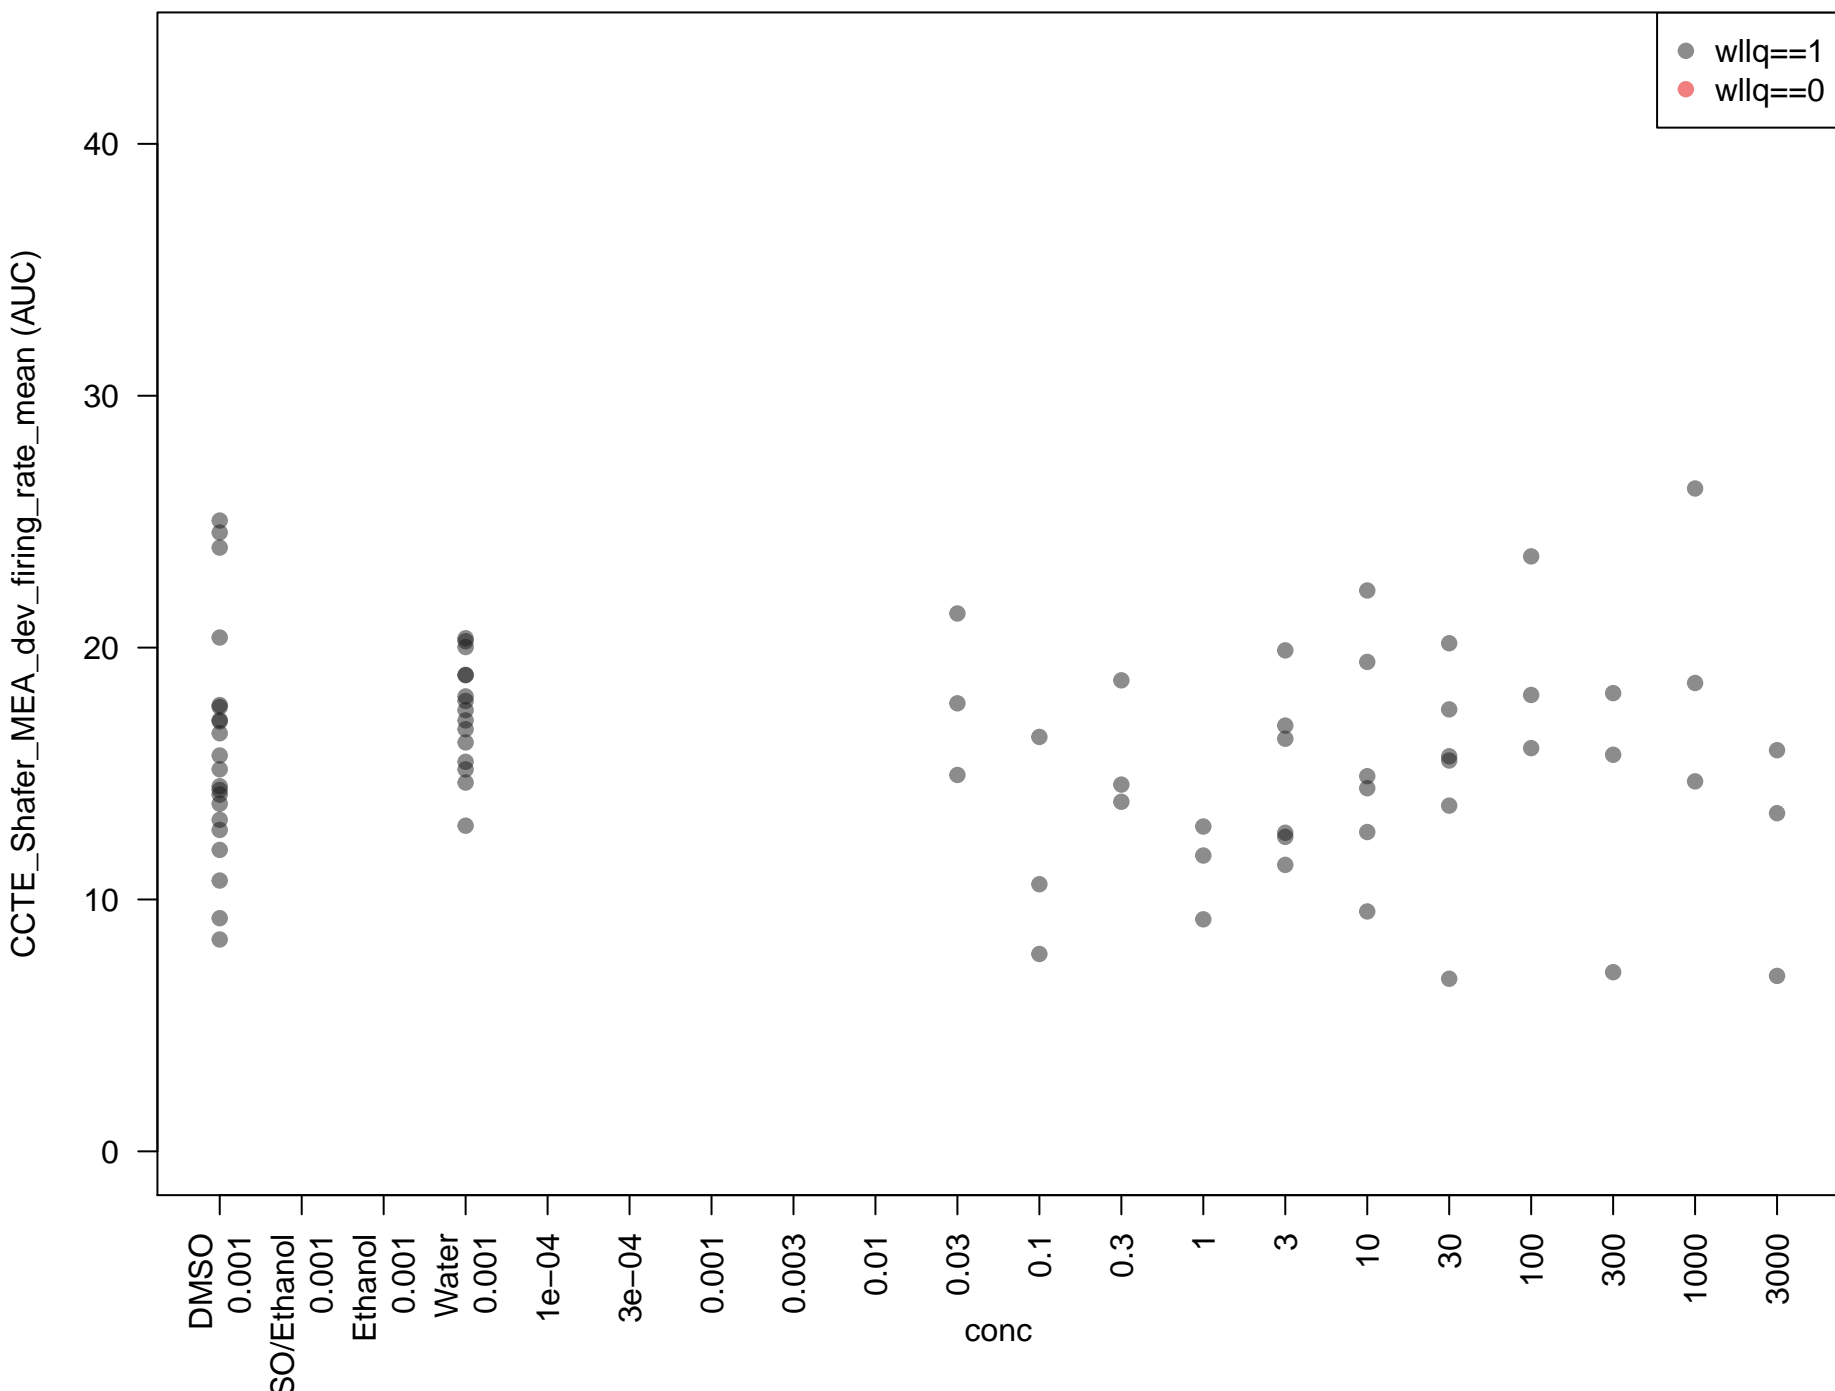

AB Blank-Corrected Values for Frank2017 where $wlq == 1$

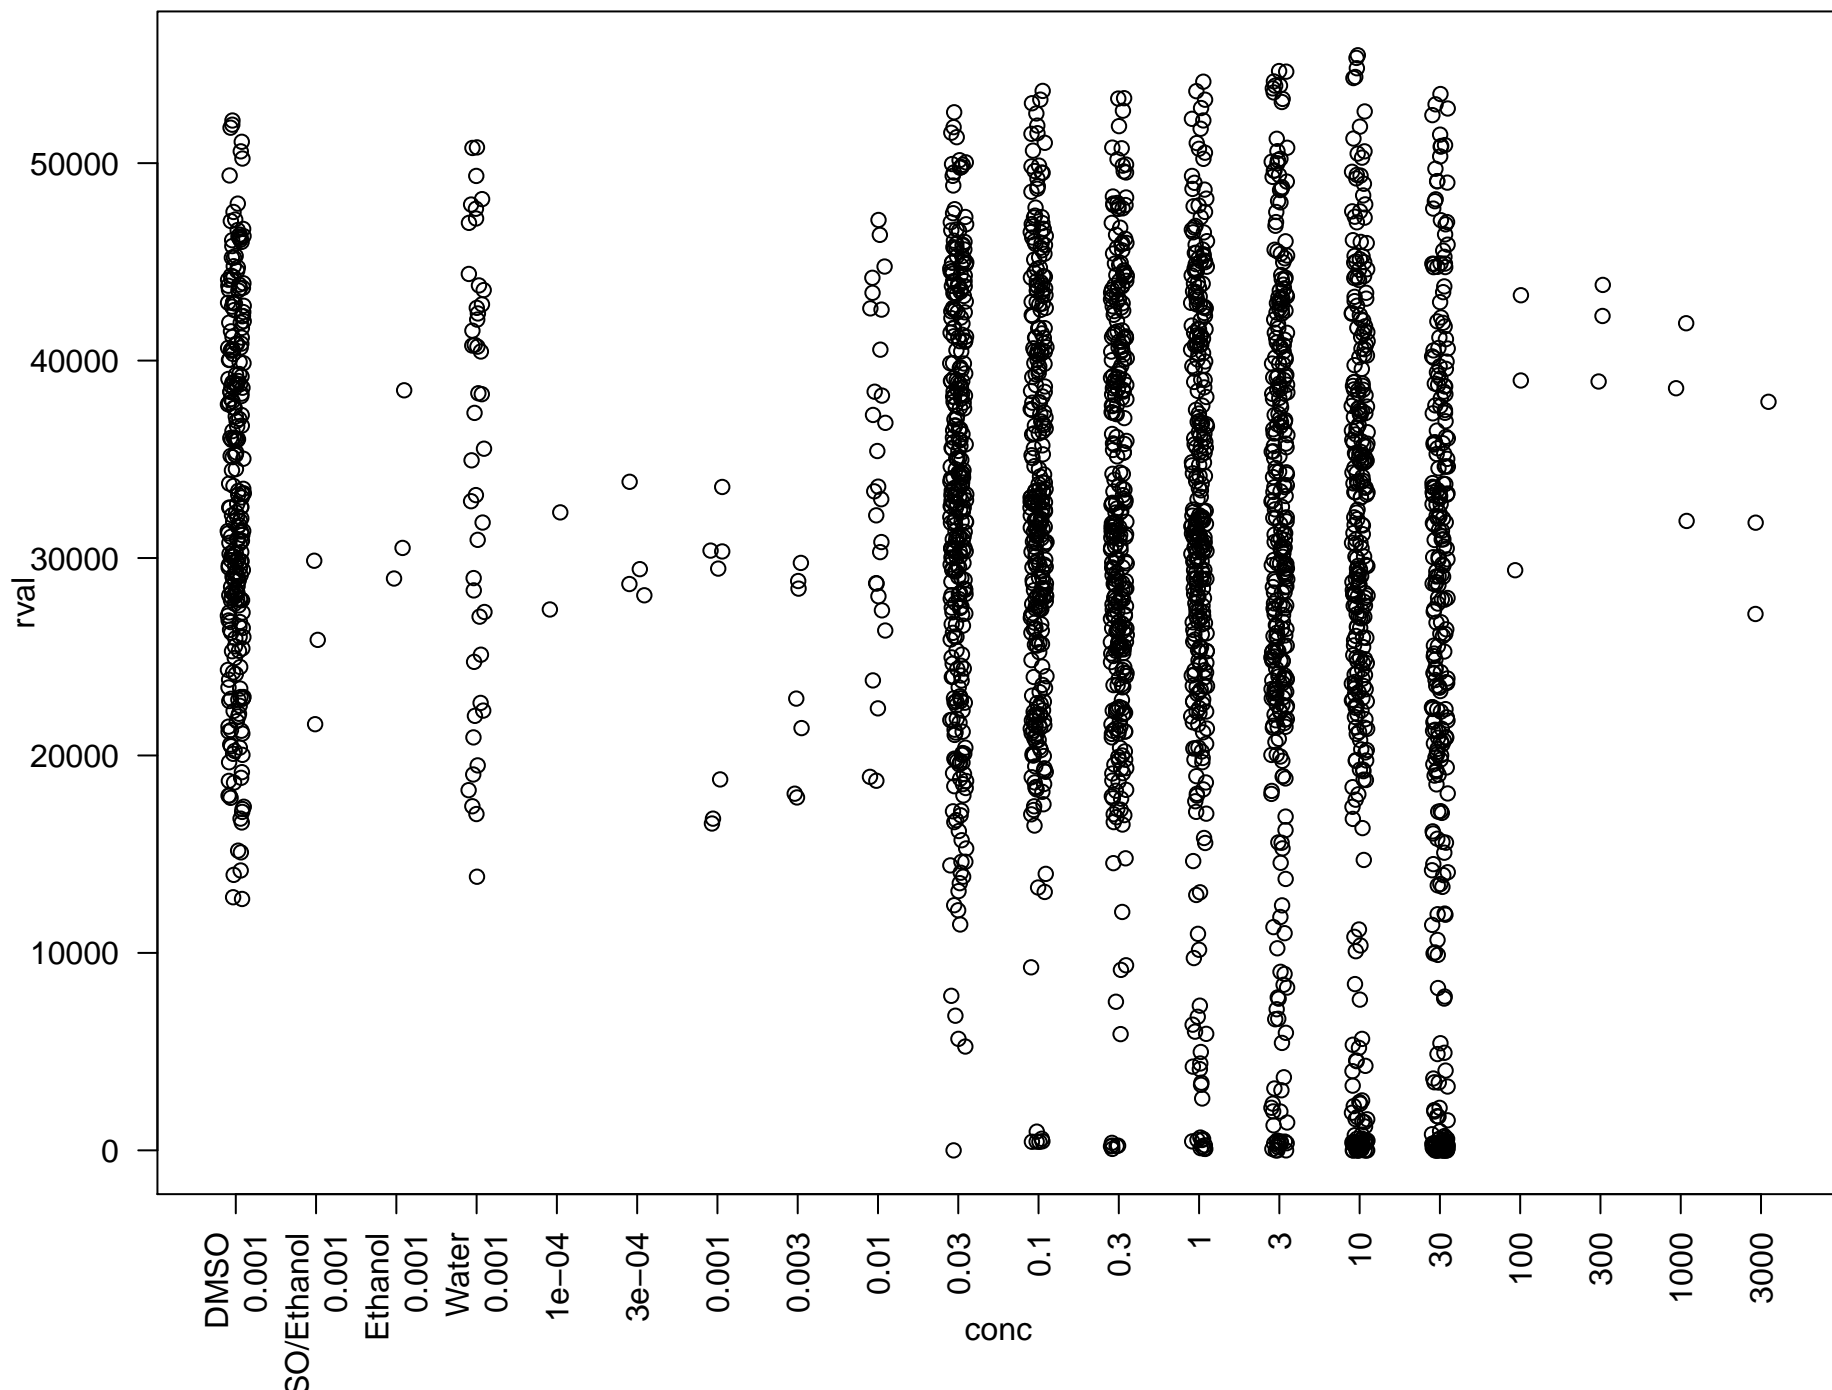

LDH Blank-Corrected Values for Frank2017
where wllq == 1

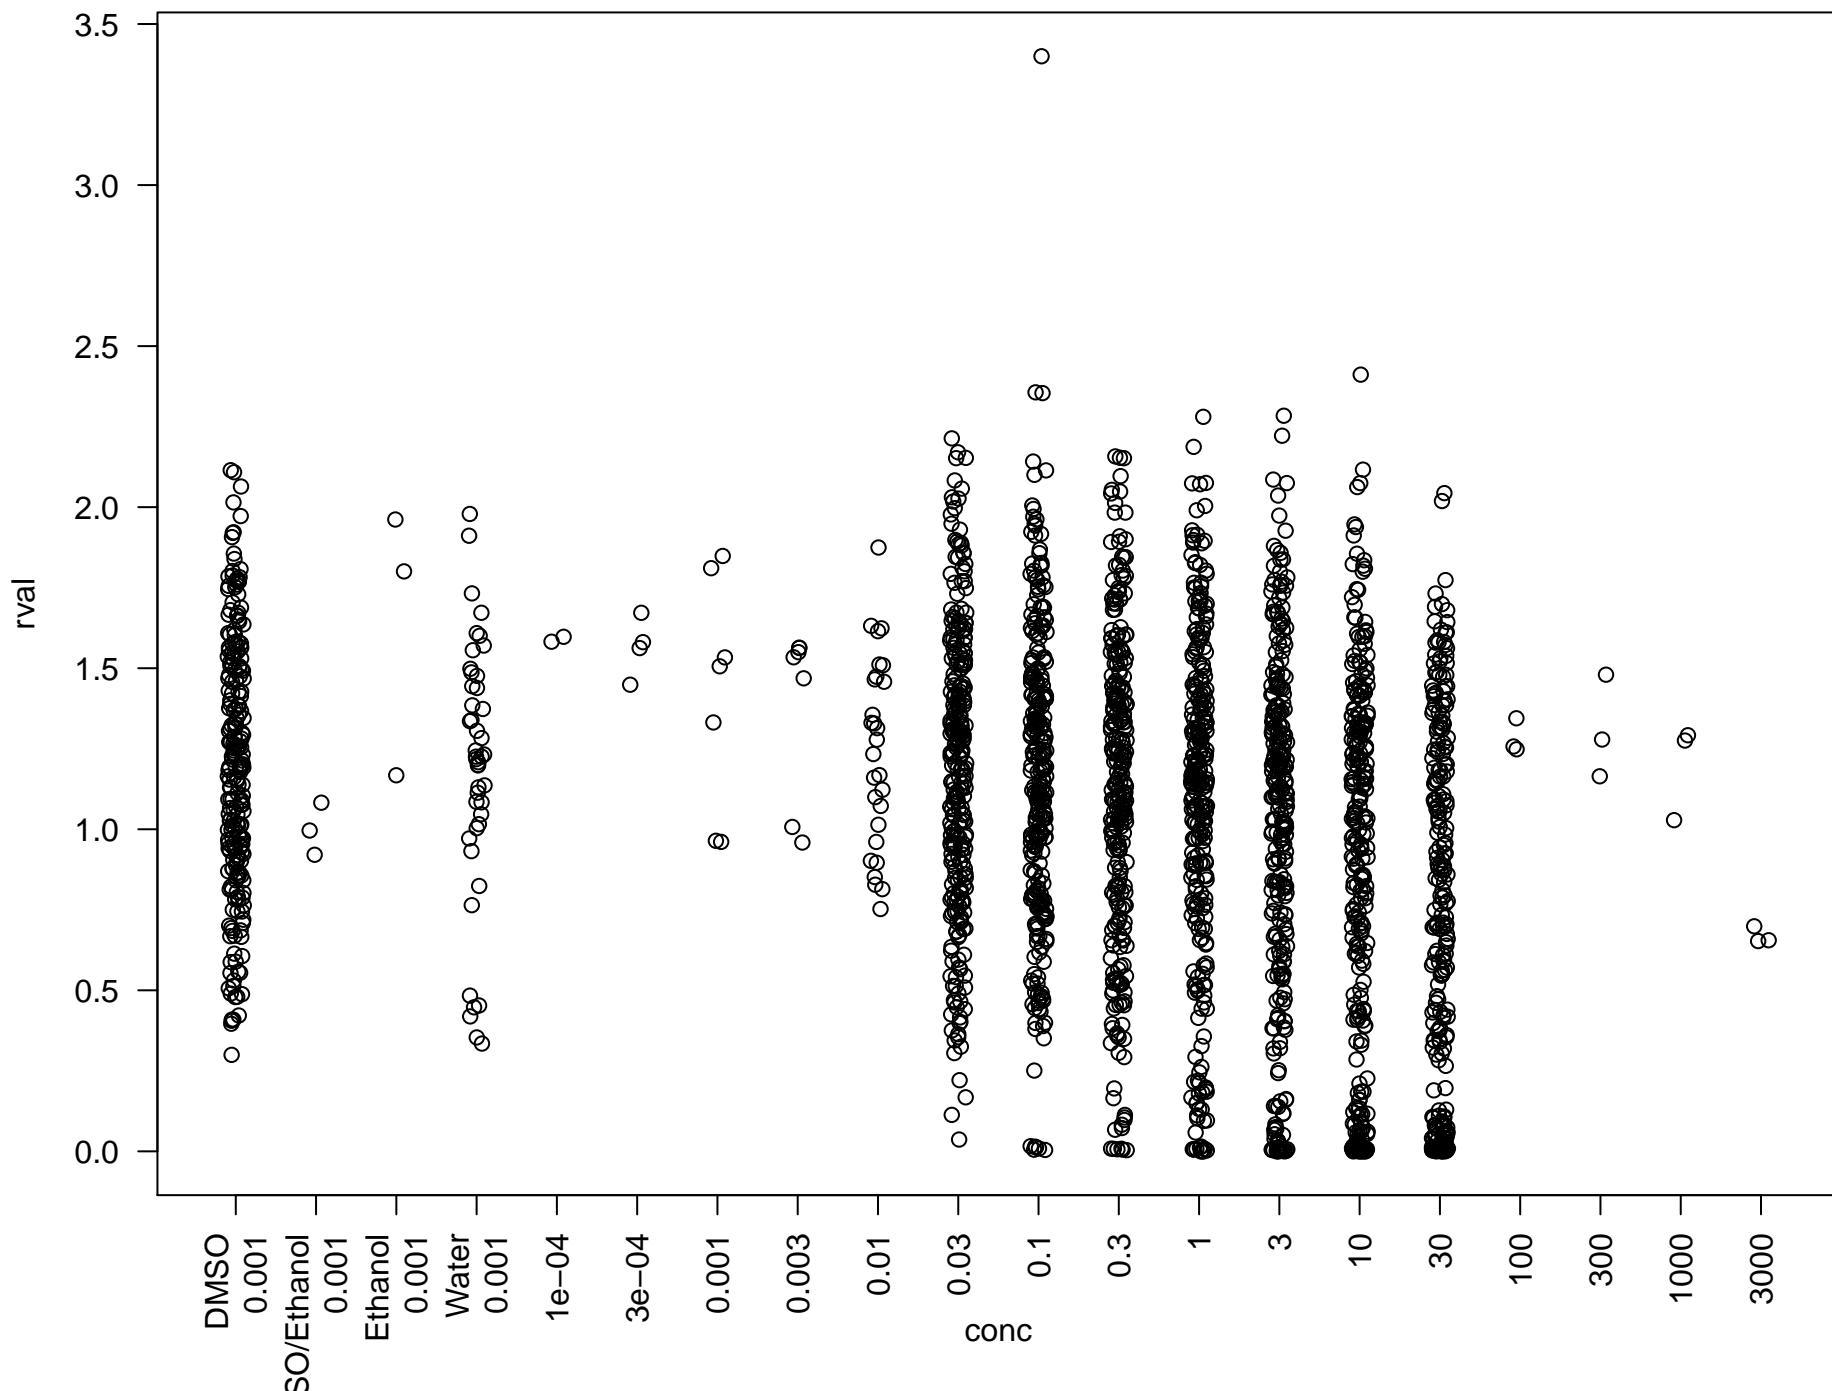

Mean Firing Rate in Controls at DIV 12 for all apid in Frank2017

