




DNT_NTP2021 NFA Mean Firing Rate DIV12 by Plate

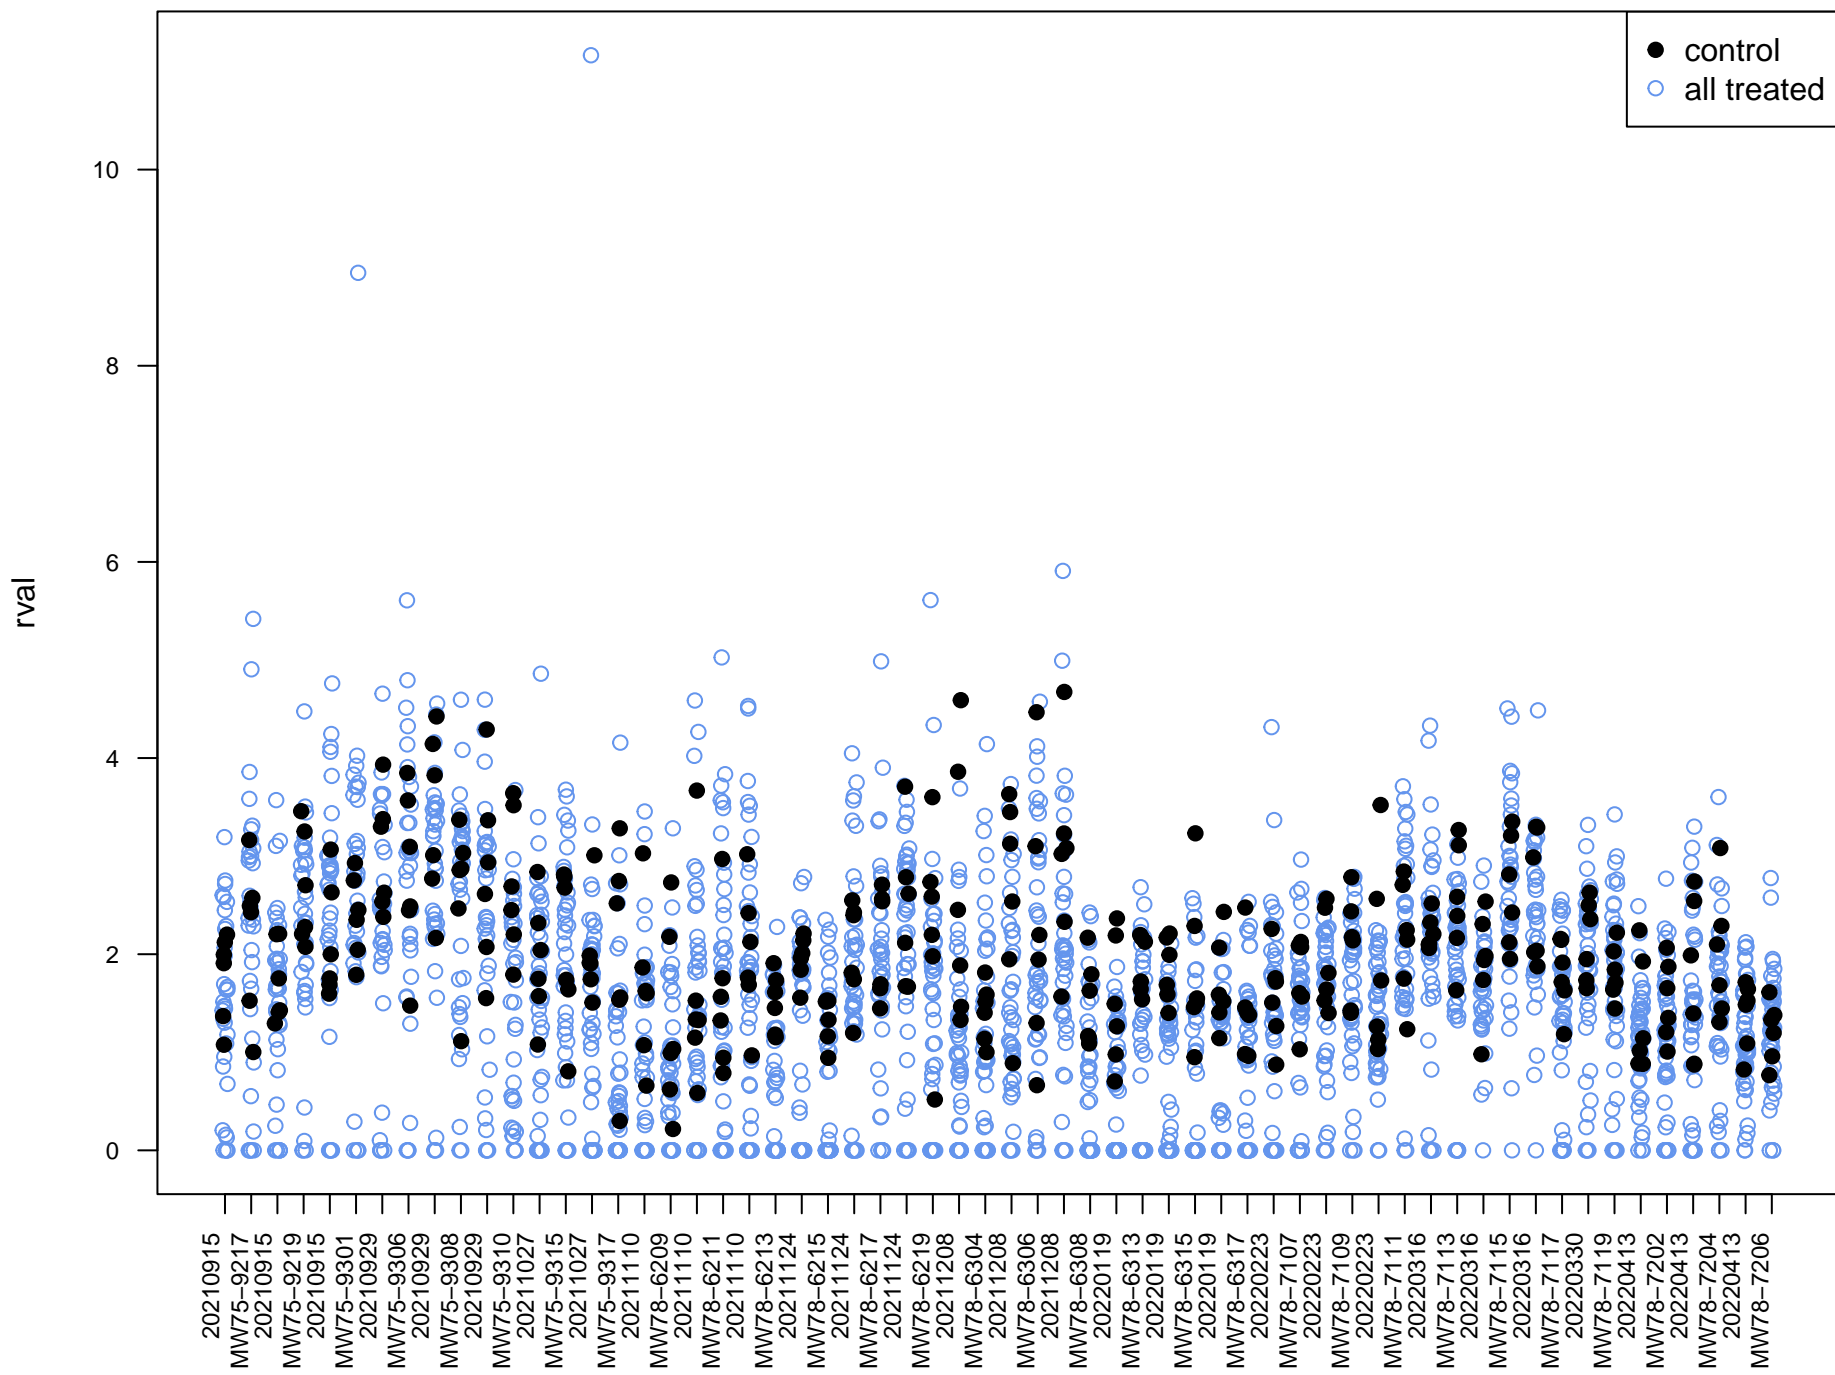


DNT_NTP2021 NFA # Active Electrodes DIV12 by Plate

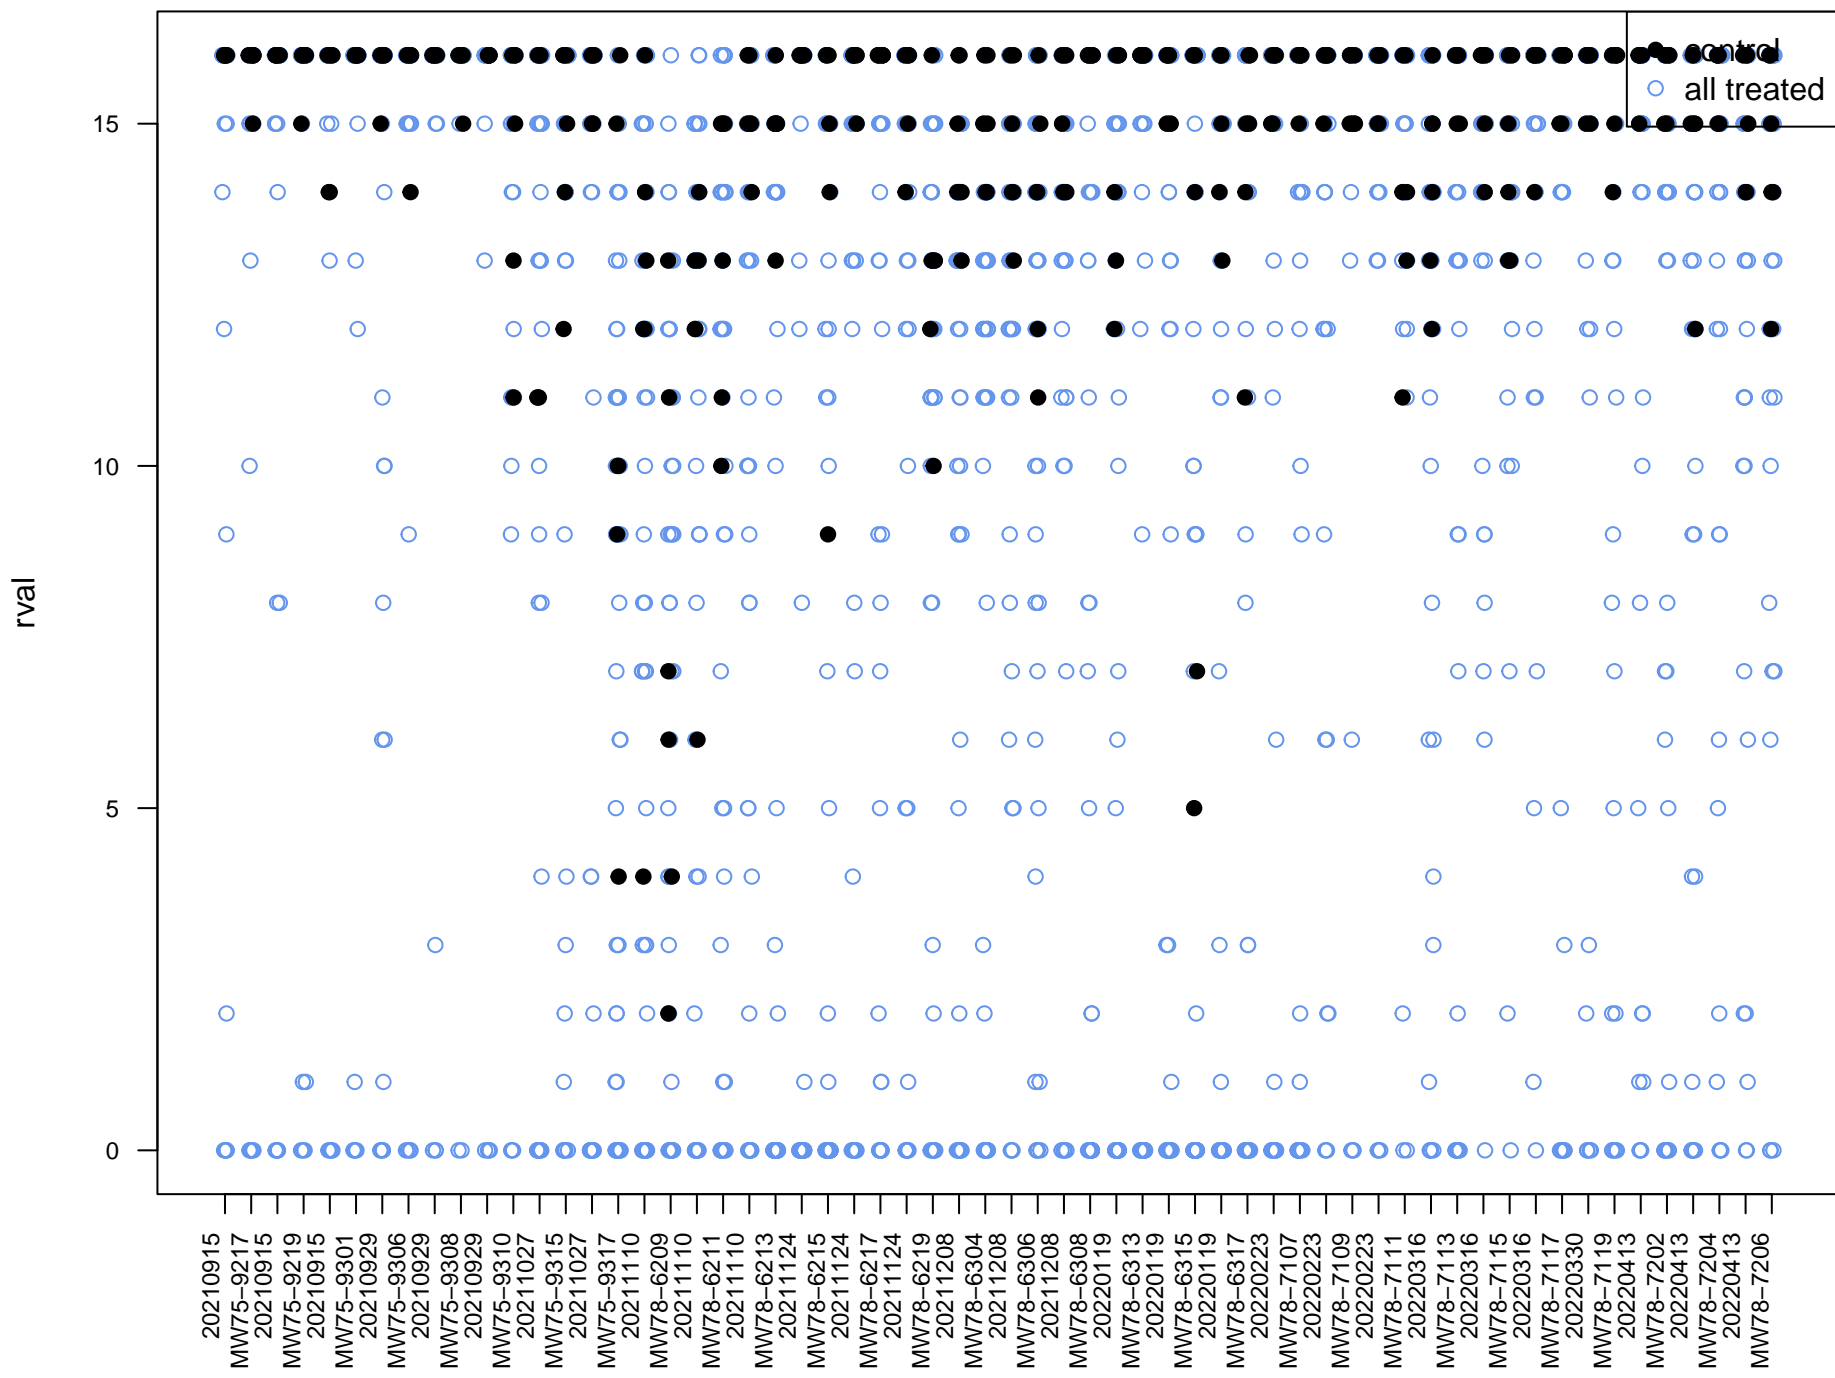


DNT_NTP2021 NFA # Active Electrodes AUC by Plate

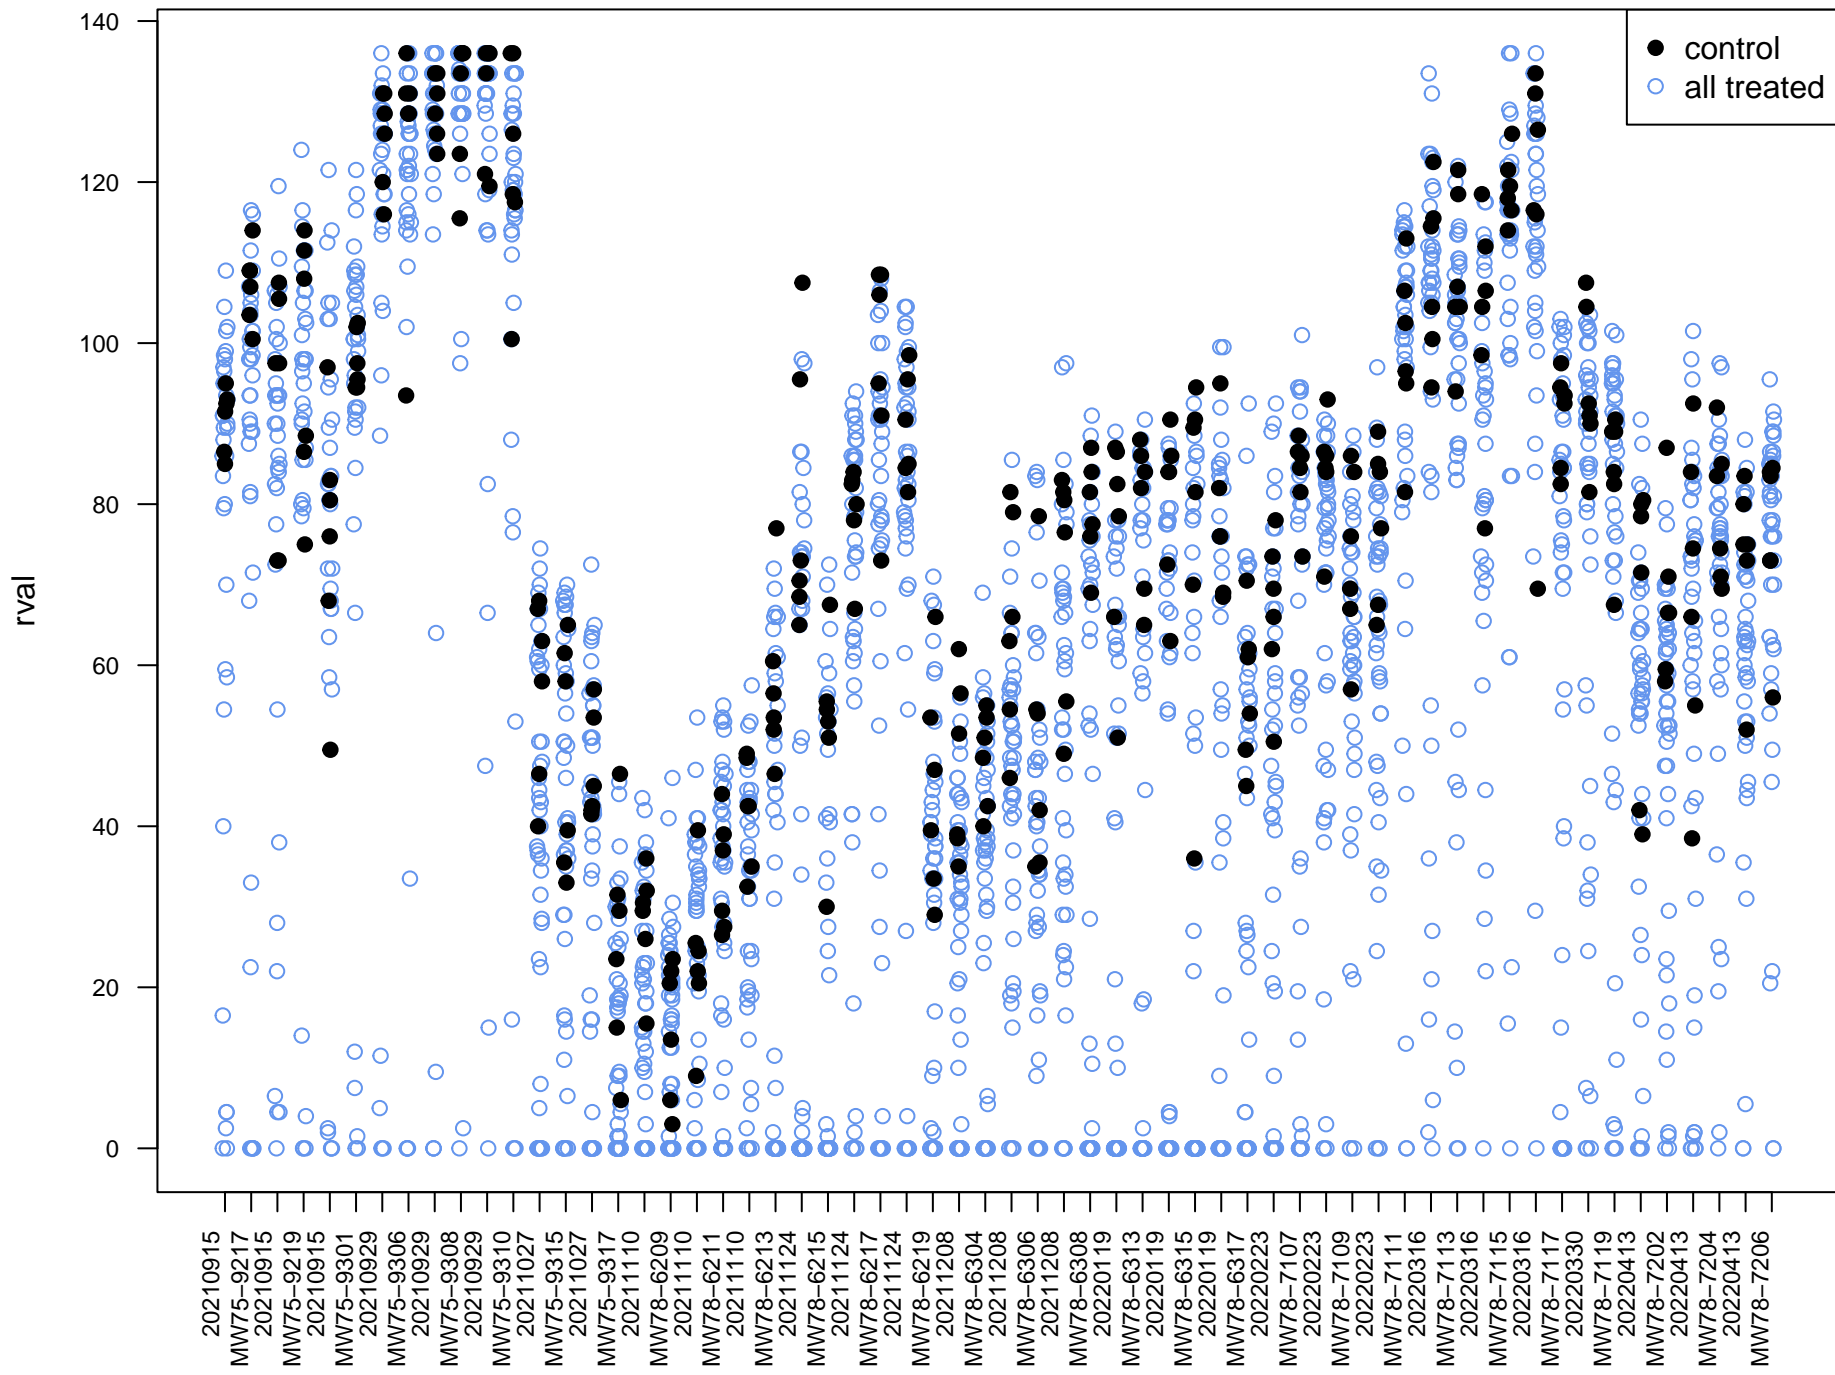


Mean Firing Rate AUC by dose for all compounds in DNT_NTP2021

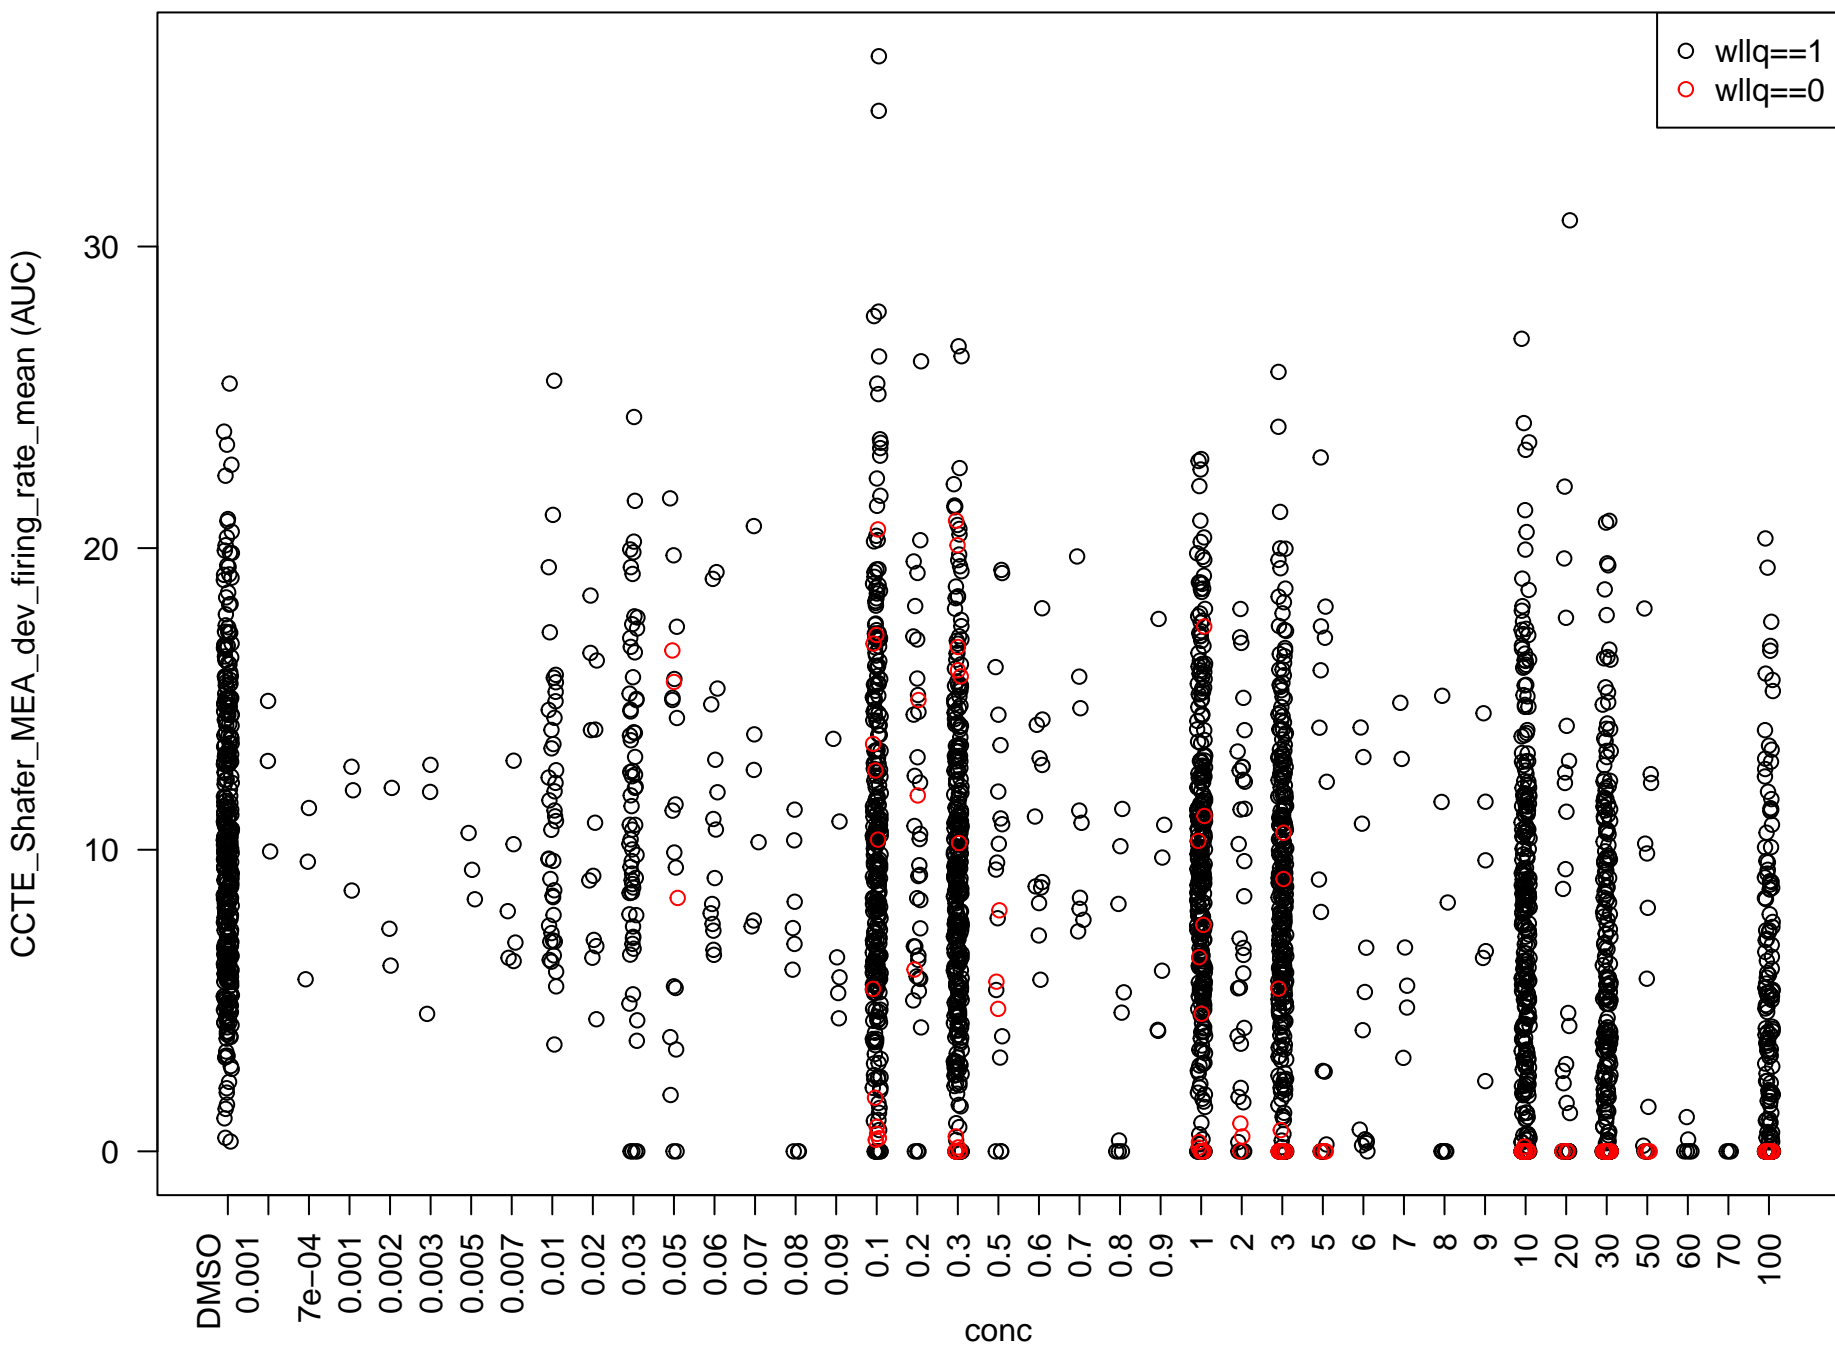

Example Down Response:
7126 A2 Mean Firing Rate AUC Dose Response

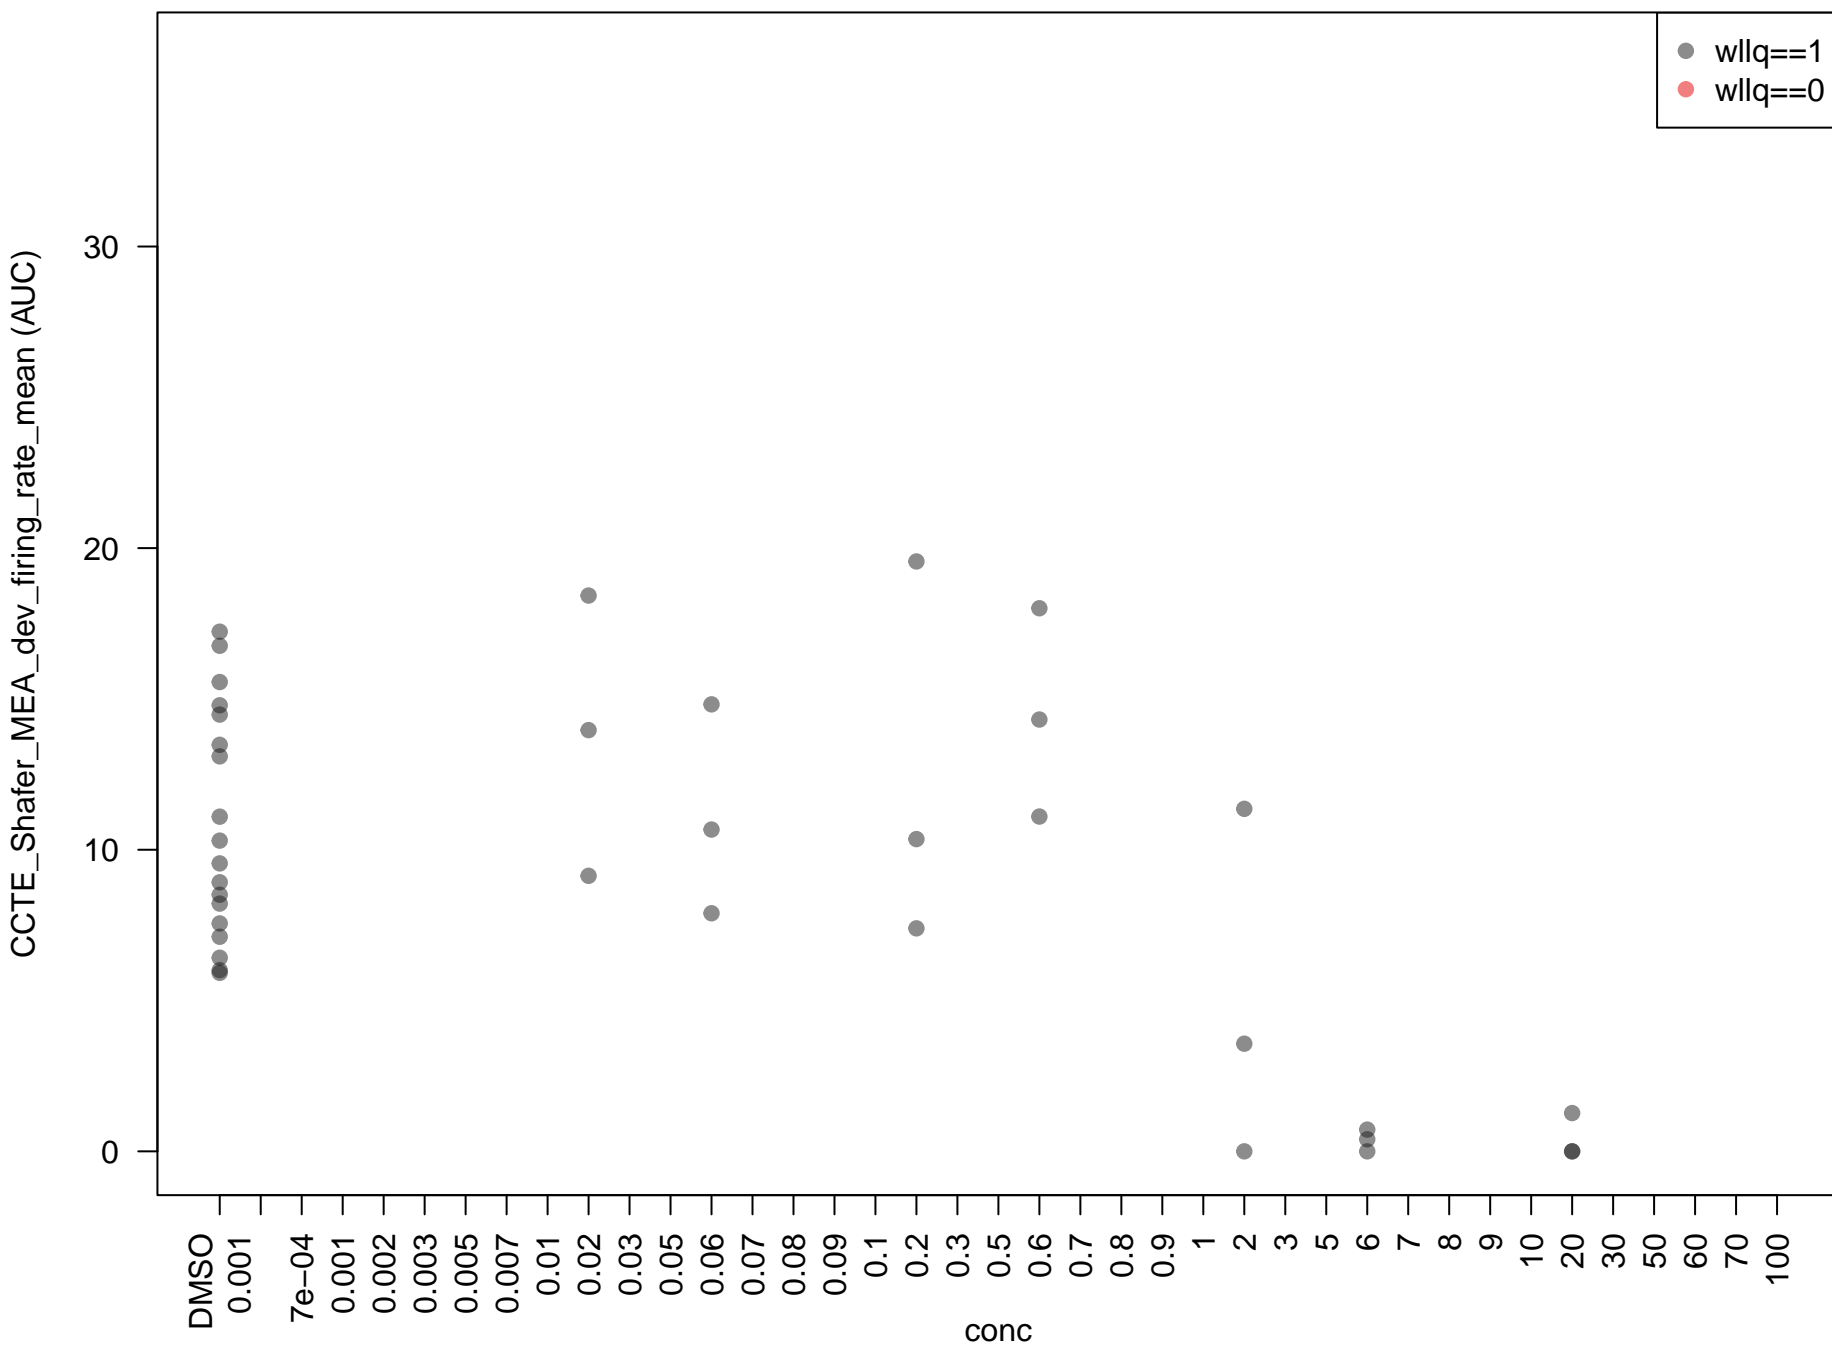

AB Blank-Corrected Values for DNT_NTP2021
where wllq == 1

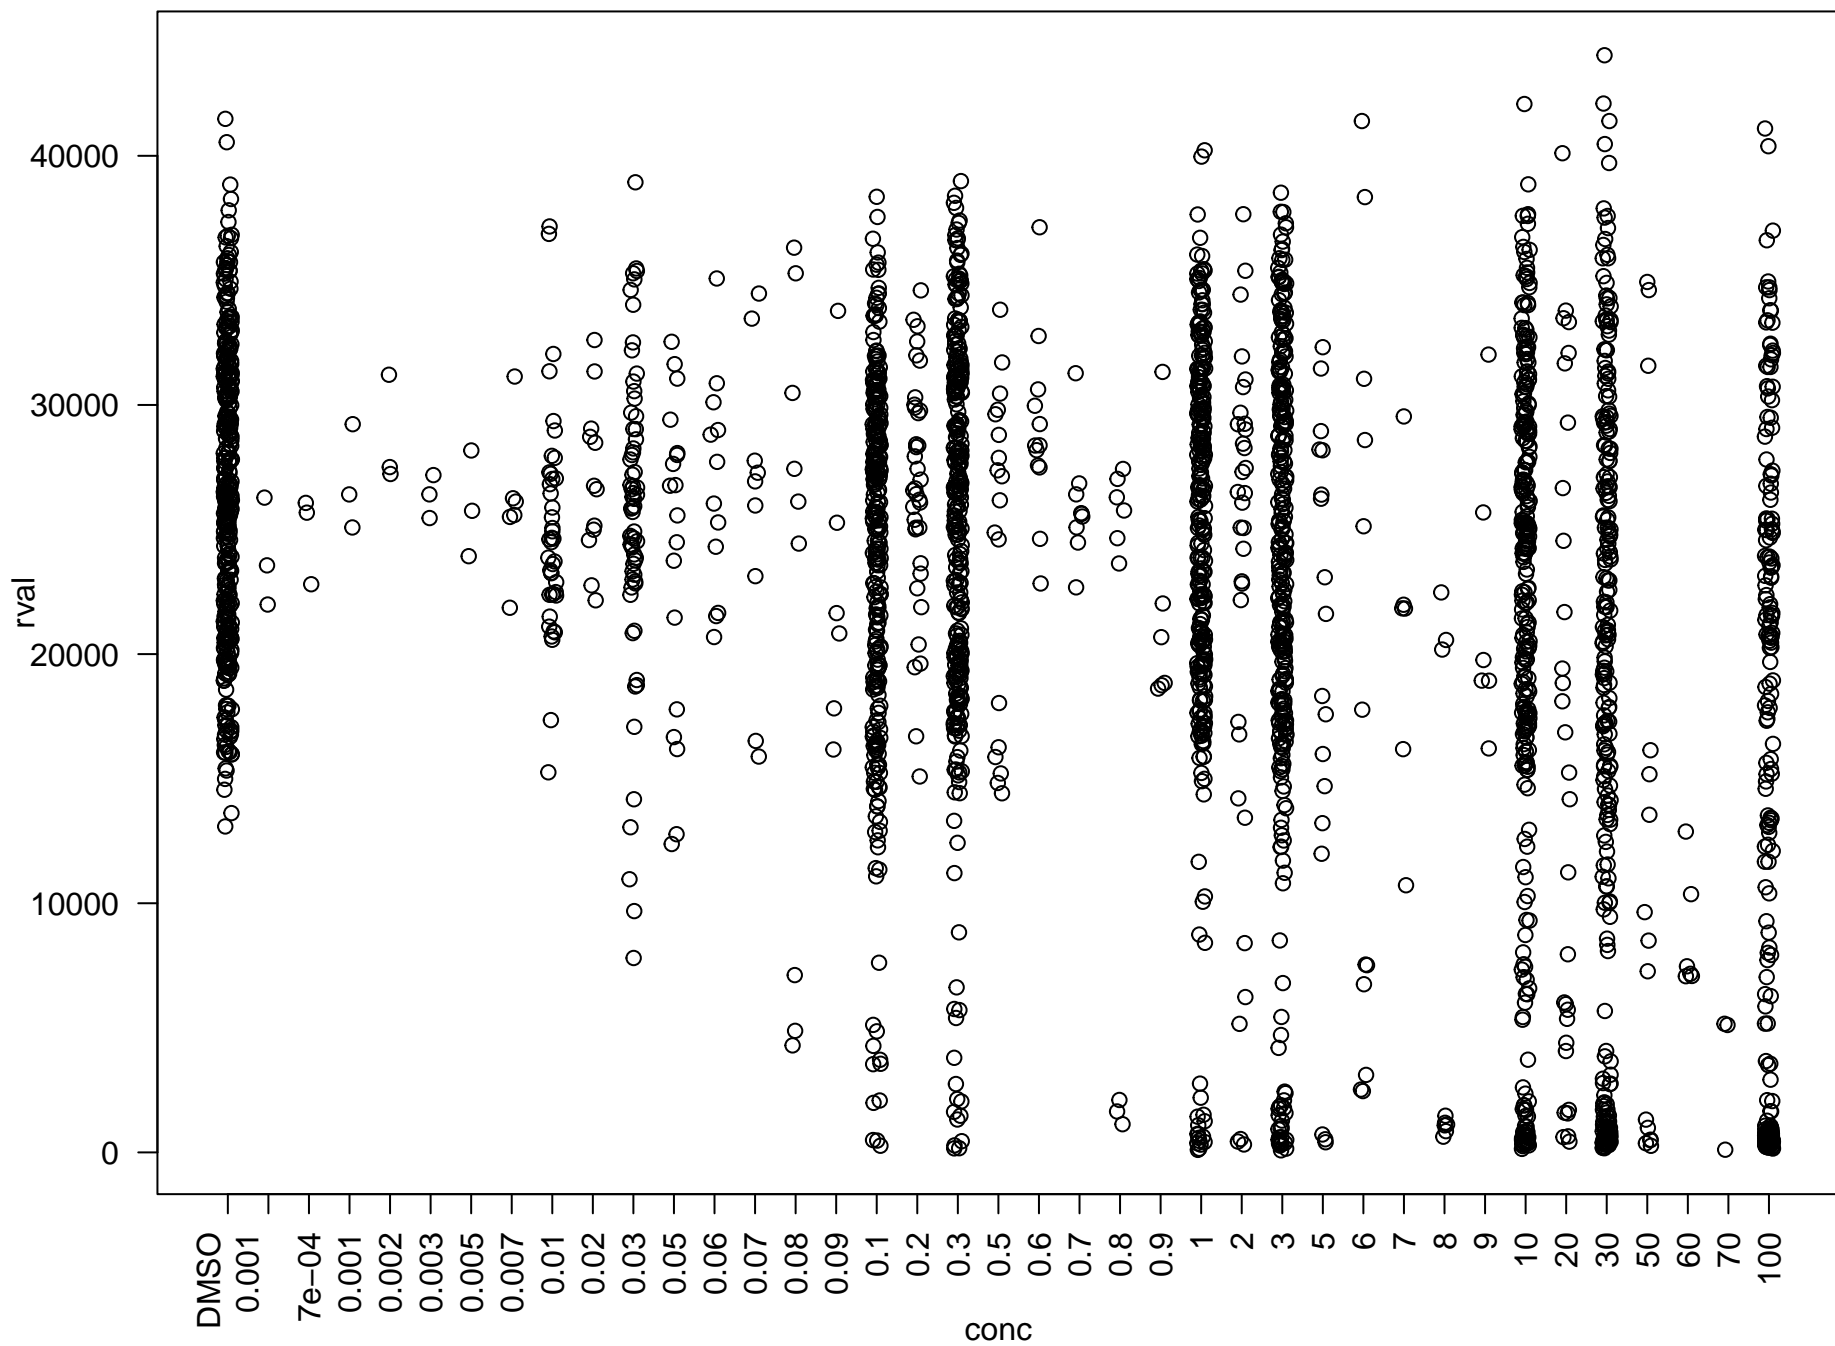

LDH Blank-Corrected Values for DNT_NTP2021
where wllq == 1

