




SPS_PFAS2019 NFA Mean Firing Rate AUC by Plate

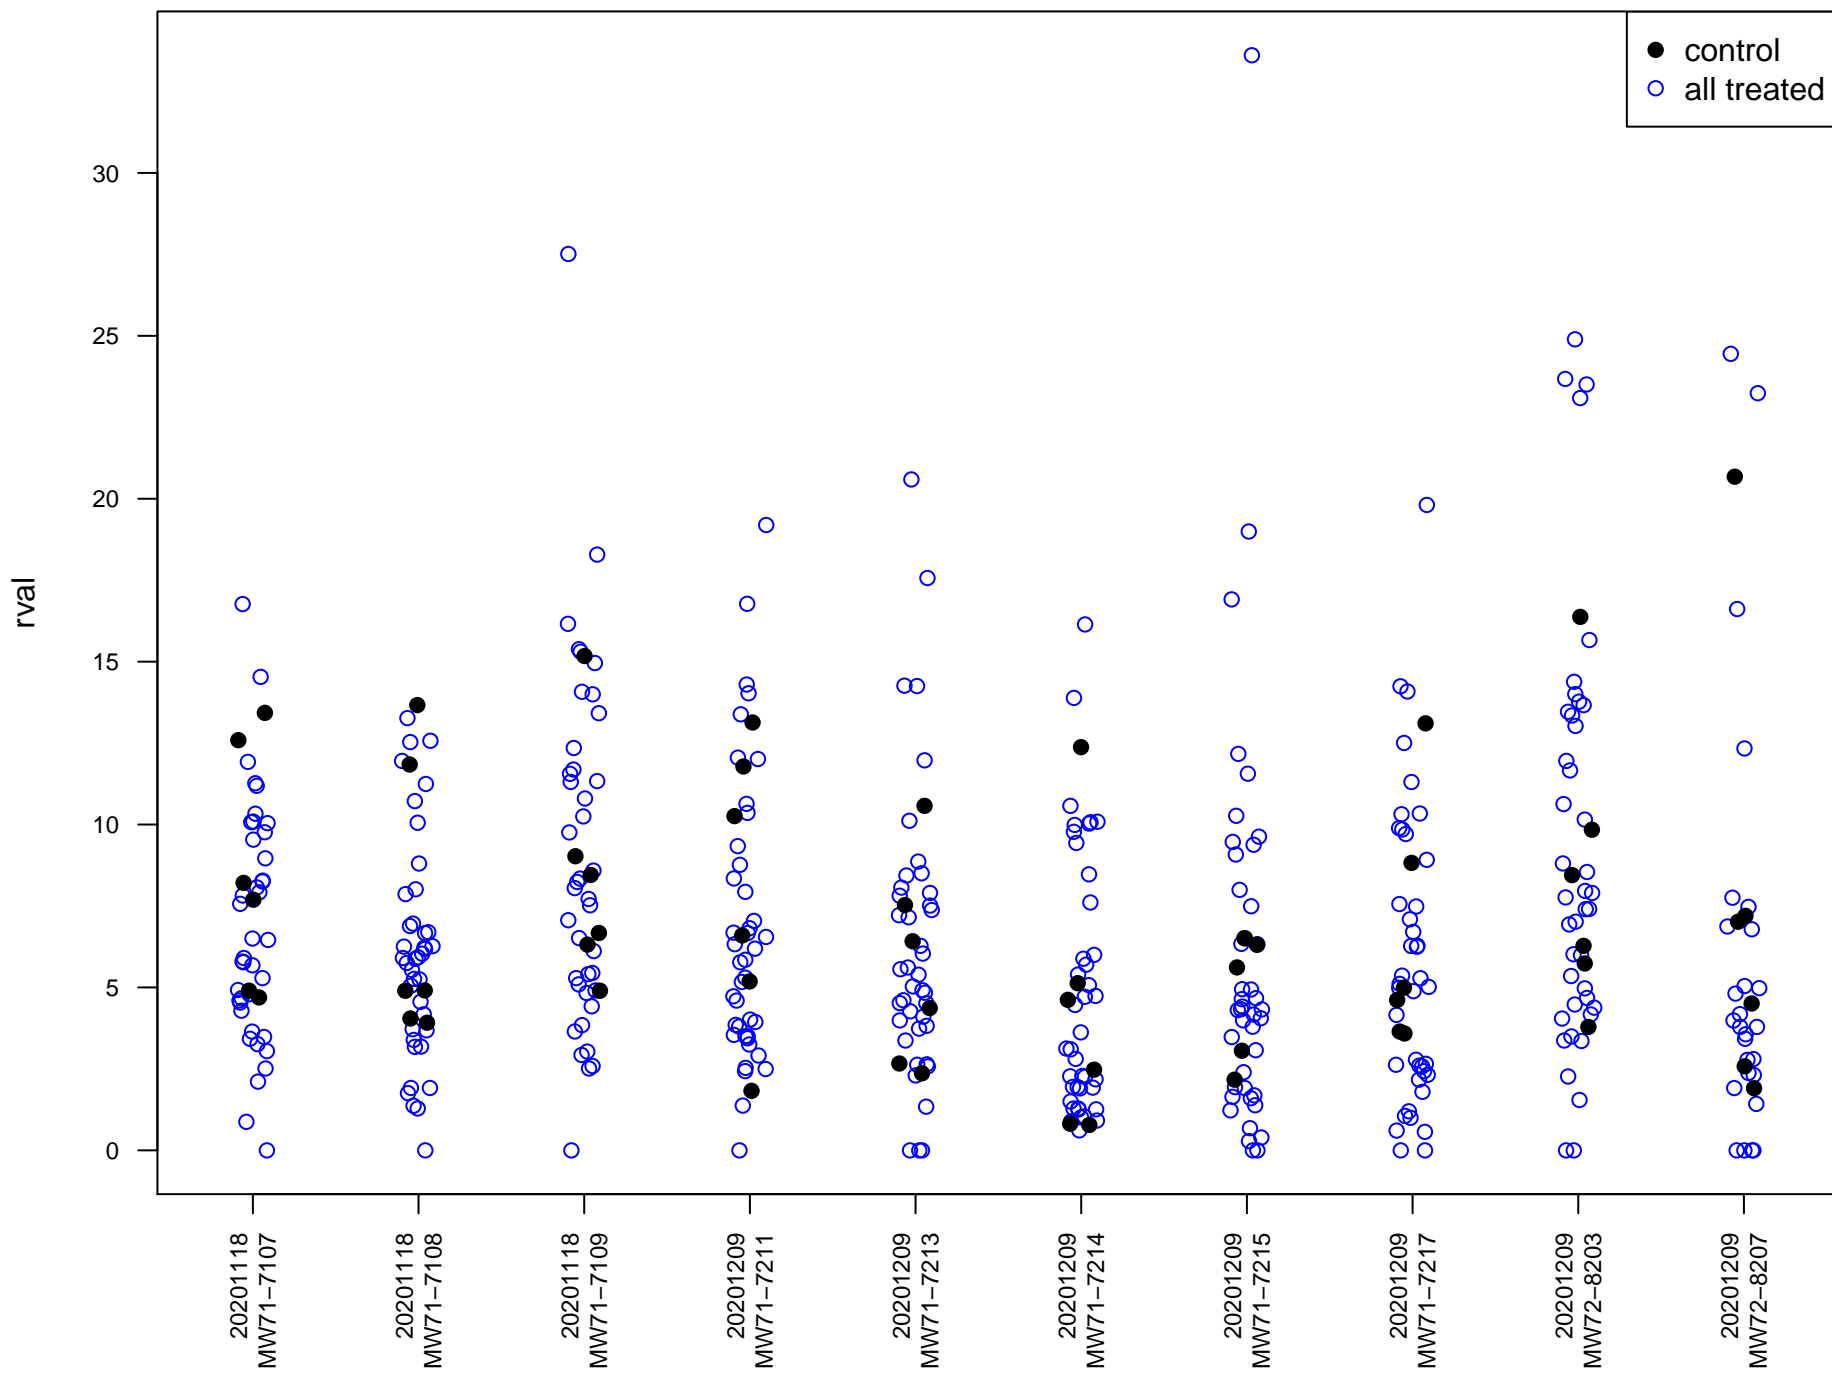


SPS_PFAS2019 NFA # Active Electrodes AUC by Plate

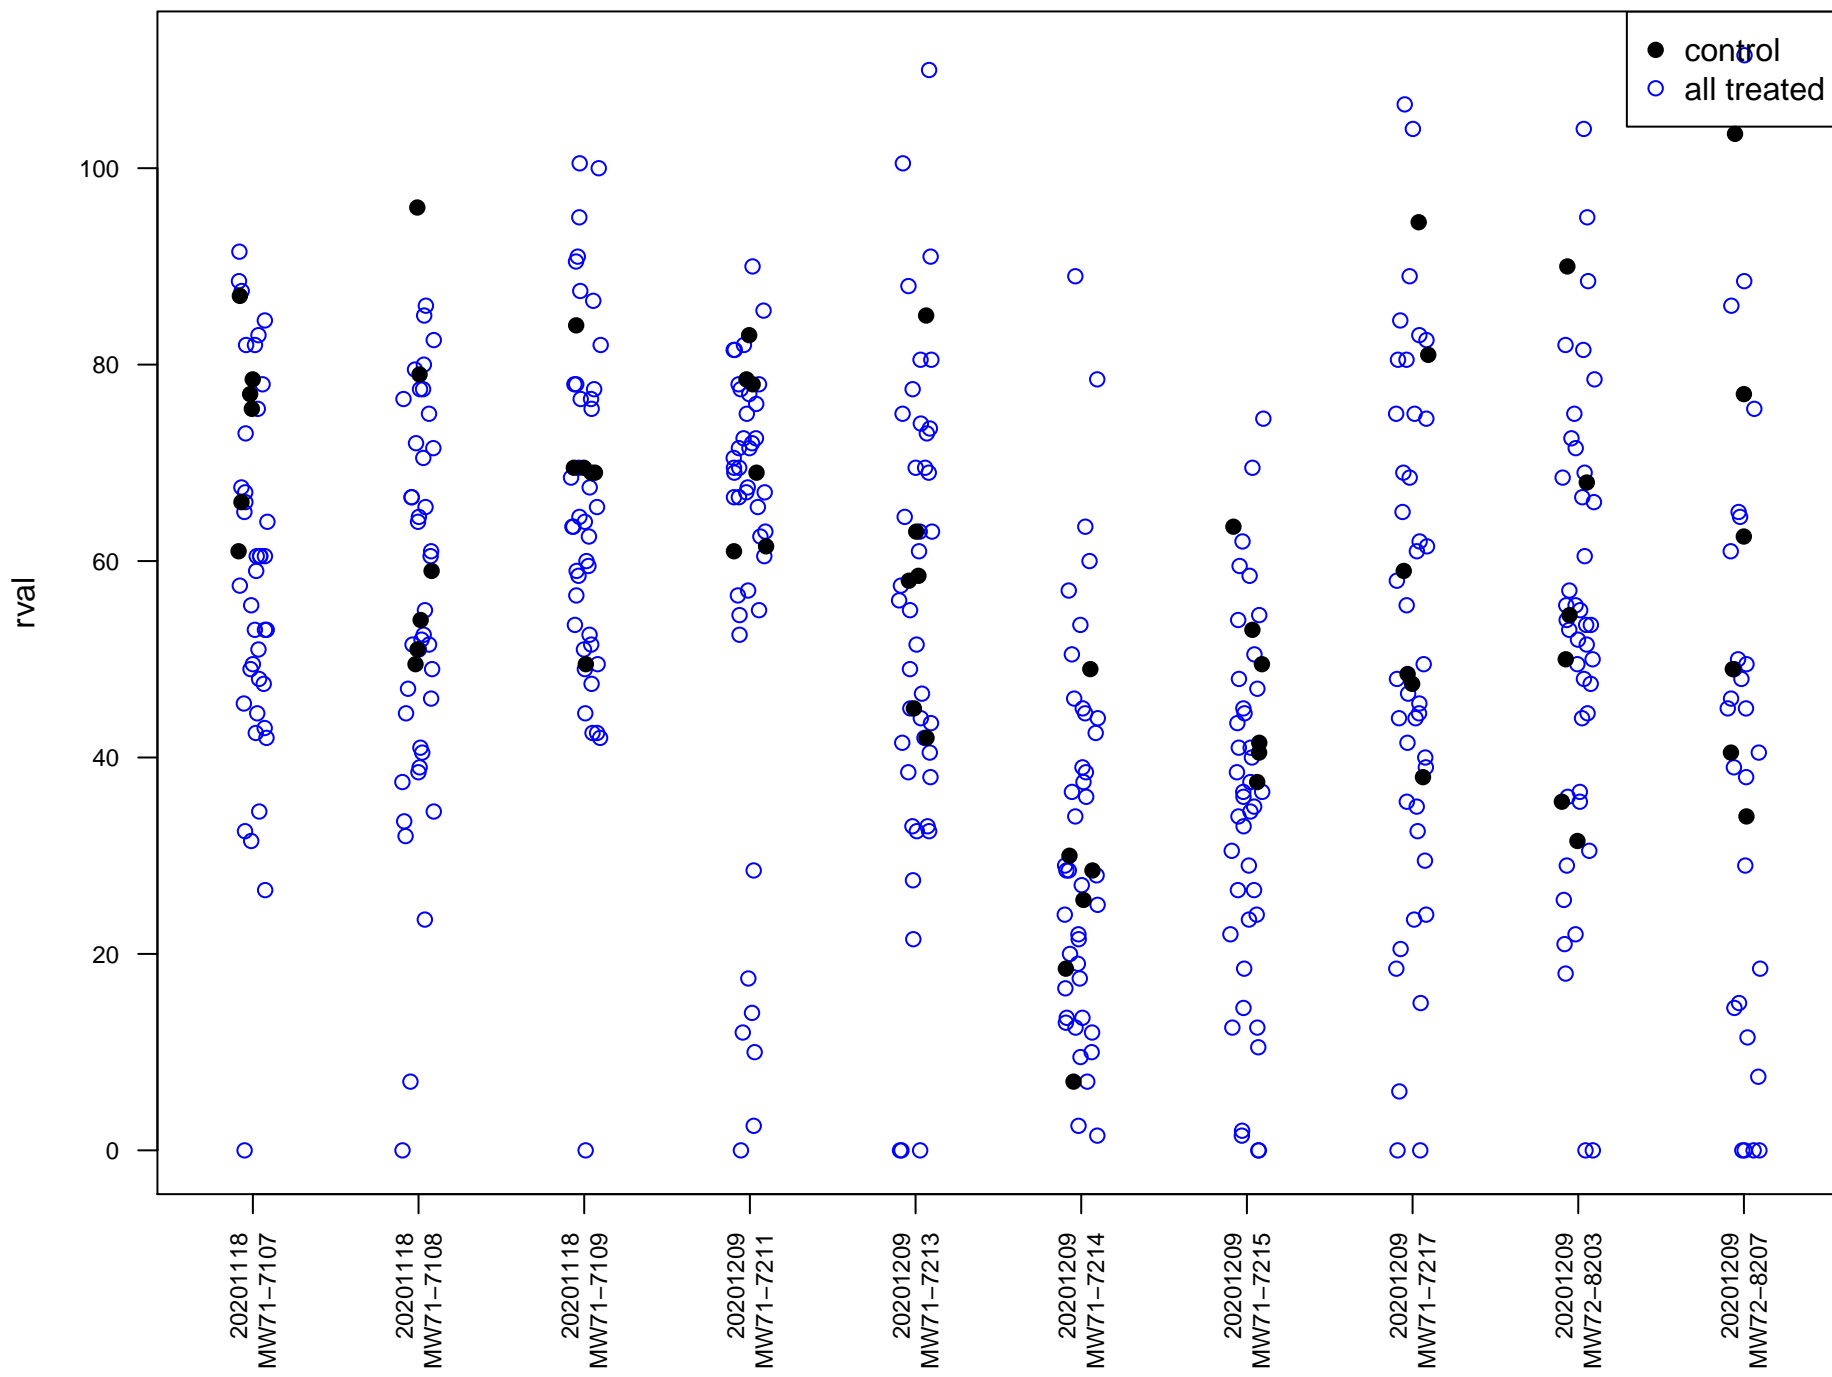


Mean Firing Rate AUC by dose for all compounds in SPS_PFAS2019

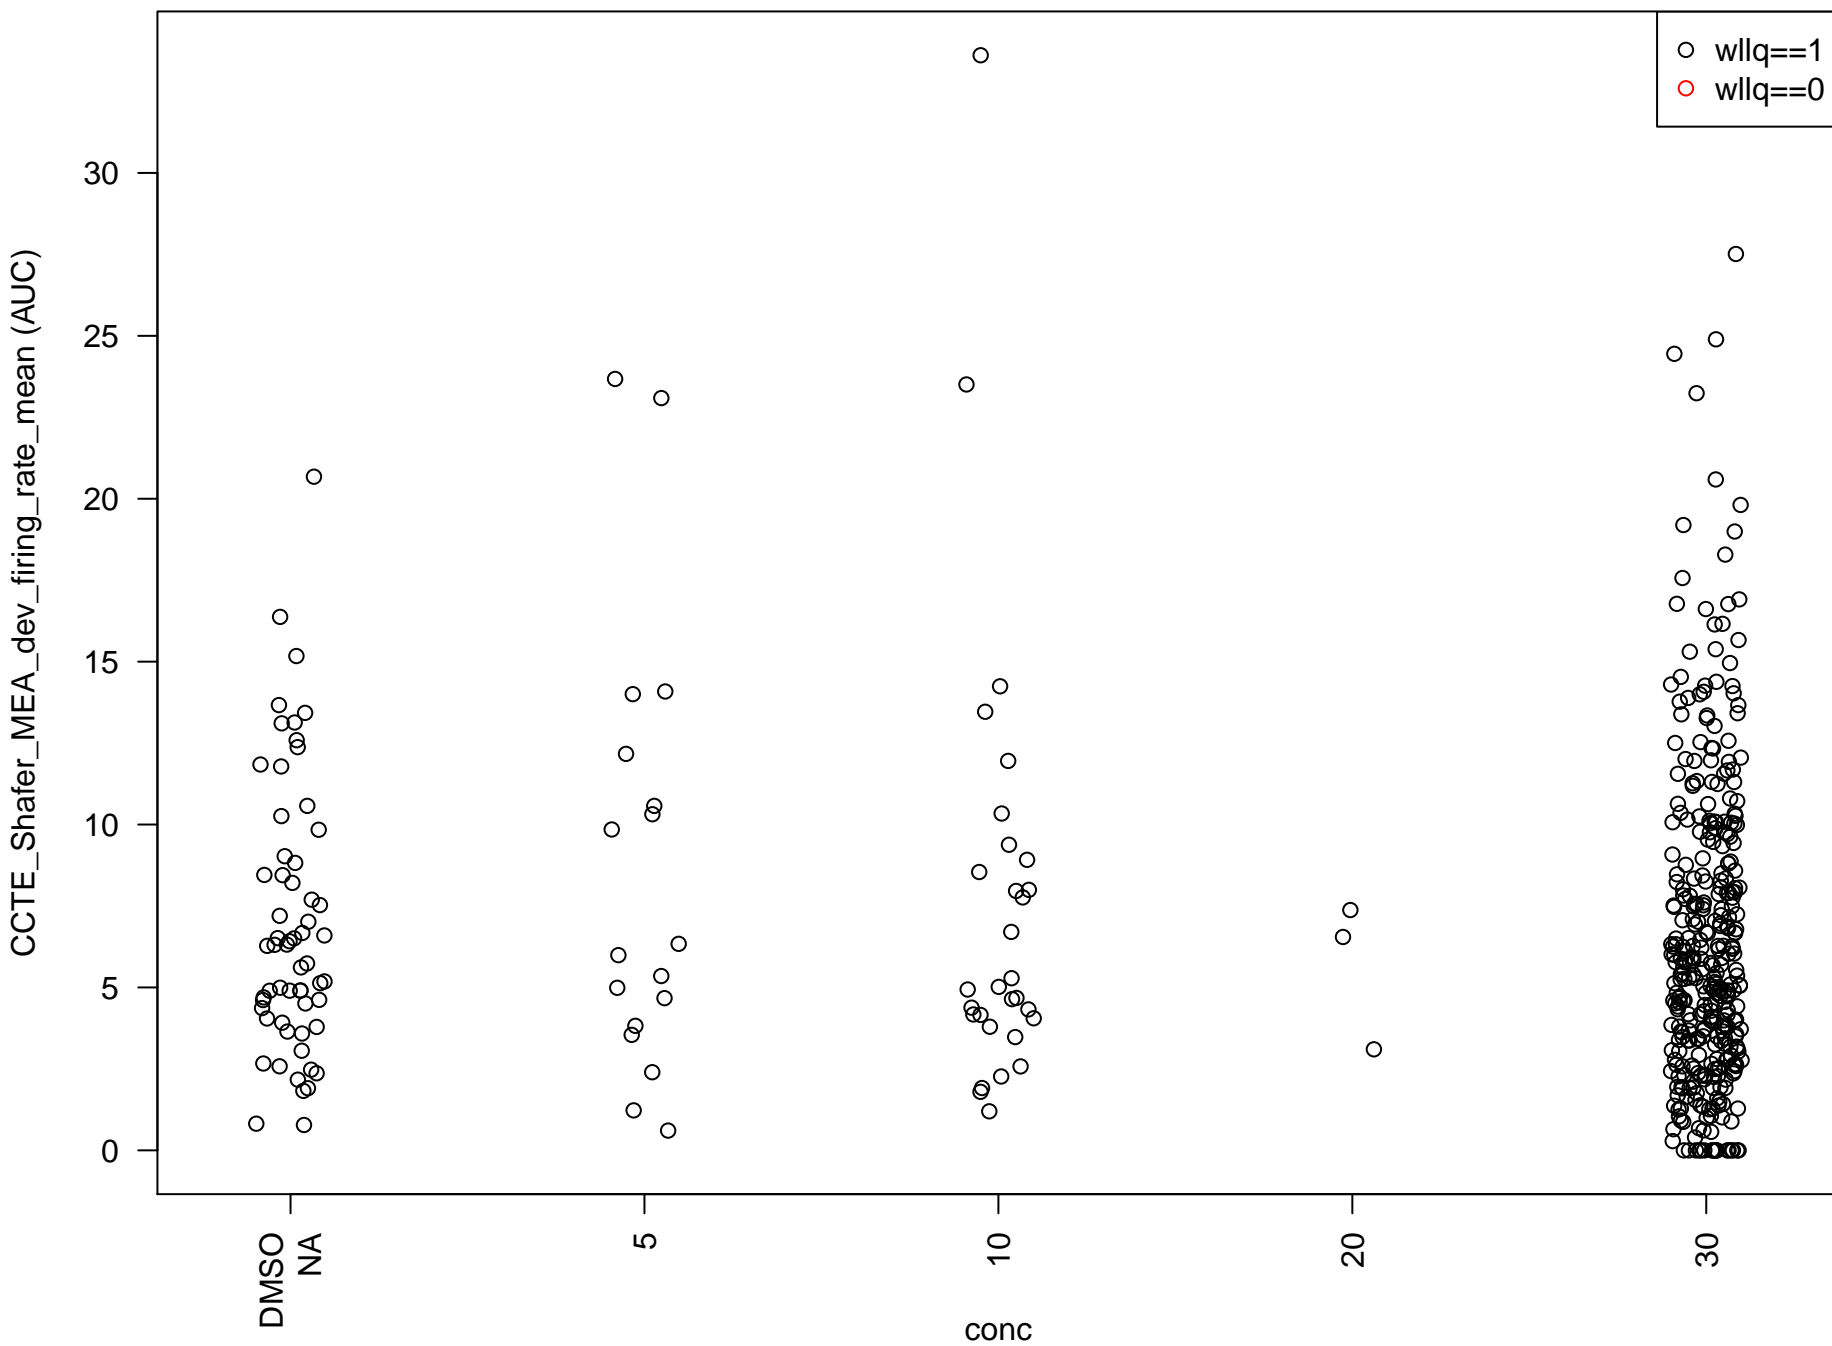

Mean Firing Rate AUC Dose Response

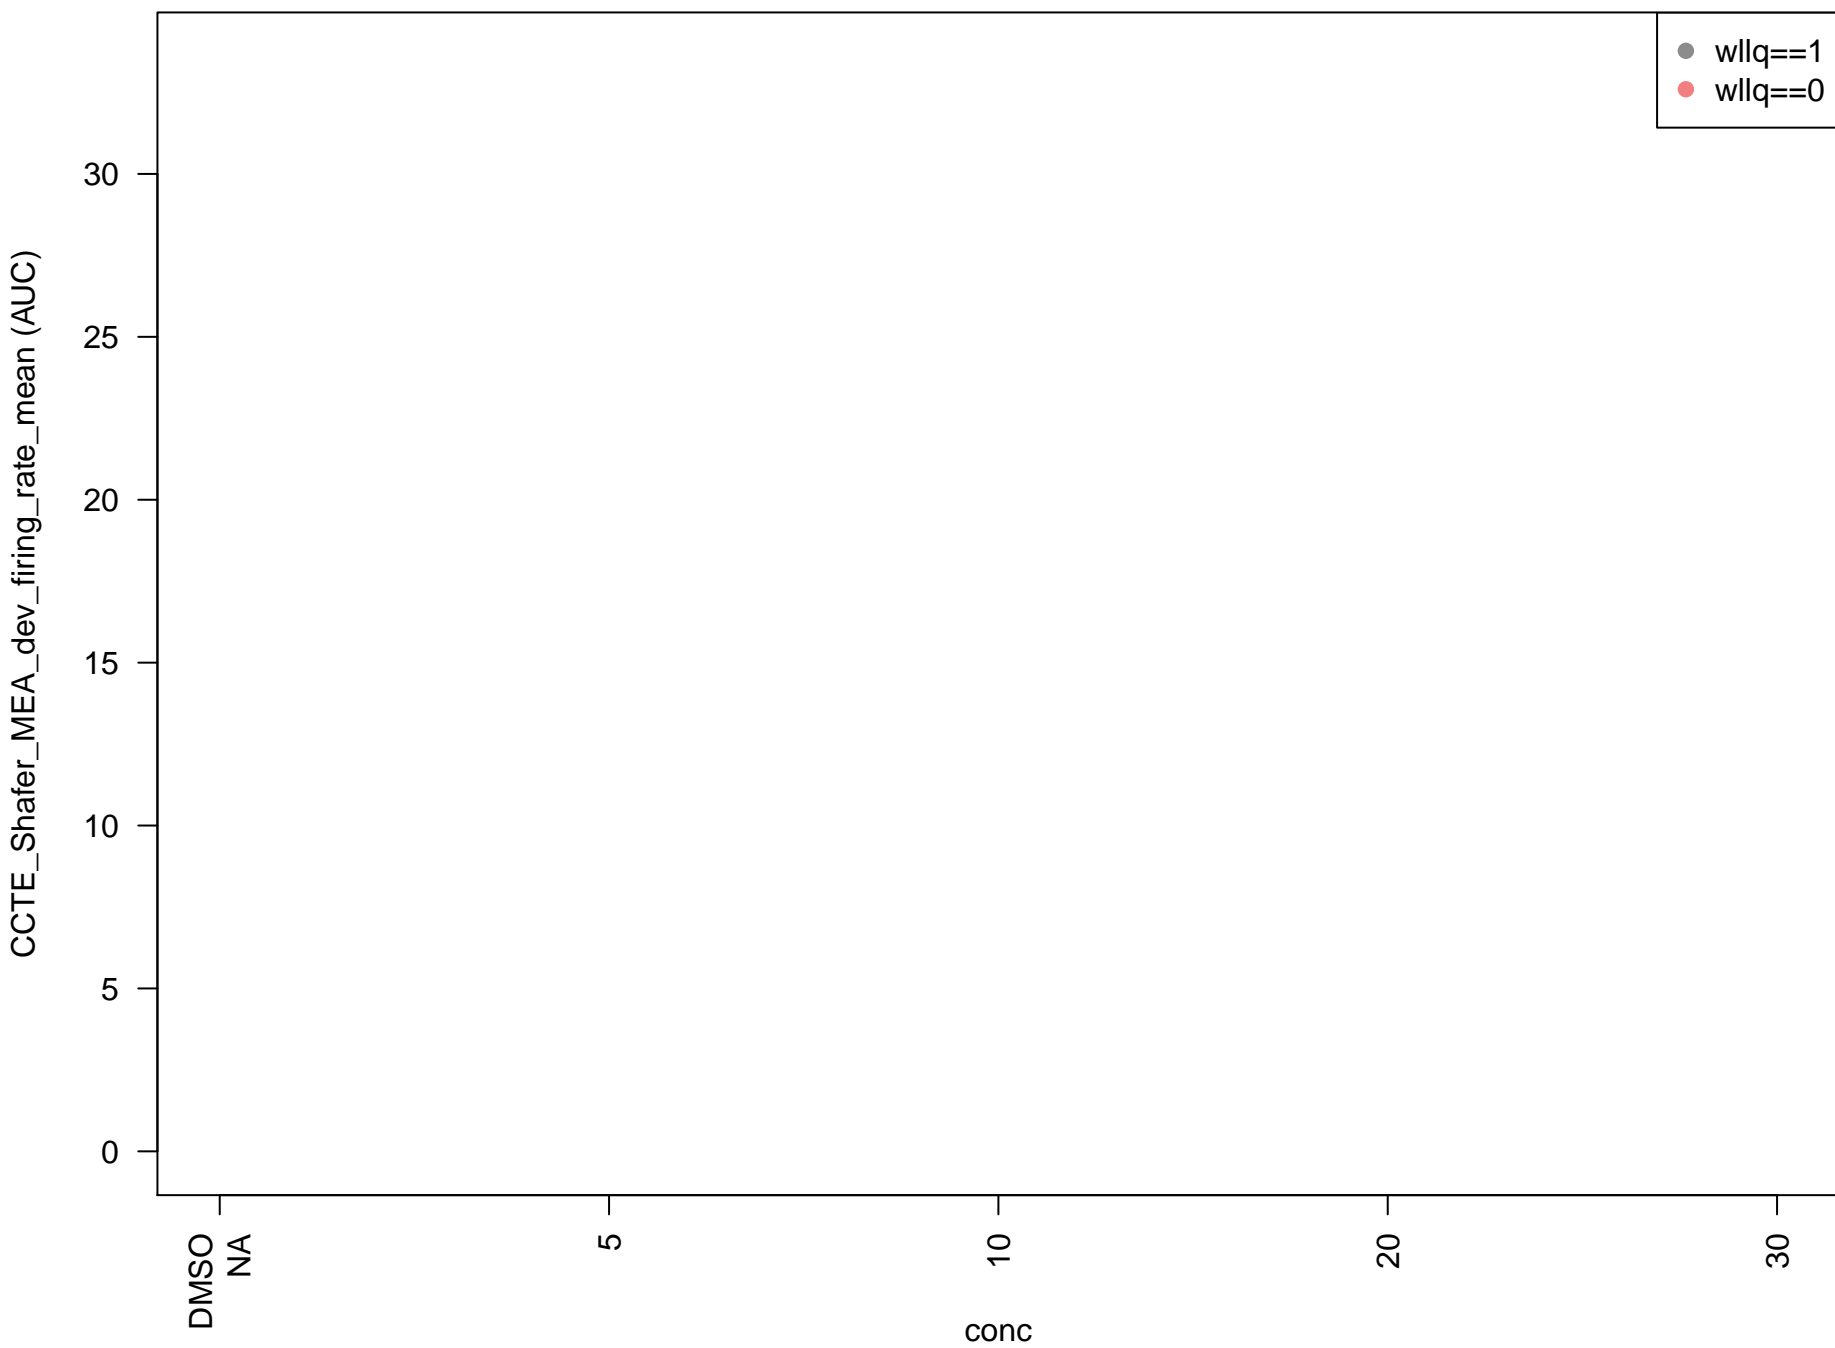

AB Blank-Corrected Values for SPS_PFAS2019
where wllq == 1

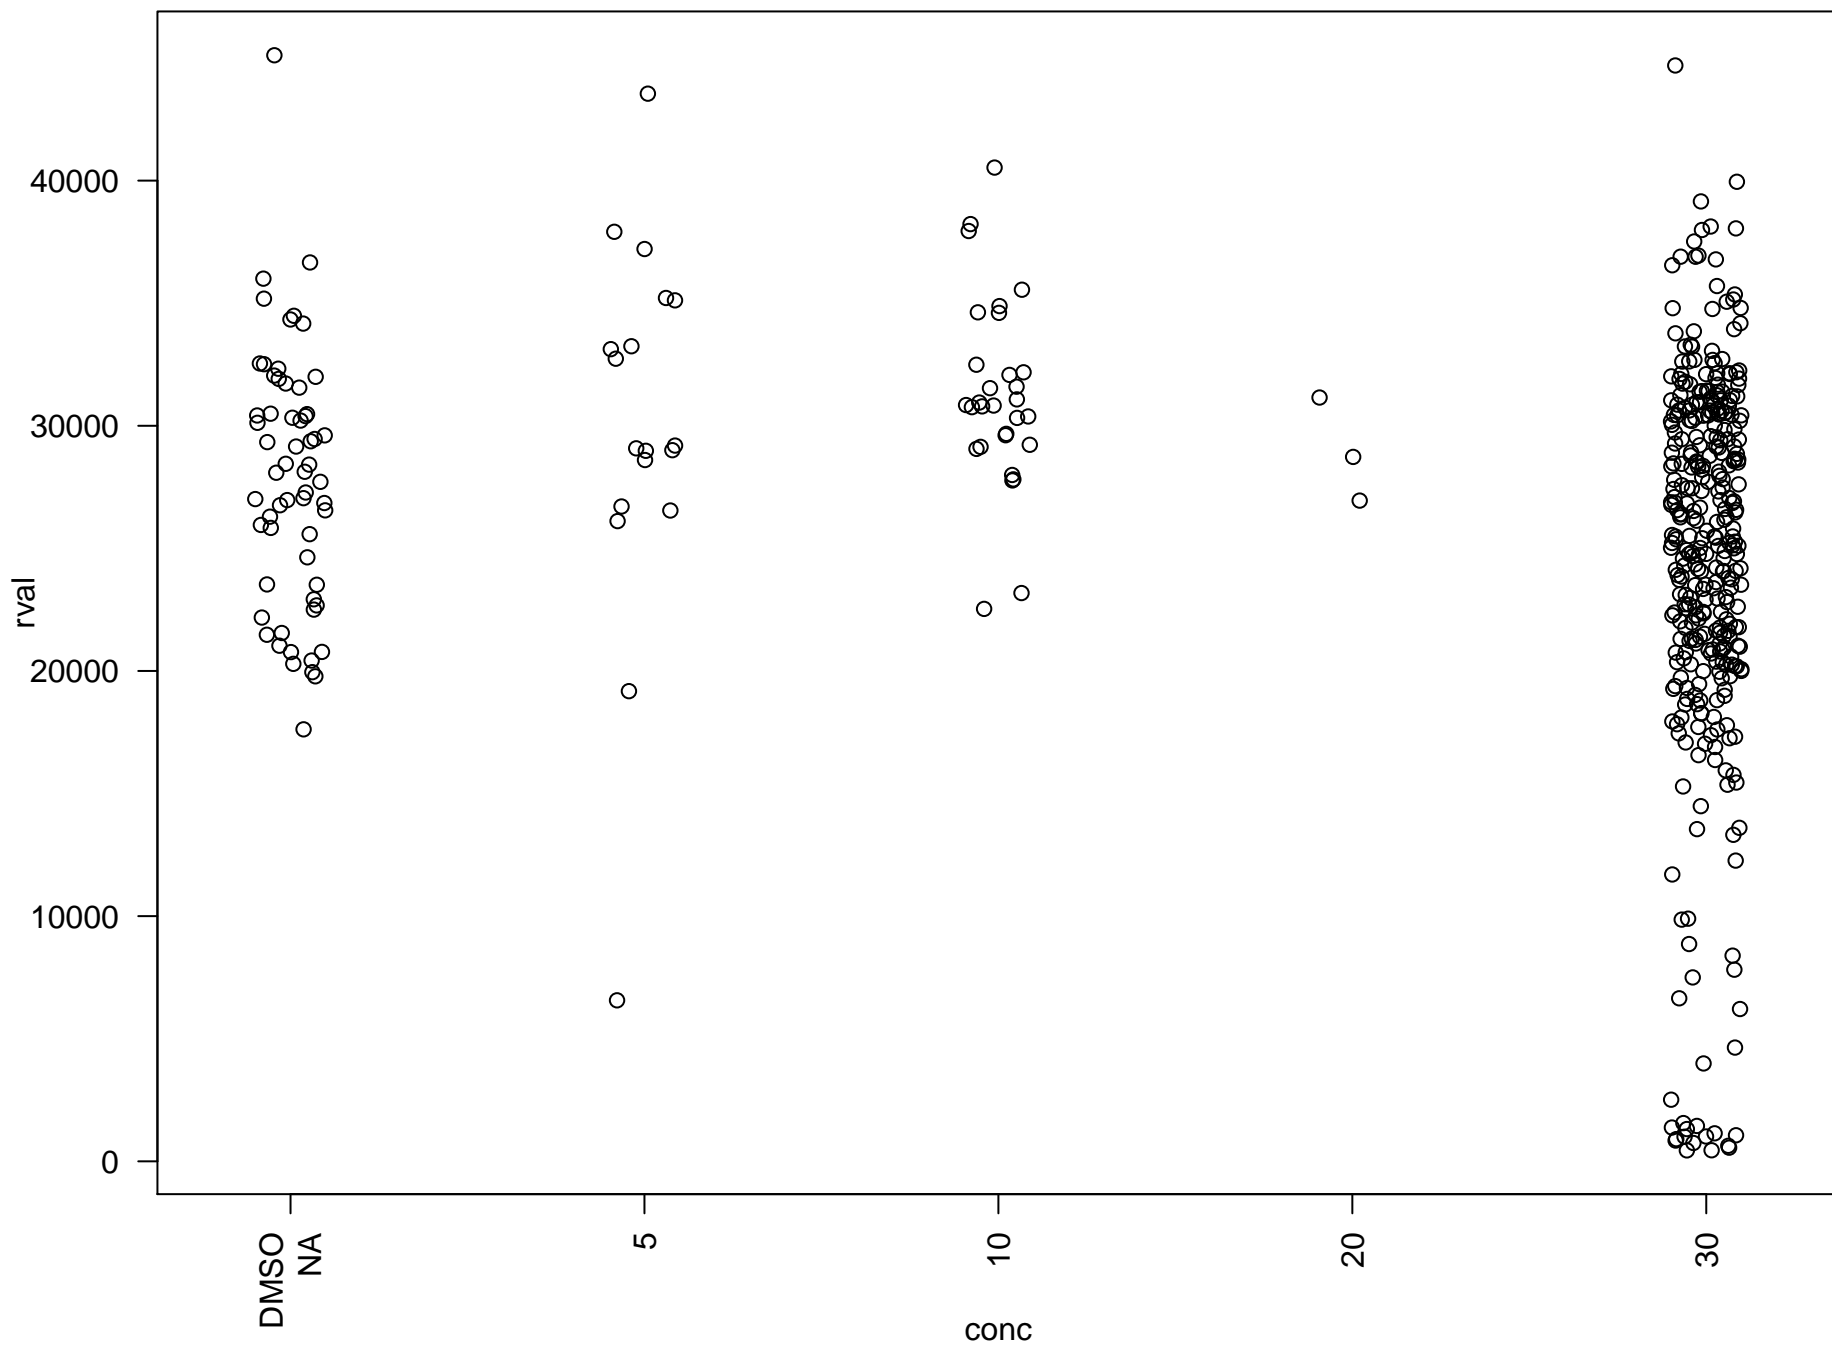

LDH Blank-Corrected Values for SPS_PFAS2019
where wllq == 1

