Radiators (Traditional Variants - 2021) - Stelrad Compact Horizontal

Emitter No.	Room	Type	Stelrad UIN	Watts*	Btu/hr*	Heating Zone
Rad 1	Living Room	P+ - 450mm High x 900mm	143703	950	3242	Zone 1
Rad 2	Kitchen / Dining	K2 - 700mm High x 1000mm	143854	1961	6693	Zone 1
Rad 3	Cloakroom	K1 - 600mm High x 300mm	143646	294	1003	Zone 1
Rad 4	Hall	P+ - 600mm High x 800mm	143768	1076	3672	Zone 1
Rad 5	Landing	K1 - 600mm High x 600mm	143748	588	2007	Zone 1
Rad 6	Bedroom 1	K1 - 450mm High x 1000mm	143686	756	2580	Zone 2
Rad 7	Bedroom 2	K1 - 600mm High x 700mm	143749	686	2341	Zone 2
Rad 8	Bedroom 3	K1 - 600mm High x 600mm	143748	588	2007	Zone 2
Rad 9	Bathroom	K1 - 600mm High x 700mm	143749	686	2341	Zone 2

Radiators (Traditional Variants - 2021) - Stelrad Elite

Emitter No.	Room	Type	Stelrad UIN	Watts*	Btu/hr*	Heating Zone
Rad 1	Living Room	P+ - 450mm High x 900mm	8484	995	3396	Zone 1
Rad 2	Kitchen / Dining	K2 - 700mm High x 1000mm	8637	2011	6864	Zone 1
Rad 3	Cloakroom	K1 - 600mm High x 300mm	Not Available	0	0	Zone 1
Rad 4	Hall	P+ - 600mm High x 800mm	8550	1127	3846	Zone 1
Rad 5	Landing	K1 - 600mm High x 600mm	8530	600	2048	Zone 1
Rad 6	Bedroom 1	K1 - 450mm High x 1000mm	8467	768	2621	Zone 2
Rad 7	Bedroom 2	K1 - 600mm High x 700mm	8531	700	2389	Zone 2
Rad 8	Bedroom 3	K1 - 600mm High x 600mm	8530	600	2048	Zone 2
Rad 9	Bathroom	K1 - 600mm High x 700mm	8531	700	2389	Zone 2

Radiators (Contemporary Variants - 2021) - Stelrad Compact...

Emitter No.	Room	Type	Stelrad UIN	Watts*	Btu/hr*	Heating Zone
Rad 1	Living Room	K1 - 600mm High x 500mm	143747	490	1672	Zone 1
Rad 2	Kitchen / Dining	K2 - 700mm High x 1000mm	143854	1961	6693	Zone 1
Rad 2*	Living Room	K1 - 600mm High x 500mm	143747	490	1672	Zone 1
Rad 3	Cloakroom	K1 - 600mm High x 300mm	143646	294	1003	Zone 1
Rad 4	Hall	P+ - 600mm High x 800mm	143768	1076	3672	Zone 1
Rad 6	Bedroom 1	K1 - 450mm High x 1000mm	143686	756	2580	Zone 2
Rad 7	Bedroom 2	K1 - 600mm High x 700mm	143749	686	2341	Zone 2
Rad 8	Bedroom 3	K1 - 600mm High x 600mm	143748	588	2007	Zone 2
Rad 9	Bathroom	K1 - 600mm High x 700mm	143749	686	2341	Zone 2
Rad 13	Landing	K1 - 600mm High x 600mm	143748	588	2007	Zone 1

Radiators (Contemporary Variants - 2021) - Stelrad Elite

Emitter No.	Room	Type	Stelrad UIN	Watts*	Btu/hr*	Heating Zone
Rad 1	Living Room	K1 - 600mm High x 500mm	8529	500	1707	Zone 1
Rad 2	Kitchen / Dining	K2 - 700mm High x 1000mm	8637	2011	6864	Zone 1
Rad 2*	Living Room	K1 - 600mm High x 500mm	8529	500	1707	Zone 1
Rad 3	Cloakroom	K1 - 600mm High x 300mm	Not Available	0	0	Zone 1
Rad 4	Hall	P+ - 600mm High x 800mm	8550	1127	3846	Zone 1
Rad 6	Bedroom 1	K1 - 450mm High x 1000mm	8467	768	2621	Zone 2
Rad 7	Bedroom 2	K1 - 600mm High x 700mm	8531	700	2389	Zone 2
Rad 8	Bedroom 3	K1 - 600mm High x 600mm	8530	600	2048	Zone 2
Rad 9	Bathroom	K1 - 600mm High x 700mm	8531	700	2389	Zone 2
Rad 13	Landing	K1 - 600mm High x 600mm	8530	600	2048	Zone 1

* N.B. - All wattage and Btu/hr figures are presented with a Δt 50°C.

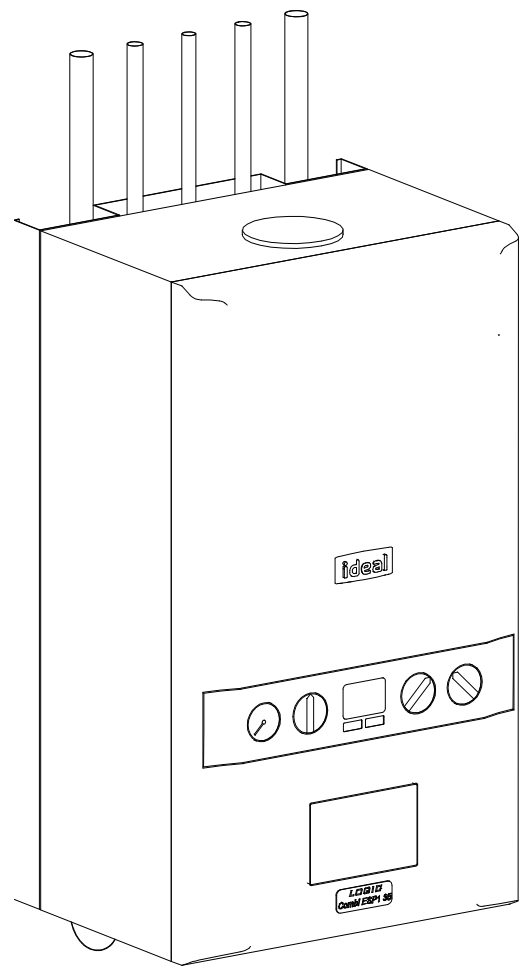

ANCILLARY EQUIPMENT - COMBI BOILER ZONED

Boiler Type	Ideal Logic ESP1 35 [SAP ref: 17929]
Rated Heat Output	35kW
Stand Off Kit	Required - Part No. 211333 (inc piping)
Plastic Pipework	Pipework and fittings by Hepworth Hep 20
Heating Pump	Included with Boiler
Room Thermostat	2x Honeywell T6R Wireless Smart Thermostat Dual Zone
T.R.V.s	Pegler Mistral II TRVs to all radiators except rooms with room thermostats
Motorised Valves	Danfoss 22mm heating zone valve x2
Radiator Valves	Lock Shield rad valves - Pegler Mercia
Weather Compensator	N/A
Cleaner and Inhibitor	Adey MCI + inhibitor 500ml. Adey MC3 + cleaner 500ml. In accordance with the manufacturers instructions, and BS 7593:1992
Automatic By-Pass Valve	Myson automatic by-pass valve or equal and approved
Scale Inhibitor	Adey Magnascale 15; product number SRI-03-07978 (where required)
DHW Expansion	Ideal DHW expansion vessel kit (if required)
Additional Kits	Weather compensation kit (if required) Frost pipe stat (if required) Adey Magnaclean filter (if approved)

Revision Schedule

Rev	Date	Description	Drn By
C1	28.11.25	Construction Issue	-

2021 Regs Only

1. This system has been designed in accordance with CIBSE, BS Standards, The Building Regulations, NHBC Technical Standards and the clients own specification, where applicable, at the time of design to the temperatures specified and operating under continuous operation. However, to maintain these temperatures during extreme conditions it may be necessary to provide a supplementary heat source.
2. It is the responsibility of the installer to fully complete the Ideal Group Benchmark Installation, Commissioning and Servicing Record Log Book provided with the boiler.
3. The installation MUST comply with the current edition of the Building Regulations, all Codes of Practice, British Standards & the boiler installations instructions provided with the boiler.
4. The Design is based upon drawings and information received and therefore it's accuracy and performance is dependant on that information being correct.
5. Where boilers are to be located in cupboards / kitchen units these may have to be ventilated. See the specific boiler installation instructions and the British Standard 5440 : Part 2 :2000.
6. The flues shown on the drawing are to be used as a guide only with the terminal positions to comply with British Standard and Building Regulations. Where twin pipe flue and / or extended runs of flue are to be used the types & exact runs are to be determined by the installer on site with special attention being taken to ensure the correct gradient of the flue is maintained.
7. All radiators / towel rails to be securely fitted with the brackets provided & with a minimum clearance beneath the emitter of at least 100mm and 50mm above. All Radiators with an output exceeding 1500w MUST have a 15mm supply, this will generally be indicated on the drawing.
8. Where applicable, a pre-insulated indirect cylinder manufactured to the relevant British Standards, and a capacity of at least that indicated on the drawing shall be positioned all as shown on the drawing.
9. All pipework to be laid to fall to allow ease of draining and venting with air vents at all high points and drain cocks at all low points.
10. The design for the DHW is based upon sufficient mains cold water flow and pressure to enable correct operation of the system. If this is insufficient then a suitable accumulator and pressure booster pump may need to be fitted. A water softener may also need to be fitted and this needs to be checked on commissioning and installation of the system.
11. When the system requires a pressurisation unit the size and type shall be as indicated on the drawing. All the equipment shall be installed in accordance with the manufacturers specific installation instructions to ensure the correct operation of the equipment.
12. All pipework to be insulated in accordance with the Building Regulations & British Standards, with specific attention being given to pipework in unheated areas such as roof spaces and garages.
13. Boilers that are to be used in the high efficiency mode must have the condensate pipework and safety discharge pipe installed in accordance with the installation instructions provided with the boiler.
14. All the ancillary equipment specified must be installed to the manufacturers own installation instructions.
15. All Plumbing fittings & outlets to be fitted in accordance with the manufacturers instruction and be fitted with isolating / regulating valves.
16. All notching & drilling of floor joists to be carried out in accordance with BS 12828:2003, Figure NA.1 - Limitations on notching and drilling in structural joists.
17. The Ideal Design Service (BH) recommend all joints that are to be soldered should be made using a flux that is sparingly applied. All residue must be flushed out of the system before commissioning using a chemical cleanser. All as required by British Gas Specification for Wet Central Heating Systems.
18. The heating system must be treated with a corrosion inhibitor used in accordance with manufacturers instructions.
19. The boiler shall be commissioned all in accordance with the installation instructions provided with the boiler. The system shall be balanced by regulating the flow rate to ensure a 20°C difference across the boiler. On each radiator the lockshield valve is to be adjusted to give a 20°C drop across the emitter.
20. As some of these items may be heavy, reference should be made to the installers own CDM requirements for lifting and installing of this equipment. Care should also be taken when handling the boiler insulation panels which may cause irritation to the skin. No asbestos, mercury or CFCs are included in any part of the boiler or its manufacture.
21. This drawing has been prepared by Ideal Group and remains their sole copyright and it must not be altered or amended in any form without the written consent of the Ideal Group. It is also supplied on the understanding that it will be treated as confidential and will only be used by our client or their nominees for the purpose of installing the equipment specified.

Plots 32, 34, 36, 46 (AS) & 33, 35, 47 (OPP)

CONSTRUCTION

Bellway
www.bellway.co.uk

Bellway Homes (Eastern Counties)
Building 2030, Cambourne Business Park,
Cambridgeshire CB23 6DW
Tel: 01480 425 200

Project
Somersham
St Ives Road
Working Drawings

Drawing Title
The Draftsman-Life DML-3B-2S-0
934 ft² | 3b Semi/Mid | All Variants
Heating Schedules and Installation Notes

Drawing Created By	First Issue Date	Scale(s)
Group	April '25	
Project No	**Drg Status**	**Revision**
BI01	Construction	C1

Drawing No. BI01/934DML/80/0/2021/05

Do not scale - if in doubt, ask