


Greenlighting ECO800 Recessed Spotlights indicated on Layout.
Note: If **ANY** other recessed spotlight manufacturer is proposed, please ensure reference is made to Bellway Technical Alert ref: 3.0 TechAlert - Downlight and Noggins_01_V1.0 and Recessed Downlighting and Noggins Summary_01_V1.2 dated 06/04/20 to establish correct installation protocols.

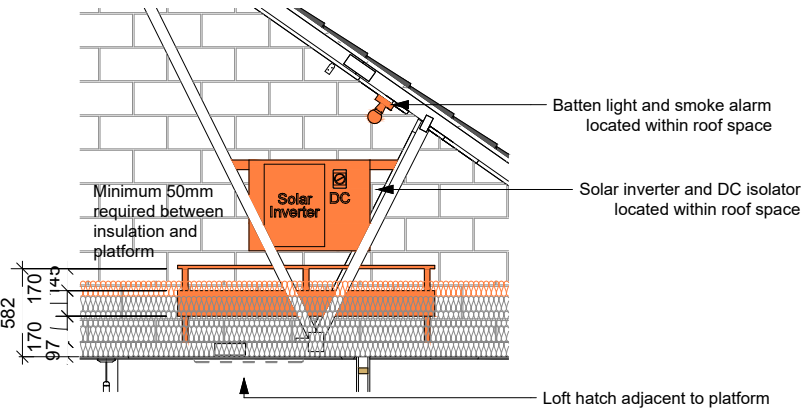

3 Solar Invertor in Loft Space (2021 Only)
1 : 50

	Ceiling mounted extract fan (arrow indicates ducting direction, RT = roof terminal) Yellow = intermittent fan for 2013 regs, dMEV fan for 2021 regs. Orange = dMEV for 2021 regs only; no fan required for 2013 regs. (dMEV = Decentralised Mechanical Extract Ventilation - System 3) See 95/0/02 for details of individual fan requirements
	Wall mounted extract fan (installed @ 2000mm above FFL to centreline). Yellow = intermittent fan for 2013 regs, dMEV fan for 2021 regs. Orange = dMEV for 2021 regs only; no fan required for 2013 regs. (dMEV = Decentralised Mechanical Extract Ventilation - System 3) See 95/0/02 for details of individual fan requirements
	Orange Boost Switch - lightswitch to control boost function of dMEV fan (2021 specification only)
	Orange Isolator Switch - 2021 specification switch only. Text identifies use (IS - Fan = Extract Fan Isolator AC Solar = Solar Inverter AC Isolator)

2021 Regulations
All radiators sizes illustrated here are to satisfy 2021 regulations.

All Radiators and Extract Fan locations shown in orange are to be provided for 2021 Regulation properties only.

Refer to 80 series drawings for Radiator schedules and sizes, and refer to 95 series for Extract Fan schedules for both 2013 and 2021 regulations.

Revision Schedule			
Rev	Date	Description	Drn By
C1	27.11.25	Construction Issue	-

Electrical Legend (Private Range)			
	Pendant light fitting		25A Flex outlet plate high level ⁽²⁾ low level ⁽³⁾
	Batten holder fitting		Frost thermostat
	IP65 recessed spotlight		Weather compensator
	IP65 recessed spotlight to be supplied with Fire Hood / Shroud		Ceiling mounted detector Smoke Heat
	External Wall mounted light fitting		Wall mounted CO detector (installed @ 2000mm above FFL)
	Multi (8g)		BT Customer Splice Point located externally (conduit to be installed 300-770mm above FGL)
	Remote switches to unswitched sockets ⁽²⁾ Single Multi (8no max)		Room thermostat ⁽¹⁾
	Light switch 1 way ⁽¹⁾ 1 2 3 gang		Fan isolator switch (installed to centreline of door, 2150mm above FFL to underside of switch)
	Light switch 2 way ⁽¹⁾ 1 2 3 gang		Shower isolator switch ⁽¹⁾
	Light switch - Intermediate ⁽¹⁾		AC isolator switch for solar panels ⁽¹⁾
	13A Single Un-switched fused spur connection		A = Co-axial aerial
	FS-3A Double pole switched fused spur connection (13A 3A)		A = Co-axial aerial D = CAT6 data
	(IMR) 20A DP Switch Flex Outlet w/ Neon indicator (for Immersion Heater)		D = CAT6 data
	Single unswitched socket (13A) high level ⁽²⁾ low level ⁽³⁾		Wall mounted meter box (Electricity or Gas). Base of box / structural opening @ 900mm (12no bc) above external FGL
	Single switched socket (13A) high level ⁽²⁾ low level ⁽³⁾		Low level Gas meter box (external ground level)
	Double switched socket (13A) high level ⁽²⁾ low level ⁽³⁾		FTP Key:- ONT:- Optical Network Termination unit, complete with Battery Backup Unit (BBU) CP-Rou:- Customer Provided Router NetSwitch:- Customer Provided Unmanaged Gigabit Network Switch
	Cooker outlet plate ⁽³⁾ with 6mm Ø cable to 45A double pole switch		Consumer unit (underside of unit installed 1350mm above FFL)
	45A double pole switch ⁽²⁾ with 6mm Ø cable to distribution board		
	(CYL) Hot water cylinder connection box (Blank Faceplate) ⁽²⁾		

Submain Isolator must be installed where cable length from meter to consumer unit exceeds 3m
Refer to Section 110 of STANDARD DETAILS - GROUP HOUSE TYPES for typical details

⁽¹⁾ Switches / controls installed @ 1200mm above FFL to top of fitting
⁽²⁾ Switches installed @ 1050mm above FFL to underside of fitting (sockets located in kitchen islands to be mounted @ 750mm above FFL)
⁽³⁾ Switches installed @ 450mm above FFL to underside of fitting
General Note - sockets located 400mm from internal corners of rooms to centrelines of sockets, unless otherwise stated

General Note - M4(2) requires all electrical items to have a min clear access of 300mm to any inside corner. Red dims denote critical areas.

ELECTRICAL

Bellway
www.bellway.co.uk


Bellway Homes (Eastern Counties)
Building 2030, Cambourne Business Park,
Cambridgeshire CB23 6DW
Tel: 01480 425 200

Project
Somersham
St Ives Road
Working Drawings

Drawing Title
The Coppersmith-Life CSL-3B-2S-AT
1026 ft² | 3b Det / Semi | All Traditional Variants
First Floor Electrical GA

Drawing Created By Group	First Issue Date April '25	Scale(s) 1 : 50
Project No BI01	Drng Status Construction	Revision C1
Drawing No. BI01/1026CSL/15/AT/02		

1 First Floor Electrical GA
1 : 50

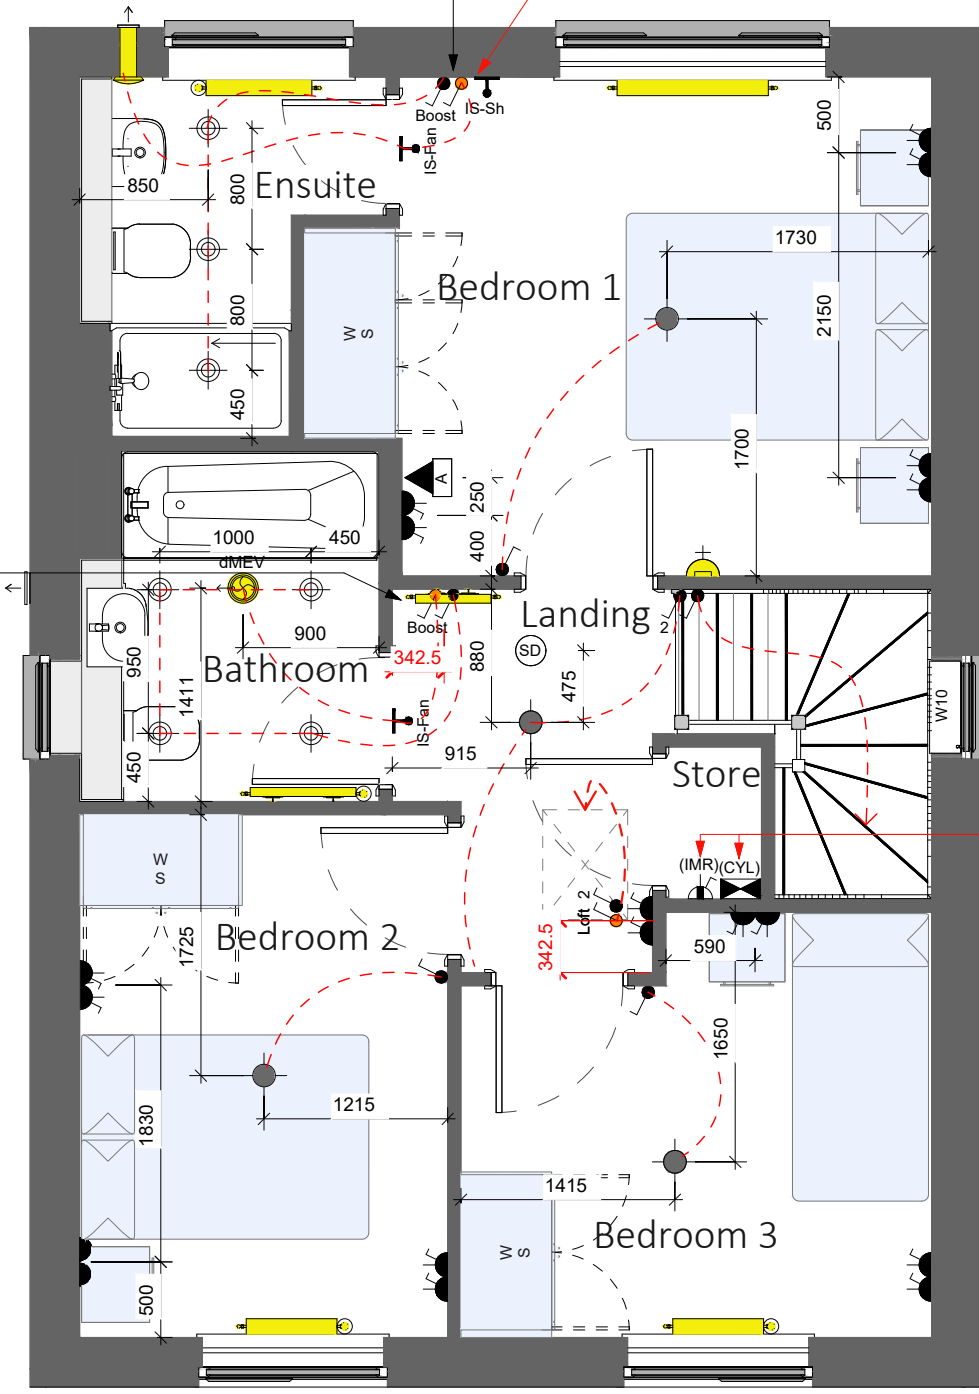

2 First Floor - Semi-Detached Callout
1 : 50 Plots 08, 14, 50 (AS) & 01, 03, 09, 18, 19, 49 OPP

Window to Plot 1 ONLY Fixed, obscured & toughen glass.
Only to be used when using a cylinder (2013) in house type.

Do not scale - if in doubt, ask