




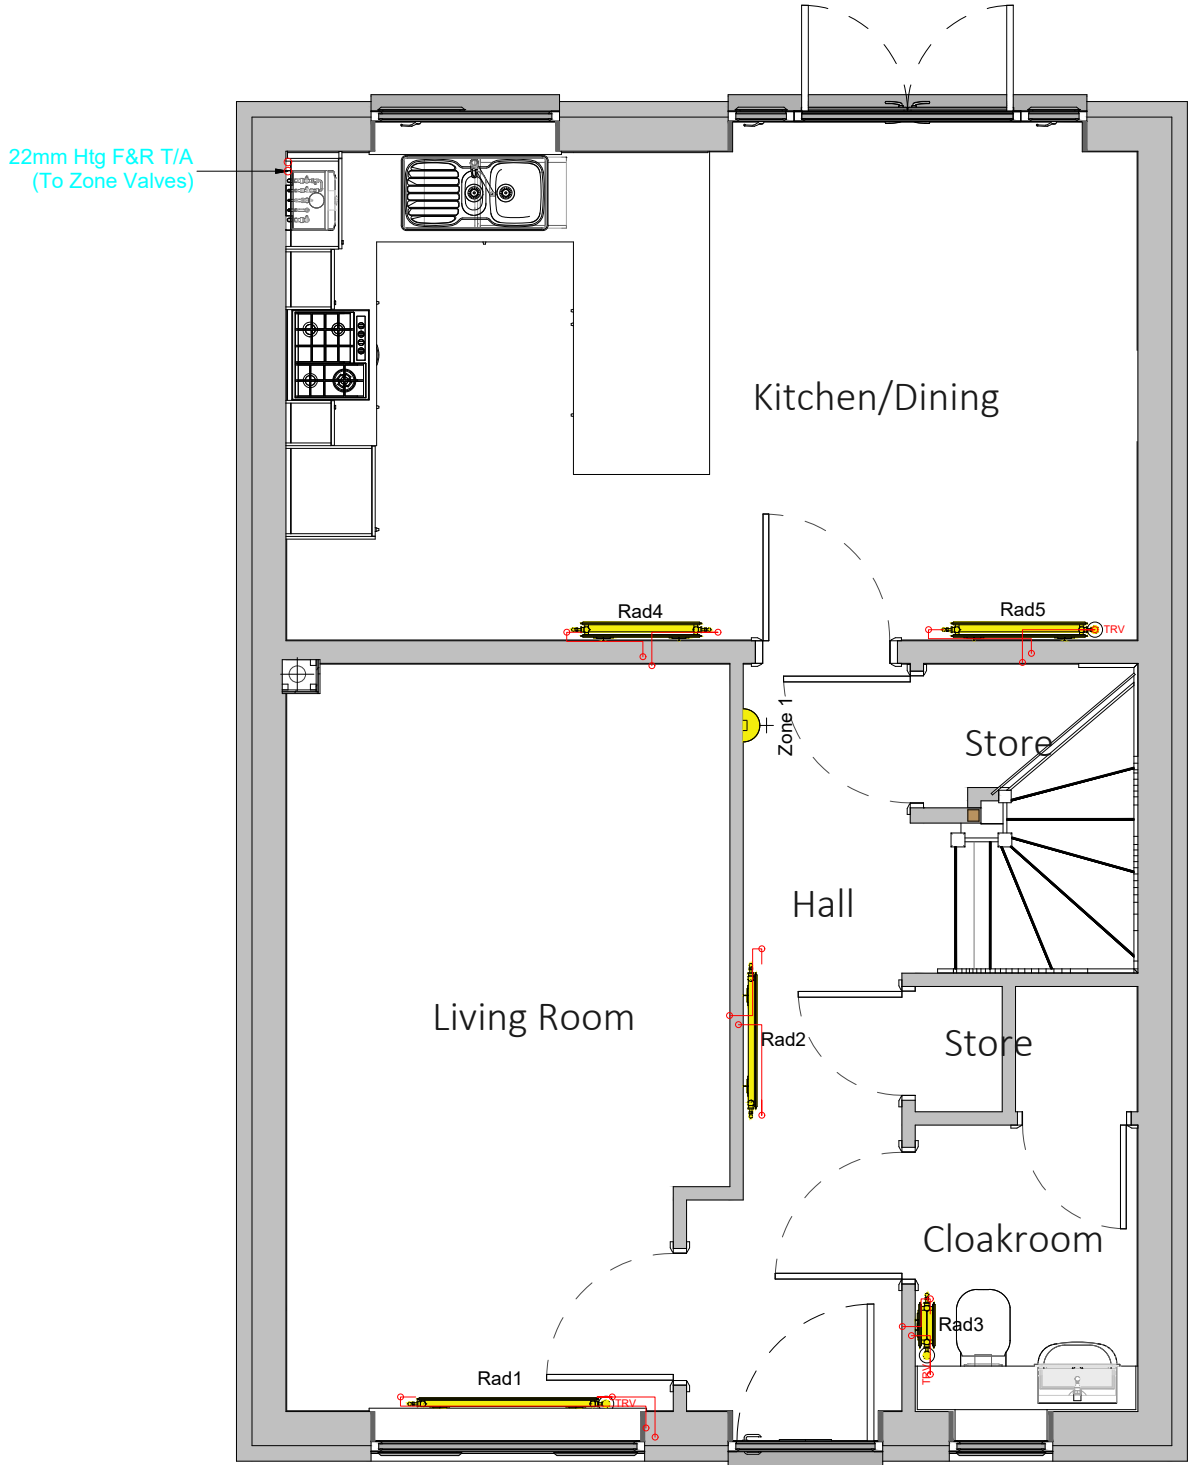

1 Ground Floor Heating GA
1 : 50

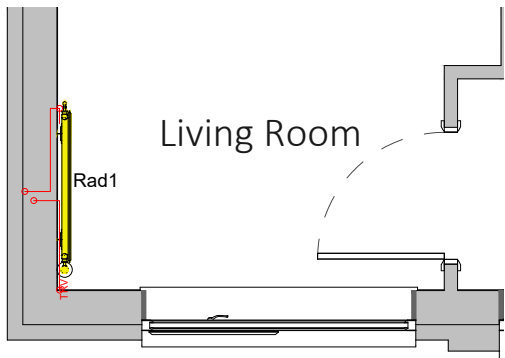

2 AC Living Room Heating GA
1 : 50

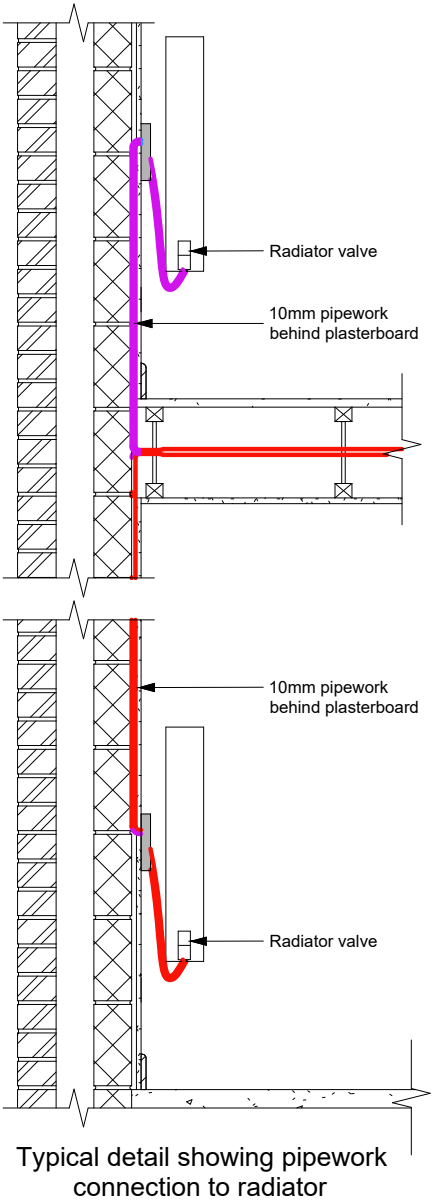

Revision Schedule			
Rev	Date	Description	Drn By
C1	27.11.25	Construction Issue	-

Notes

All plumbing fitting and outlets must be fitted in accordance with manufacturers instructions and have isolating flow rate and pressure reducing valves as required. The installation must be in accordance with all relevant regulations.

The first metre of pipework from the boiler to be copper; all pipework in airing cupboard to be copper, all exposed pipework to be copper.

System to be balanced to achieve 55°C flow, 45°C return, with 10°C temperature drop across the boiler and radiators.

Gas Pipes	—
Zone 1 Flow Return Pipes	— — — — —
Zone 2 Flow Return Pipes	— — — — —

Balanced flue to outside wall. The flue terminal must not be positioned less than 300mm from a window, air vent, or other ventilation opening; and must be fitted in accordance with the installation instructions.

All drops to ground floor radiators to be 10mm F&R TB unless otherwise stated with 15mm to point of drop.

Pipework routes should be confirmed as being compatible with joist layouts



Face-fix radiator pipe guide and seal to be utilised behind each radiator as above

MECHANICAL

Bellway
www.bellway.co.uk

Bellway Homes (Eastern Counties)
Building 2030, Cambourne Business Park,
Cambridgeshire CB23 6DW
Tel: 01480 425 200

Project
Somersham
St Ives Road
Working Drawings

Drawing Title
The Coppersmith-Life

1026 ft² | 3b Det / Semi | All Variants
Ground Floor Heating GA

CSL-3B-2S-0

Drawing Created By Group	First Issue Date April '25	Scale(s) As indicated
Project No BI01	Drg Status Construction	Revision C1
Drawing No. BI01/1026CSL/80/0/2021/01		

2021 Regs Only

Plots 08, 14, 50 (AS) & 01, 03, 09, 18, 19, 49 OPP

Do not scale - if in doubt, ask