

Greenlighting ECO800 Recessed Spotlights indicated on Layout.
Note: If **ANY** other recessed spotlight manufacturer is proposed, please ensure reference is made to Bellway Technical Alert ref: 3.0 TechAlert - Downlight and Noggins_01_V1.0 and Recessed Downlighting and Noggin Summary_01_V1.2 dated 06/04/20 to establish correct installation protocols.

2021 Regulations
All radiators sizes illustrated here are to satisfy 2021 regulations.

All Radiators and Extract Fan locations shown in orange are to be provided for 2021 Regulation properties only.

Refer to 80 series drawings for Radiator schedules and sizes, and refer to 95 series for Extract Fan schedules for both 2013 and 2021 regulations.

Revision Schedule			
Rev	Date	Description	Drn By
C1	28.11.25	Construction Issue	-

Electrical Legend (Affordable Range)

	Pendant light fitting		Weather compensator	
	Batten holder fitting			Ceiling mounted detector Smoke Heat
	External Wall mounted light fitting		Wall mounted CO detector (installed @ 2000mm above FFL)	
	Remote switches to unswitched sockets ⁽²⁾	BT Entry	BT Customer Splice Point located externally (conduit to be installed 300-770mm above FGL)	
	Light switch 1 way ⁽¹⁾ 1 2 3 gang	St.1	St.2	Room thermostat ⁽¹⁾ Zone 1 Zone 2
	Light switch 2 way ⁽¹⁾ 1 2 3 gang	IS-Fan	Fan isolator switch (installed to centreline of door, 2150mm above FFL to underside of switch)	
	Light switch - Intermediate ⁽¹⁾	IS-Sh	Shower isolator switch ⁽¹⁾	
	13A Single Un-switched fused spur connection	AC Solar	AC isolator switch for solar panels ⁽¹⁾	
	Double pole switched fused spur connection (13A 3A)		A = Co-axial aerial	
	Single unswitched socket (13A) high level ⁽²⁾ low level ⁽³⁾		A = Co-axial aerial D = CAT6 data	
	Single switched socket (13A) high level ⁽²⁾ low level ⁽³⁾	Elec	Wall mounted meter box (Electricity or Gas). Base of box / structural opening @ 900mm (12no bc) above external FGL	
	Double switched socket (13A) high level ⁽²⁾ low level ⁽³⁾		Low level Gas meter box (external ground level)	
	Cooker outlet plate ⁽³⁾ with 6mm Ø cable to 45A double pole switch	FTTP Key:- ONT:- Optical Network Termination unit, complete with Battery Backup Unit (BBU) CP-Rou:- Customer Provided Router NetSwitch:- Customer Provided Unmanaged Gigabit Network Switch		
	45A double pole switch ⁽²⁾ with 6mm Ø cable to distribution board		Frost thermostat	
	Consumer unit (underside of unit installed 1350mm above FFL)			
	25A Flex outlet plate high level ⁽²⁾ low level ⁽³⁾			

Submain Isolator must be installed where cable length from meter to consumer unit exceeds 3m
Refer to Section 110 of STANDARD DETAILS - GROUP HOUSE TYPES for typical details

⁽¹⁾ Switches / controls installed @ 1200mm above FFL to top of fitting
⁽²⁾ Switches installed @ 1050mm above FFL to underside of fitting (sockets located in kitchen islands to be mounted @ 750mm above FFL)
⁽³⁾ Switches installed @ 450mm above FFL to underside of fitting
General Note - sockets located 400mm from internal corners of rooms to centrelines of sockets, unless otherwise stated
General Note - M4(2) requires all electrical items to have a min clear access of 300mm to any inside corner. Red dims denote critical areas.

ELECTRICAL



Bellway Homes (Eastern Counties)

Building 2030, Cambourne Business Park,
Cambridgeshire CB23 6DW
Tel: 01480 425 200

Project

Somersham
St Ives Road
Working Drawings


Drawing Title

The Draftsman-Life

DML-3B-2S-AT

934 ft² | 3b Semi/Mid | All Traditional Variants
First Floor Electrical GA

Drawing Created By Group	First Issue Date April '25	Scale(s) 1 : 50
Project No BI01	Drng Status Construction	Revision C1
Drawing No.	BI01/934/15/AT/02	

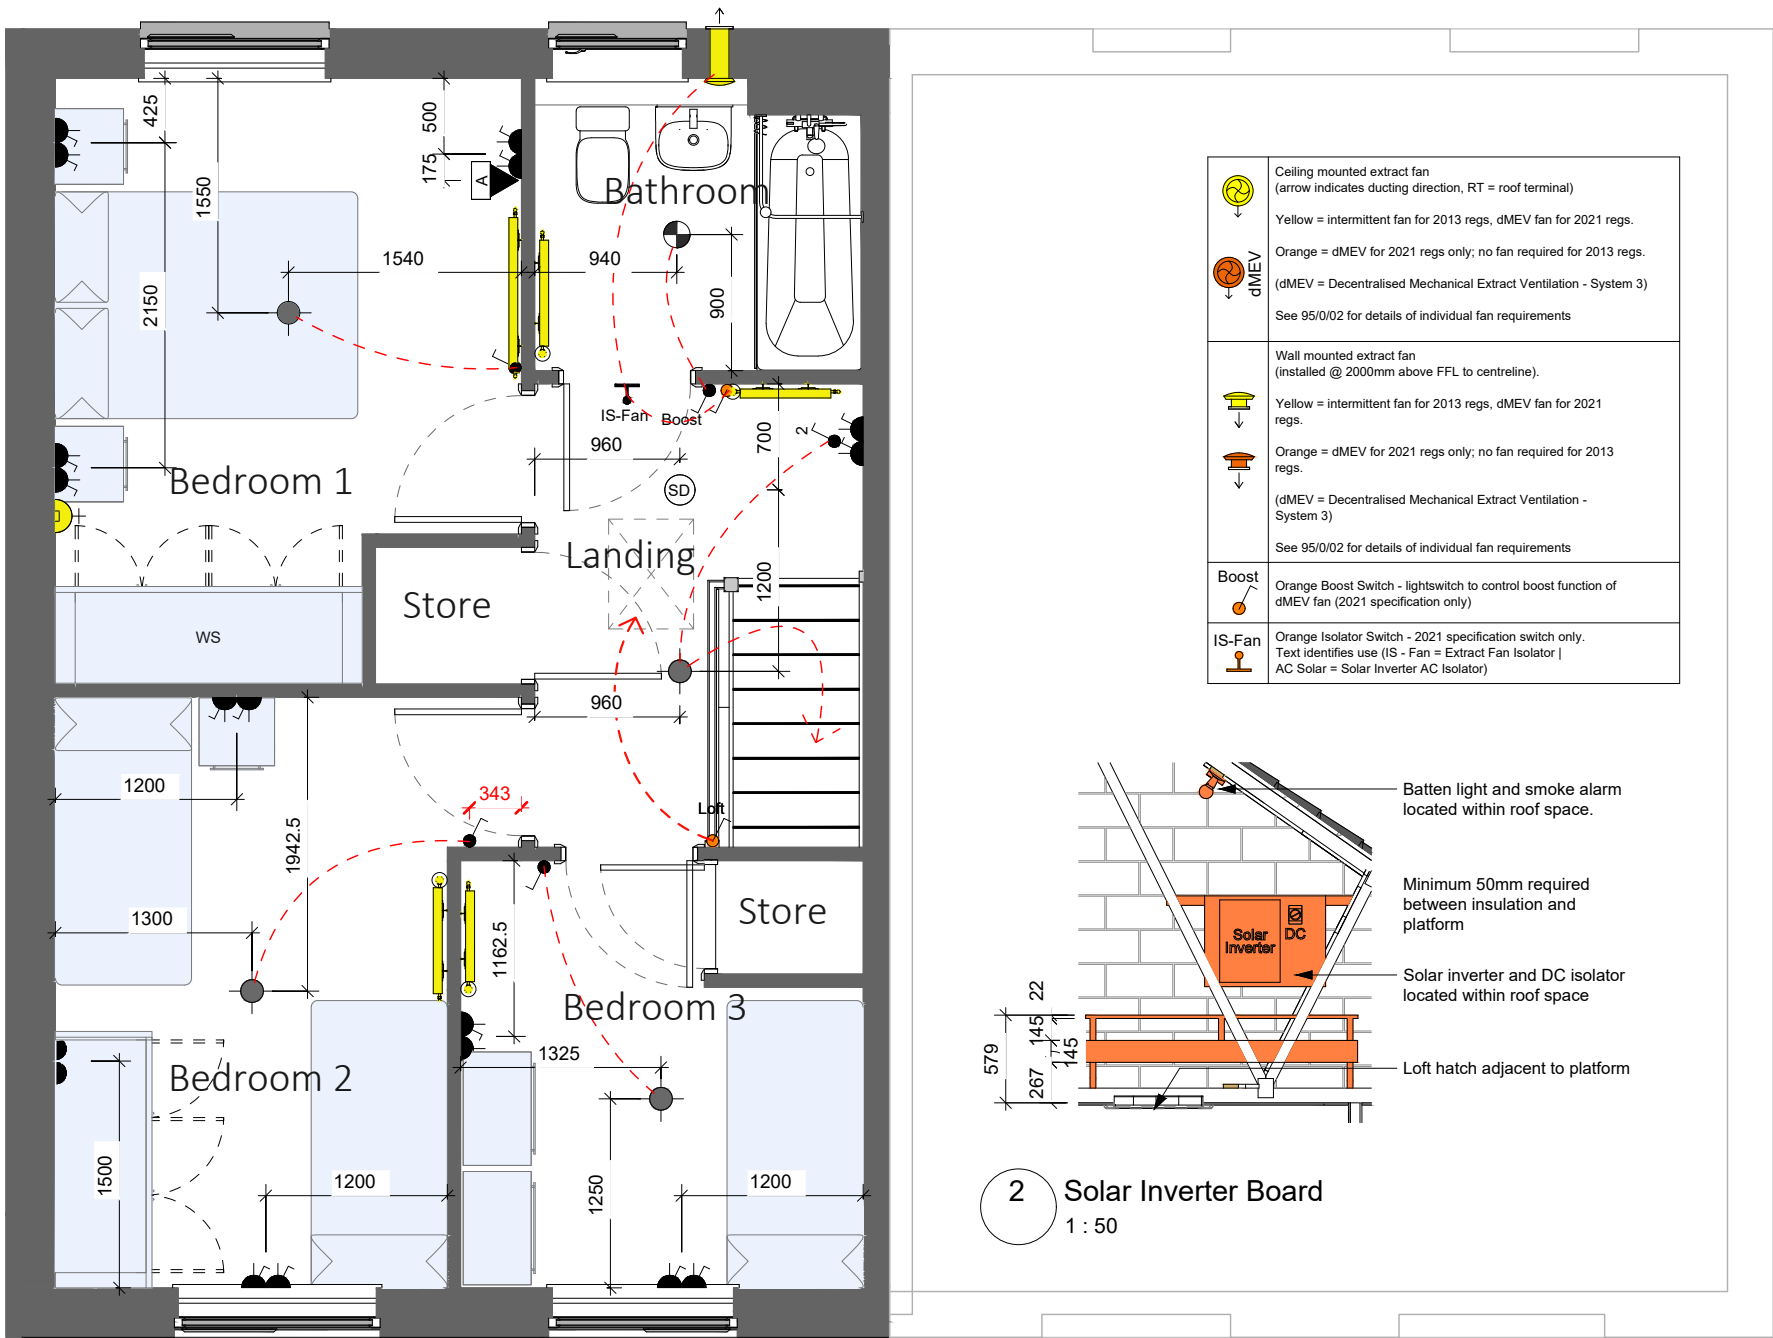

1 First Floor Electrical GA
1 : 50

2 Solar Inverter Board
1 : 50