


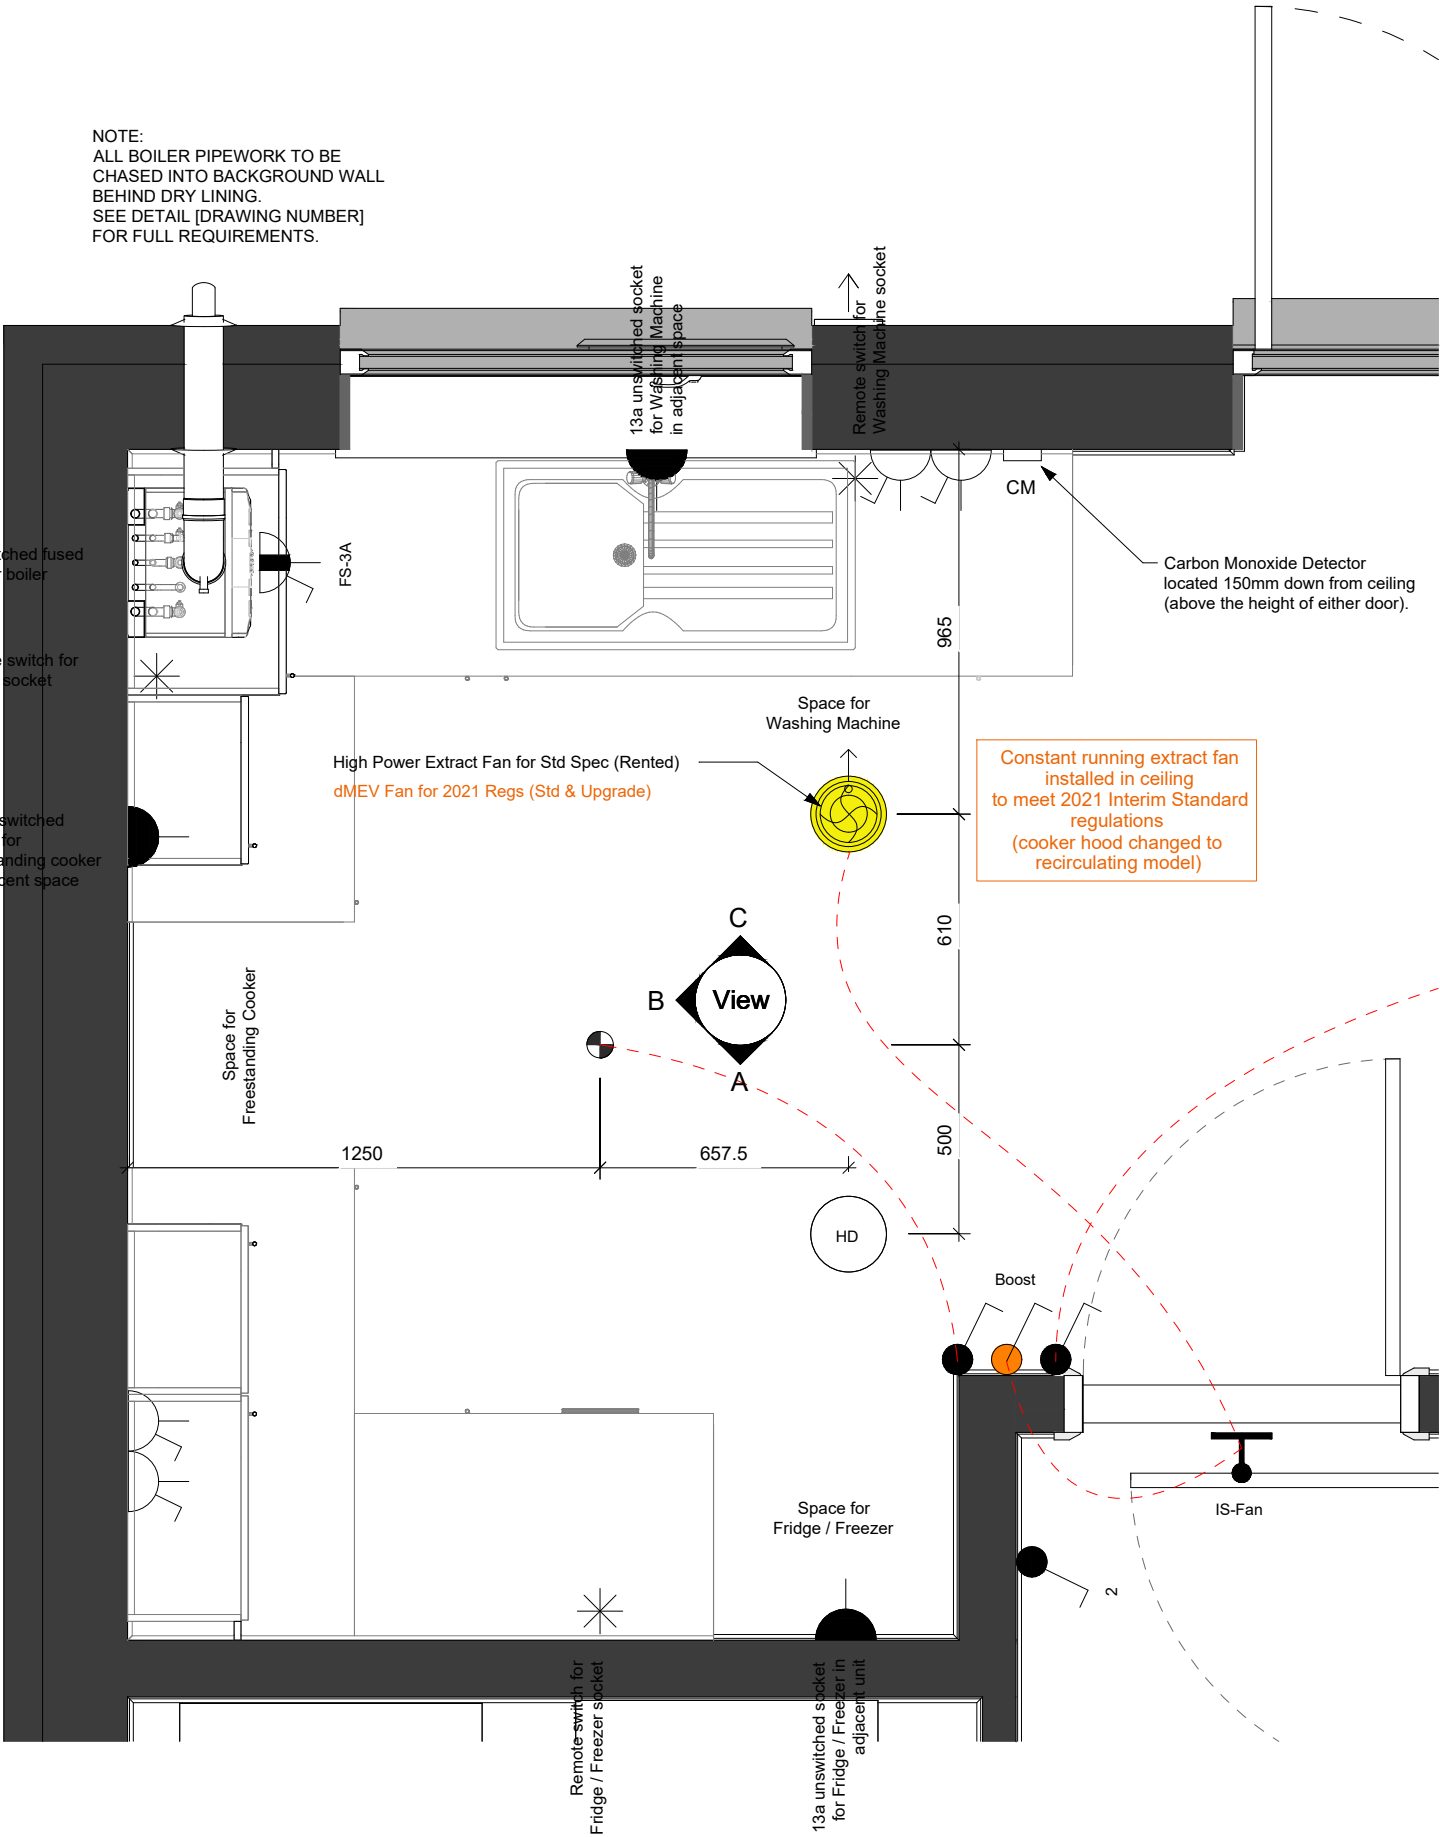

Kitchen Electrical Legend

	Pendant light fitting		INT	Light switch - Intermediate ⁽¹⁾
	Batten holder fitting		AC Solar	AC isolator switch for solar panels
	IP65 recessed spotlight		IS-Fan	Fan isolator switch (installed to centreline of door, 2150mm above FFL to underside of switch)
	IP65 recessed spotlight to be supplied with Fire Hood / Shroud			13A Single Un-switched fused spur connection
	External Wall mounted light fitting		FS-3A	Double pole switched fused spur connection (13A 3A)
	Multi (8g)			Single unswitched socket (13A) high level ⁽²⁾ low level ⁽³⁾
	Remote switches to unswitched sockets ⁽²⁾ Single Multi (8no max)			Single switched socket (13A) high level ⁽²⁾ low level ⁽³⁾
	Light switch 1 way ⁽¹⁾ 1 2 3 gang			Double switched socket (13A) high level ⁽²⁾ low level ⁽³⁾
	Light switch 2 way ⁽¹⁾ 1 2 3 gang			
	Ceiling mounted detector Smoke Heat		CM	Wall mounted CO detector (installed @ 2000mm above FFL)
	Room thermostat ⁽¹⁾ Zone 1 Zone 2			Cooker outlet plate ⁽³⁾ with 6mm Ø cable to 45A double pole switch
	25A Flex outlet plate high level ⁽²⁾ low level ⁽³⁾			45A double pole switch ⁽²⁾ with 6mm Ø cable to distribution board
			CU	Consumer unit (underside of unit installed 1350mm above FFL)

⁽¹⁾ Switches / controls installed @ 1200mm above FFL to top of fitting
⁽²⁾ Switches installed @ 1050mm above FFL to underside of fitting
(sockets located in kitchen islands to be mounted @ 750mm above FFL)
⁽³⁾ Switches installed @ 450mm above FFL to underside of fitting

General Note - sockets located 400mm from internal corners of rooms to centrelines of sockets, unless otherwise stated

	Ceiling mounted extract fan (arrow indicates ducting direction, RT = roof terminal) Yellow = intermittent fan for 2013 regs, dMEV fan for 2021 regs. Orange = dMEV for 2021 regs only; no fan required for 2013 regs. (dMEV = Decentralised Mechanical Extract Ventilation - System 3) See 95/0/02 for details of individual fan requirements
	Wall mounted extract fan (installed @ 2000mm above FFL to centreline). Yellow = intermittent fan for 2013 regs, dMEV fan for 2021 regs. Orange = dMEV for 2021 regs only; no fan required for 2013 regs. (dMEV = Decentralised Mechanical Extract Ventilation - System 3) See 95/0/02 for details of individual fan requirements
	Boost Orange Boost Switch - lightswitch to control boost function of dMEV fan (2021 specification only)
	IS-Fan Orange Isolator Switch - 2021 specification switch only. Text identifies use (IS - Fan = Extract Fan Isolator AC Solar = Solar Inverter AC Isolator)


2021 Regulations
All radiators sizes illustrated here are to satisfy 2021 regulations.

All Radiators and Extract Fan locations shown in orange are to be provided for 2021 Regulation properties only.

Refer to 80 series drawings for Radiator schedules and sizes, and refer to 90/0/02 drawing for Extract Fan schedules for both 2013 and 2021 regulations.

Plots 32, 34, 36, 46 (AS) & 33, 35, 47 (OPP)

Revision Schedule			
Rev	Date	Description	Drn By
C1	28.11.25	Construction Issue	-

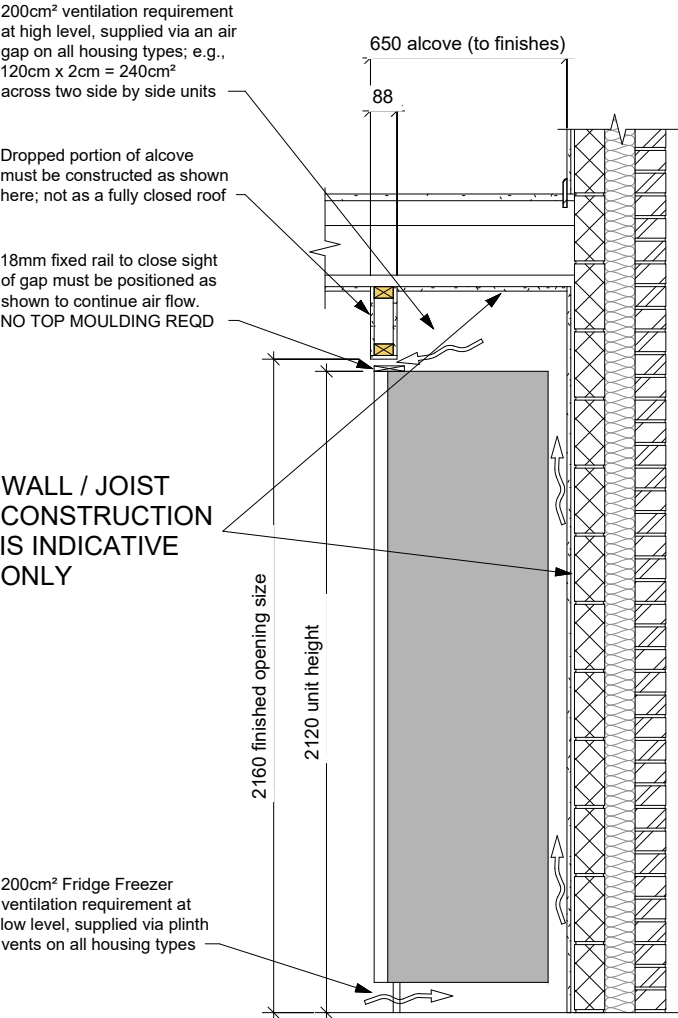

Section through enclosed housing (1 : 25)

CONSTRUCTION

Bellway
www.bellway.co.uk

Bellway Homes (Eastern Counties)
Building 2030, Cambourne Business Park,
Cambridgeshire CB23 6DW
Tel: 01480 425 200

Project
Somersham
St Ives Road
Working Drawings

Drawing Title

The Draftsman-Life

934 ft² | 3b Semi/Mid | All Variants

Kitchen Layout

DML-3B-2S-0

Drawing Created By	First Issue Date	Scale(s)
Group	April '25	As indicated
Project No	Drg Status	Revision
BI01	Construction	C1
Drawing No.	BI01/934DML/70/0/AR/01	

Do not scale - if in doubt, ask

1 Kitchen Layout - Rented Specification
1 : 20