
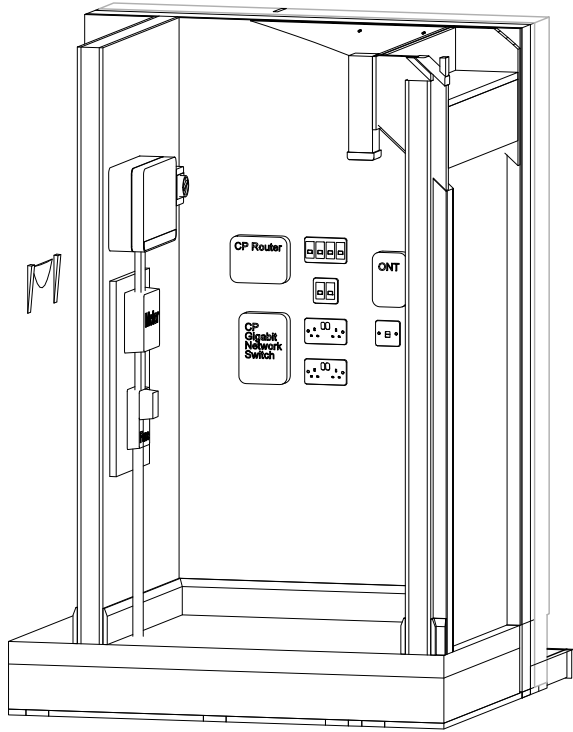


Greenlighting ECO800 Recessed Spotlights indicated on Layout.
Note: If **ANY** other recessed spotlight manufacturer is proposed, please ensure reference is made to Bellway Technical Alert ref: 3.0 TechAlert - Downlight and Noggins_01_V1.0 and Recessed Downlighting and Noggin Summary_01_V1.2 dated 06/04/20 to establish correct installation protocols.

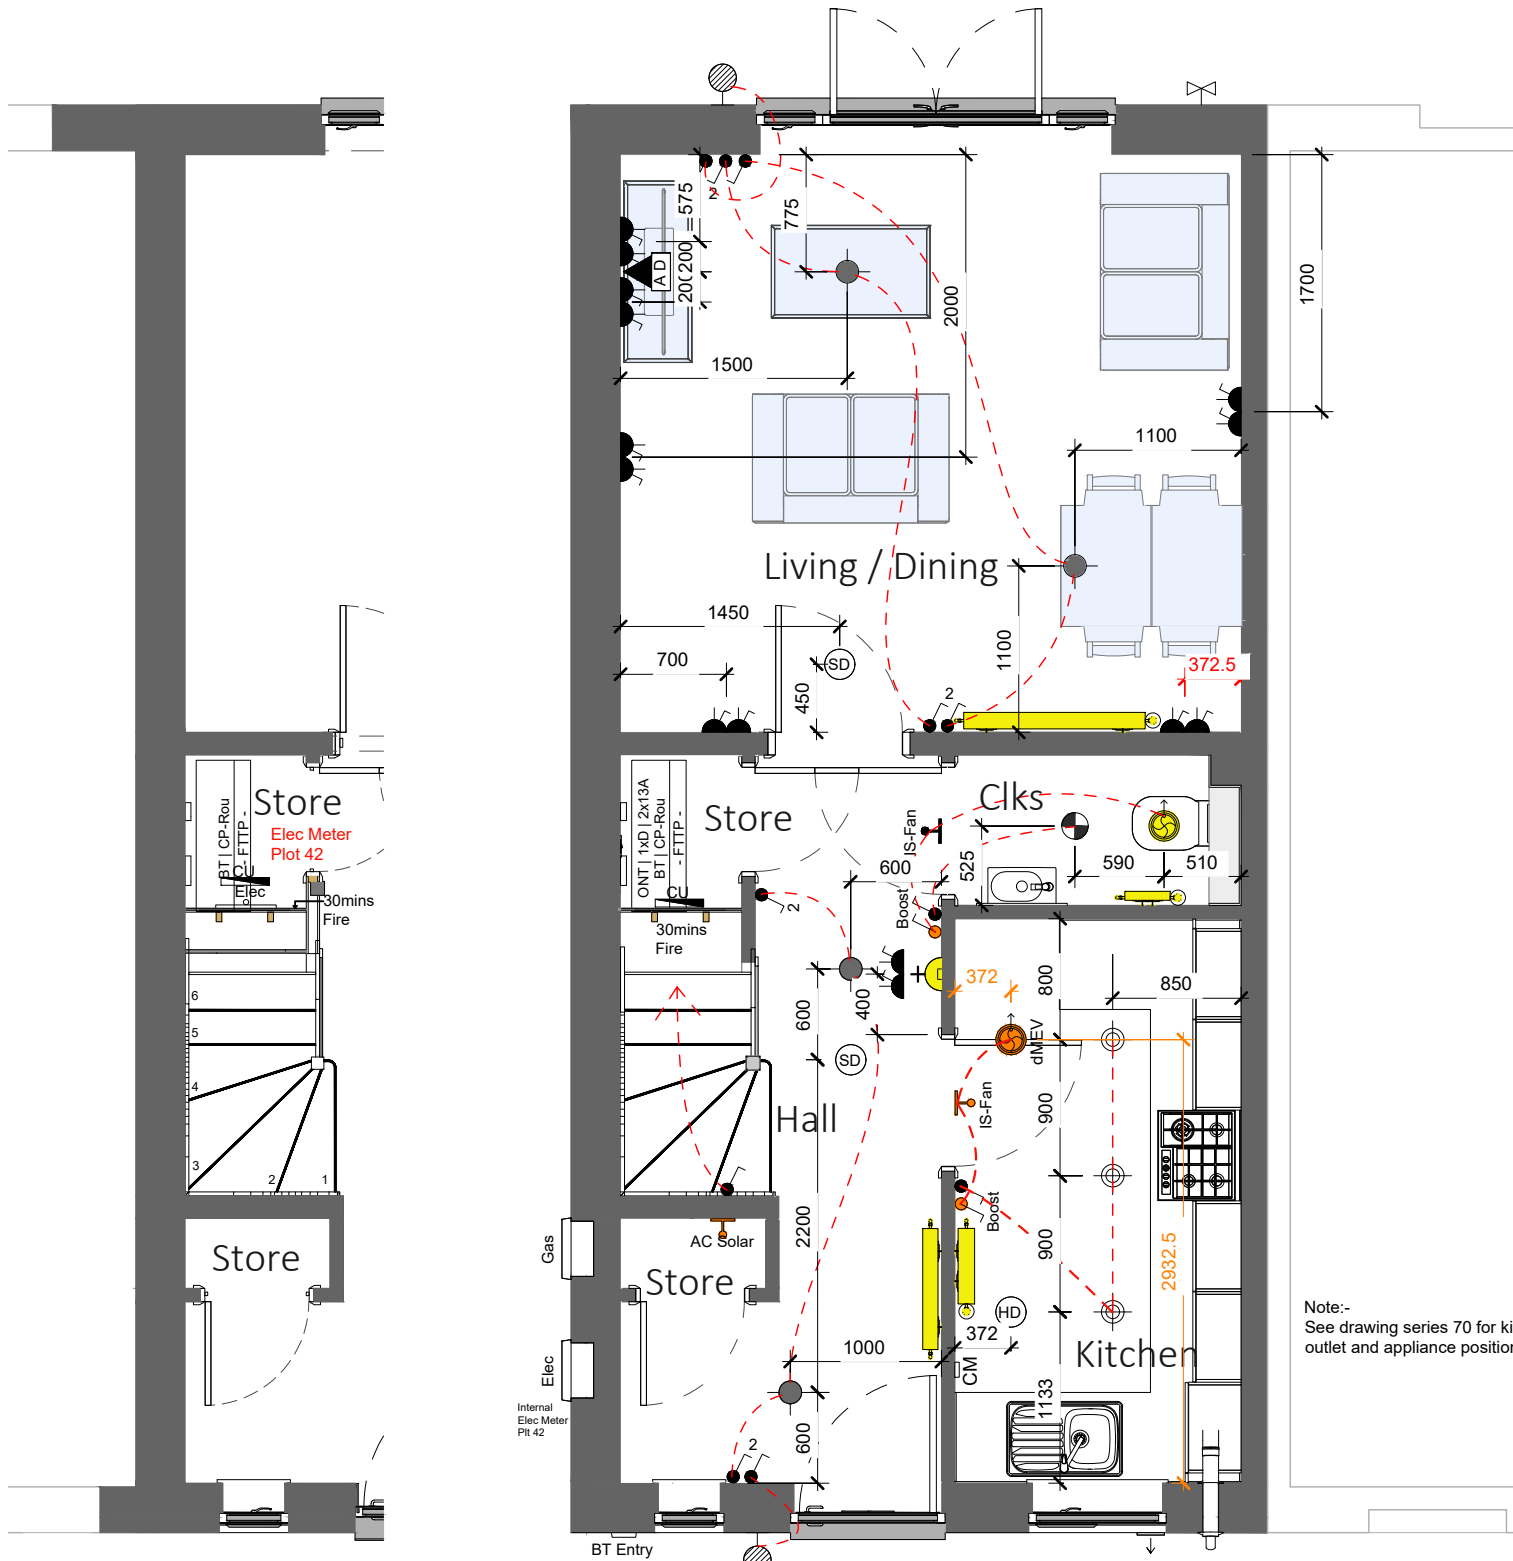

Plot 42 Internal cupboard layout
2 Mid Terrace Cup'd (View A)

2021 Regulations
All radiators sizes illustrated here are to satisfy 2021 regulations.

All Radiators and Extract Fan locations shown in orange are to be provided for 2021 Regulation properties only.

Refer to 80 series drawings for Radiator schedules and sizes, and refer to 90/0/02 drawing for Extract Fan schedules for both 2013 and 2021 regulations.

Note:-
See drawing series 70 for kitchen outlet and appliance positions

	Ceiling mounted extract fan (arrow indicates ducting direction, RT = roof terminal) Yellow = intermittent fan for 2013 regs, dMEV fan for 2021 regs. Orange = dMEV for 2021 regs only; no fan required for 2013 regs. (dMEV = Decentralised Mechanical Extract Ventilation - System 3) See 95/0/02 for details of individual fan requirements
	Wall mounted extract fan (installed @ 2000mm above FFL to centreline). Yellow = intermittent fan for 2013 regs, dMEV fan for 2021 regs. Orange = dMEV for 2021 regs only; no fan required for 2013 regs. (dMEV = Decentralised Mechanical Extract Ventilation - System 3) See 95/0/02 for details of individual fan requirements
	Orange Boost Switch - lightswitch to control boost function of dMEV fan (2021 specification only)
	Orange Isolator Switch - 2021 specification switch only. Text identifies use (IS - Fan = Extract Fan Isolator AC Solar = Solar Inverter AC Isolator)

Plots 10, 16, 41, 42 (AS) & 11, 17, 43 (OPP)

Revision Schedule			
Rev	Date	Description	Drn By
C1	01.12.25	Construction Issue	FDL
C2	05.03.26	Mid. terrace extract added.	FDL

Electrical Legend (Private Range)	
	Pendant light fitting
	Batten holder fitting
	IP65 recessed spotlight
	IP65 recessed spotlight to be supplied with Fire Hood / Shroud
	External Wall mounted light fitting
	Multi (8g) Remote switches to unswitched sockets (2) Single Multi (8no max)
	Light switch 1 way (1) 1 2 3 gang
	Light switch 2 way (1) 1 2 3 gang
	Light switch - intermediate (1)
	13A Single Un-switched fused spur connection
	Double pole switched fused spur connection (13A 3A)
	20A DP Switch Flex Outlet w/ Neon Indicator (for Immersion Heater)
	Single unswitched socket (13A) high level (2) low level (3)
	Single switched socket (13A) high level (2) low level (3)
	Double switched socket (13A) high level (2) low level (3)
	Cooker outlet plate (3) with 6mm Ø cable to 45A double pole switch
	45A double pole switch (2) with 6mm Ø cable to distribution board
	Hot water cylinder connection box (Blank Faceplate) (2)

	25A Flex outlet plate high level (2) low level (3)
	Frost thermostat
	Weather compensator
	Ceiling mounted detector Smoke Heat
	Wall mounted CO detector (installed @ 2000mm above FFL)
	BT Customer Splice Point located externally (conduit to be installed 300-770mm above FGL)
	Room thermostat (1) Zone 1 Zone 2
	Fan isolator switch (installed to centreline of door, 2150mm above FFL to underside of switch)
	Shower isolator switch (1)
	AC isolator switch for solar panels (1)
	A = Co-axial aerial
	A = Co-axial aerial D = CAT6 data
	D = CAT6 data
	Wall mounted meter box (Electricity or Gas). Base of box / structural opening @ 900mm (12no bc) above external FGL
	Low level Gas meter box (external ground level)
FTTP Key:- ONT:- Optical Network Termination unit, complete with Battery Backup Unit (BBU) CP-Rou:- Customer Provided Router NetSwitch:- Customer Provided Unmanaged Gigabit Network Switch	
	Consumer unit (underside of unit installed 1350mm above FFL)

Submain Isolator must be installed where cable length from meter to consumer unit exceeds 3m
Refer to Section 110 of STANDARD DETAILS - GROUP HOUSE TYPES for typical details

(1) Switches / controls installed @ 1200mm above FFL to top of fitting
(2) Switches installed @ 1050mm above FFL to underside of fitting (sockets located in kitchen islands to be mounted @ 750mm above FFL)
(3) Switches installed @ 450mm above FFL to underside of fitting
General Note - sockets located 400mm from internal corners of rooms to centrelines of sockets, unless otherwise stated

General Note - M4(2) requires all electrical items to have a min clear access of 300mm to any inside corner. Red dims denote critical areas.

** Internal meter cupboard on plot 42

Bellway
www.bellway.co.uk

ELECTRICAL

Bellway Homes (Eastern Counties)
Building 2030, Cambourne Business Park,
Cambridgeshire CB23 6DW
Tel: 01480 425 200

Building Regulations
2013 & 2021
Compliant

Project
Somersham
St Ives Road
Working Drawings

Drawing Title
The Hooper-Life
790 ft² | 2b Semi/Terr | All Variants
Ground Floor Electrical GA

HPL-2B-2S-0

Drawing Created By Group	First Issue Date April '25	Scale(s) 1 : 50
Project No BIO1	Drg Status Construction	Revision C2
Drawing No. BIO1/790HP/15/0/01		

Do not scale - if in doubt, ask

2 Ground Floor - Mid Tce
1 : 50

1 Ground Floor Electrical GA
1 : 50