


Revision Schedule			
Rev	Date	Description	Drn By
C1	01.12.25	Construction Issue	FDL

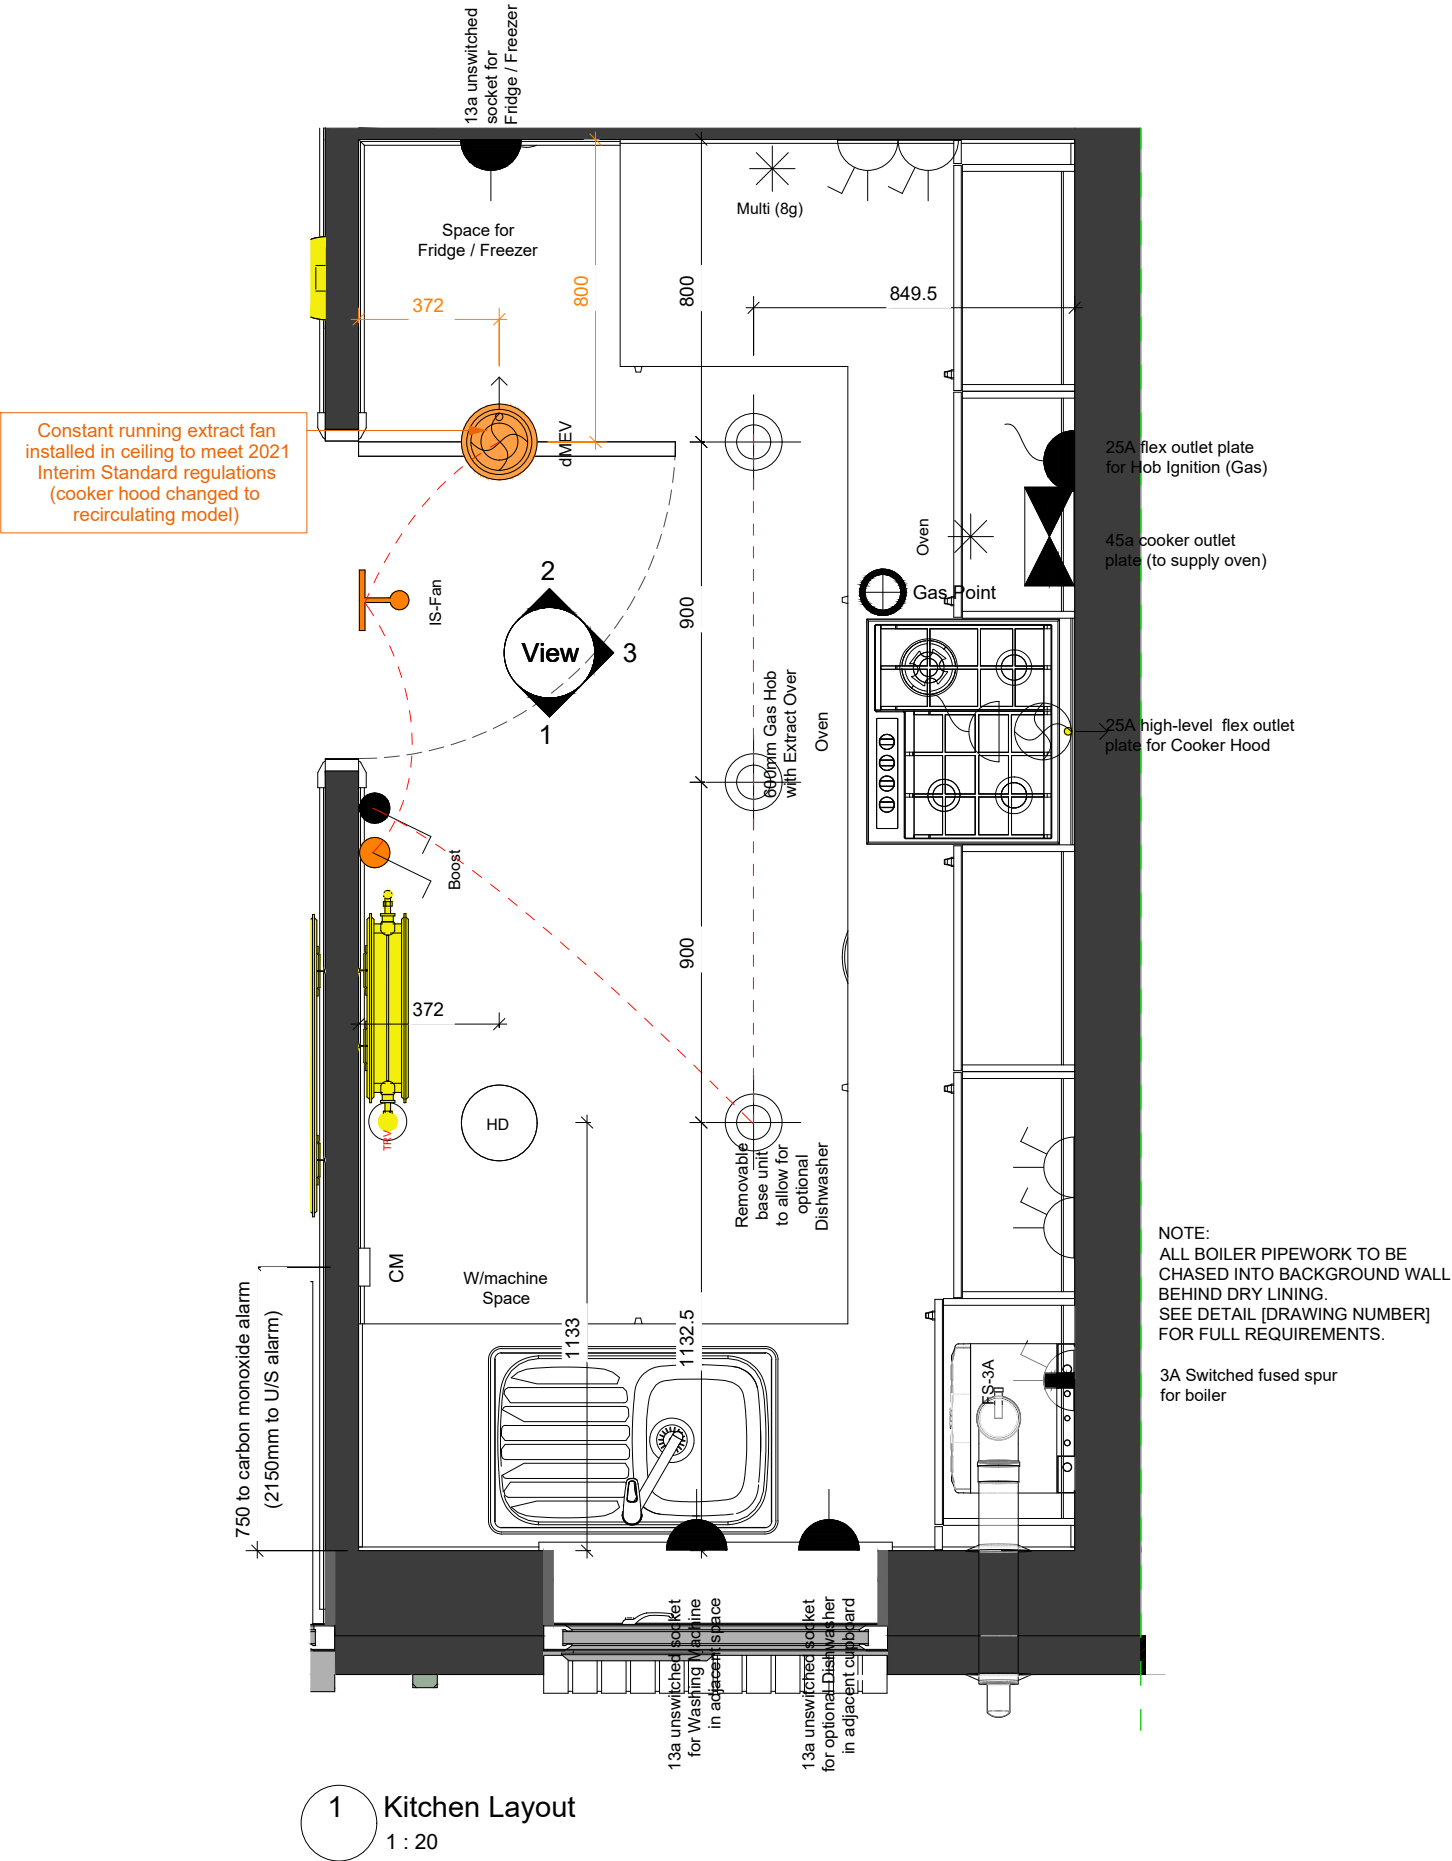

Kitchen Electrical Legend

	Pendant light fitting		Light switch - Intermediate ⁽¹⁾		Wall mounted CO detector (installed @ 2000mm above FFL)
	Batten holder fitting		AC isolator switch for solar panels		25A Flex outlet plate high level ⁽²⁾ low level ⁽³⁾
	IP65 recessed spotlight		Fan isolator switch (installed to centreline of door, 2150mm above FFL to underside of switch)		Cooker outlet plate ⁽³⁾ with 6mm Ø cable to 45A double pole switch
	IP65 recessed spotlight to be supplied with Fire Hood / Shroud		13A Single Un-switched fused spur connection		45A double pole switch ⁽²⁾ with 6mm Ø cable to distribution board
	External Wall mounted light fitting		Double pole switched fused spur connection (13A 3A)		Consumer unit (underside of unit installed 1350mm above FFL)
	Multi (8g)		Remote switches to unswitched sockets ⁽²⁾ Single Multi (8no max)		Single unswitched socket (13A) high level ⁽²⁾ low level ⁽³⁾
	Light switch 1 way ⁽¹⁾ 1 2 3 gang		Single switched socket (13A) high level ⁽²⁾ low level ⁽³⁾		Zone 1
	Light switch 2 way ⁽¹⁾ 1 2 3 gang		Double switched socket (13A) high level ⁽²⁾ low level ⁽³⁾		Zone 2
					Ceiling mounted detector Smoke Heat
					Room thermostat ⁽¹⁾ Zone 1 Zone 2

- ⁽¹⁾ Switches / controls installed @ 1200mm above FFL to top of fitting
- ⁽²⁾ Switches installed @ 1050mm above FFL to underside of fitting (sockets located in kitchen islands to be mounted @ 750mm above FFL)
- ⁽³⁾ Switches installed @ 450mm above FFL to underside of fitting

General Note - sockets located 400mm from internal corners of rooms to centrelines of sockets, unless otherwise stated

2021 Regulations
All radiators sizes illustrated here are to satisfy 2021 regulations.

All Radiators and Extract Fan locations shown in orange are to be provided for 2021 Regulation properties only.

Refer to 80 series drawings for Radiator schedules and sizes, and refer to 90/0/02 drawing for Extract Fan schedules for both 2013 and 2021 regulations.

	Ceiling mounted extract fan (arrow indicates ducting direction, RT = roof terminal) Yellow = intermittent fan for 2013 regs, dMEV fan for 2021 regs. Orange = dMEV for 2021 regs only; no fan required for 2013 regs. (dMEV = Decentralised Mechanical Extract Ventilation - System 3) See 95/0/02 for details of individual fan requirements
	Wall mounted extract fan (installed @ 2000mm above FFL to centreline). Yellow = intermittent fan for 2013 regs, dMEV fan for 2021 regs. Orange = dMEV for 2021 regs only; no fan required for 2013 regs. (dMEV = Decentralised Mechanical Extract Ventilation - System 3) See 95/0/02 for details of individual fan requirements
	Orange Boost Switch - lightswitch to control boost function of dMEV fan (2021 specification only)
	Orange Isolator Switch - 2021 specification switch only. Text identifies use (IS - Fan = Extract Fan Isolator AC Solar = Solar Inverter AC Isolator)
ALL SERVICES TO BE CHASED INTO BACKGROUND WALL BEHIND DRY LINING. SEE DETAIL [DRAWING NUMBER] FOR FULL REQUIREMENTS.	

CONSTRUCTION

Bellway

www.bellway.co.uk

Bellway Homes (Eastern Counties)

Building 2030, Cambourne Business Park,
Cambridgeshire CB23 6DW

Tel: 01480 425 200

Building Regulations
2013 & 2021
Compliant

Project
Somersham
St Ives Road
Working Drawings

Drawing Title
The Hooper-Life
790 ft² | 2b Semi/Terr | All Variants
Kitchen Layout - Standard

HPL-2B-2S-0

Drawing Created By Group	First Issue Date April '25	Scale(s) As indicated
Project No BI01	Drng Status Construction	Revision C1
Drawing No.		BI01/790HP/70/0/S/01