



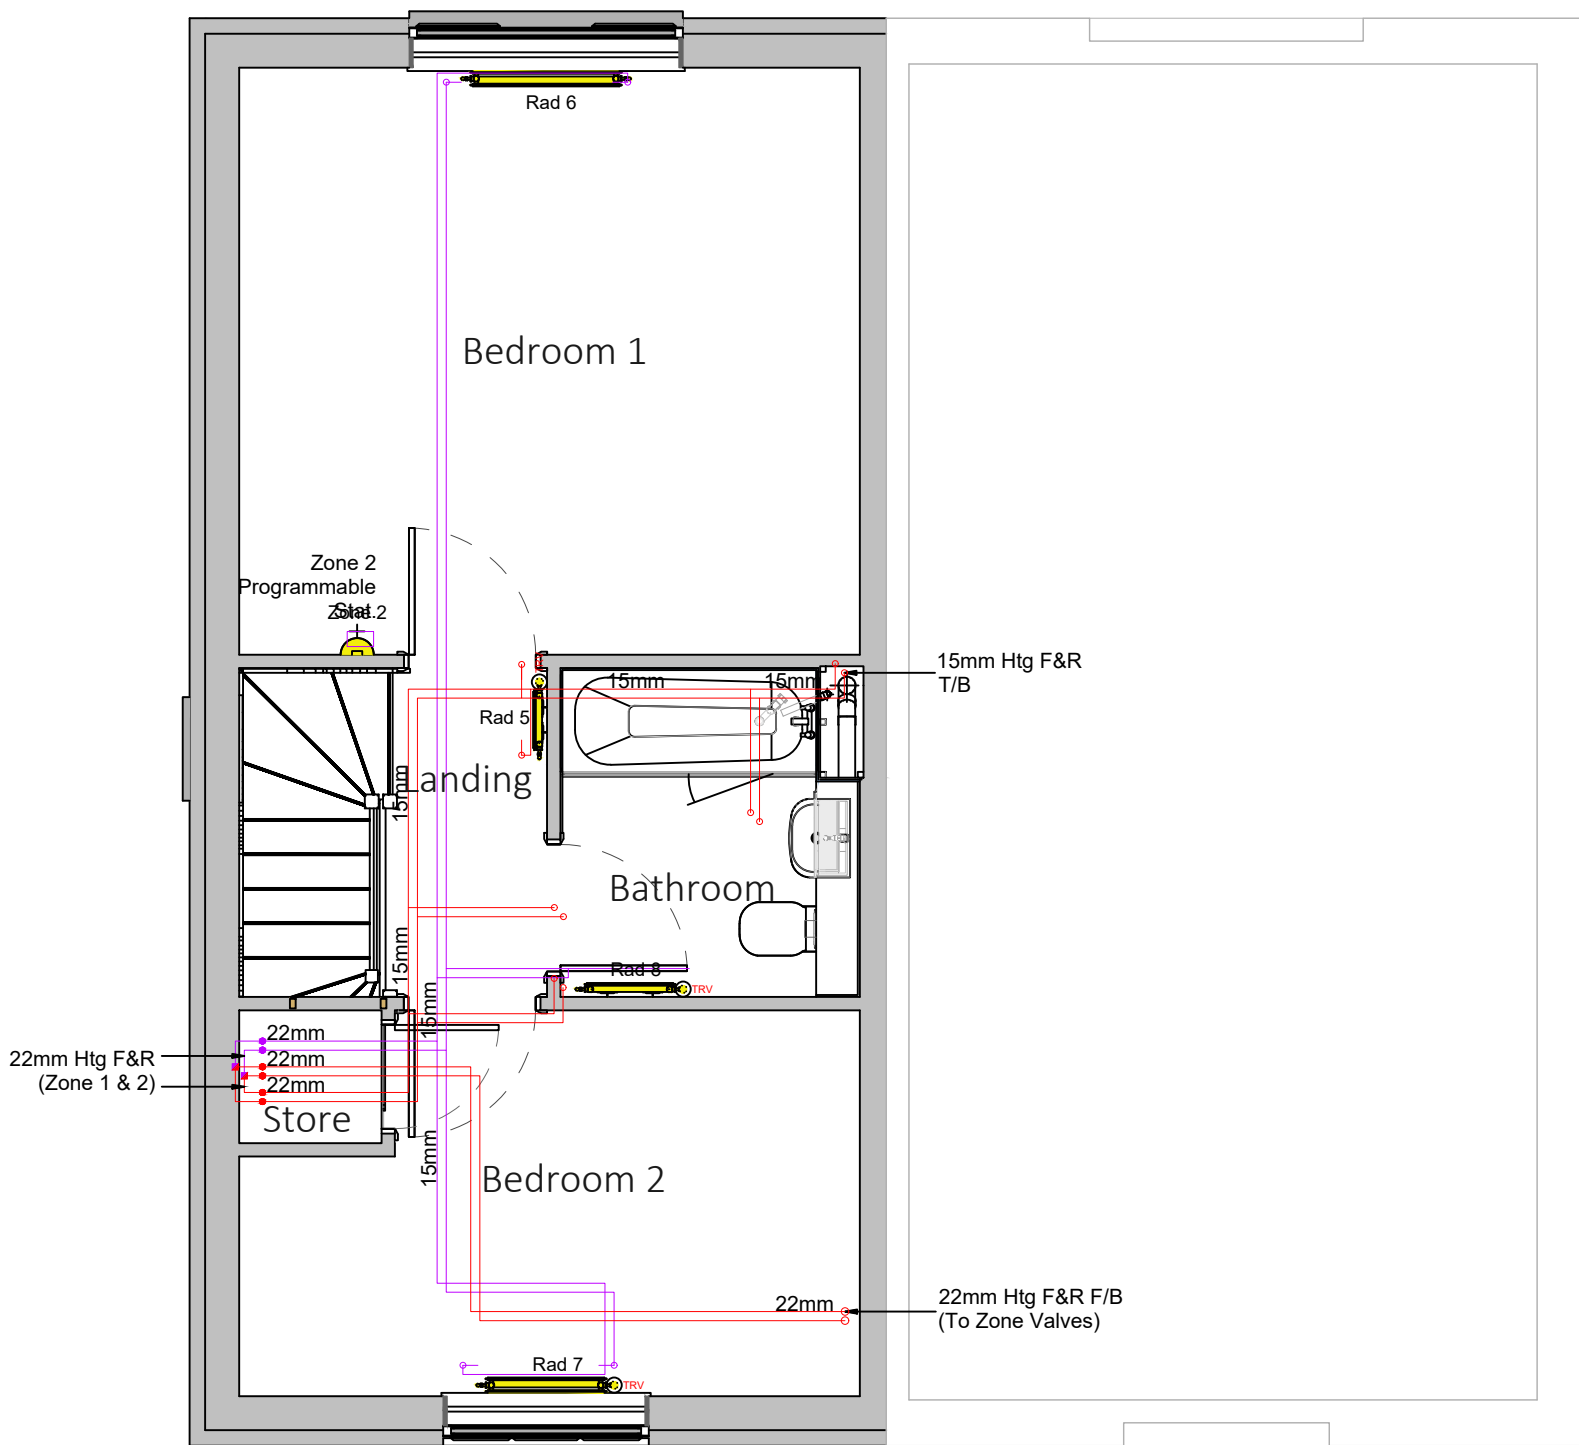

1 First Floor Heating GA  
1 : 50

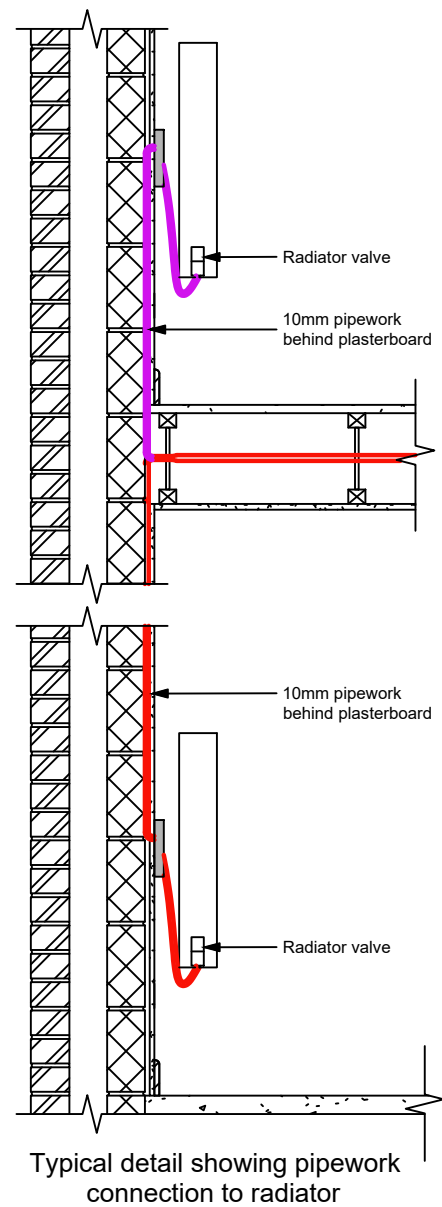

| Revision Schedule |          |                    |        |
|-------------------|----------|--------------------|--------|
| Rev               | Date     | Description        | Drn By |
| C1                | 01.12.25 | Construction Issue | FDL    |

**Notes**

All plumbing fitting and outlets must be fitted in accordance with manufacturers instructions and have isolating flow rate and pressure reducing valves as required. The installation must be in accordance with all relevant regulations.

The first metre of pipework from the boiler to be copper; all pipework in airing cupboard to be copper, all exposed pipework to be copper.

System to be balanced to achieve 55°C flow, 45°C return, with 10°C temperature drop across the boiler and radiators.

|                            |  |
|----------------------------|--|
| Gas Pipes                  |  |
| Zone 1 Flow   Return Pipes |  |
| Zone 2 Flow   Return Pipes |  |

Balanced flue to outside wall. The flue terminal must not be positioned less than 300mm from a window, air vent, or other ventilation opening; and must be fitted in accordance with the installation instructions.

All drops to ground floor radiators to be 10mm F&R TB unless otherwise stated with 15mm to point of drop.

Pipework routes should be confirmed as being compatible with joist layouts



Face-fix radiator pipe guide and seal to be utilised behind each radiator as above

**MECHANICAL**

**Bellway**  
www.bellway.co.uk

**Bellway Homes (Eastern Counties)**  
Building 2030, Cambourne Business Park,  
Cambridgeshire CB23 6DW  
Tel: 01480 425 200

Project  
**Somersham**  
St Ives Road  
Working Drawings

Building Regulations  
2013 & 2021  
Compliant

Drawing Title  
**The Hooper-Life**  
790 ft² | 2b Semi/Terr | All Variants  
First Floor Heating GA

**HPL-2B-2S-0**

|                                               |                                 |                          |
|-----------------------------------------------|---------------------------------|--------------------------|
| Drawing Created By<br>Group                   | First Issue Date<br>29 Nov 2022 | Scale(s)<br>As indicated |
| Project No                                    | Drg Status<br>Construction      | Revision<br>C1           |
| Drawing No.<br><b>BI01/790HP/80/0/2021/02</b> |                                 |                          |

2021 Regs Only

Do not scale - if in doubt, ask