



Main KPIs

865.07 ↓ 98.49% 57.19K

263.78K

date

All

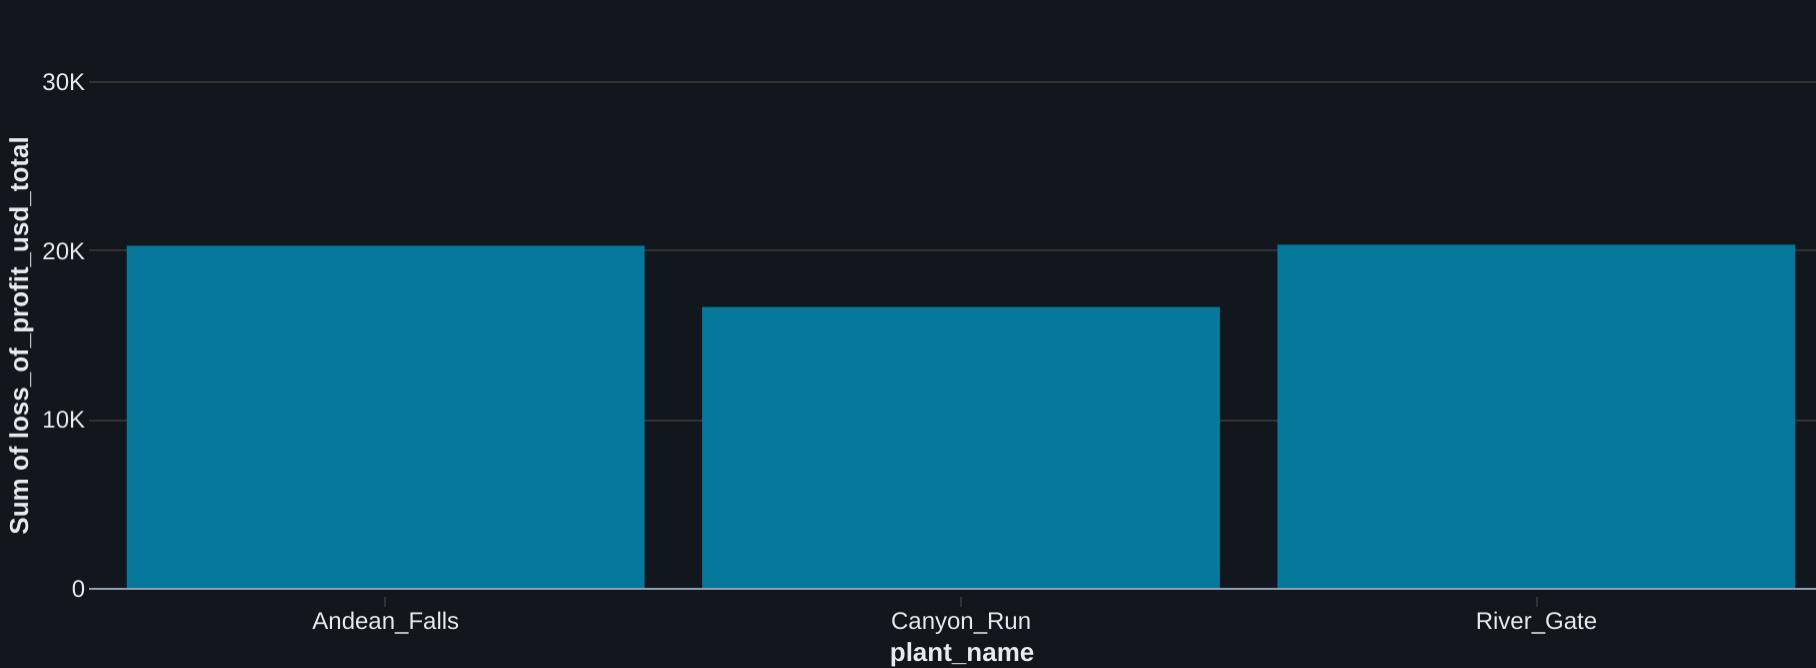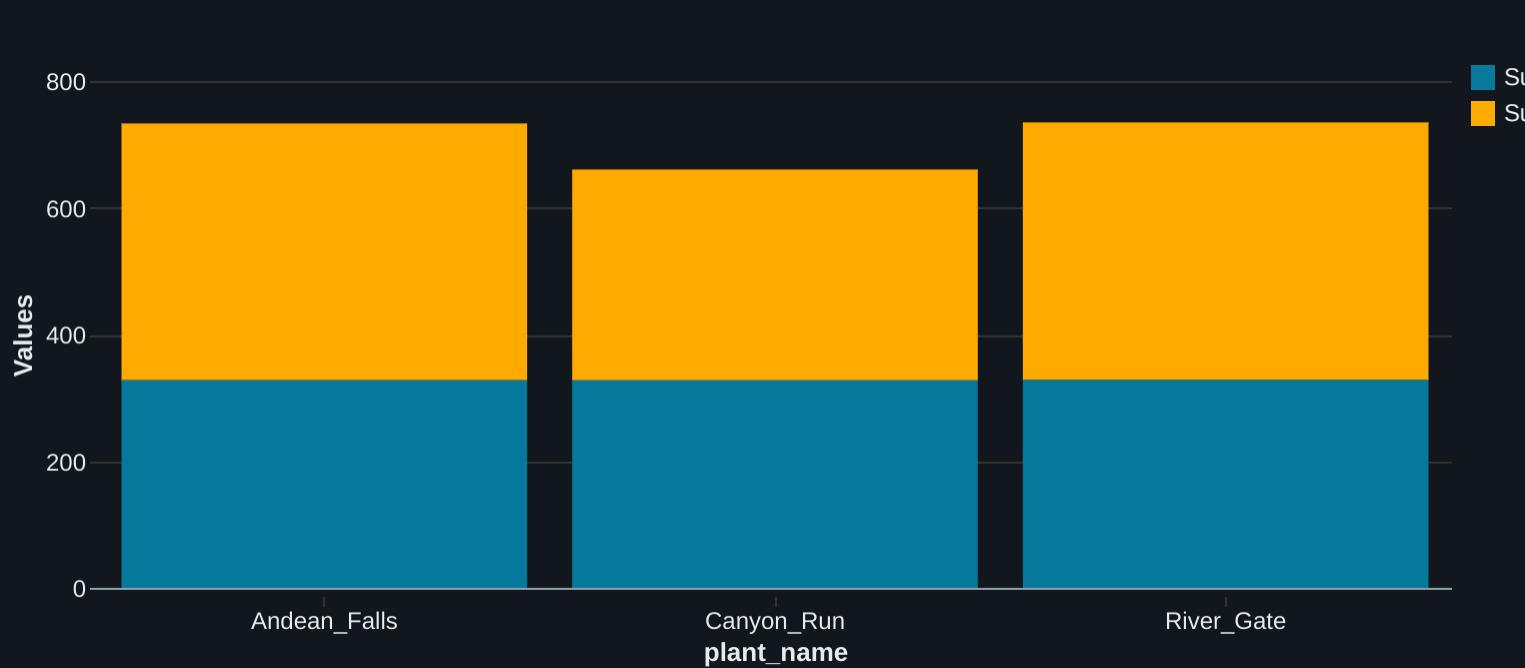

date	plant_name	avg_turbine_efficiency	avg_inflow_m3s	outage_hours	loss_of_profit_usd	energy_mwh
2024-01-01	Andean_Falls	0.90	220.26	0.00	0.00	108.48
2024-01-01	River_Gate	0.88	193.65	0.00	0.00	162.50
2024-01-01	Canyon_Run	0.89	142.65	0.00	0.00	179.49
2024-01-02	Andean_Falls	0.90	222.08	0.00	0.00	407.65
2024-01-02	River_Gate	0.90	192.82	0.00	0.00	255.10
2024-01-02	Canyon_Run	0.91	139.79	0.00	0.00	154.86
2024-01-03	Andean_Falls	0.89	222.73	0.00	0.00	324.94
2024-01-03	River_Gate	0.89	192.75	0.00	0.00	300.83