## TELECOMM / DATA CONNECTION SCHEDULE

| EQUIPMENT ID | EQUIPMENT DESCRIPTION | IDF | SWITCH / PORT |
|---|---|---|---|
| AHU-7 | AIR HANDLING UNIT #7 - MAIN OFFICE (EAST) | 2M11 | 2M11OT-SW01_3 |
| BAS-70001 | BAS PANEL | 2M11 | 2M11OT-SW01_7 |
| BAS-70002 | BAS PANEL | 2M11 | 2M11OT-SW01_8 |
| BAS-70003 | BAS PANEL | 2M11 | 2M11OT-SW01_9 |

Grand total: 4

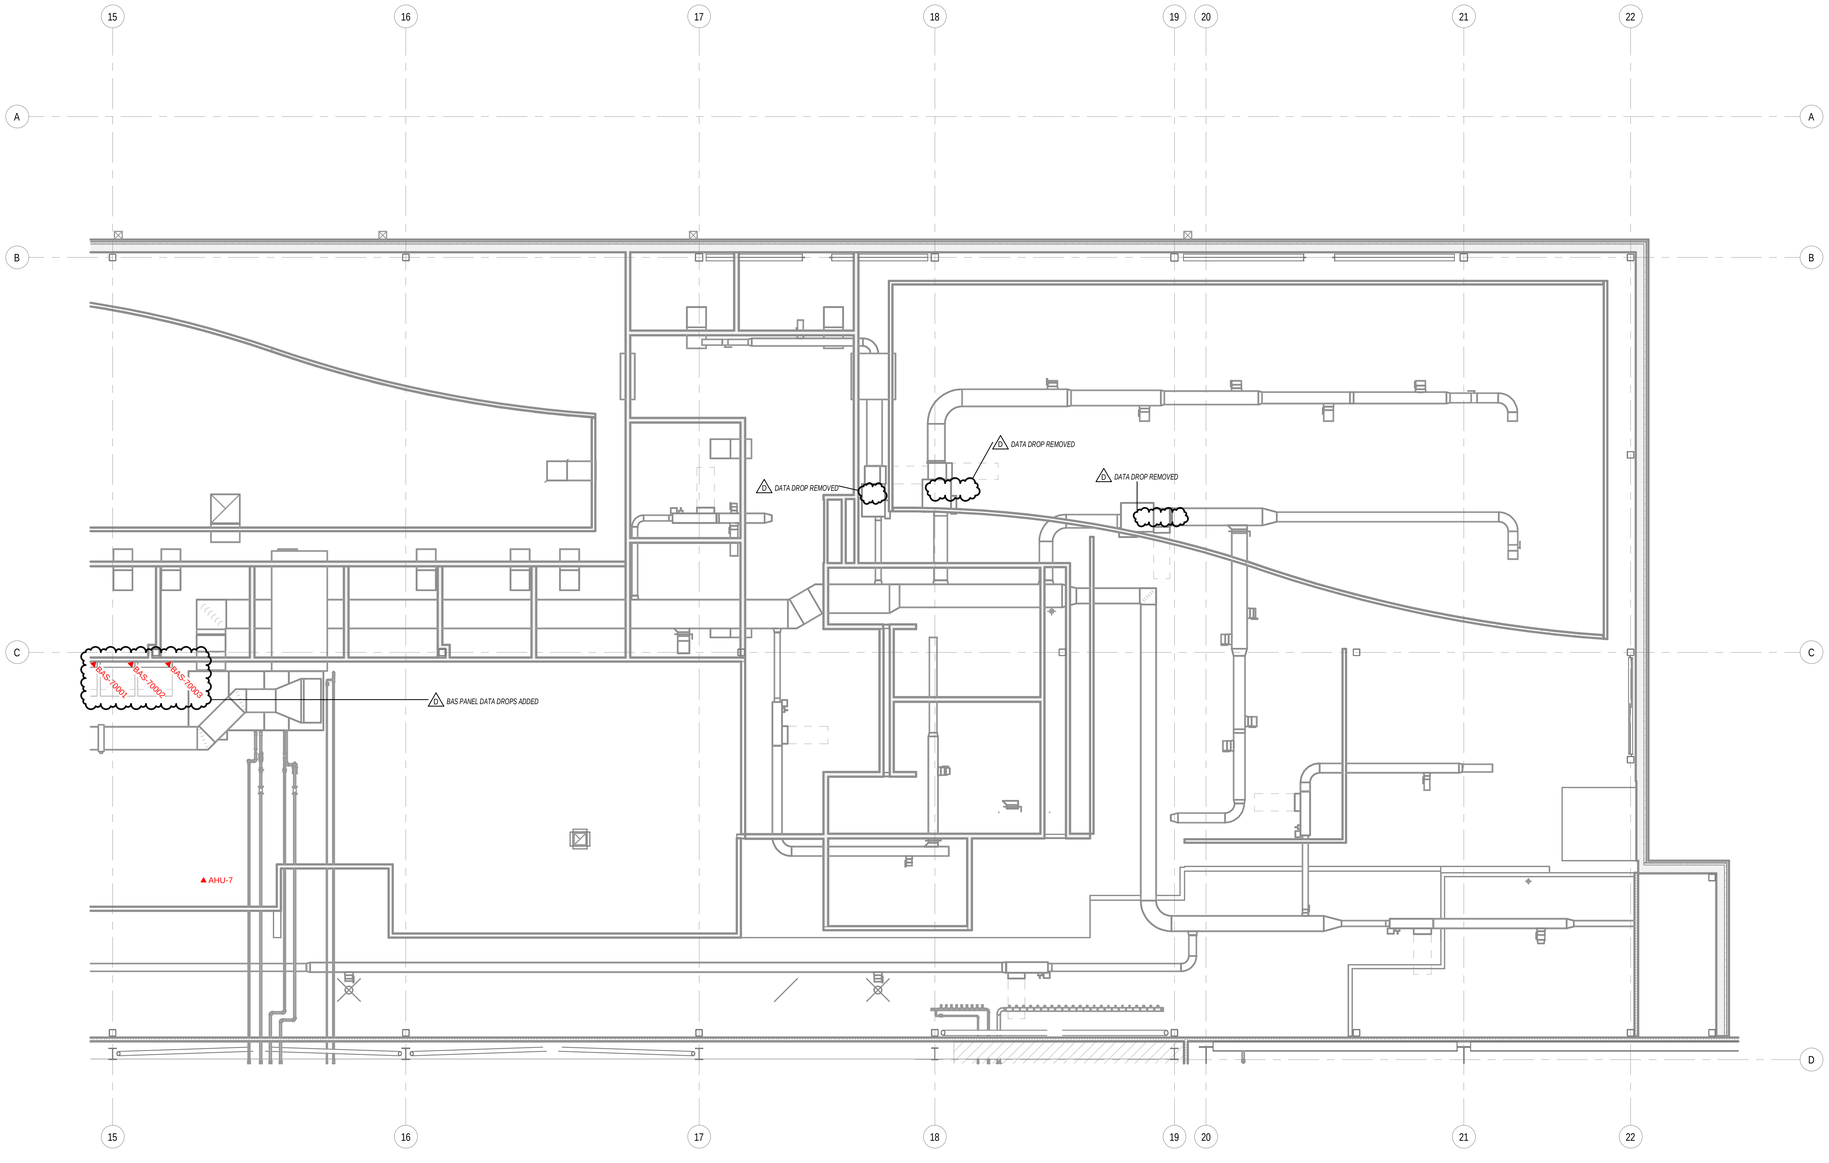


A1 ENLARGED PROCESS TELECOM 2ND FLOOR PLAN AREA 2, SECTOR 2

SCALE: 3/16" = 1'-0"

0' 4' 8' 12' 16'

NOTES

1. ALL NETWORK DROPS SHALL BE TAGGED ON BOTH ENDS OF CABLE WITH "FROM / TO" FORMAT WITH BRADY B-427 ROTATING VINYL WIRE LABELS. (EX. 2I01T-SW01_24 / TD-1001)

KEY PLAN

SECTORS

N

OWNER

PROJECT INFORMATION

**VITAL FARMS**
**EGG CENTRAL 2**
SEYMOUR,IN

OPERATING AS:
THE STELLAR GROUP
2900 HARTLEY ROAD, JACKSONVILLE, FL, 32257 (904) 260-2900
WWW.STELLAR.NET

SEAL

Professional certification. I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect/engineer under the laws of the state of IN

CONSULTANT

The Stellar Group, Inc.
All rights reserved. No part of this work may be used, reproduced, distributed, displayed, or otherwise communicated in any form or by any means without the prior written consent of The Stellar Group, Inc.

REVISIONS

| NO. | DESCRIPTION | DATE |
|---|---|---|
| A | DESIGN DEVELOPMENT 2 | 12/12/2025 |
| B | ISSUED FOR BID | 01/16/2026 |
| C | REVISED FOR BID | 02/06/2026 |
| D | GMP ISSUE | 04/02/2026 |

| | |
|---|---|
| DATE ISSUED: | 12/12/2025 |
| DESIGNED BY: | EJT |
| REVIEWED BY: | MAM |
| AIEOR: | |
| PROJECT NUMBER: | 07645 |

SHEET TITLE

PROCESS TELECOM 2ND FLOOR PLAN, AREA 2 SECTOR 2

SHEET ID

DT4222

PRINT IN COLOR

4/3/2026 1:15:51 AM Autodesk Docs://07645_Vital Farms Egg Central Station 2/07645_VF EGG ST1A 2_D_R23.rvt