TELECOMM / DATA CONNECTION SCHEDULE

EQUIPMENT ID	EQUIPMENT DESCRIPTION	IDF	SWITCH / PORT
ACCU-1	CRAC CONDENSING UNIT #1	2M11	2M11OT-SW01_1

Grand total: 1

NOTES

1. ALL NETWORK DROPS SHALL BE TAGGED ON BOTH ENDS OF CABLE WITH "FROM / TO" FORMAT WITH BRADY B-427 ROTATING VINYL WIRE LABELS.
(EX. 2001T-SW01_24 / TD-1001)

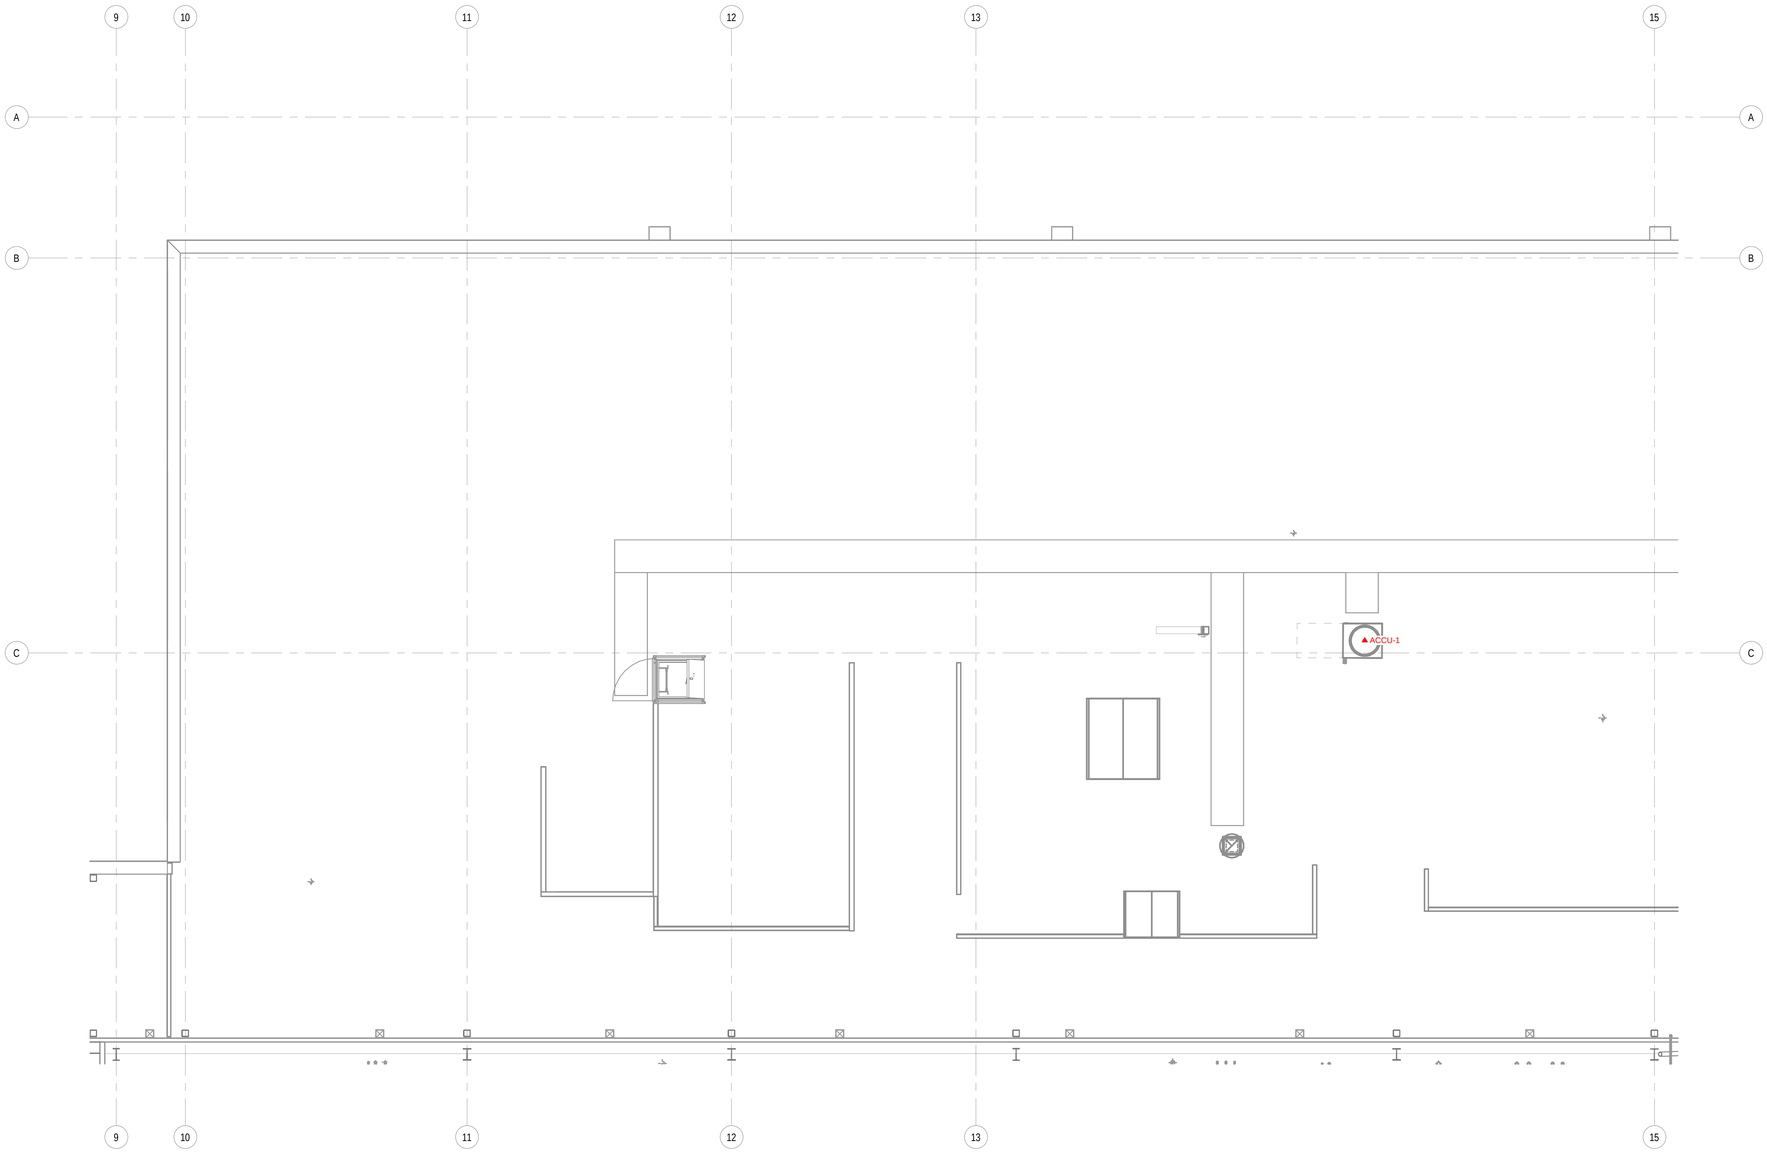

A1 ENLARGED PROCESS TELECOM ROOF FLOOR PLAN AREA 2, SECTOR 1

SCALE: 3/16" = 1'-0"

0' 4' 8' 12' 16'

KEY PLAN

SECTORS

N

OWNER

PROJECT INFORMATION

VITAL FARMS
EGG CENTRAL 2
SEYMOUR,IN

stellar
TAKING SOLUTIONS FURTHER

OPERATING AS:
THE STELLAR GROUP
2900 HARTLEY ROAD, JACKSONVILLE, FL, 32257 (904) 260-2900
WWW.STELLAR.NET

SEAL

Professional certification. I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect/engineer under the laws of the state of IN .

CONSULTANT

The Stellar Group, Inc.
All rights reserved. No part of this work may be used, reproduced, distributed, displayed, or otherwise communicated in any form or by any means without the prior written consent of The Stellar Group, Inc.

REVISIONS

NO.	DESCRIPTION	DATE
A	DESIGN DEVELOPMENT 2	12/12/2025
B	ISSUED FOR BID	01/16/2026
C	REVISED FOR BID	02/06/2026
D	GMP ISSUE	04/02/2026

DATE ISSUED:	12/12/2025
DESIGNED BY:	EJT
REVIEWED BY:	MAM
A/E/OR:	
PROJECT NUMBER:	07645

SHEET TITLE

PROCESS TELECOM ROOF PLAN, AREA 2 SECTOR 1

SHEET ID

DT4421

PRINT IN COLOR

4/3/2026 1:22:05 AM Autodesk Docs://07645_Vital Farms Egg Central Station 2/07645_VF EGG ST'A 2_D_R23.rvt