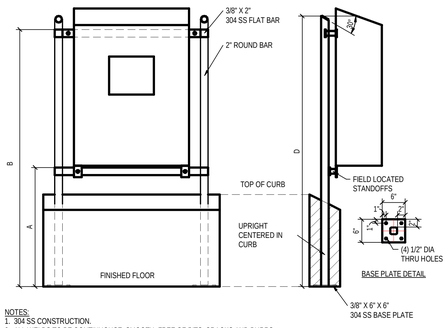

TAG	A	B	C	D
CMS-1				
CMS-2				

NOTES:
1. 304 SS CONSTRUCTION.
2. ALL WELDS TO BE CONTINUOUSE, SMOOTH, FREE OF PITS, CRACKS AND BURRS.
3. TOP OF HMI MOUNTED 60" AFF.
4. UTILIZE 2" LENGTH STAINLESS STEEL STANDOFFS FOR SECURING THE ENCLOSURE TO THE STRUCTURE AS REQUIRED.
5. UTILIZE 3/8" WEDGE ANCHORS TO ATTACH BASE PLATES TO THE FINISHED FLOOR BEFORE POURING CURB.

B1 CURB MOUNTED STAND DETAIL

SCALE: NOT TO SCALE

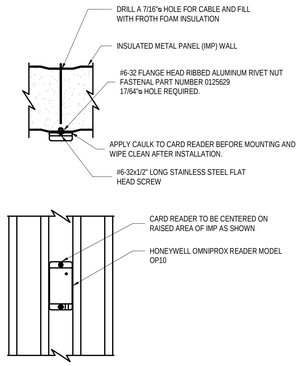

B3 IMP WALL CARD READER MOUNTING

SCALE: NOT TO SCALE

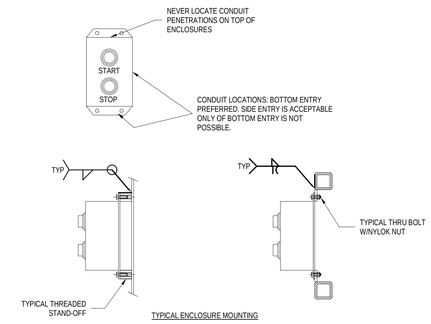

ALL WELDS TO BE CONTINUOUS, SMOOTH, FREE OF PITS, CRACKS AND BURRS. USE SOLID MACHINED STAND-OFF MATERIAL CONSTRUCTION. DO NOT USE PIPE OR TUBE. ELECTRICAL PANEL MOUNTING PUSH STATION SHOWN. THIS DETAIL APPLIES FOR DISCONNECTS AND ALL OTHER ELECTRICAL ENCLOSURES.

B4 ELECTRICAL ENCLOSURE MOUNTING

SCALE: NOT TO SCALE

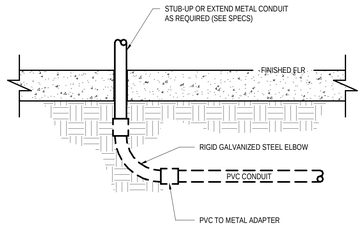

B5 PVC TO METAL CONDUIT DETAIL

SCALE: NOT TO SCALE

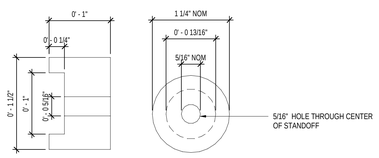

A1 NYLON BUSHING STANDOFF DETAIL

SCALE: NOT TO SCALE

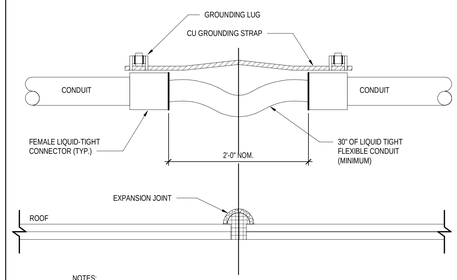

NOTES:
1. ALLOW FOR EQUIVALENT SLACK IN CABLES/WIRES WHEN PULLING.
2. CONDITION SHOWN IS FOR CONDUIT ROUTED ABOVE ROOF. BELOW ROOF ELECTRICAL EXPANSION JOINT SIMILAR. VERIFY ALL CONDUIT TYPE REQUIREMENTS WITH ELECTRICAL SPECIFICATIONS AND DRAWINGS.

A2 CONDUIT EXPANSION JOINT GROUNDING

SCALE: NOT TO SCALE

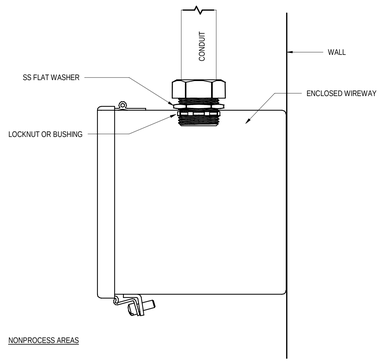

A3 CONDUIT TO WIREWAY CONNECTION

SCALE: NOT TO SCALE

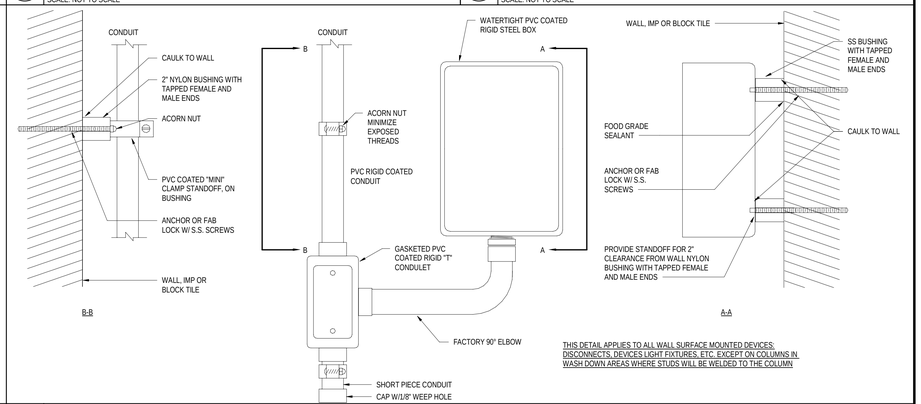

THIS DETAIL APPLIES TO ALL WALL SURFACE MOUNTED DEVICES: DISCONNECTS, DEVICES LIGHT FIXTURES, ETC. EXCEPT ON COLUMNS IN WASH DOWN AREAS WHERE STUDS WILL BE WELDED TO THE COLUMN

A4 PROCESS ROOMS RECEPTACLE AND BOX DETAIL

SCALE: NOT TO SCALE

OWNER

PROJECT INFORMATION

VITAL FARMS
EGG CENTRAL 2
SEYMOUR,IN

stellar
TAKING SOLUTIONS FURTHER

OPERATING AS:
THE STELLAR GROUP
2900 HARTLEY ROAD, JACKSONVILLE, FL, 32257 (904) 260-2900
WWW.STELLAR.NET

SEAL

Professional certification. I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect/engineer under the laws of the state of IN .

CONSULTANT

The Stellar Group, Inc.
All rights reserved. No part of this work may be used, reproduced, distributed, displayed, or otherwise communicated in any form or by any means without the prior written consent of The Stellar Group, Inc.

REVISIONS

NO.	DESCRIPTION	DATE
A	REVISED FOR BID	02/06/2026
B	GMP ISSUE	04/02/2026

DATE ISSUED:	12/12/2025
DESIGNED BY:	EJT
REVIEWED BY:	MAM
A/EOR:	
PROJECT NUMBER:	07645

SHEET TITLE

STANDARD ELECTRICAL POWER DETAILS

SHEET ID

DT5002

4/3/2026 1:45:51 AM Autodesk Docs://07645_Vital Farms Egg Central Station 2/07645_VF EGG STA 2_D_R23.rvt