BILL OF MATERIALS

ITEM	REQ'D	DESCRIPTION
1	1	42U TRIPP-LITE 30" WIDE RACK W/ 6FT CABLE MANAGER, M/N SR42UBWDVRT
2	2	1U PANDUIT OPTICOM RACK MOUNT FIBER ENCLOSURE, M/N FRME1U
3	2	1U PANDUIT DUPLEX LC OPTICOM FIBER ADAPTER PANEL
4	25	1U PANDUIT HORIZONTAL BLACK STEEL FILLER PANEL, M/N DPFP1
5	5	ARISTA 48-PORT NETWORK SWITCH
6	10	1U PANDUIT 24-PORT ETHERNET PATCH PANEL, M/N CPP24WBLY
7	2	EATON MANAGED RACK PDU, 200-240V, 5.76kW MAX, NEMAL6-30P INPUT, TWENTY (20) IEC C13 & FOUR (4) IEC19 OUTPUTS, M/N EMA107-10

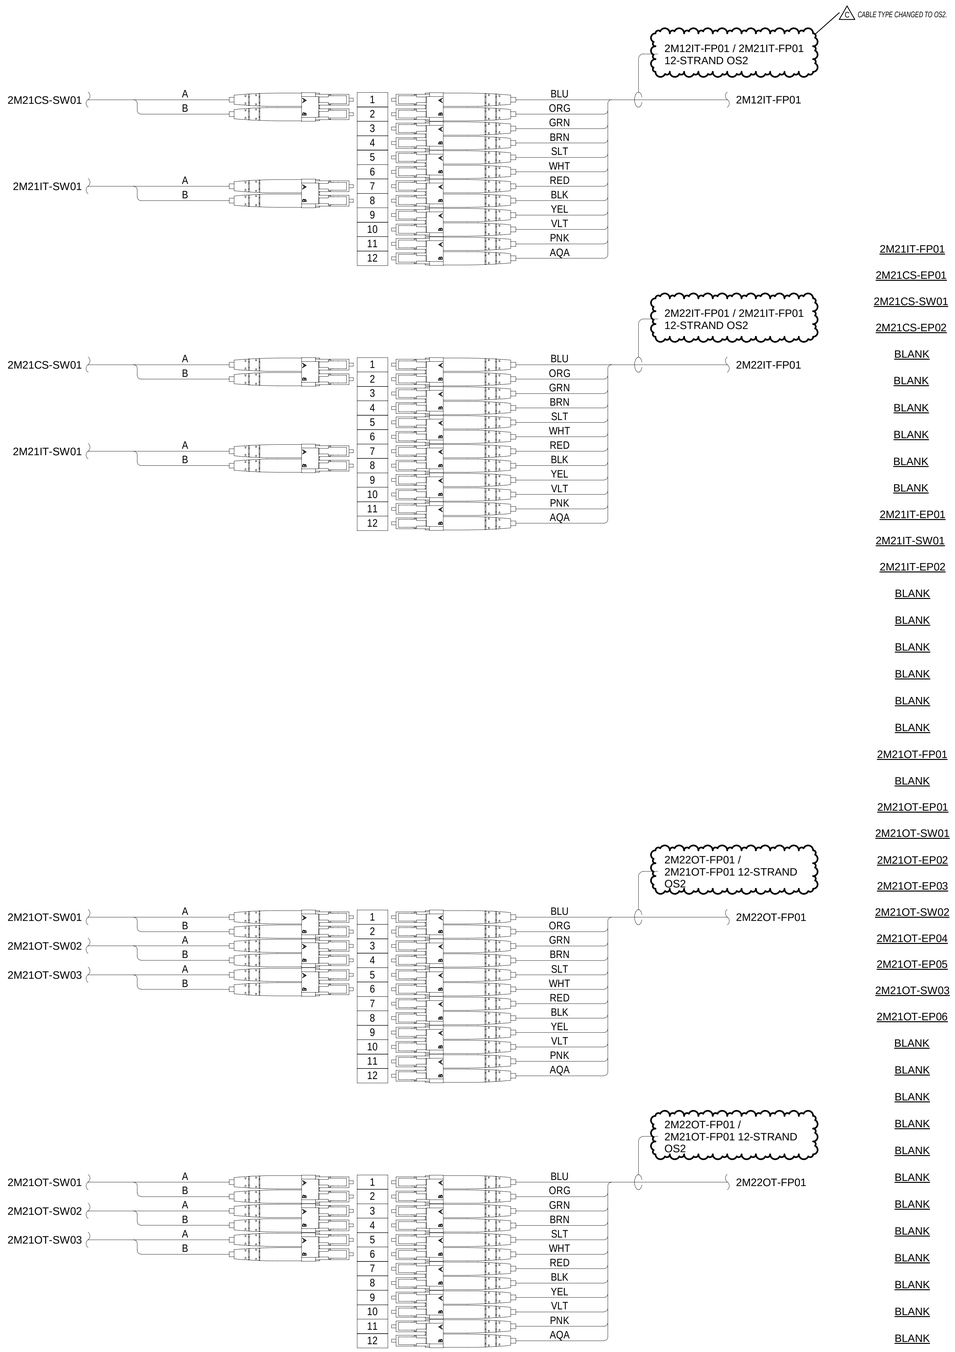

2M21IT-FP01
2M21CS-EP01
2M21CS-SW01
2M21CS-EP02
BLANK
BLANK
BLANK
BLANK
BLANK
BLANK
2M21IT-EP01
2M21IT-SW01
2M21IT-EP02
BLANK
BLANK
BLANK
BLANK
BLANK
BLANK
2M21OT-FP01
BLANK
2M21OT-EP01
2M21OT-SW01
2M21OT-EP02
2M21OT-EP03
2M21OT-SW02
2M21OT-EP04
2M21OT-EP05
2M21OT-SW03
2M21OT-EP06
BLANK
BLANK
BLANK
BLANK
BLANK
BLANK
BLANK
BLANK
BLANK
BLANK
BLANK

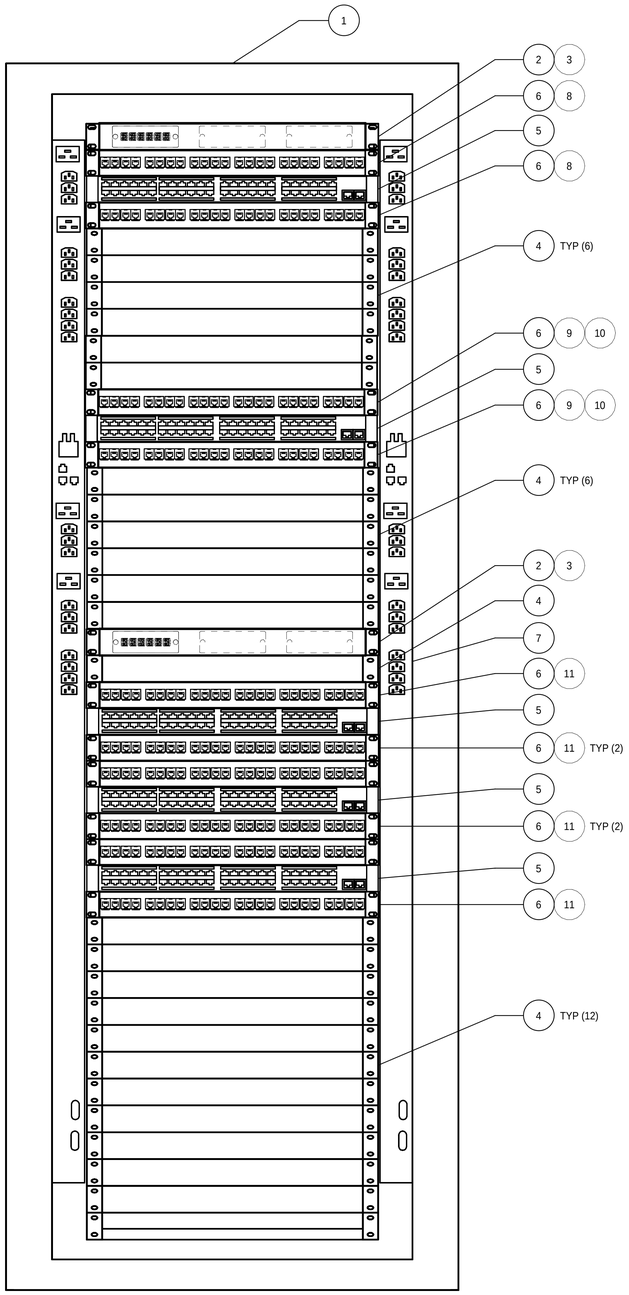

A3 MDF 2M21 LAYOUT
SCALE: 3" = 1'-0"

NOTES

1. CUSTOMER WILL PROVIDE ALL NETWORK SWITCHES
2. KEEP POWER & COMMUNICATION CABLES ROUTED AS SEPARATELY AS POSSIBLE - CROSS AT 90 IF CABLES MUST CROSS
3. ALL NETWORK DROPS SHALL BE TAGGED ON BOTH ENDS OF CABLE WITH "FROM/TO" FORMAT WITH BRADY B-427 ROTATING VINYL WIRE LABELS (EX. 2I01IT-SW01_24 / TD-1001)
4. PATCH CABLES FROM SWITCH TO PATCH PANEL SHALL BE TAGGED WITH FINAL EQUIPMENT / DEVICE NUMBER (EX. 2M11, WAP-1001, ETC)

IDF / MDF RACK & DEVICE LEGEND

ABXX-YYZZ

- SEQUENTIAL NUMBER
- DEVICE ABBREVIATION
  - EP = ETHERNET PATCH PANEL
  - FP = FIBER OPTIC PATCH PANEL
  - PD = POWER DISTRIBUTION UNIT
  - SW = NETWORK SWITCH
- NETWORK
  - IT = INFORMATION TECHNOLOGY
  - OT = OPERATIONAL TECHNOLOGY
  - CS = CAMERA SYSTEM
- IDF CABINET NUMBER (i01, i02, i03…)
  MDF CABINET NUMBER (M11, M12, M13…)
- FACILITY ENUMERATION (1, 2, 3…)

OWNER

PROJECT INFORMATION

VITAL FARMS
EGG CENTRAL 2
SEYMOUR,IN

OPERATING AS:
THE STELLAR GROUP
2900 HARTLEY ROAD, JACKSONVILLE, FL 32257 (904) 260-2900
WWW.STELLAR.NET

SEAL

Professional certification. I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect/engineer under the laws of the state of IN.

CONSULTANT

The Stellar Group, Inc.
All rights reserved. No part of this work may be used, reproduced, distributed, displayed, or otherwise communicated in any form or by any means without the prior written consent of The Stellar Group, Inc.

REVISIONS

NO.	DESCRIPTION	DATE
A	ISSUED FOR BID	01/16/2026
B	REVISED FOR BID	02/06/2026
C	GMP ISSUE	04/02/2026

DATE ISSUED:	01/09/2026
DESIGNED BY:	ARS
REVIEWED BY:	CDS
A/EOR:	
PROJECT NUMBER:	07645

SHEET TITLE

MDF 2M21 LAYOUT & DETAIL

SHEET ID

DT6021

4/3/2026 1:44:30 AM Autodesk Docs://07645_Vital Farms Egg Central Station 2/07645_VF EGG STA 2_D_R23.rvt