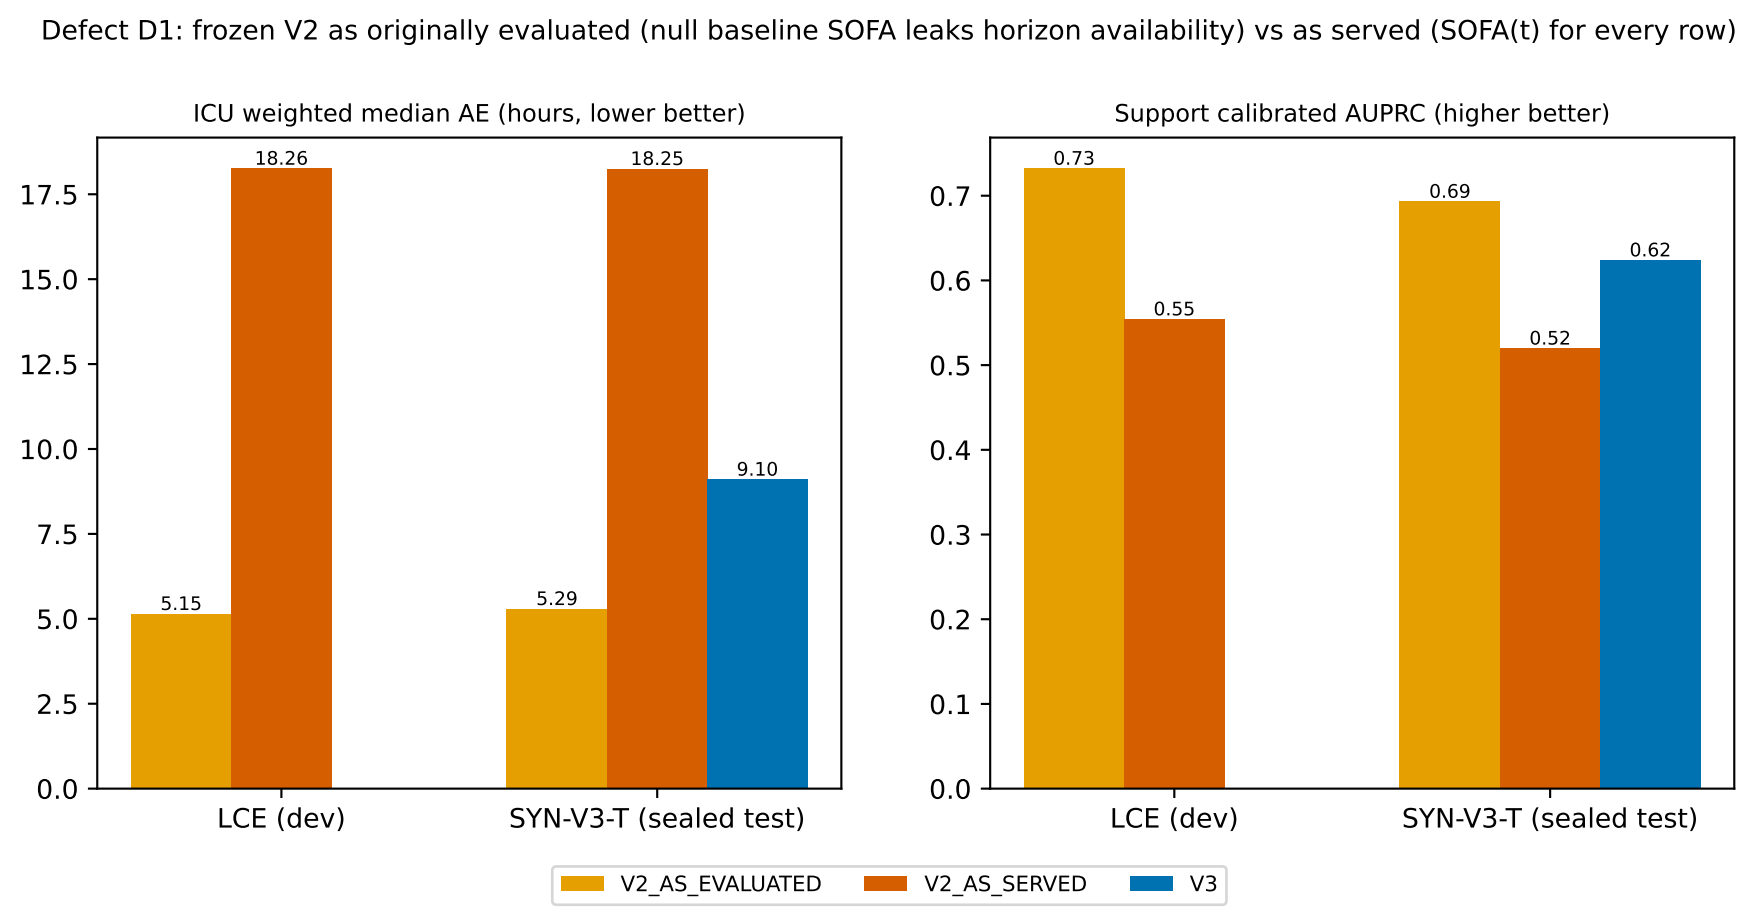
Defect D1: frozen V2 as originally evaluated (null baseline SOFA leaks horizon availability) vs as served (SOFA(t) for every row)
ICU weighted median AE (hours, lower better)
18.26
18.25
9.10
5.15
5.29
17.5
15.0
12.5
10.0
7.5
5.0
2.5
0.0
LCE (dev)
SYN-V3-T (sealed test)
Support calibrated AUPRC (higher better)
0.73
0.55
0.69
0.52
0.62
0.7
0.6
0.5
0.4
0.3
0.2
0.1
0.0
LCE (dev)
SYN-V3-T (sealed test)
V2_AS_EVALUATED
V2_AS_SERVED
V3