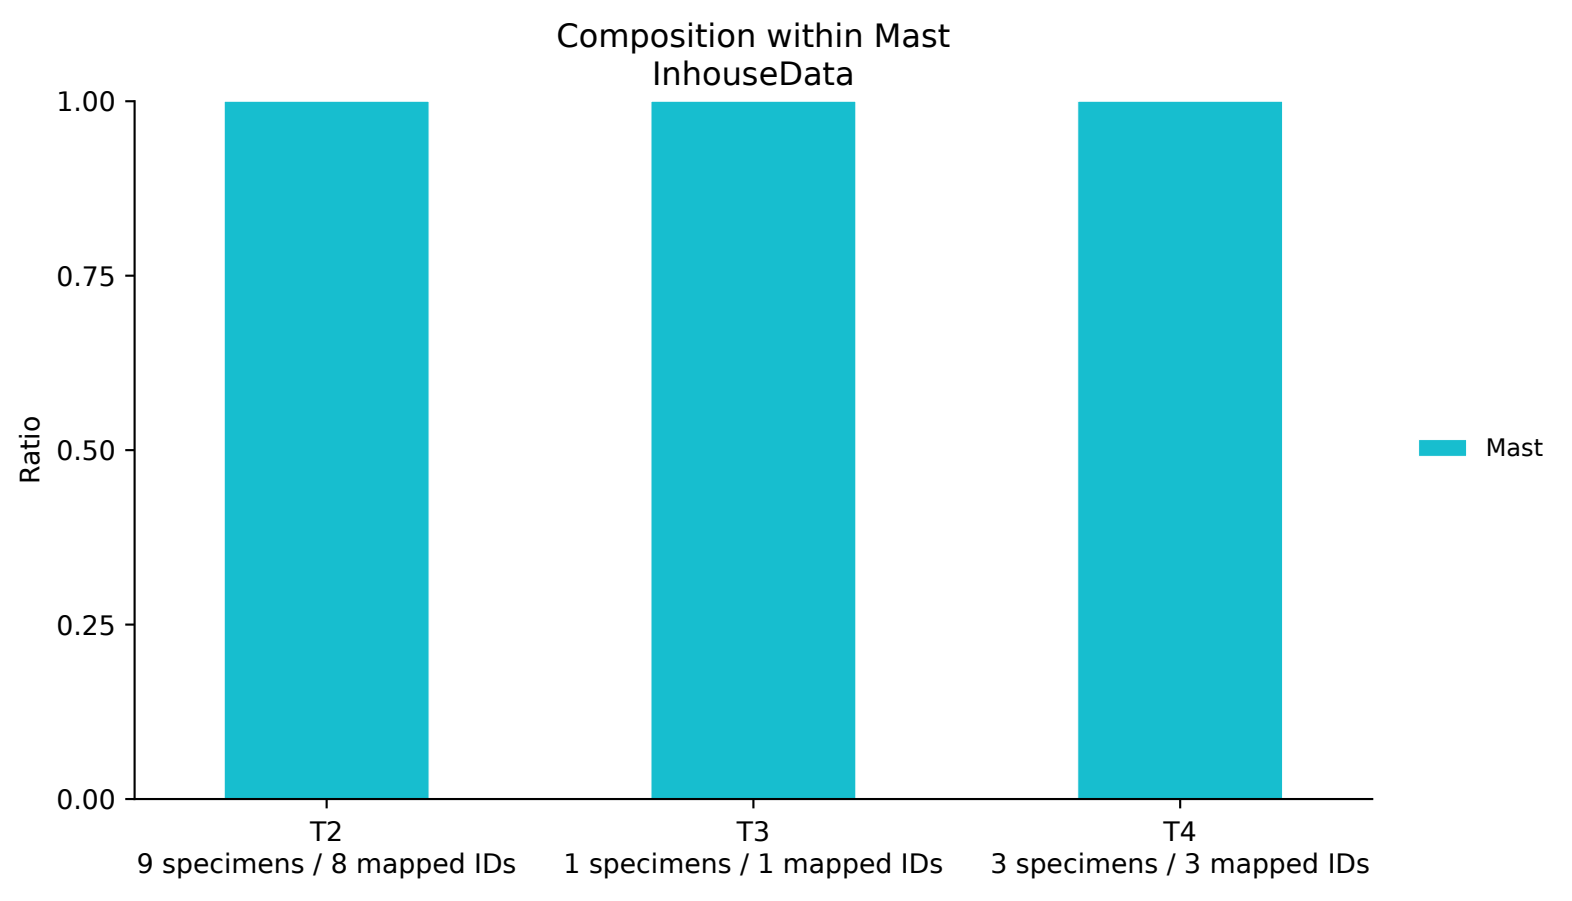
Composition within Mast
InhouseData
Ratio
1.00
0.75
0.50
0.25
0.00
T2
9 specimens / 8 mapped IDs
T3
1 specimens / 1 mapped IDs
T4
3 specimens / 3 mapped IDs
Mast