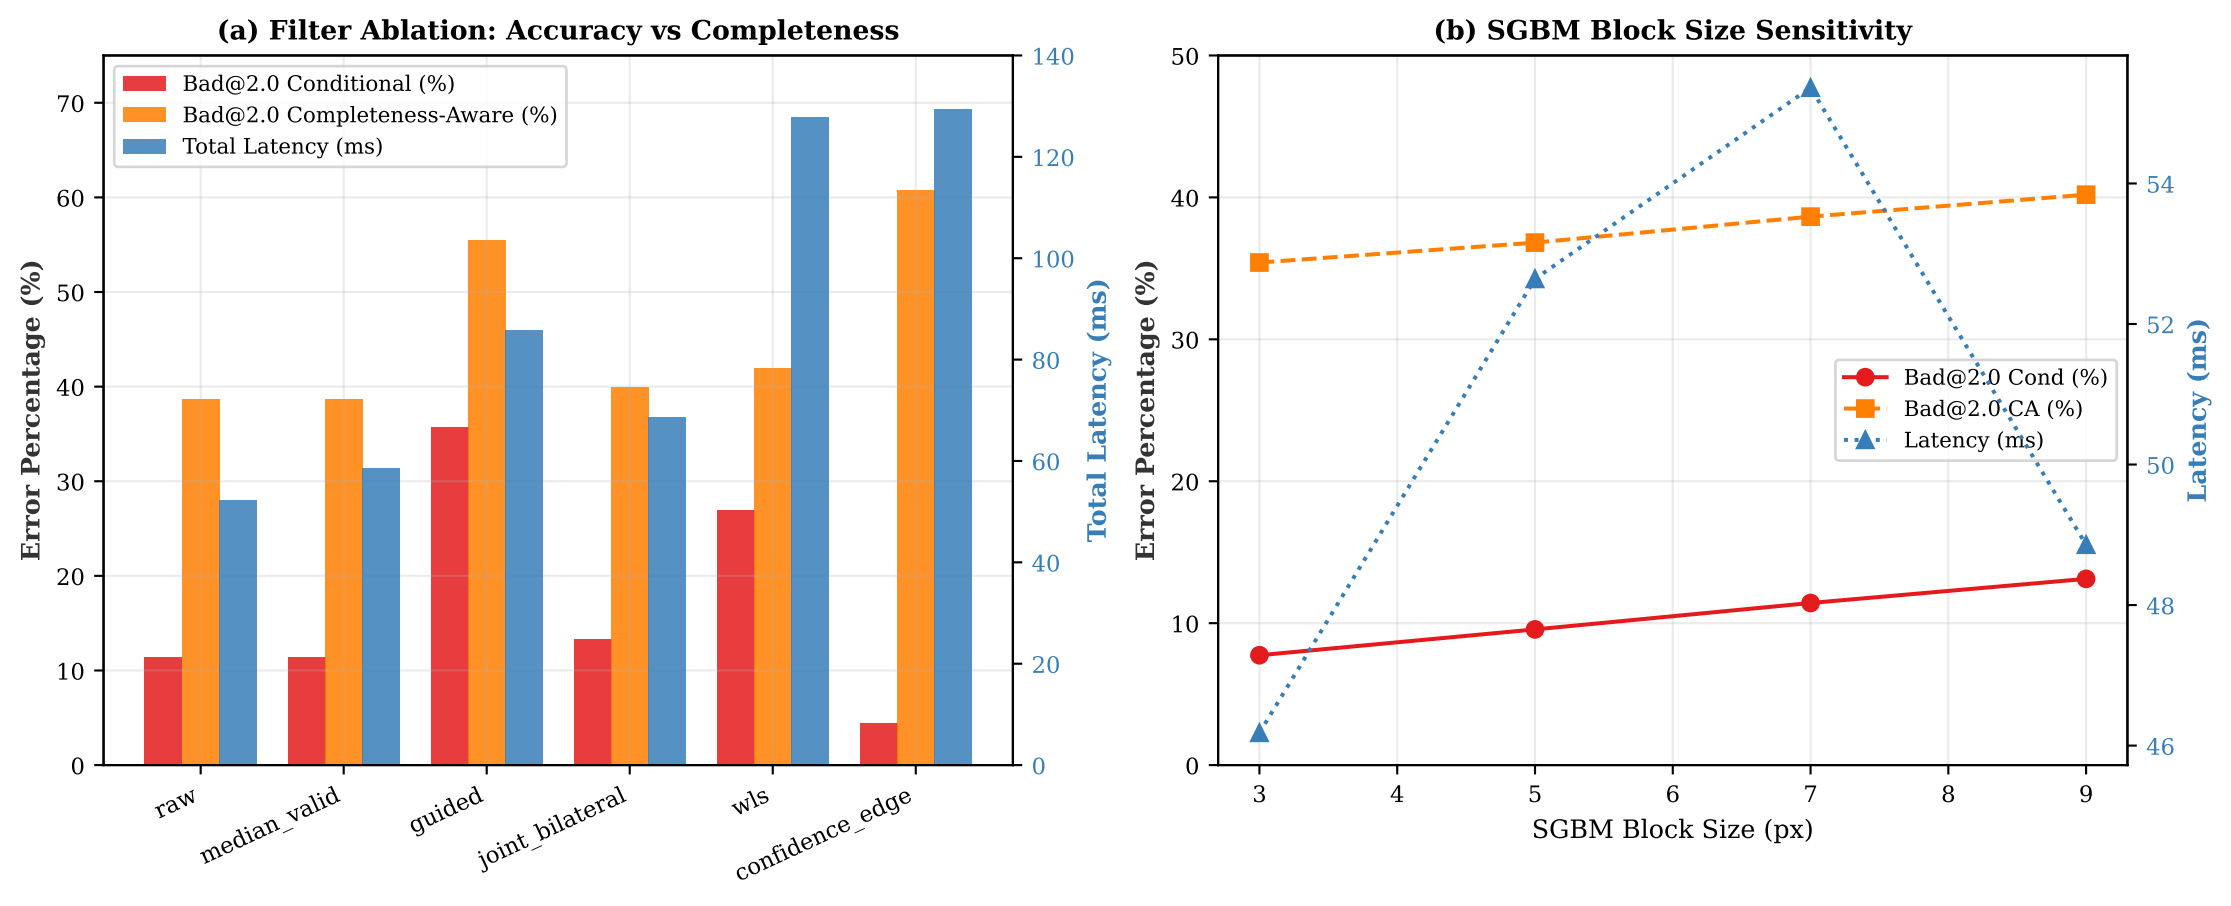
(a) Filter Ablation: Accuracy vs Completeness
Bad@2.0 Conditional (%)
Bad@2.0 Completeness-Aware (%)
Total Latency (ms)
Error Percentage (%)
Total Latency (ms)
0
10
20
30
40
50
60
70
0
20
40
60
80
100
120
140
raw
median_valid
guided
joint_bilateral
wls
confidence_edge
(b) SGBM Block Size Sensitivity
Bad@2.0 Cond (%)
Bad@2.0 CA (%)
Latency (ms)
Error Percentage (%)
Latency (ms)
SGBM Block Size (px)
0
10
20
30
40
50
46
48
50
52
54
3
4
5
6
7
8
9