


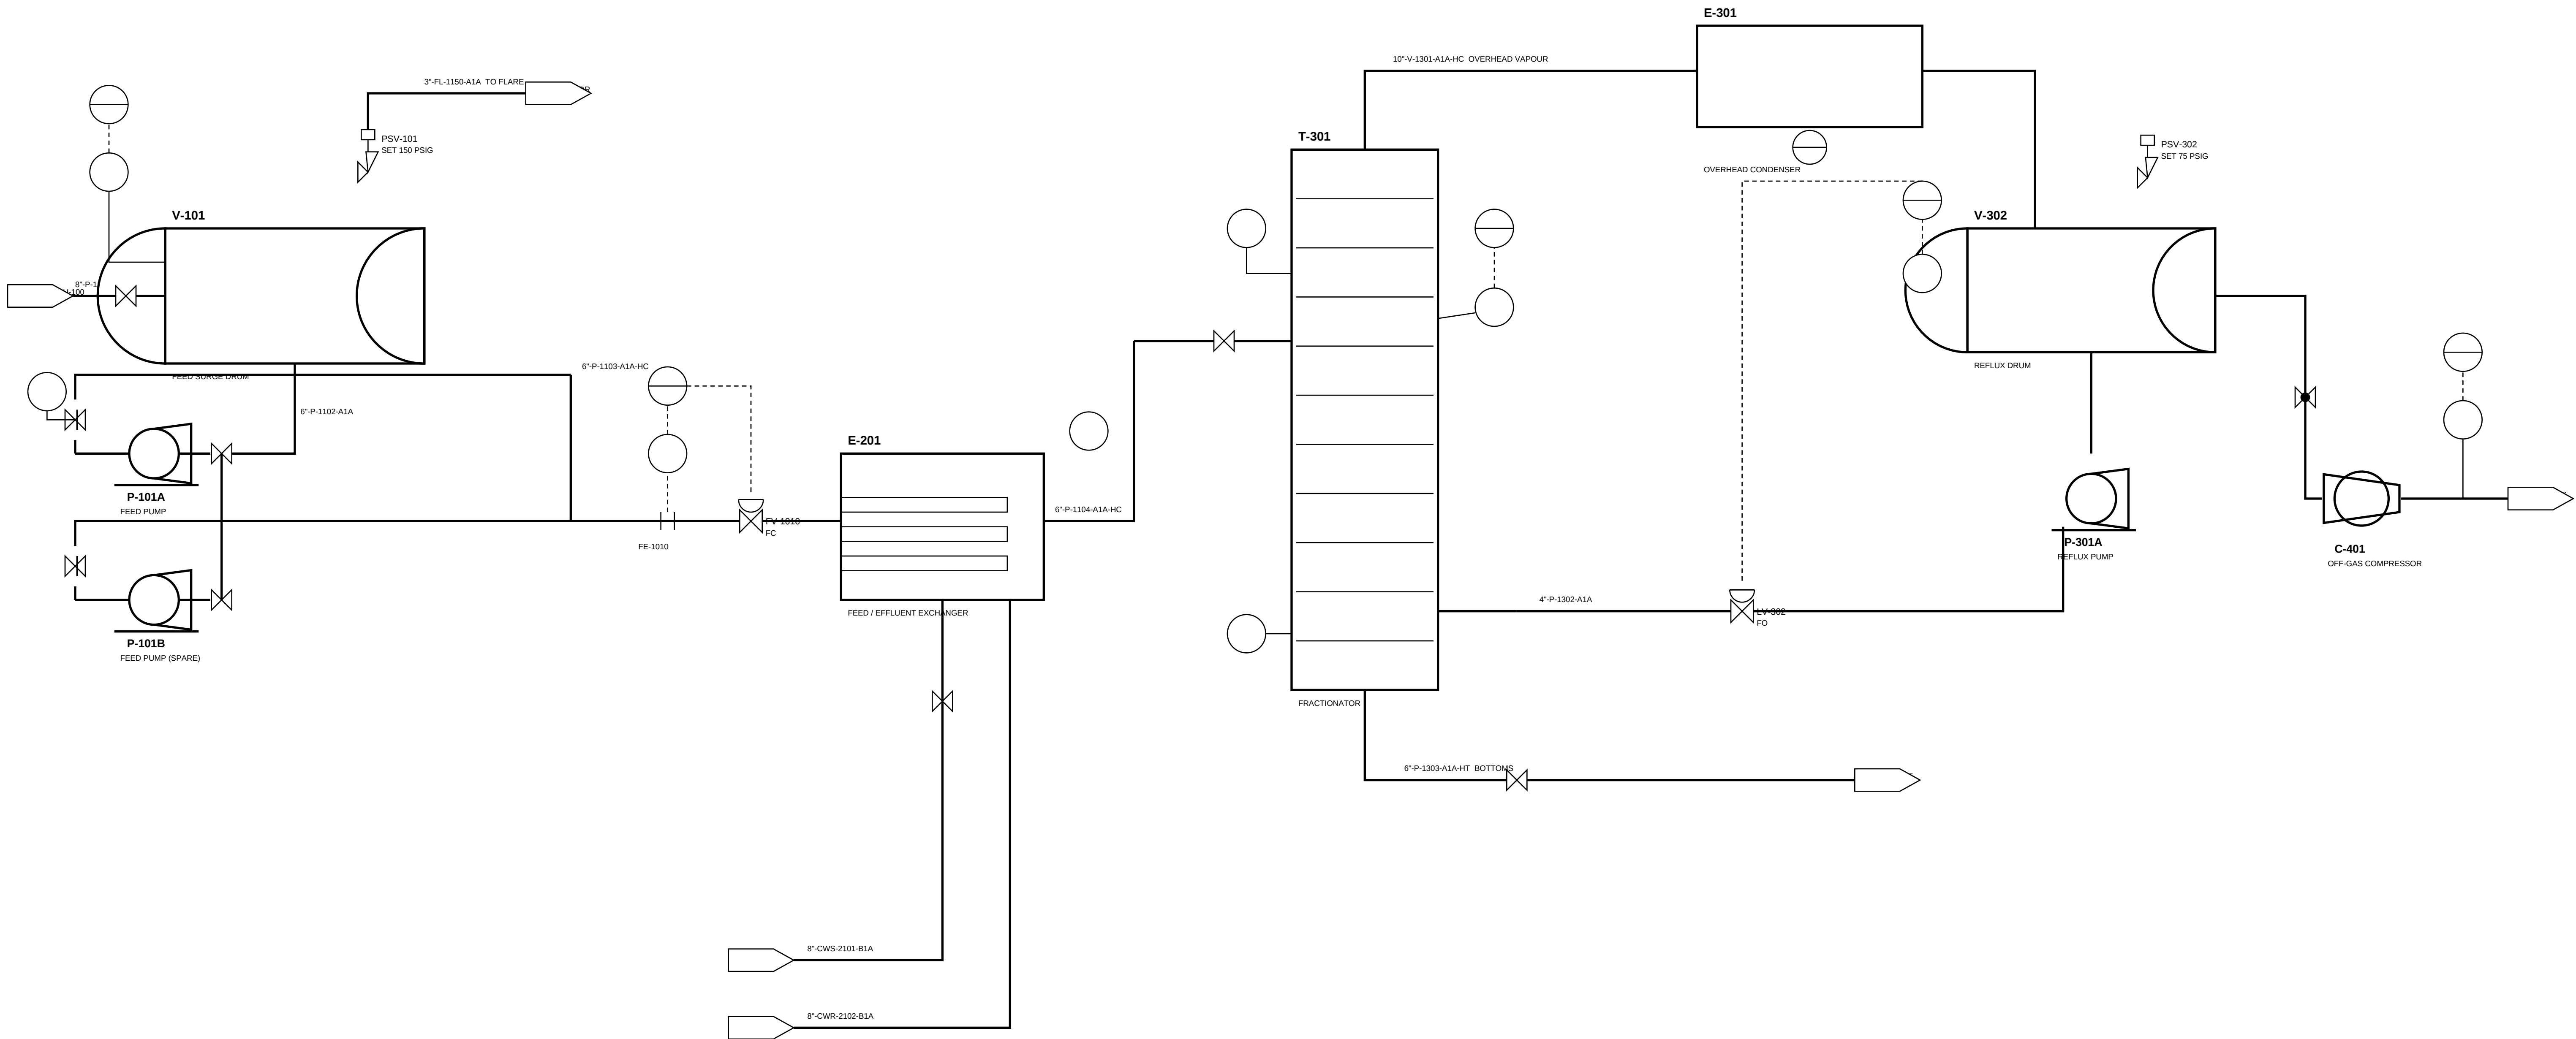

NOTES:

1. ALL VALVES 6" AND LARGER TO BE GATE UNLESS NOTED OTHERWISE.
2. INSTRUMENT AIR SUPPLY TO ALL CONTROL VALVES PER DWG D-3001.
3. PSV-101 AND PSV-302 DISCHARGE TO FLARE HEADER, DWG D-1002.
4. P-101B IS AN INSTALLED SPARE, AUTO-START ON LOW DISCHARGE PRESSURE.
5. LINE CLASS A1A = CARBON STEEL 150#, B1A = CARBON STEEL 150# UTILITY.