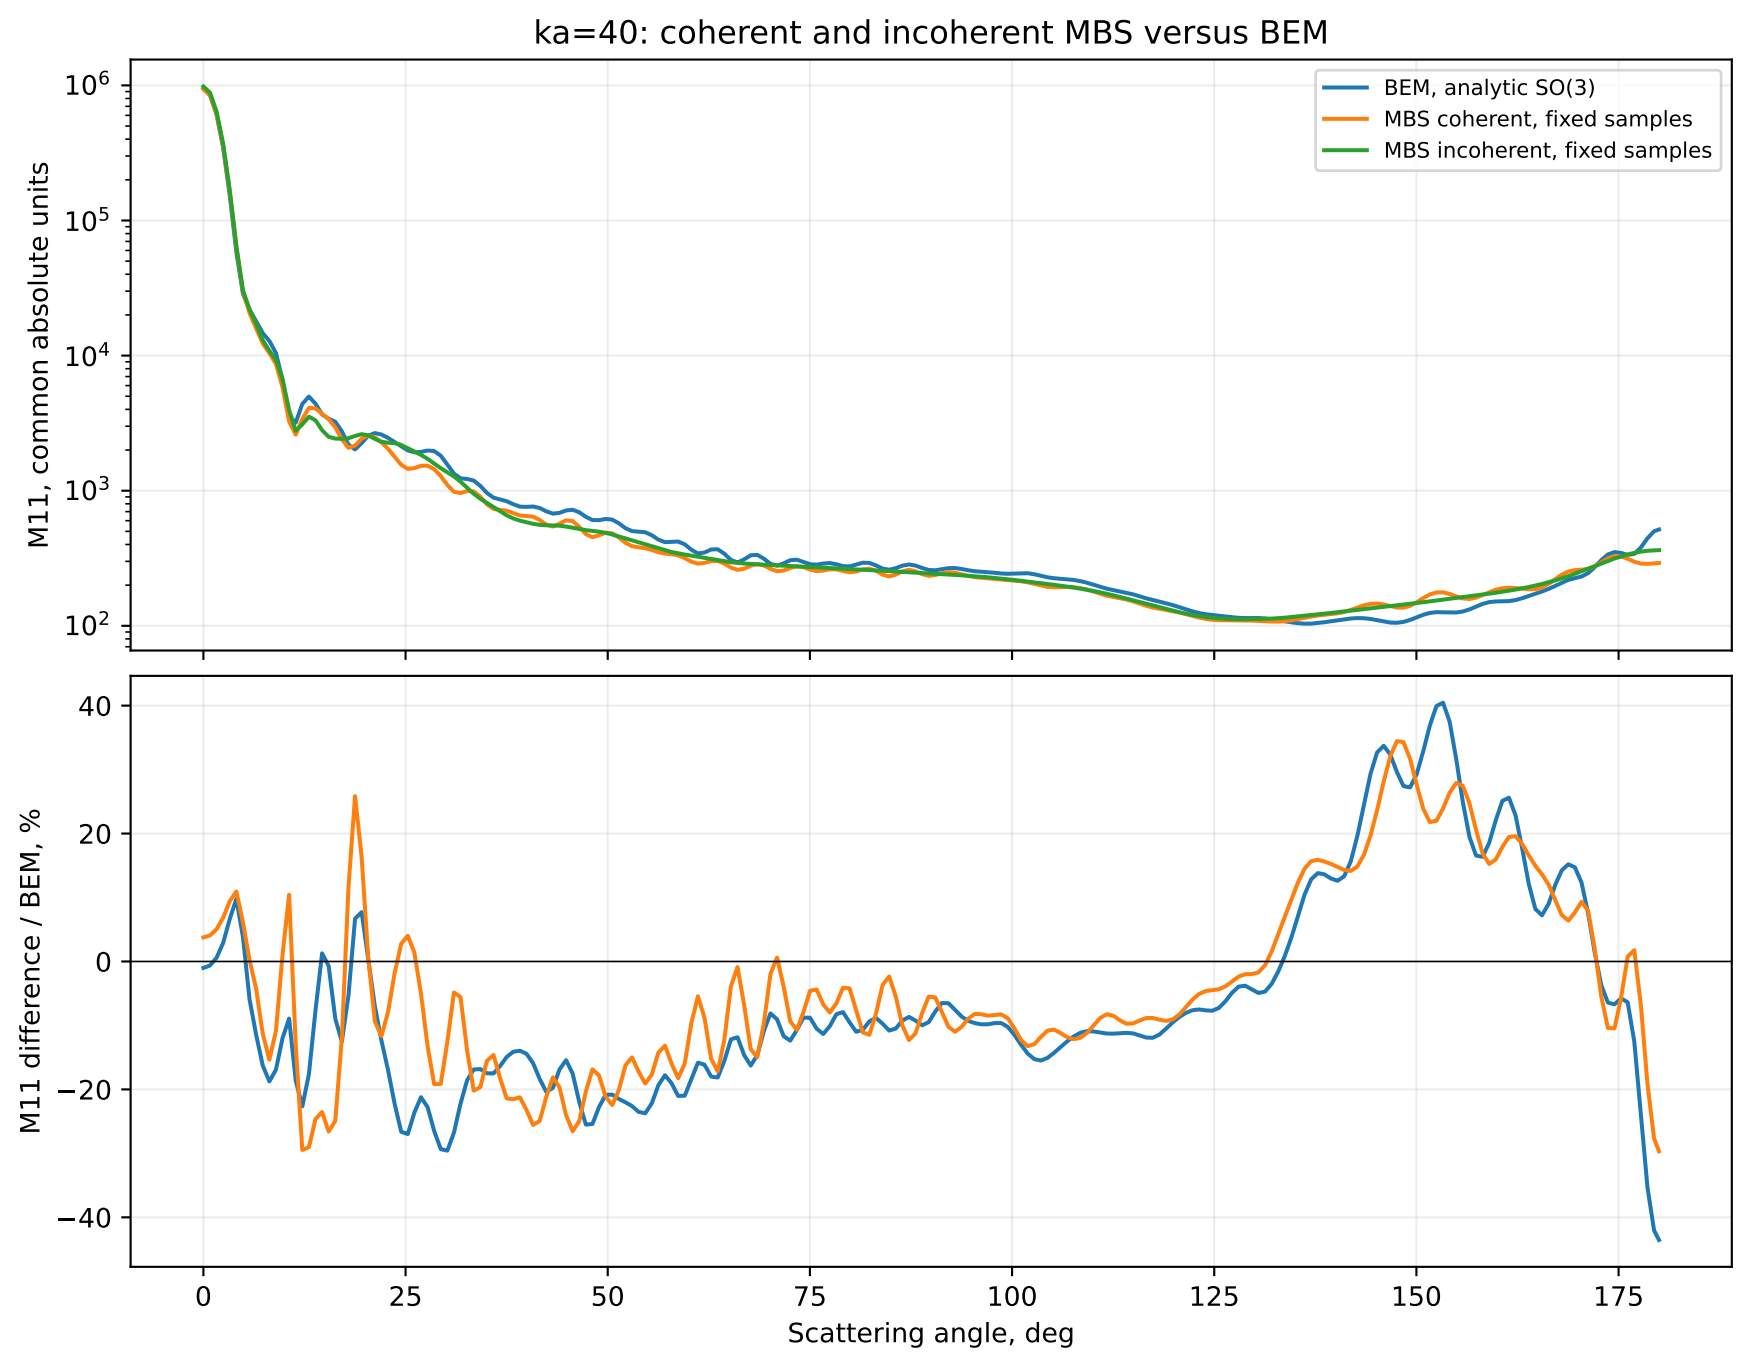
ka=40: coherent and incoherent MBS versus BEM
BEM, analytic SO(3)
MBS coherent, fixed samples
MBS incoherent, fixed samples
M11, common absolute units
$10^6$
$10^5$
$10^4$
$10^3$
$10^2$
M11 difference / BEM, %
40
20
0
−20
−40
0
25
50
75
100
125
150
175
Scattering angle, deg