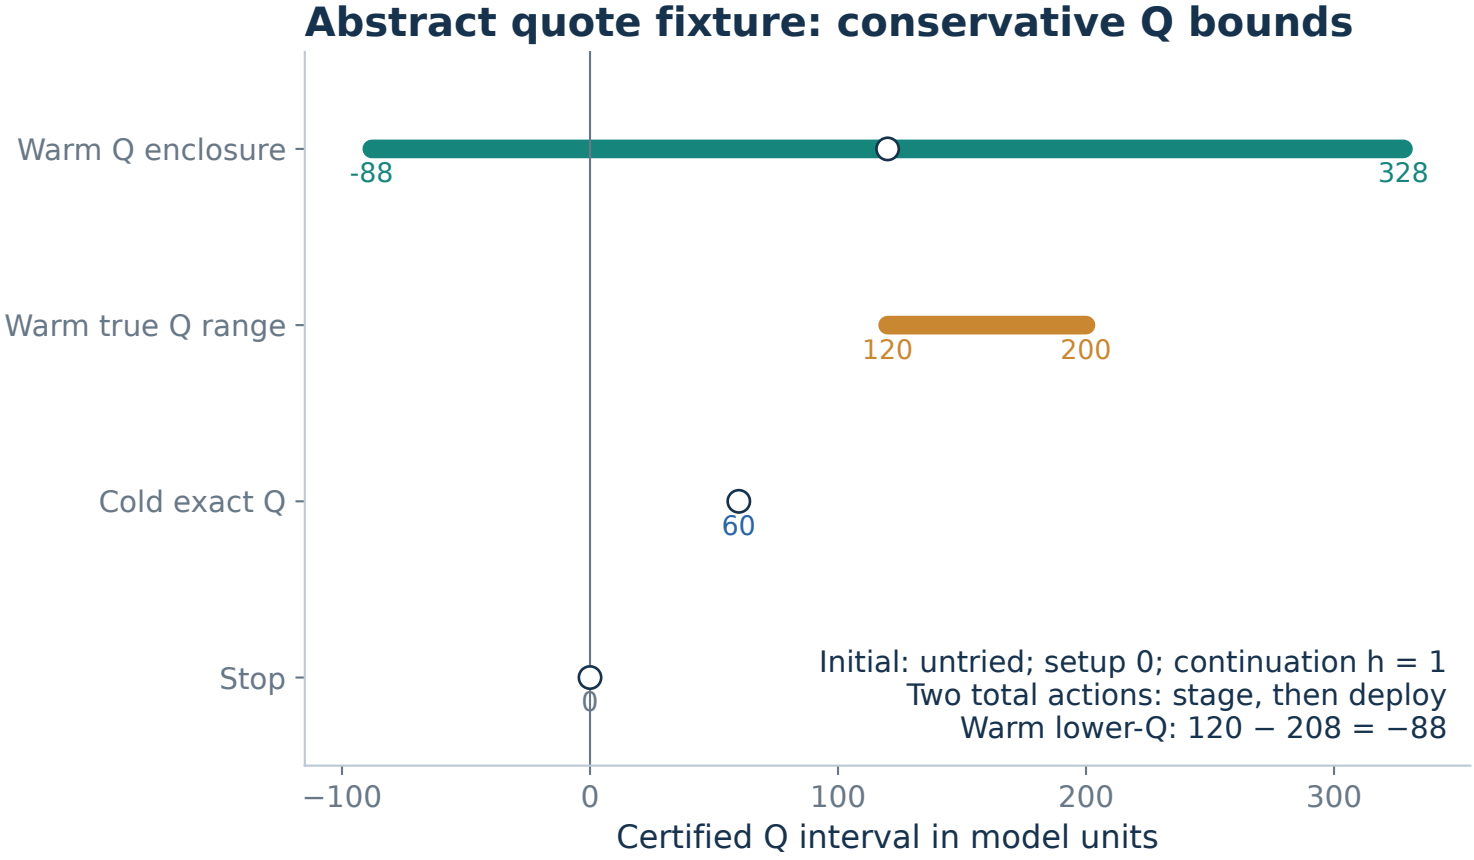
Abstract quote fixture: conservative Q bounds
Warm Q enclosure
-88
328
Warm true Q range
120
200
Cold exact Q
60
Stop
0
Initial: untried; setup 0; continuation h = 1
Two total actions: stage, then deploy
Warm lower-Q: 120 − 208 = −88
−100
0
100
200
300
Certified Q interval in model units