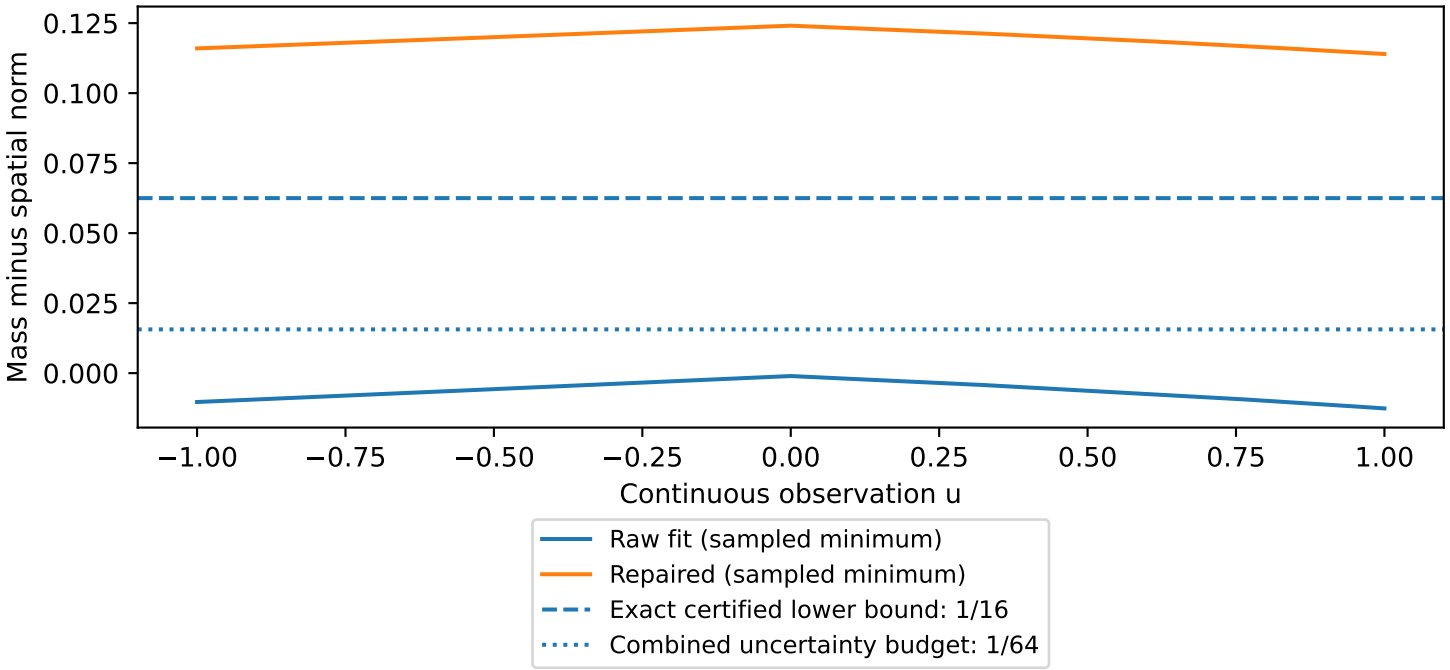
A positive margin can cover uncertainty
Mass minus spatial norm
0.125
0.100
0.075
0.050
0.025
0.000
−1.00
−0.75
−0.50
−0.25
0.00
0.25
0.50
0.75
1.00
Continuous observation u
Raw fit (sampled minimum)
Repaired (sampled minimum)
Exact certified lower bound: 1/16
Combined uncertainty budget: 1/64