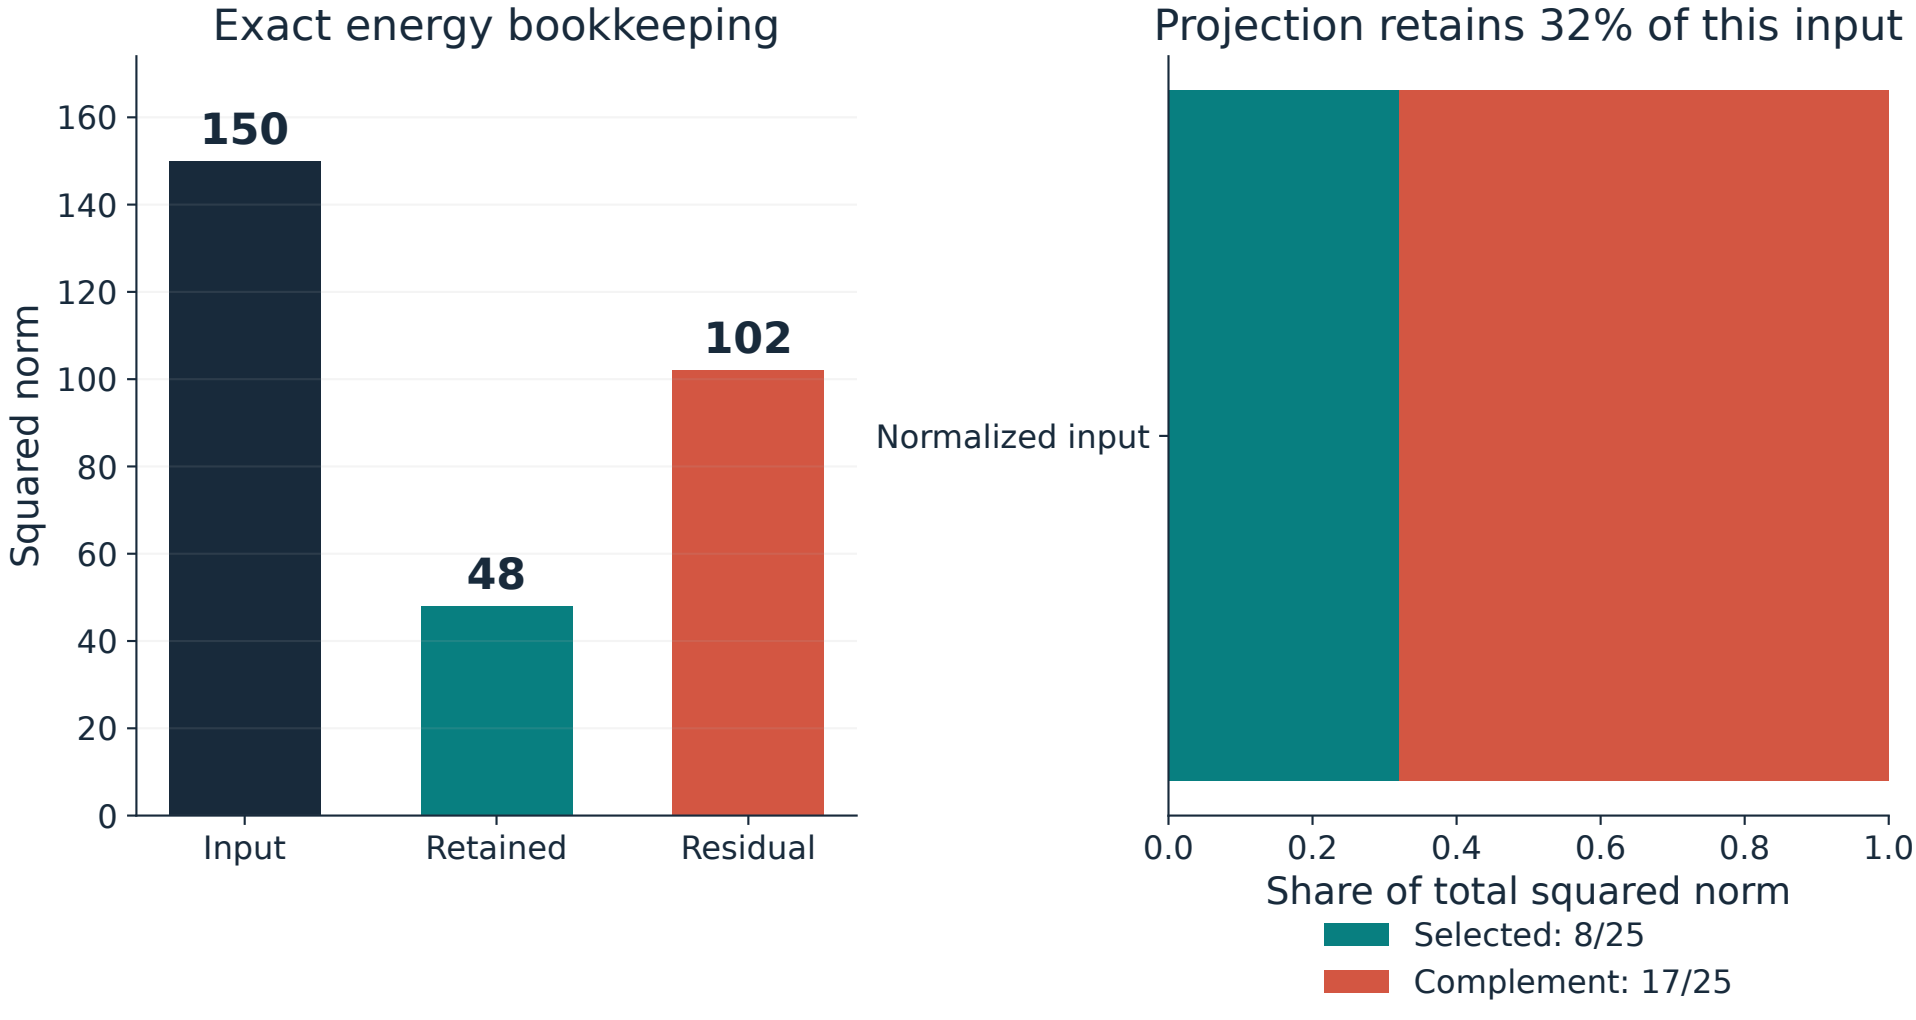
Exact energy bookkeeping
Squared norm
160
140
120
100
80
60
40
20
0
150
48
102
Input
Retained
Residual
Projection retains 32% of this input
Normalized input
0.0
0.2
0.4
0.6
0.8
1.0
Share of total squared norm
Selected: 8/25
Complement: 17/25