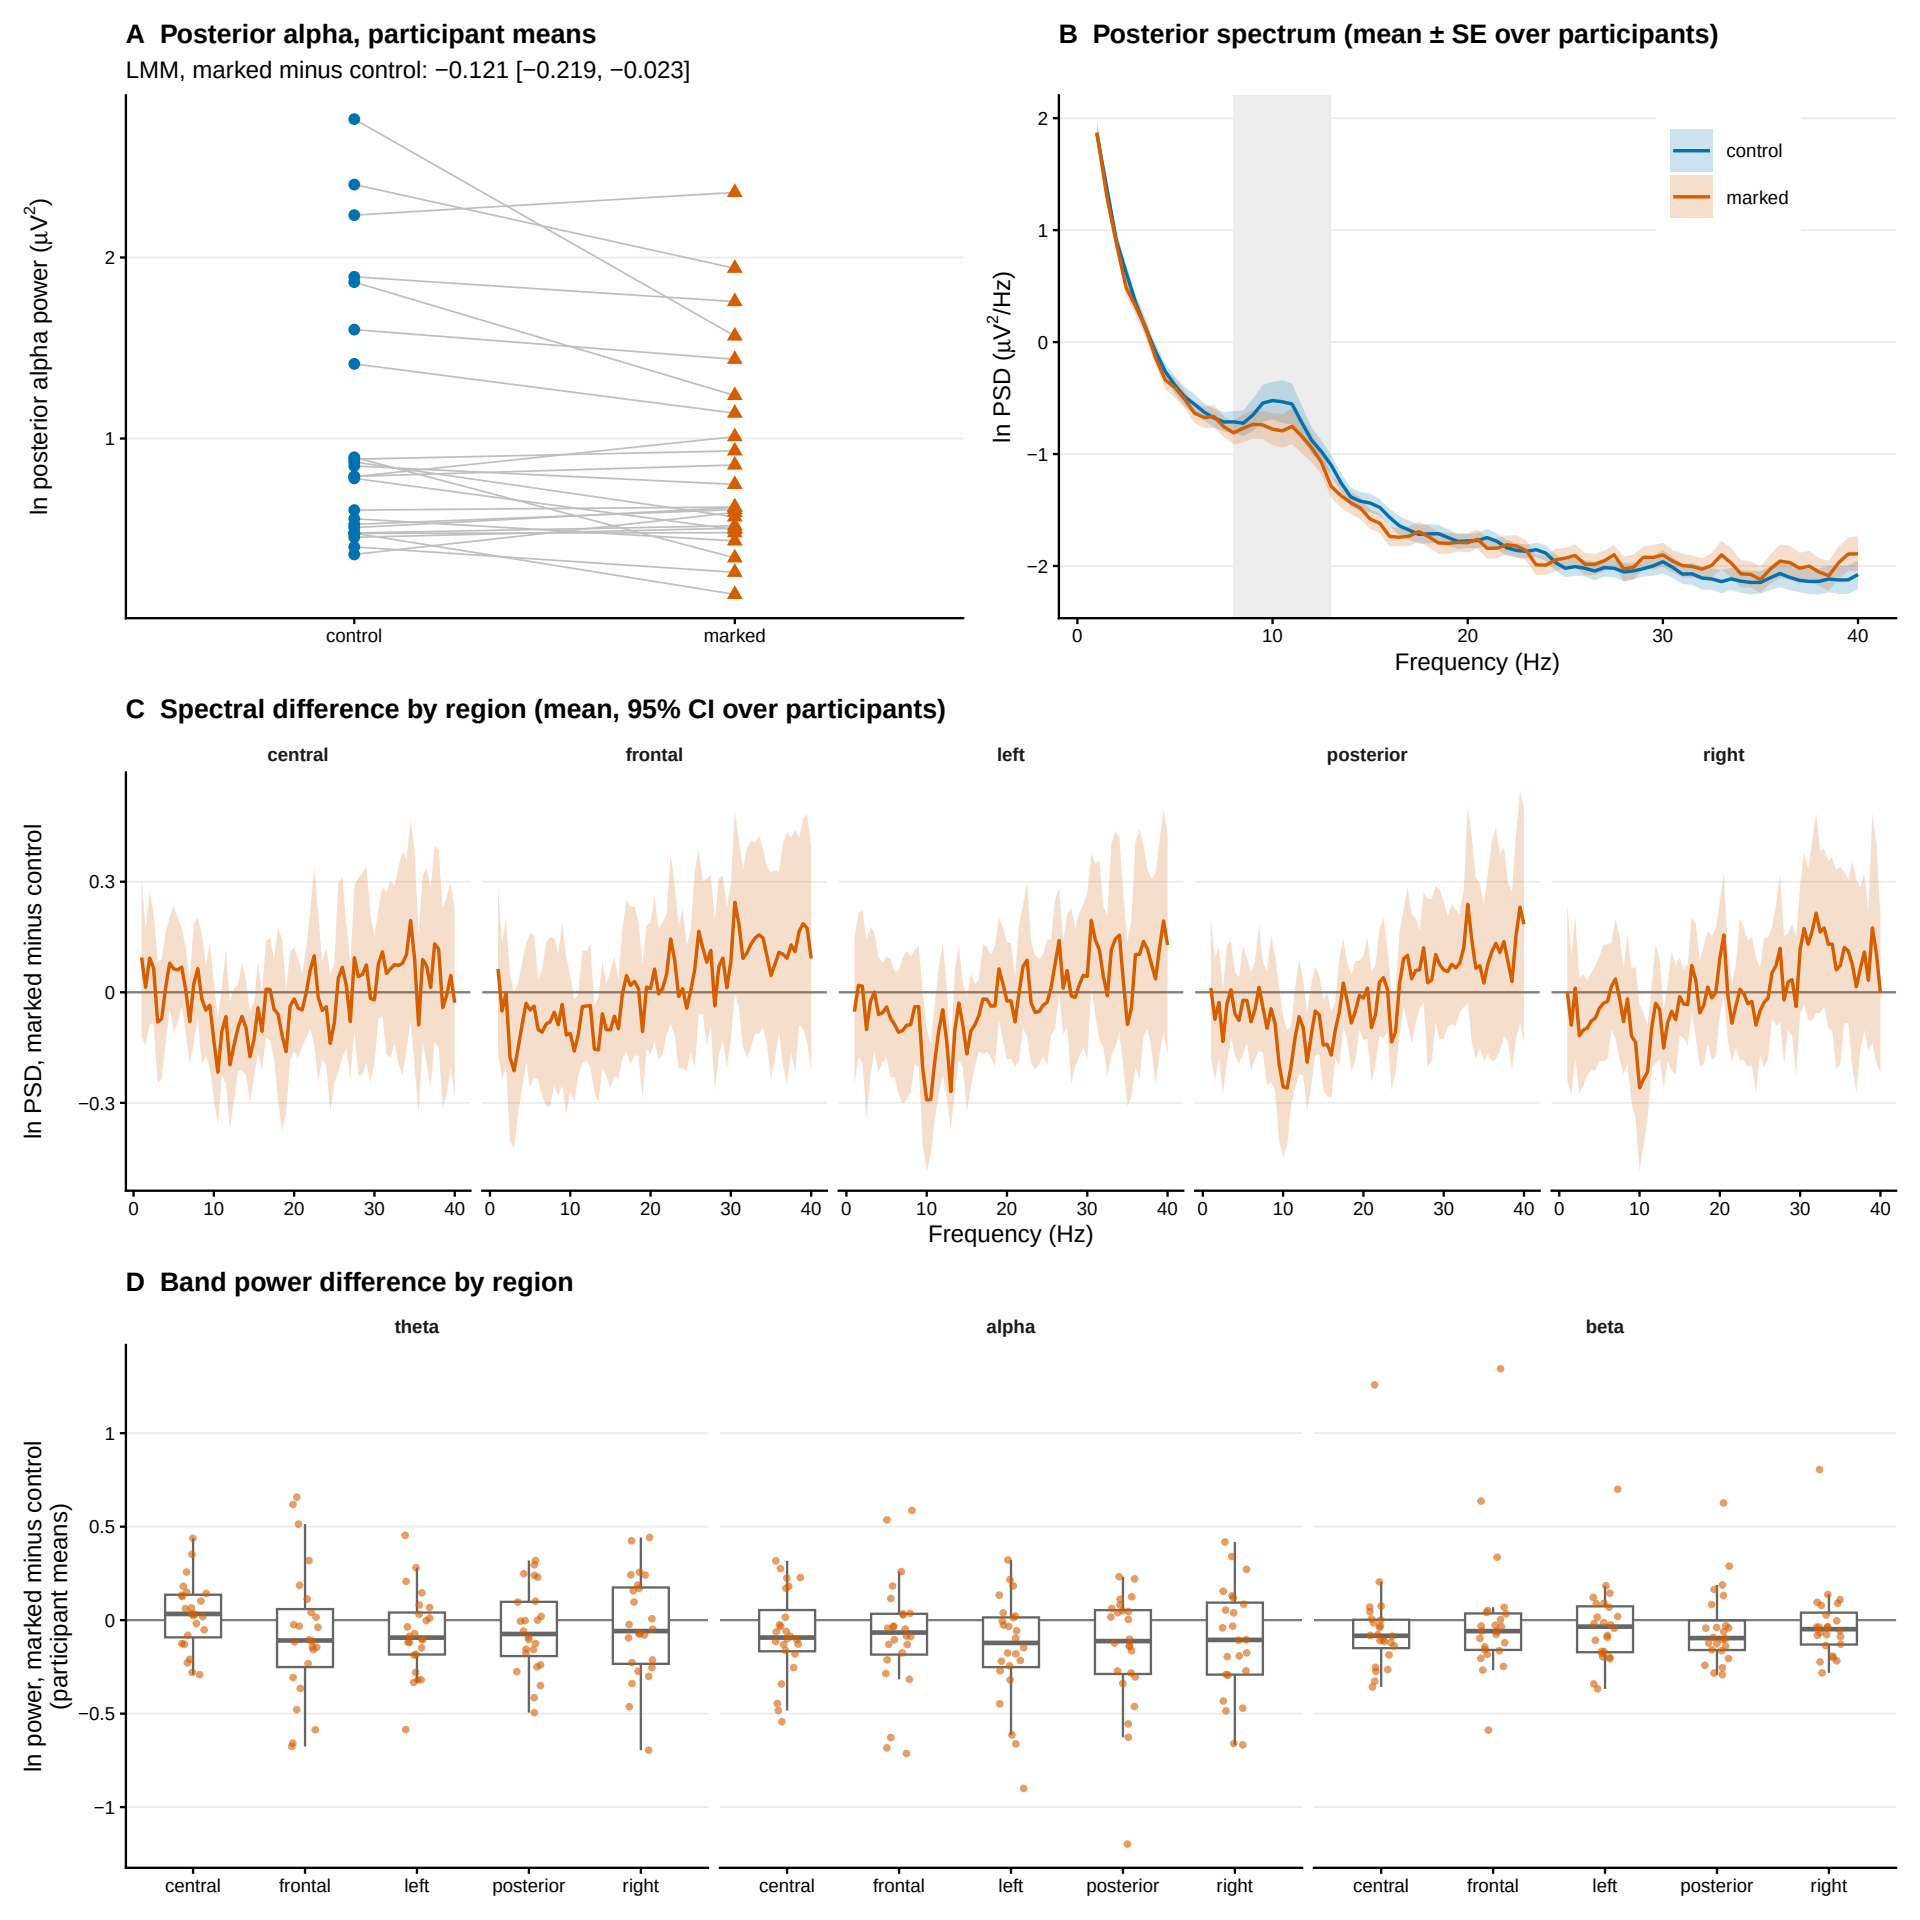
A Posterior alpha, participant means
LMM, marked minus control: −0.121 [−0.219, −0.023]
ln posterior alpha power (μV²)
control
marked
B Posterior spectrum (mean ± SE over participants)
ln PSD (μV²/Hz)
Frequency (Hz)
control
marked
C Spectral difference by region (mean, 95% CI over participants)
central
frontal
left
posterior
right
ln PSD, marked minus control
Frequency (Hz)
D Band power difference by region
theta
alpha
beta
ln power, marked minus control (participant means)