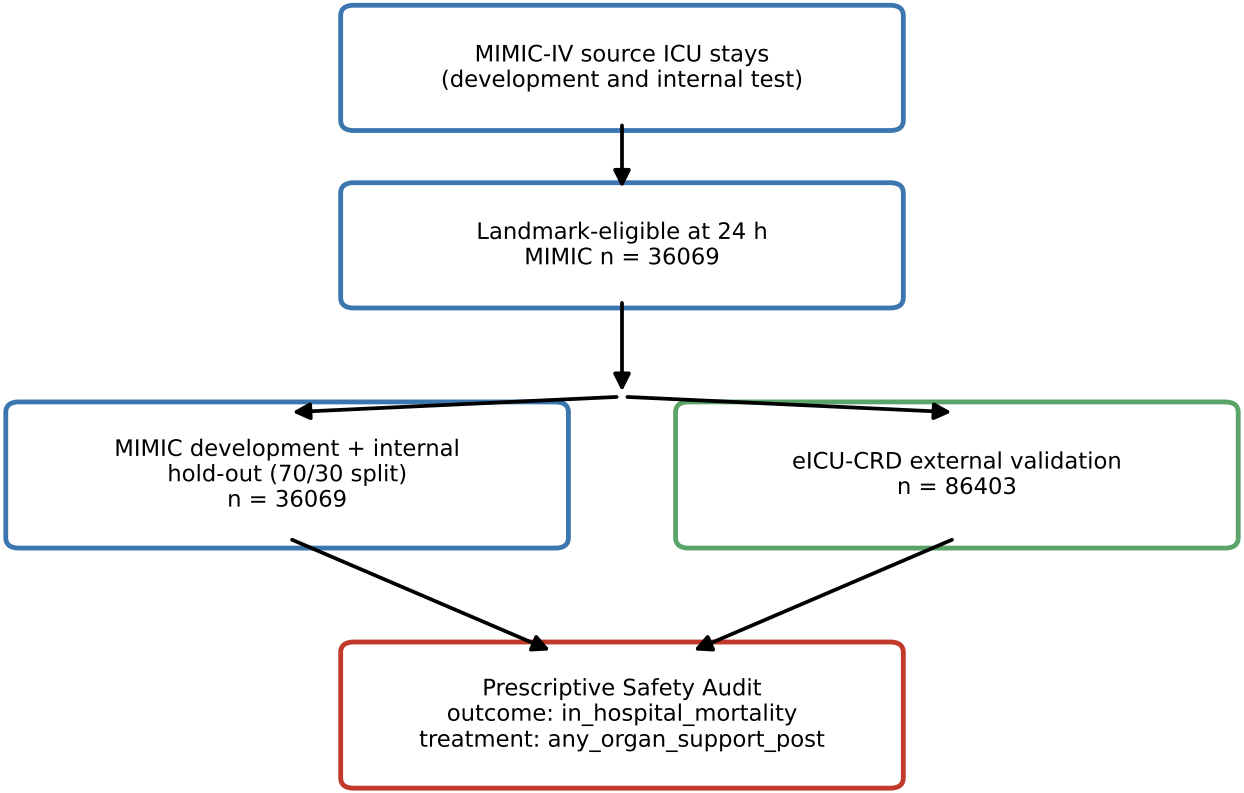
Cohort derivation and analysis flow
MIMIC-IV source ICU stays
(development and internal test)
Landmark-eligible at 24 h
MIMIC n = 36069
MIMIC development + internal
hold-out (70/30 split)
n = 36069
eICU-CRD external validation
n = 86403
Prescriptive Safety Audit
outcome: in_hospital_mortality
treatment: any_organ_support_post