BASICS_PQ_LIMS_14

Script Title	User Testing Custom Cancellation Flow


Test Script ID	BASICS-PQ-LIMS-14	**Title**	User Testing Custom Cancellation Flow
Description	Demonstrates report generation with custom form values without DB		
Vault Name	Demo Clinical Vault	**Product Version**	24.2.0
V-Assure Environment	Spotline: V-Assure Development	**Run Number**	Run-42
Start Time	08-OCT-2026 07:29:37 GMT-07:00	**End Time**	08-OCT-2026 09:30:01 GMT-07:00
Pre-Test Setup (PTS)	1. Ensure the following Test Accounts are available and record the usernames of the accounts: - USER1 (Security Profile: LIMS User, LIMS Roles: Results Entry): user02@vaultbasics-automation.com - USER2 (Security Profile: LIMS User, LIMS Roles: Batch Creator): batch@vaultbasics-automation.com 2. Ensure the following records are available: 1) SPEX1: Spec Execution in the Not Started state. The Spec Execution has: a) One sample in the Not Started state b) At least three tests in the Not Started state. Any additional tests are in the Not Started state. Record the names of the records. SPEX1: Batch-One19873384-1 Sample:S296 Tests:T417,T418,T419 3. Ensure the following records are available: 1) SPEX2: Spec Execution in the Not Started state. The Spec Execution has: a) Two samples in the Not Started state b) Each sample has at least one test in the Not Started state. Any additional tests are in the Not Started state. Record the names of the records. SPEX2: Batch-Two-1450217774-1 Sample:Sample_Plan_01_LIMS_150987459199802627 Tests:T420, 4. Ensure the following records are available: 1) SPEX3: Spec Execution in the Not Started state. The Spec Execution has: a) Two samples in the Not Started state b) Each sample has at least one test in the Not Started state. Any additional tests are in the Not Started state. 2) SPEX4: Spec Execution in the Logged state. The Spec Execution has no samples or tests Record the names of the records. SPEX3: Batch-Three-1475045691-1 SampleOne:S300 SampleTwo:S301 Tests:T425,T426		

	SPEX4: Batch-Four-1400086163-1 5. Confirm that the Vault Token: Virtual Vault? = true


Intentionally Left Blank

PTS Screenshots


PTS Step #1 Screenshot #1 Screenshot Time: 08-OCT-2026 07:30:49 GMT-07:00

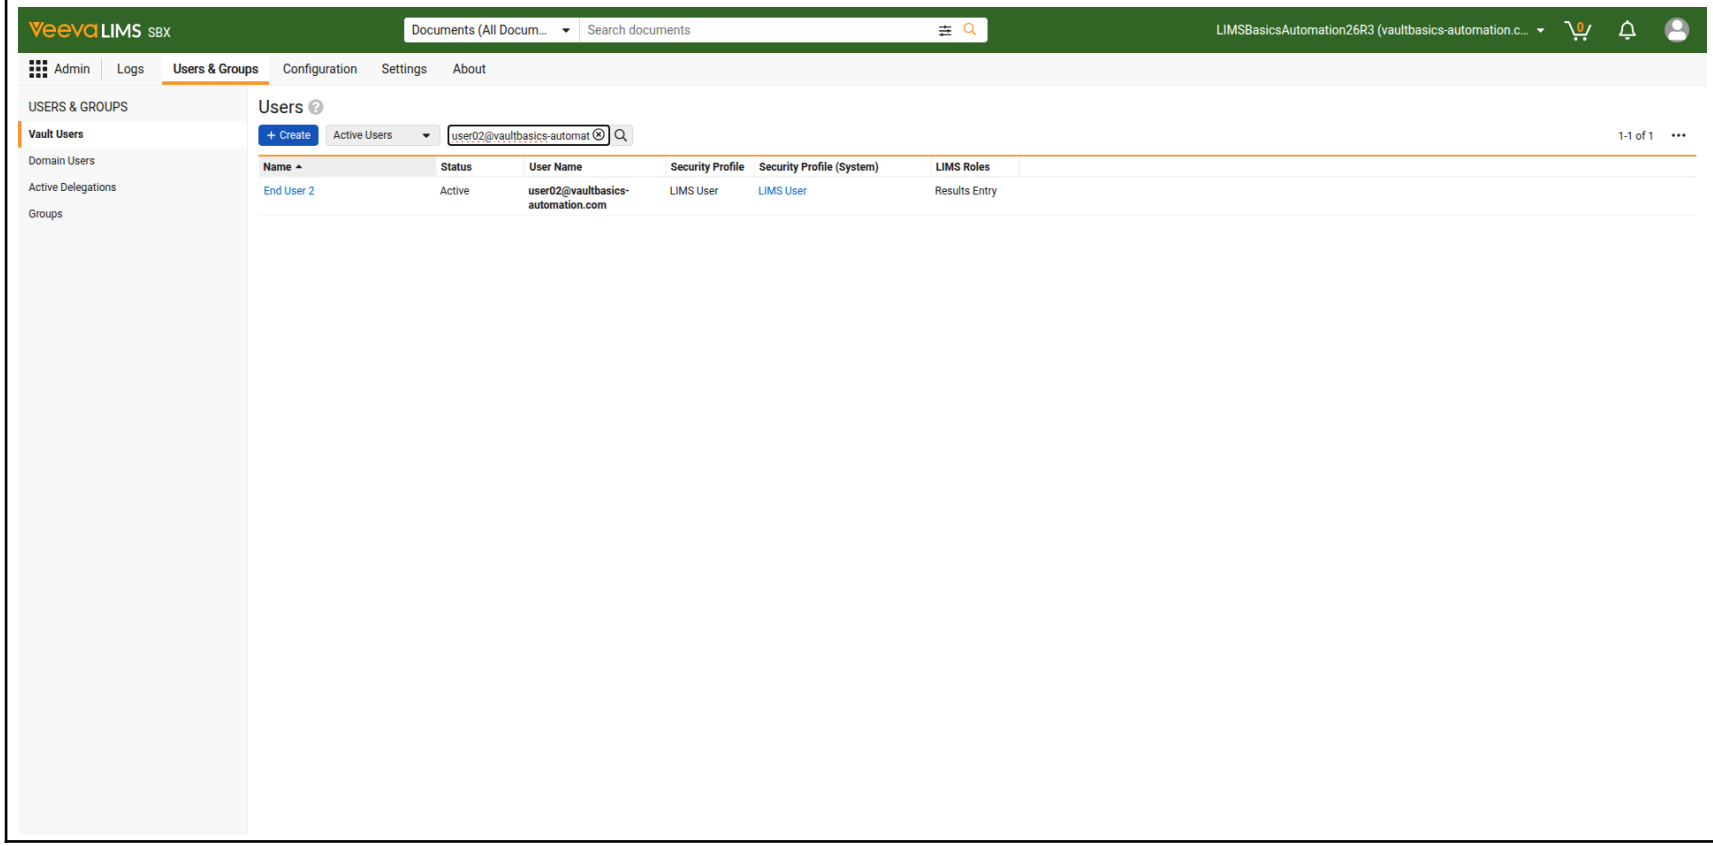


PTS Step #1 Screenshot #2 Screenshot Time: 08-OCT-2026 07:31:03 GMT-07:00

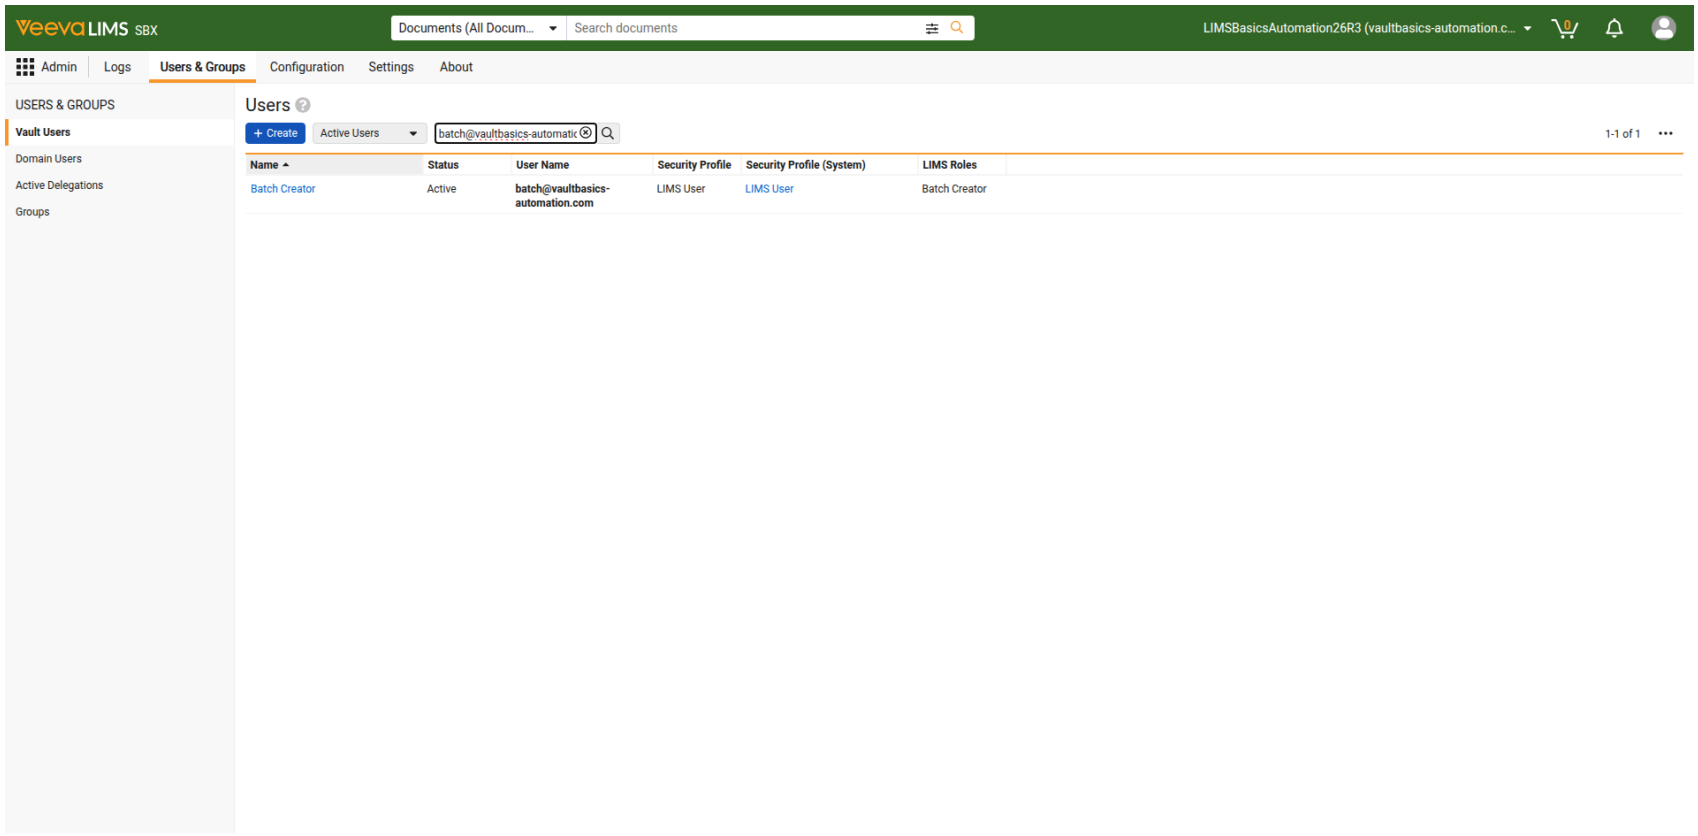


PTS Step #2 Screenshot #1 Screenshot Time: 08-OCT-2026 07:48:25 GMT-07:00

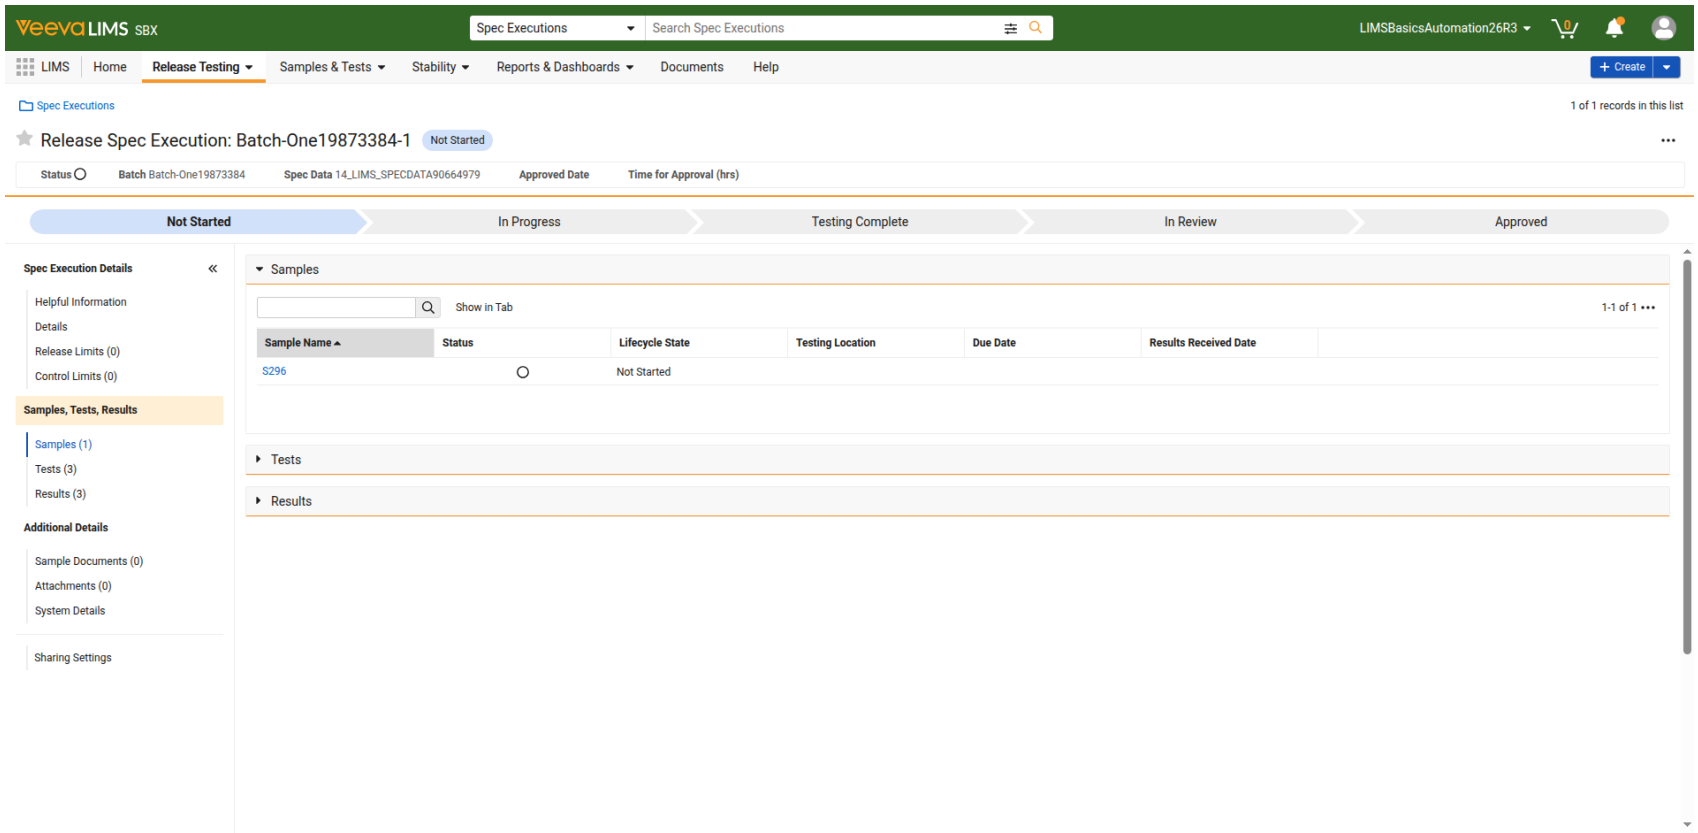


PTS Step #2 Screenshot #2 Screenshot Time: 08-OCT-2026 07:48:38 GMT-07:00

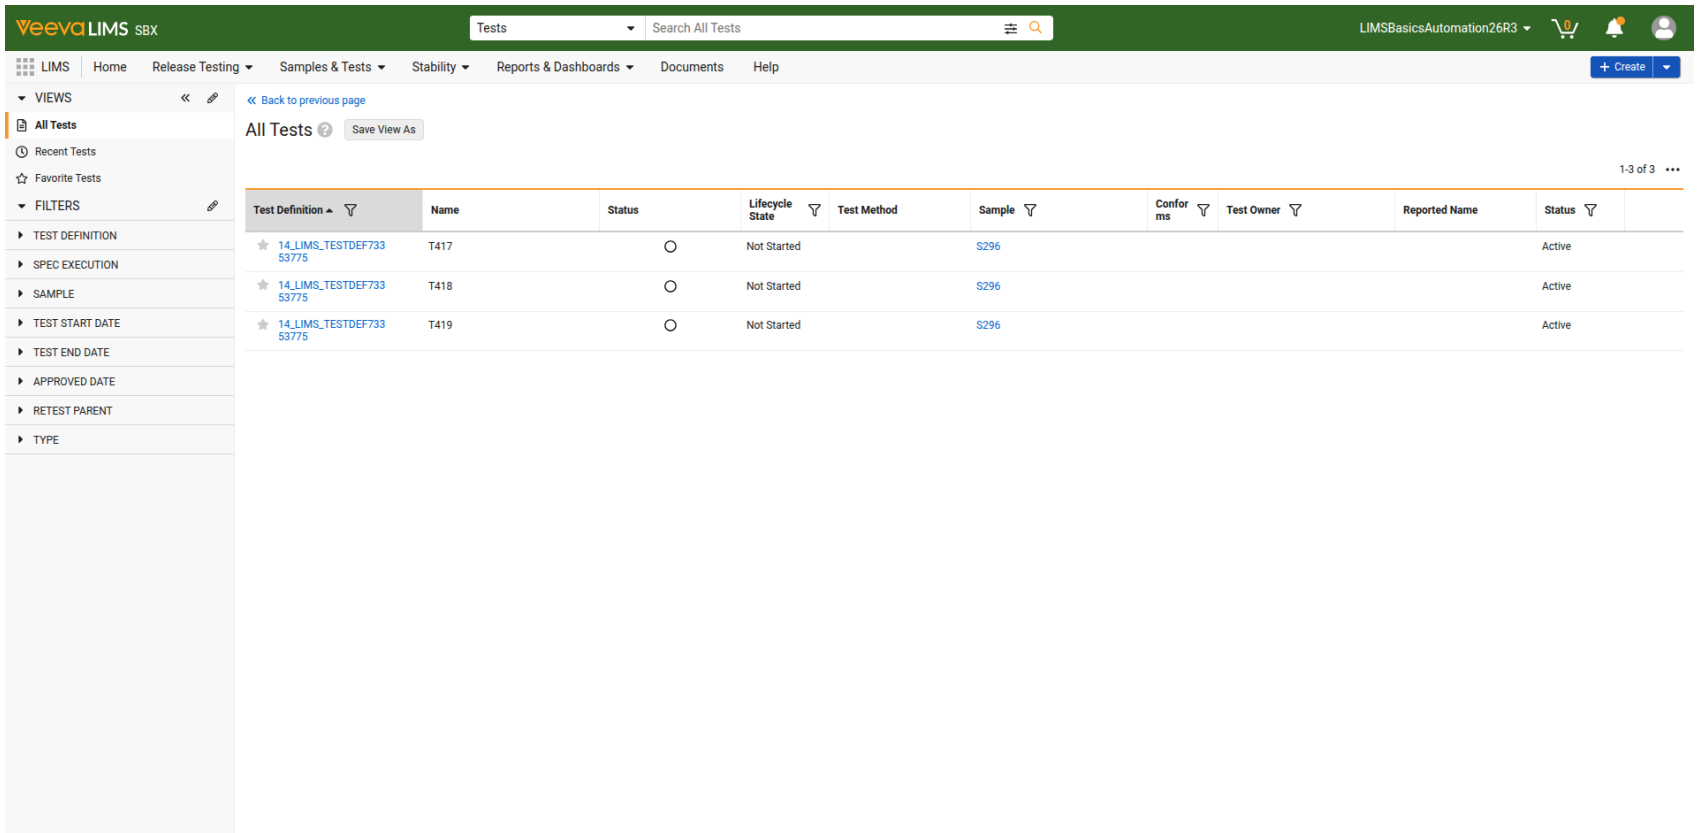


PTS Step #3 Screenshot #1 Screenshot Time: 08-OCT-2026 08:08:05 GMT-07:00

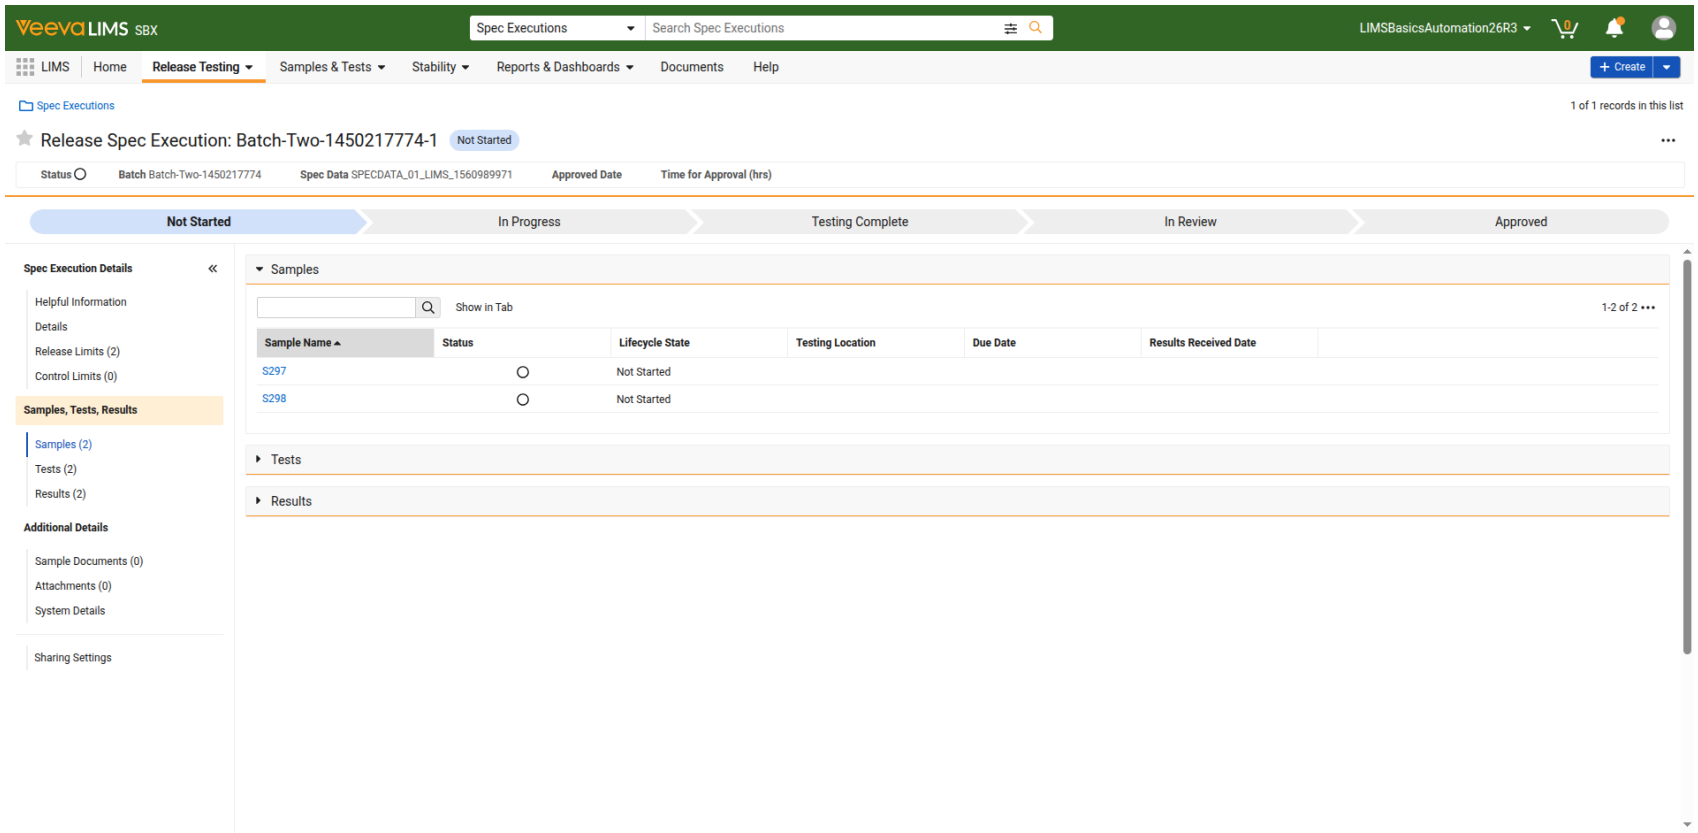


PTS Step #3 Screenshot #2 Screenshot Time: 08-OCT-2026 08:14:04 GMT-07:00

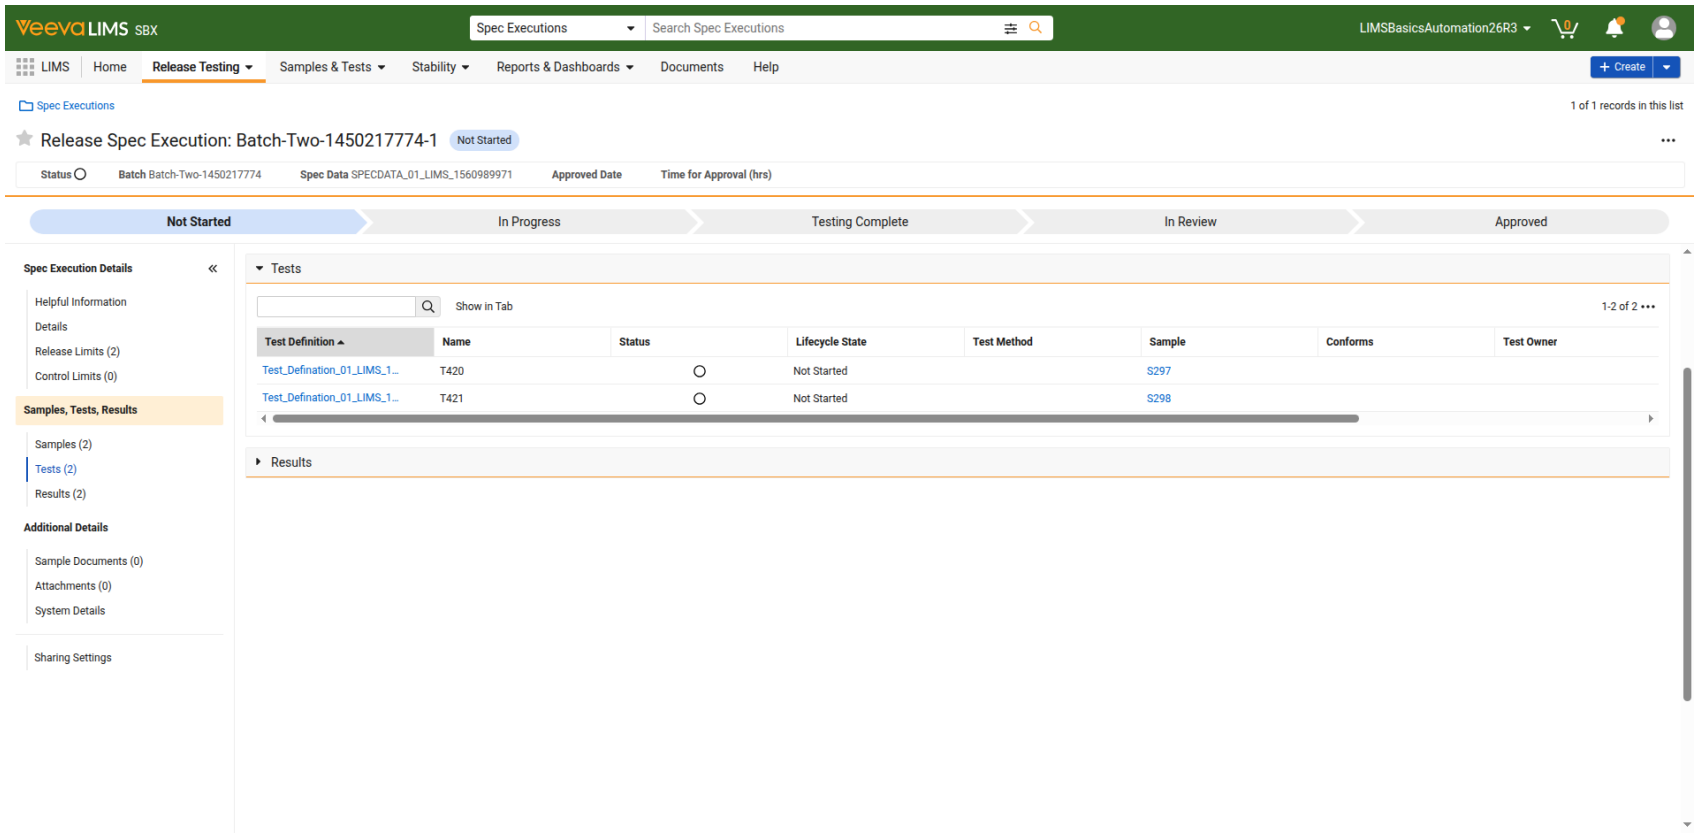


PTS Step #4 Screenshot #1 Screenshot Time: 08-OCT-2026 08:33:16 GMT-07:00

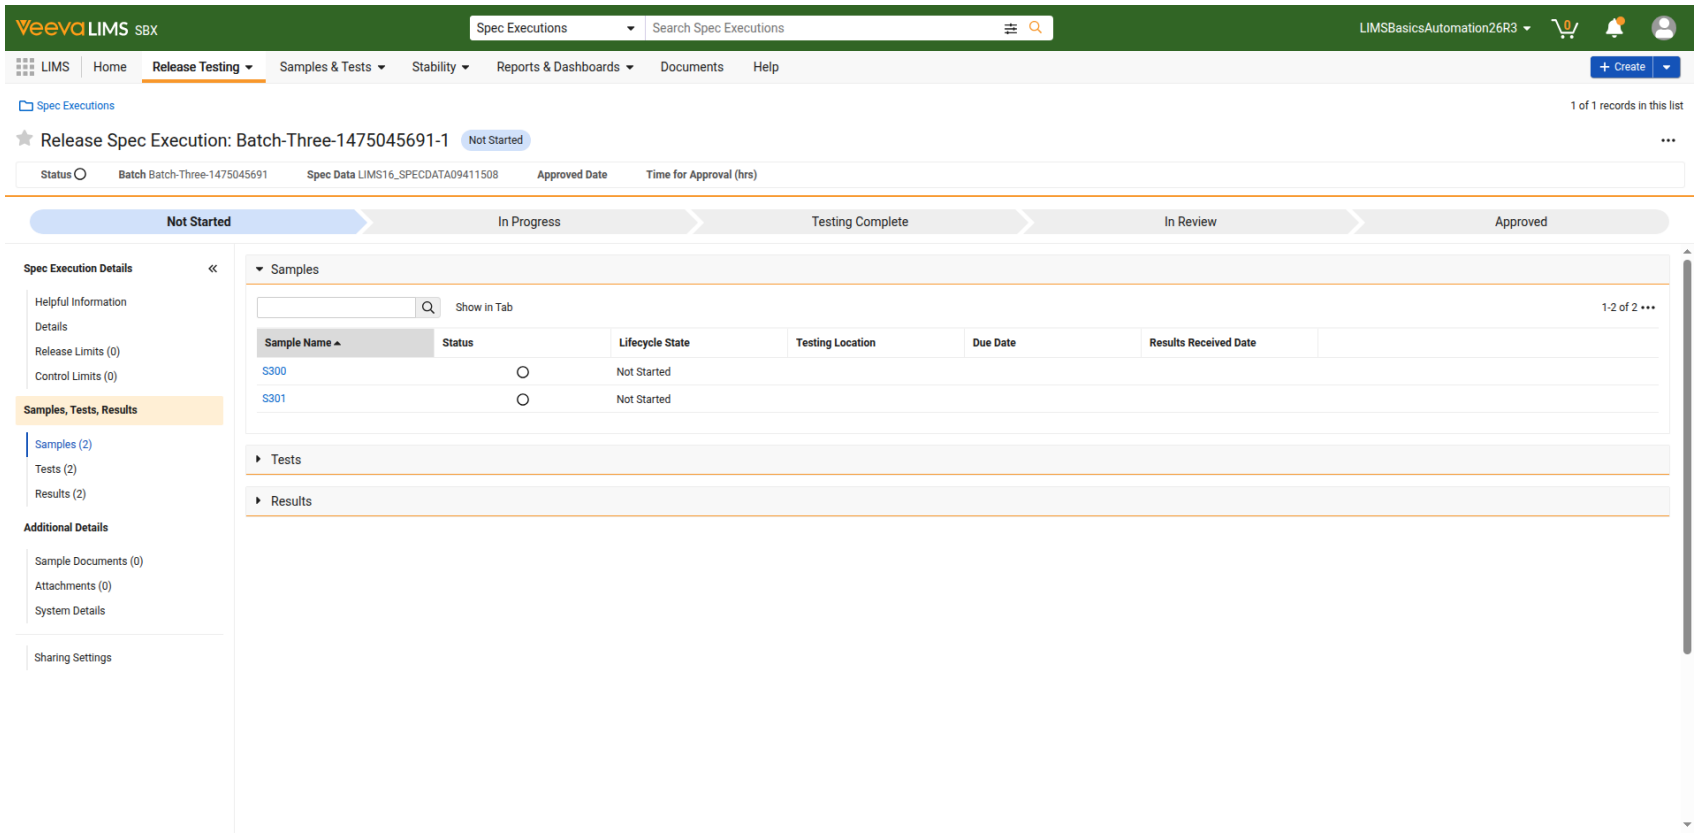


PTS Step #4 Screenshot #2 Screenshot Time: 08-OCT-2026 08:39:11 GMT-07:00

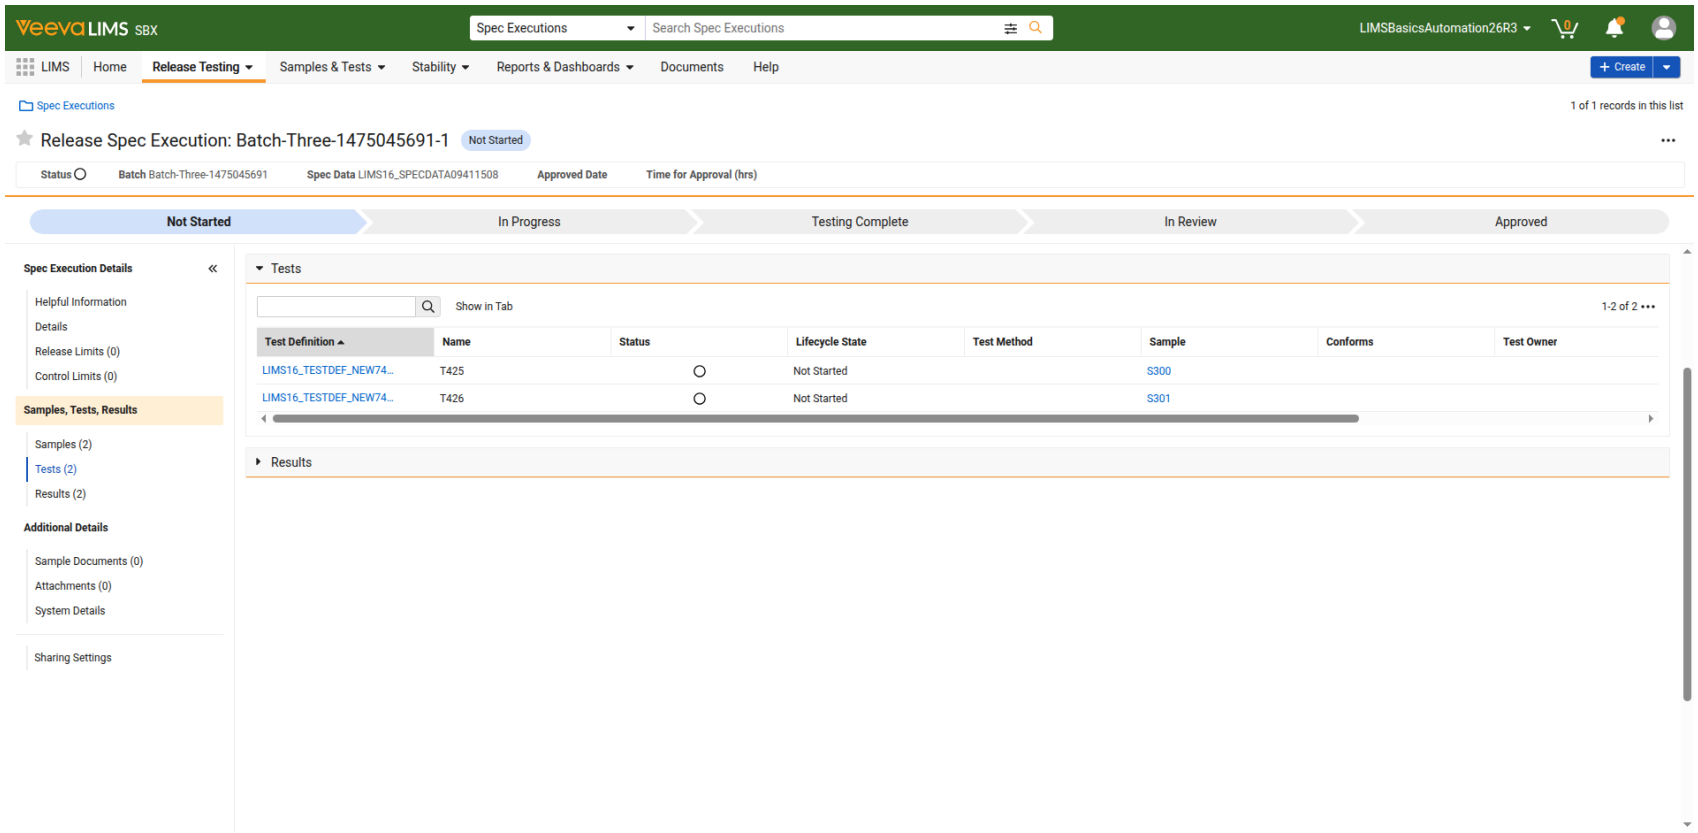

PTS Step #4 Screenshot #3 Screenshot Time: 08-OCT-2026 08:40:17 GMT-07:00

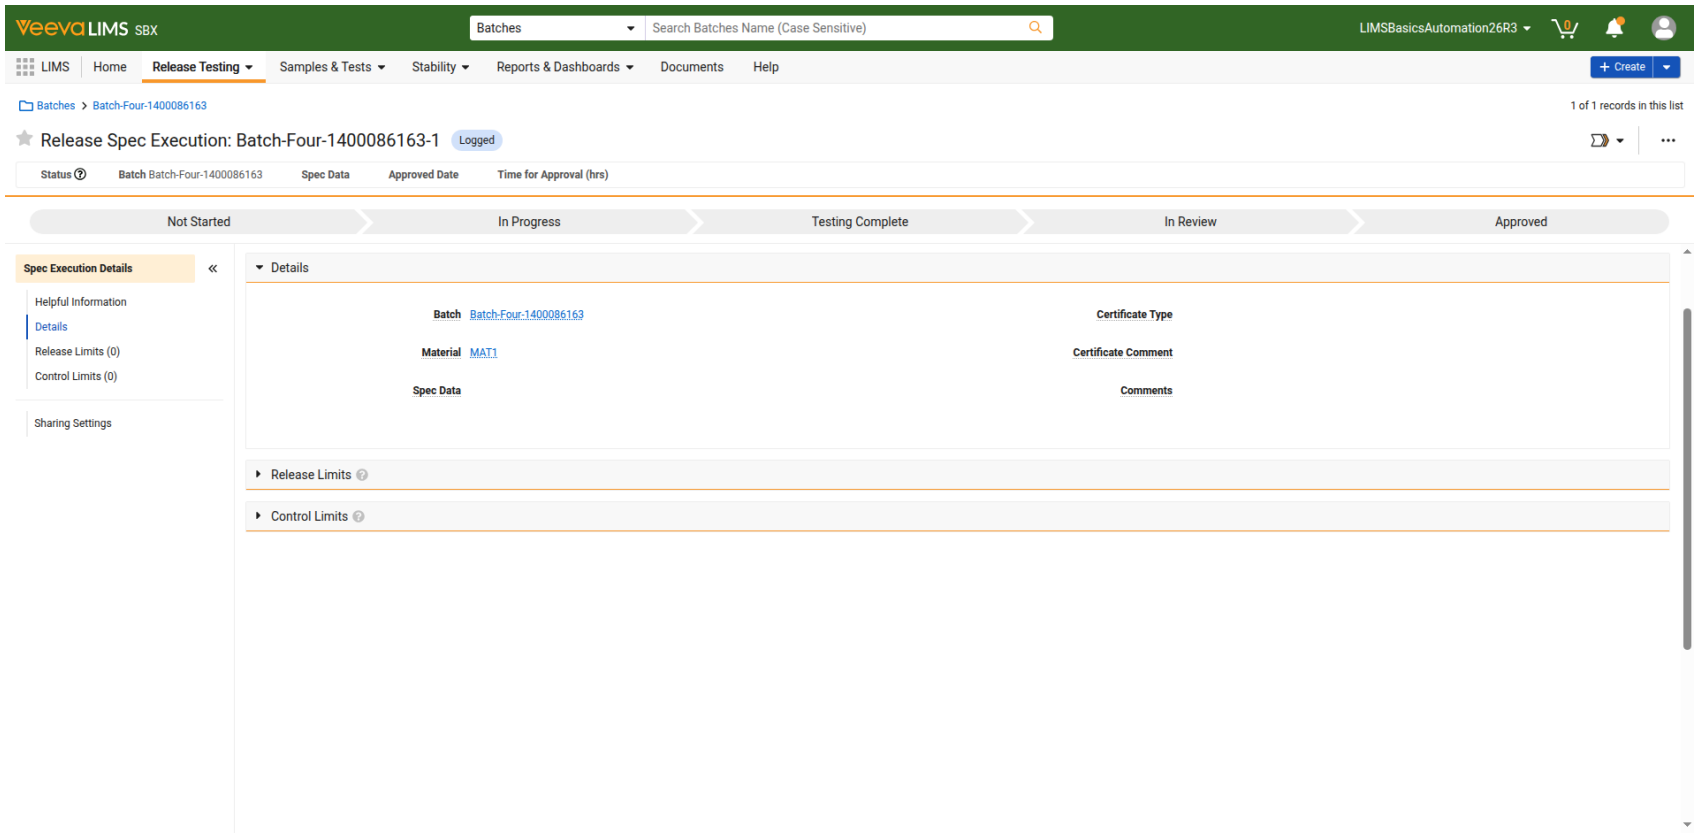

PTS Step #5 Screenshot Screenshot Time: 08-OCT-2026 08:41:31 GMT-07:00

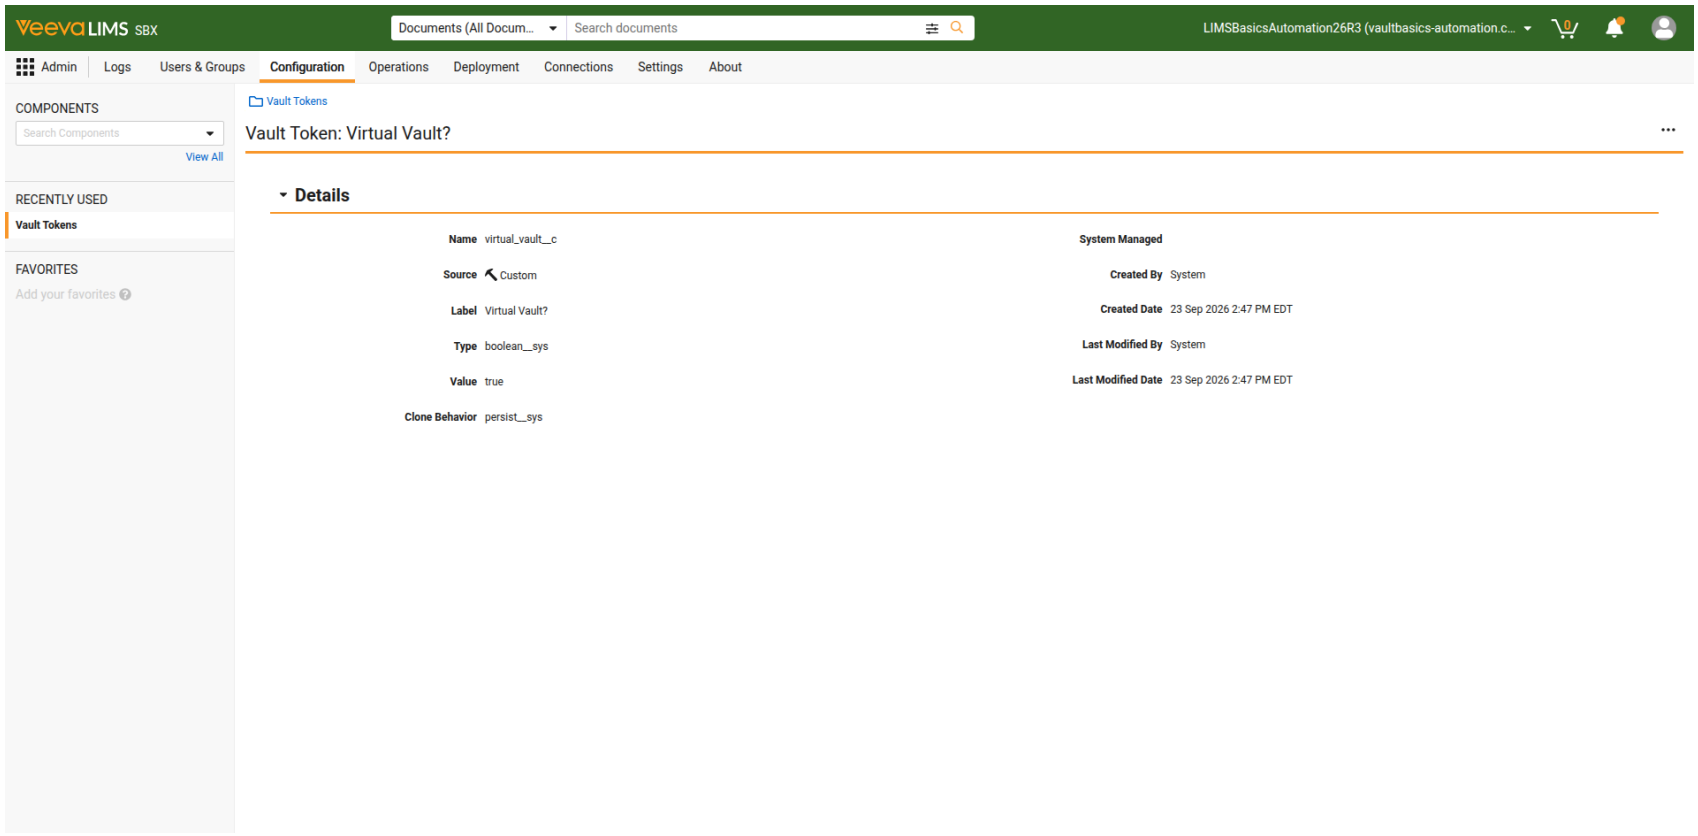

Step #	Procedure	Expected Results	Actual Results	Pass/Fail
1	Log into Vault as USER1. From the LIMS tab collection, navigate to Release Testing > Spec Execution. Locate the SPEX1 from the setup steps and click the name link to open the record.	The Spec Execution is displayed.	The Spec Execution is displayed.	PASS 08-OCT-2026 08:44:12
2	Navigate to the Tests section. Click Show in Tab. Use a filter or the favorites option so that only two tests are displayed. From the All Actions Menu, select Start Workflow. Within the Workflow dropdown select Test: Cancel. Click Continue. Click Start.	The workflow is started.	The workflow is started.	PASS 08-OCT-2026 08:45:11
3	From the notifications confirm there is a task notification "Cancel Test" for the selected tests.	There is a task notification "Cancel Test" for the selected tests.	There is a task notification "Cancel Test" for the selected tests.	PASS 08-OCT-2026 08:45:20
4	Navigate to the Home tab. Click the link to open the envelope for the cancellation task. Click Complete in the task bar. Select Do not Cancel Test verdict. Click Complete.	The workflow ends. Both tests are in the Not Started state.	The workflow ends. Both tests are in the Not Started state.	PASS 08-OCT-2026 08:46:17
5	Navigate to SPEX1 and expand the Tests section. Click Show in Tab. Use a filter or the favorites option so that only two tests are displayed. From the All Actions Menu, select Start Workflow. Within the Workflow dropdown select Test: Cancel. Click Continue. Click Start.	The workflow is started.	The workflow is started.	PASS 08-OCT-2026 08:47:06
6	Navigate to the Home tab. Click the link to open the envelope for the cancellation task. Click Complete in the task bar. Select Cancel Test verdict. Enter the Reason for Cancellation. Select an Electronic Signature Meaning, complete the e-signature. Click Complete.	The workflow ends. Both tests are in the Cancelled state. The Spec Execution and the Sample remain in the Not Started state.	The workflow ends. Both tests are in the Cancelled state. The Spec Execution and the Sample remain in the Not Started state.	PASS 08-OCT-2026 08:48:49
7	From the LIMS tab collection, navigate to Release Testing > Spec Execution. Locate the SPEX2 from the setup steps and click the name link to open the record.	The Spec Execution is displayed.	The Spec Execution is displayed.	PASS 08-OCT-2026 08:50:35


Step #	Procedure	Expected Results	Actual Results	Pass/Fail
8	Navigate to the Samples section. Click Show in Tab. From the All Actions Menu, select Start Workflow. Within the Workflow dropdown select Sample: Cancel. Click Continue. Click Start.	The workflow is started.	The workflow is started.	PASS 08-OCT-2026 08:51:24
9	From the notifications confirm there is a task notification "Cancel Sample" for the selected samples.	There is a task notification "Cancel Sample" for the selected samples.	There is a task notification "Cancel Sample" for the selected samples.	PASS 08-OCT-2026 08:51:34
10	Navigate to the Home tab. Click the link to open the envelope for the cancellation task. Click Complete in the task bar. Select Do not Cancel Sample verdict. Click Complete.	The workflow ends. Both samples are in the Not Started state.	The workflow ends. Both samples are in the Not Started state.	PASS 08-OCT-2026 08:53:52
11	Navigate to SPEX2 and expand the Samples section. Click Show in Tab. From the All Actions Menu, select Start Workflow. Within the Workflow dropdown select Sample: Cancel. Click Continue. Click Start.	The workflow is started.	The workflow is started.	PASS 08-OCT-2026 08:54:38
12	Navigate to the Home tab. Click the link to open the envelope for the cancellation task. Click Complete in the task bar. Select Cancel Sample verdict. Enter the Reason for Cancellation. Select an Electronic Signature Meaning, complete the e-signature. Click Complete.	The workflow ends. Both Samples are in the Cancelled state. All tests are in the Cancelled state. The Spec Execution remains in the Not Started state.	The workflow ends. Both Samples are in the Cancelled state. All tests are in the Cancelled state. The Spec Execution remains in the Not Started state.	PASS 08-OCT-2026 09:08:22
13	Log into Vault as USER2. From the LIMS tab collection, navigate to Release Testing > Spec Execution. Use a filter or the favorites option so that only SPEX3 and SPEX4 are displayed.	SPEX3 and SPEX4 are displayed.	SPEX3 and SPEX4 are displayed.	PASS 08-OCT-2026 09:11:12
14	From the All Actions Menu, select Start Workflow. Within the Workflow dropdown select Spec Execution: Cancel. Click Continue. Click Start.	The workflow is started.	The workflow is started.	PASS 08-OCT-2026 09:11:41
15	From the notifications confirm there is a task notification "Cancel Spec execution" for the selected spec executions	There is a task notification "Cancel Spec execution" for the selected spec executions.	There is a task notification "Cancel Spec execution" for the selected spec executions.	PASS 08-OCT-2026 09:11:48

Step #	Procedure	Expected Results	Actual Results	Pass/Fail
16	Navigate to the Home tab. Click the link to open the envelope for the cancellation task. Click Complete in the task bar. Select Do not Cancel Spec execution verdict. Click Complete.	The workflow ends. SPEX3 is in the Not Started state, SPEX4 is in the Logged state.	The workflow ends. SPEX3 is in the Not Started state, SPEX4 is in the Logged state.	PASS 08-OCT-2026 09:14:15
17	From the LIMS tab collection, navigate to Release Testing > Spec Execution. Use a filter or the favorites option so that only SPEX3 and SPEX4 are displayed. From the All Actions Menu, select Start Workflow. Within the Workflow dropdown select Spec Execution: Cancel. Click Continue. Click Start.	The workflow is started.	The workflow is started.	PASS 08-OCT-2026 09:16:45
18	Navigate to the Home tab. Click the link to open the envelope for the cancellation task. Click Complete in the task bar. Select Cancel Spec Execution verdict. Enter the Reason for Cancellation. Select an Electronic Signature Meaning, complete the e-signature. Click Complete.	The workflow ends. Both Spec Executions are in the Cancelled state. The samples and tests associated to SPEX3 are in the Cancelled state. The batches associated with SPEX3 and SPEX4 are in the Cancelled state.	The workflow ends. Both Spec Executions are in the Cancelled state. The samples and tests associated to SPEX3 are in the Cancelled state. The batches associated with SPEX3 and SPEX4 are in the Cancelled state.	PASS 08-OCT-2026 09:30:01


Intentionally Left Blank

Execution Screenshots


Step #1 Screenshot Screenshot Time: 08-OCT-2026 08:44:08 GMT-07:00

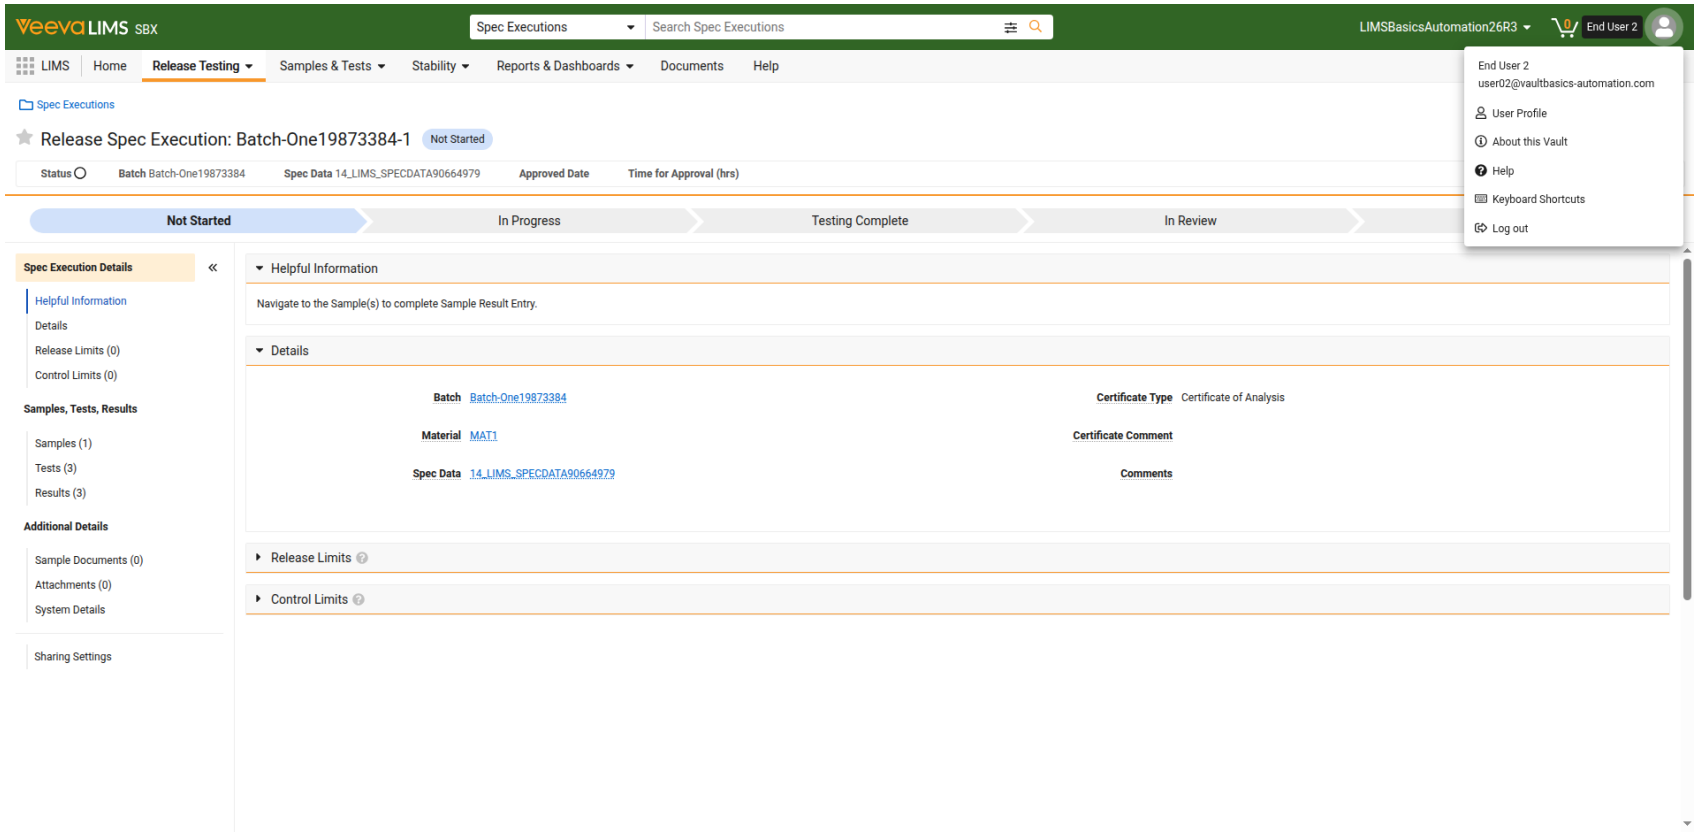

Step #2 Screenshot Screenshot Time: 08-OCT-2026 08:45:11 GMT-07:00

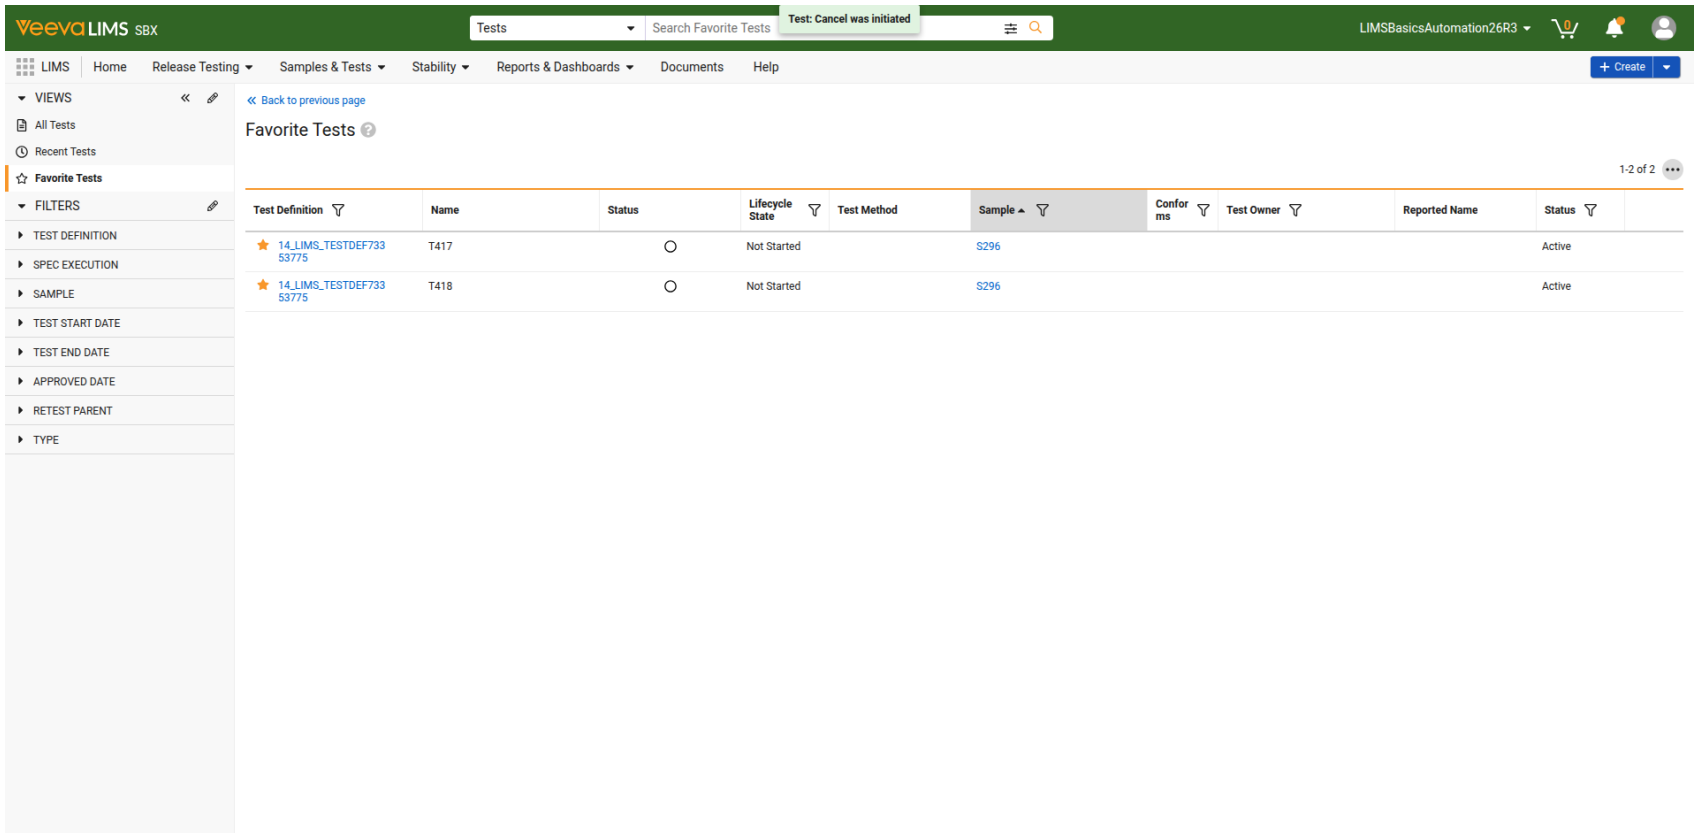


Step #3 Screenshot Screenshot Time: 08-OCT-2026 08:45:20 GMT-07:00

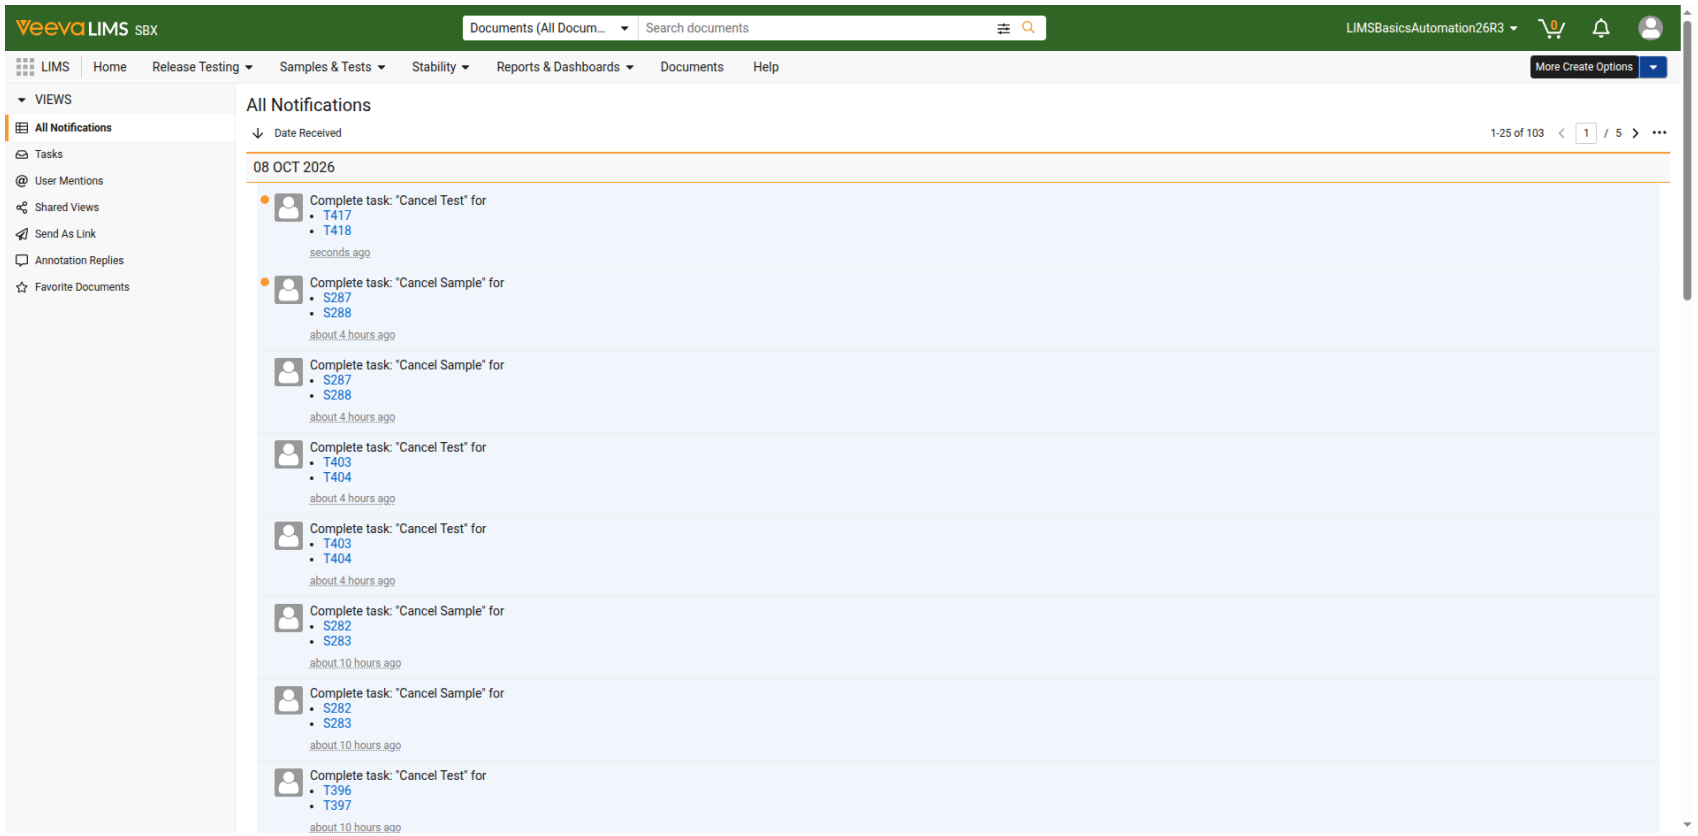


Executed Test Script


Step #4 Screenshot #1 Screenshot Time: 08-OCT-2026 08:46:10 GMT-07:00

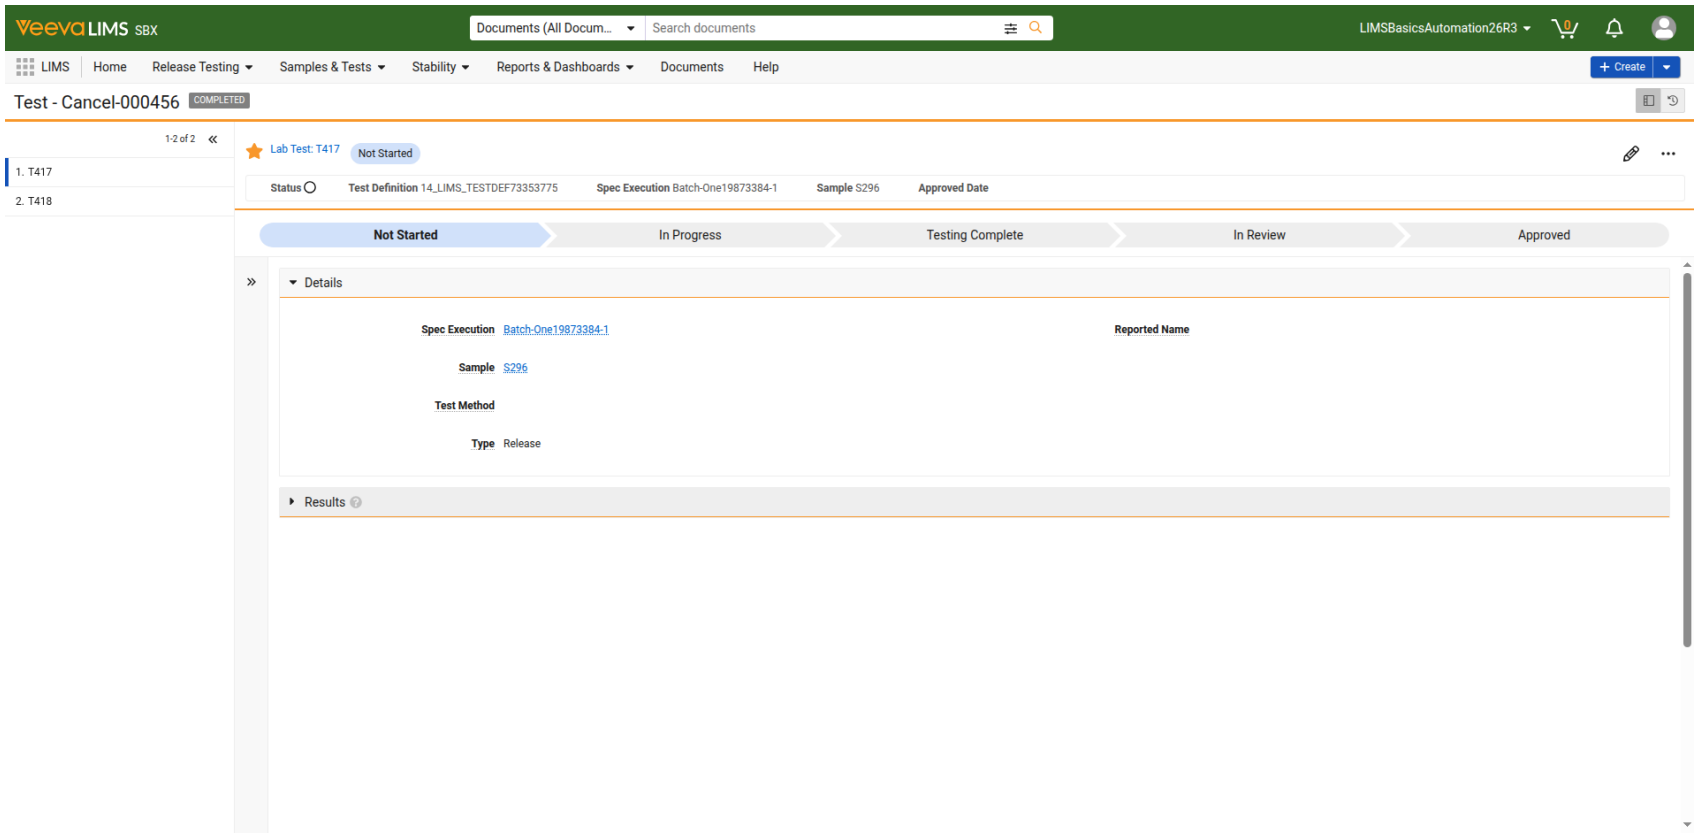


Step #4 Screenshot #2 Screenshot Time: 08-OCT-2026 08:46:17 GMT-07:00

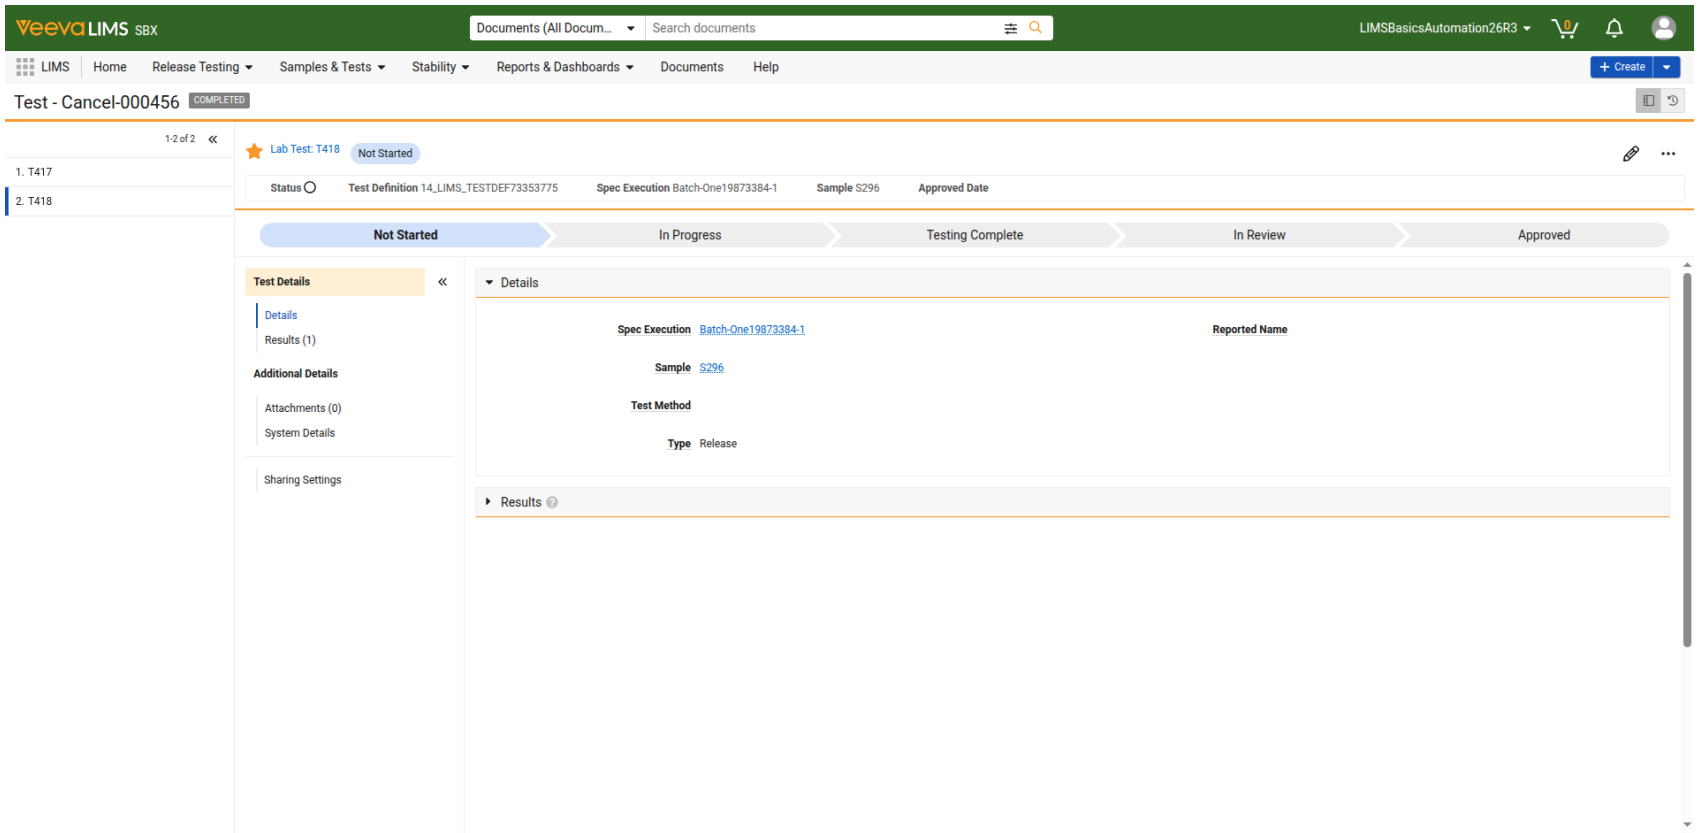


Step #5 Screenshot Screenshot Time: 08-OCT-2026 08:47:06 GMT-07:00

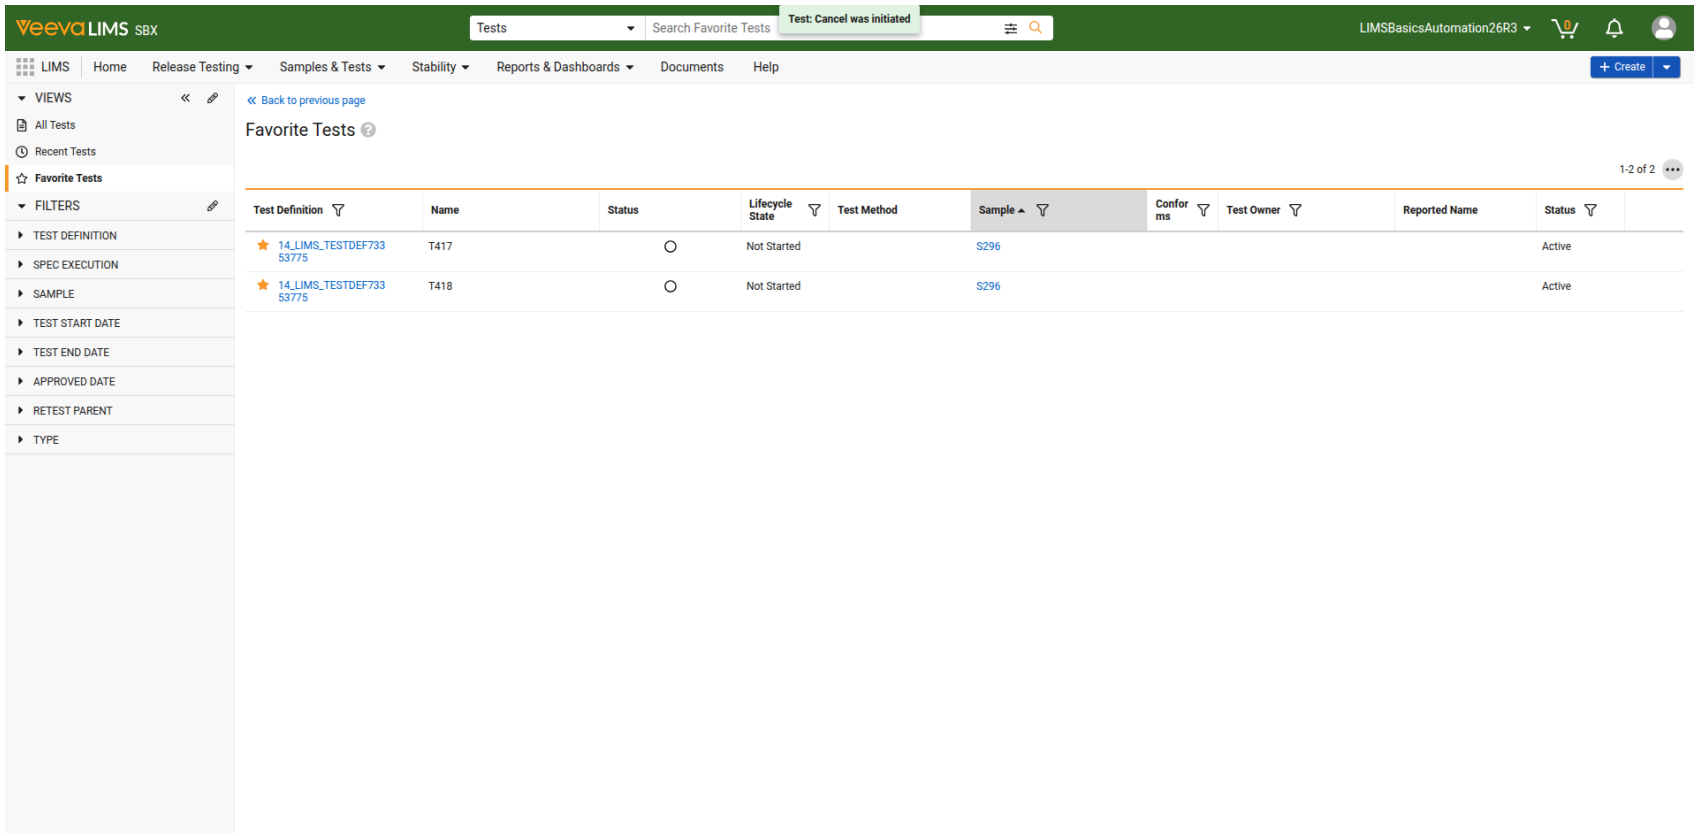


Step #6 Screenshot #1 Screenshot Time: 08-OCT-2026 08:48:23 GMT-07:00

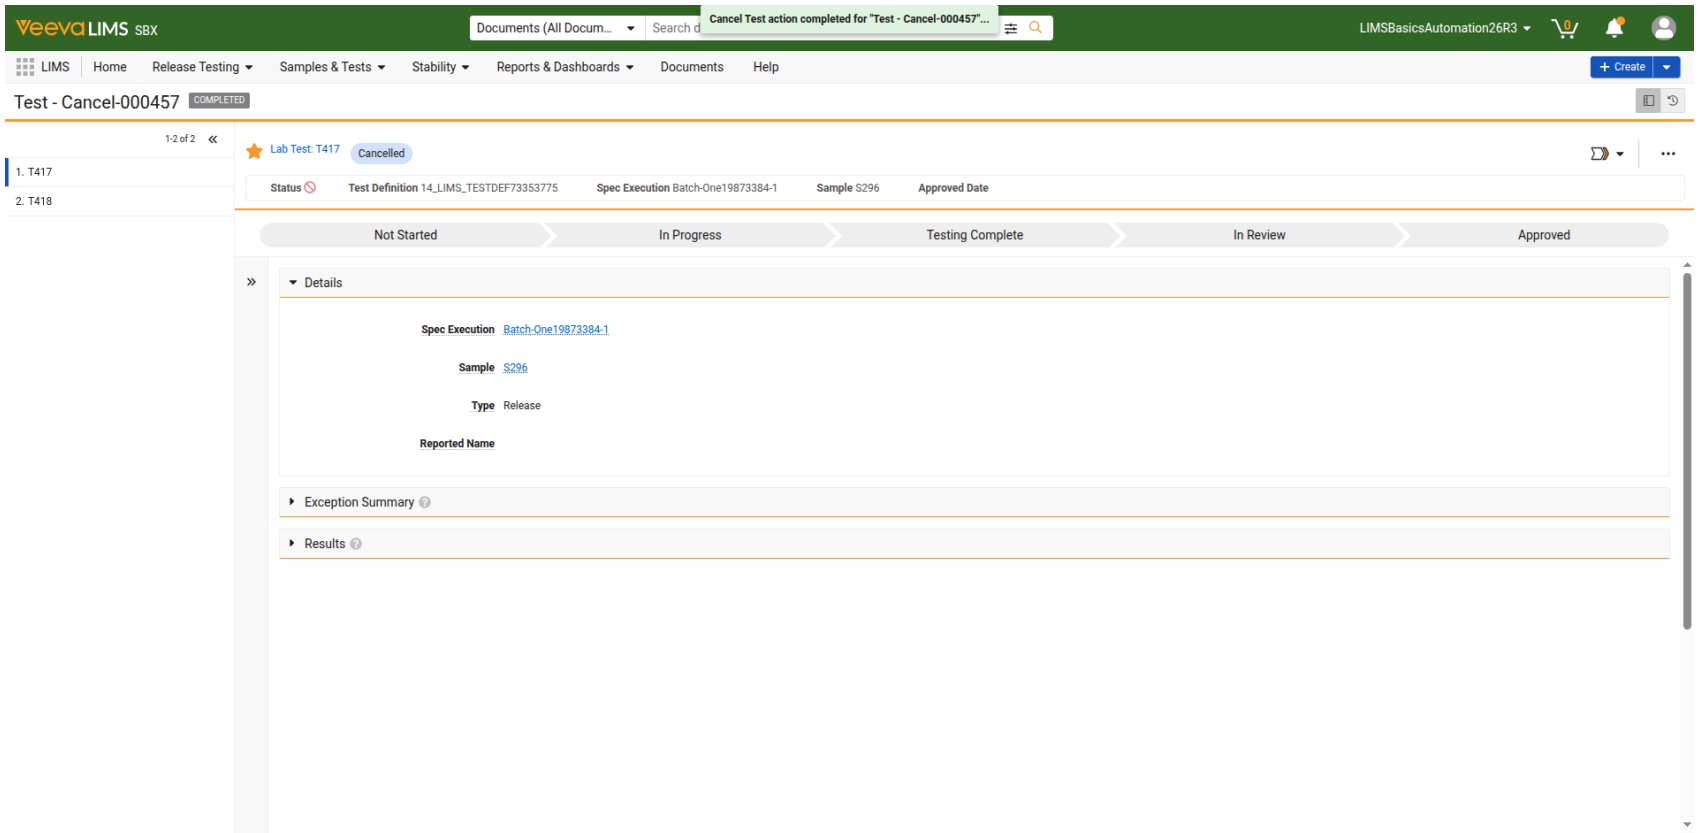


Step #6 Screenshot #2 Screenshot Time: 08-OCT-2026 08:48:31 GMT-07:00

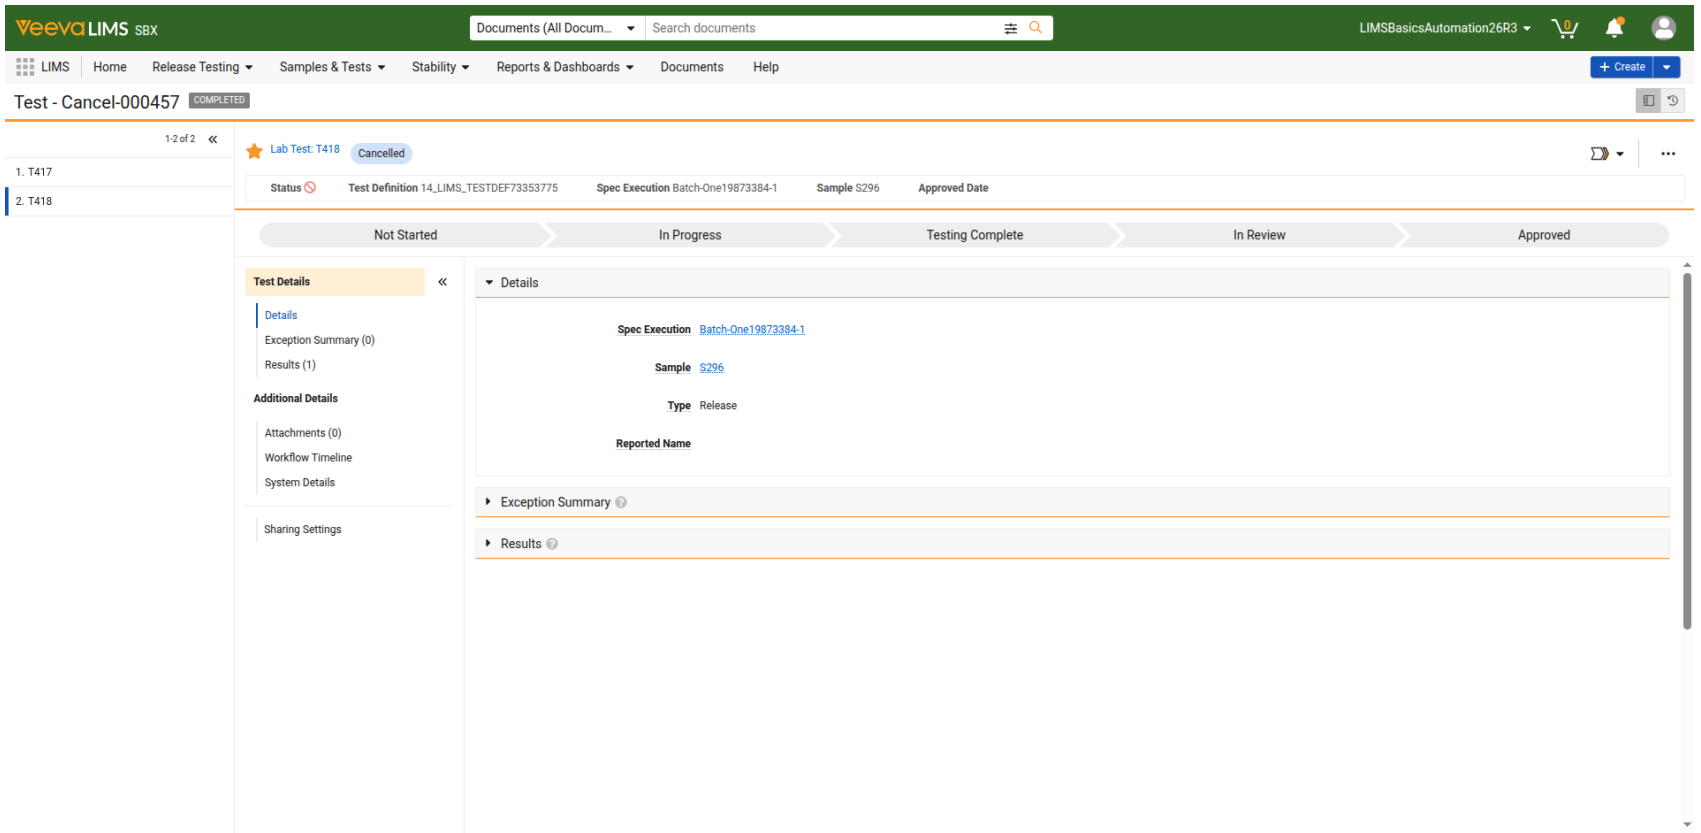

Step #6 Screenshot #3 Screenshot Time: 08-OCT-2026 08:48:38 GMT-07:00

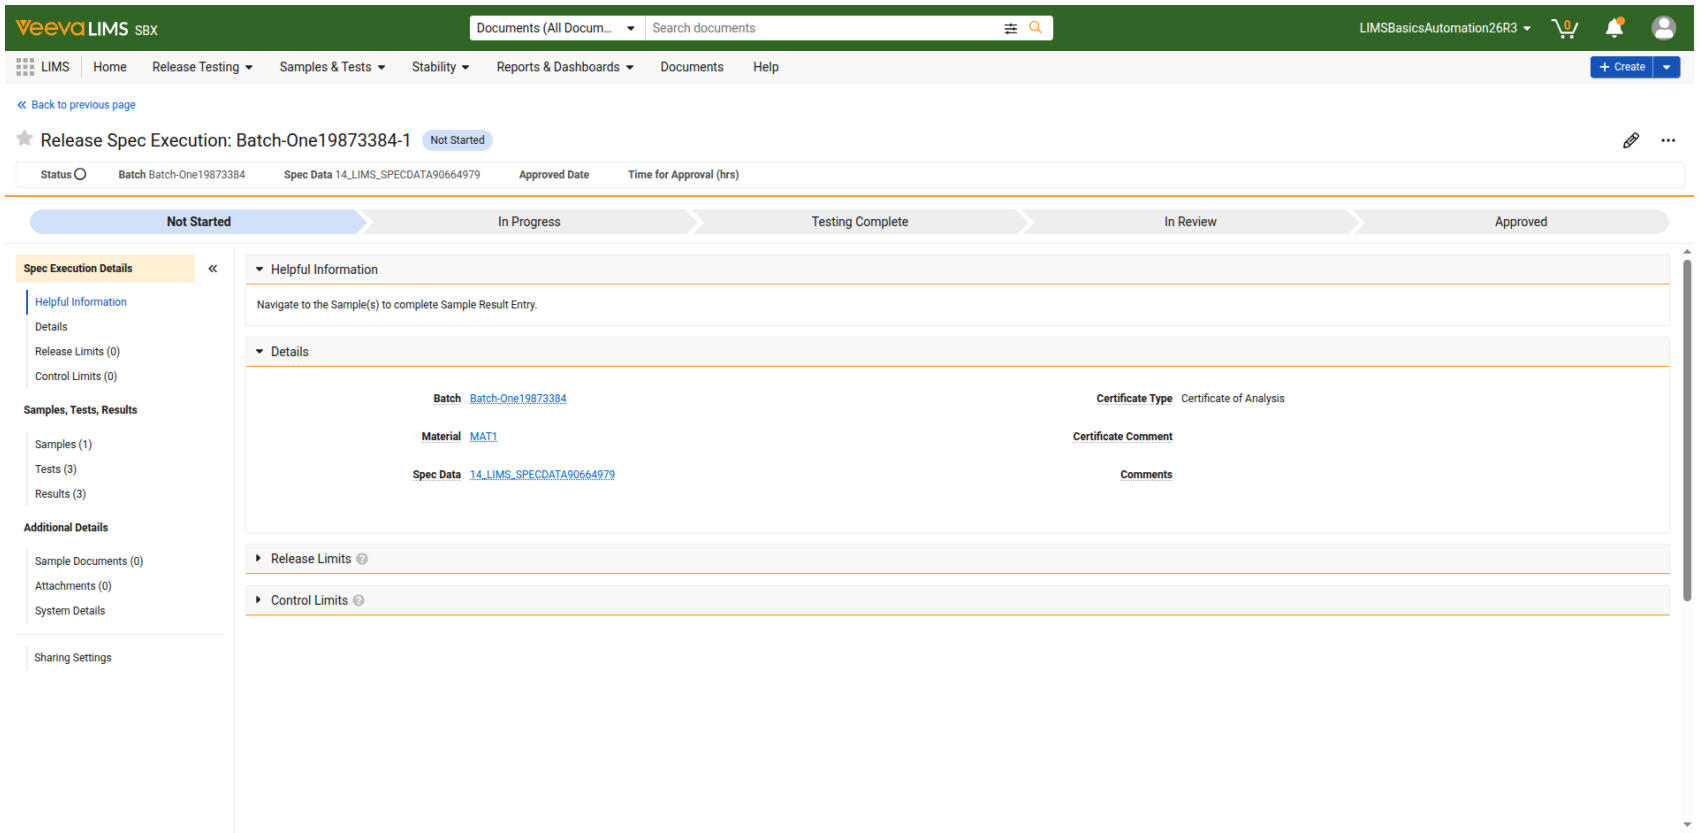


Step #6 Screenshot #4 Screenshot Time: 08-OCT-2026 08:48:49 GMT-07:00

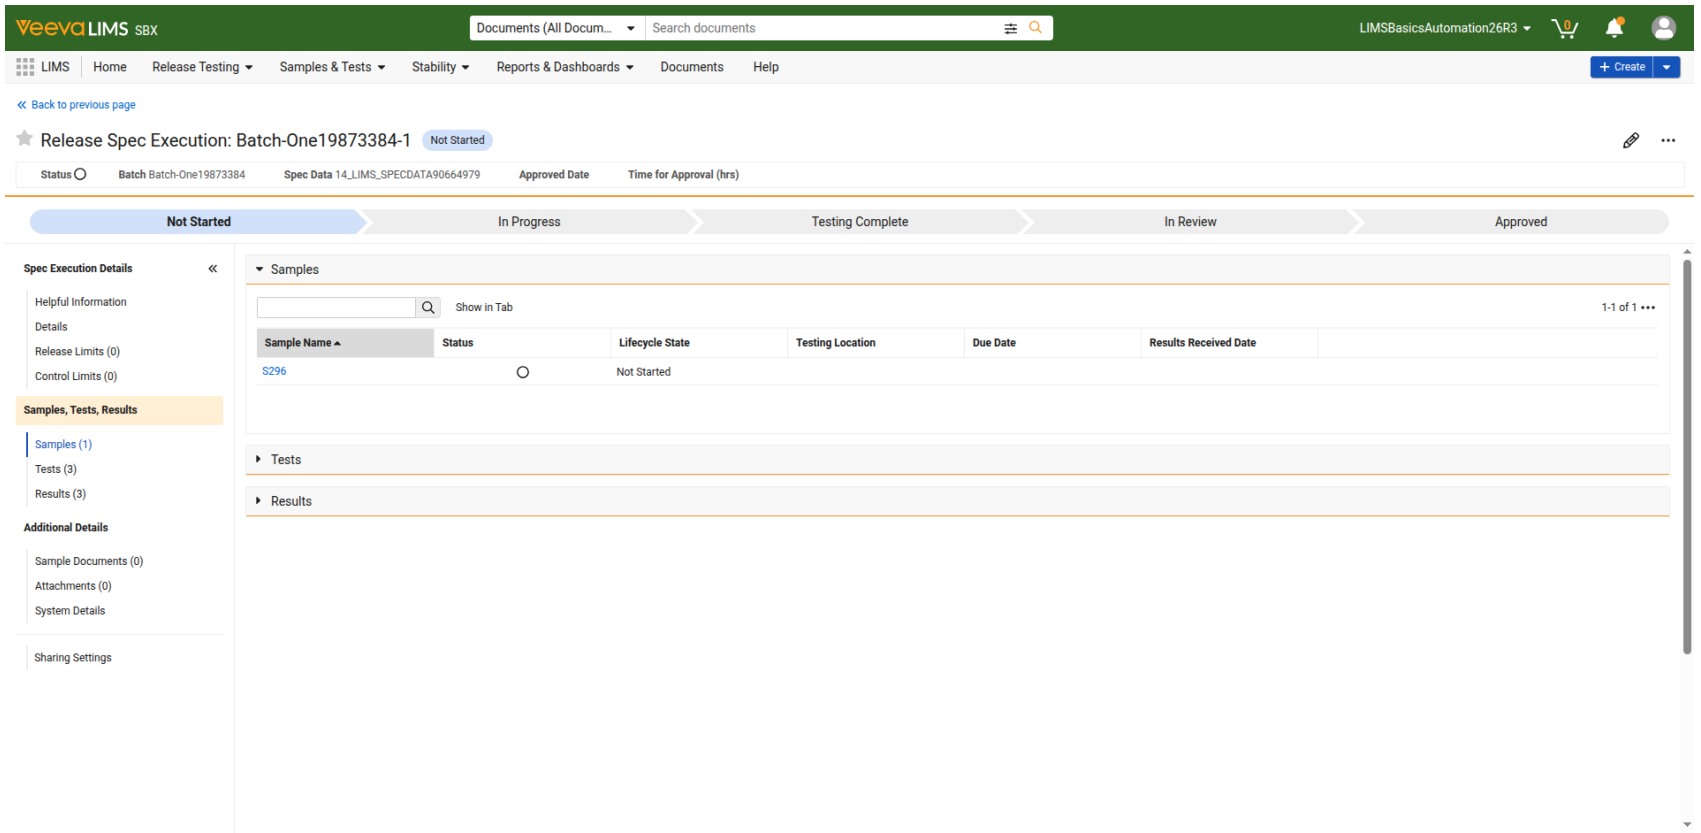


Executed Test Script


Step #7 Screenshot Screenshot Time: 08-OCT-2026 08:50:31 GMT-07:00

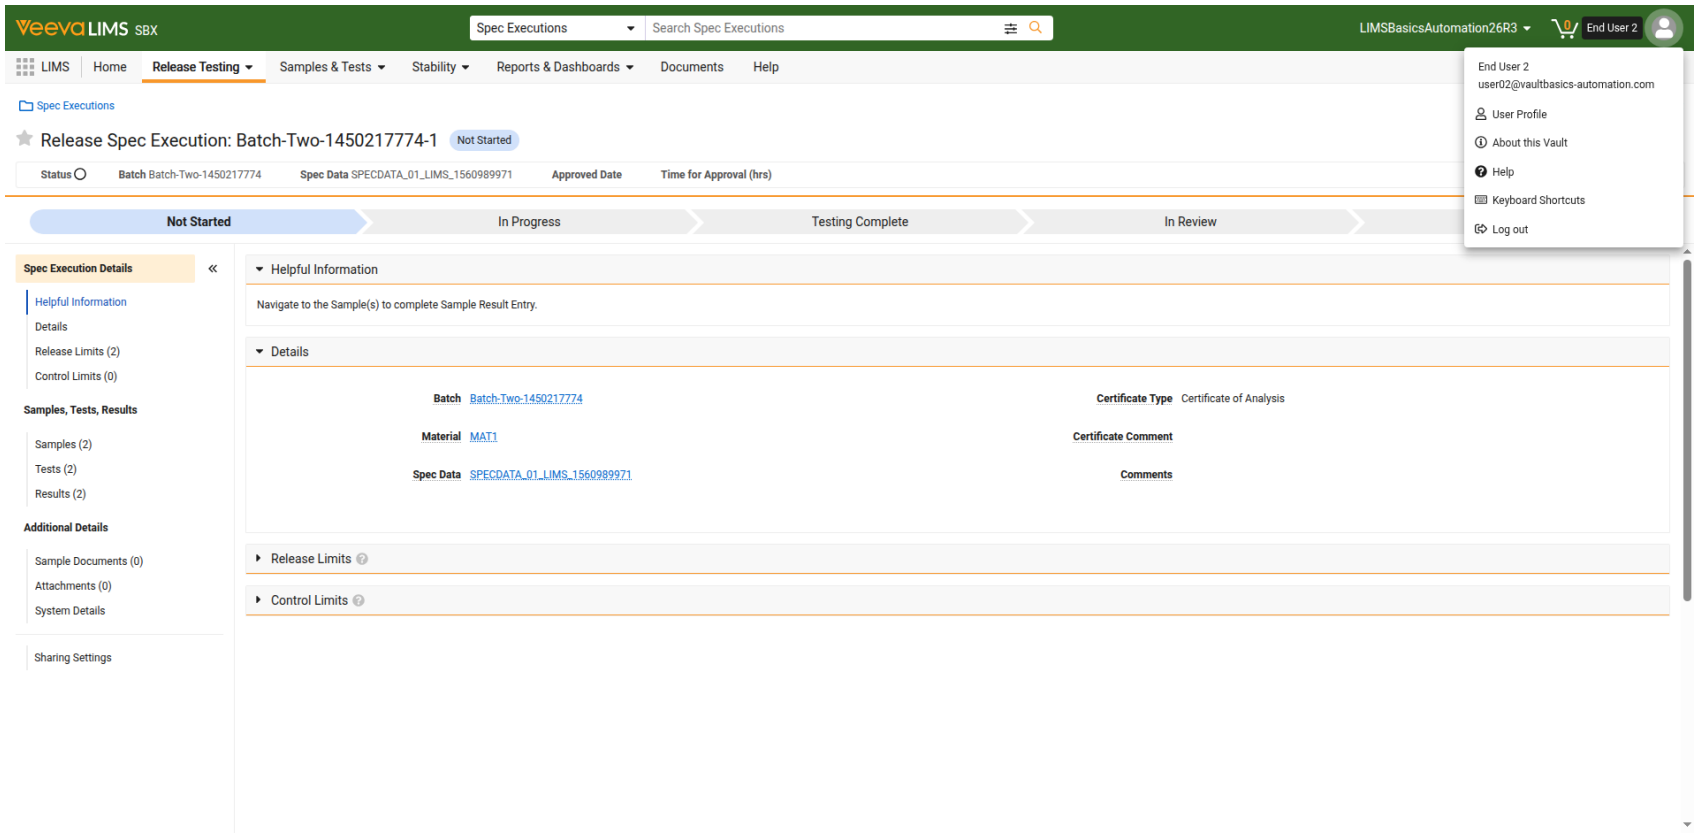


Step #8 Screenshot Screenshot Time: 08-OCT-2026 08:51:24 GMT-07:00

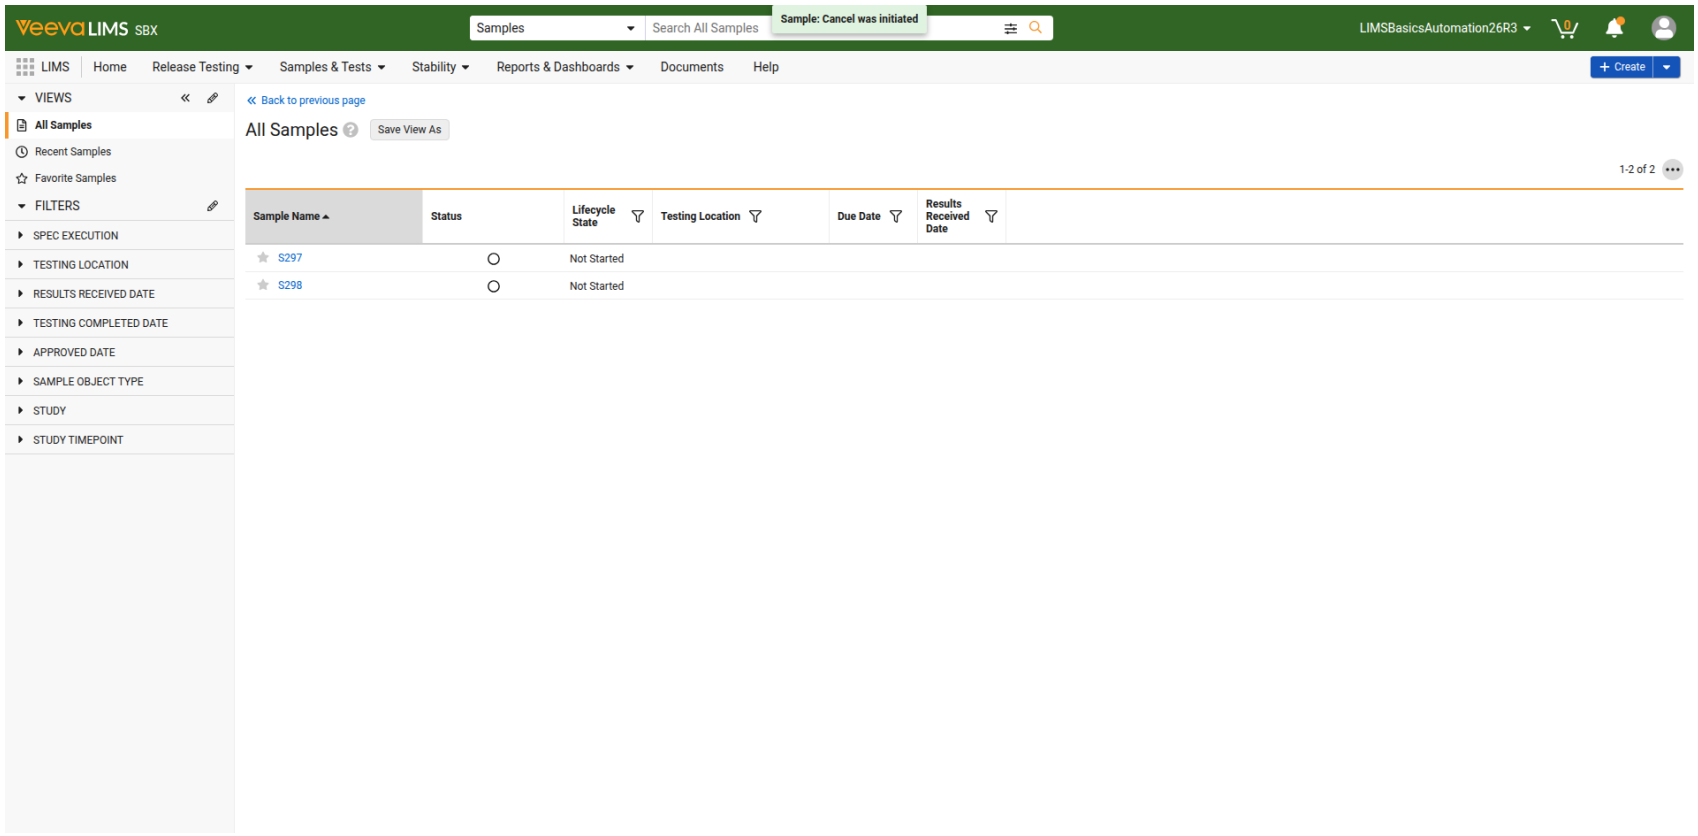


Step #9 Screenshot Screenshot Time: 08-OCT-2026 08:51:34 GMT-07:00

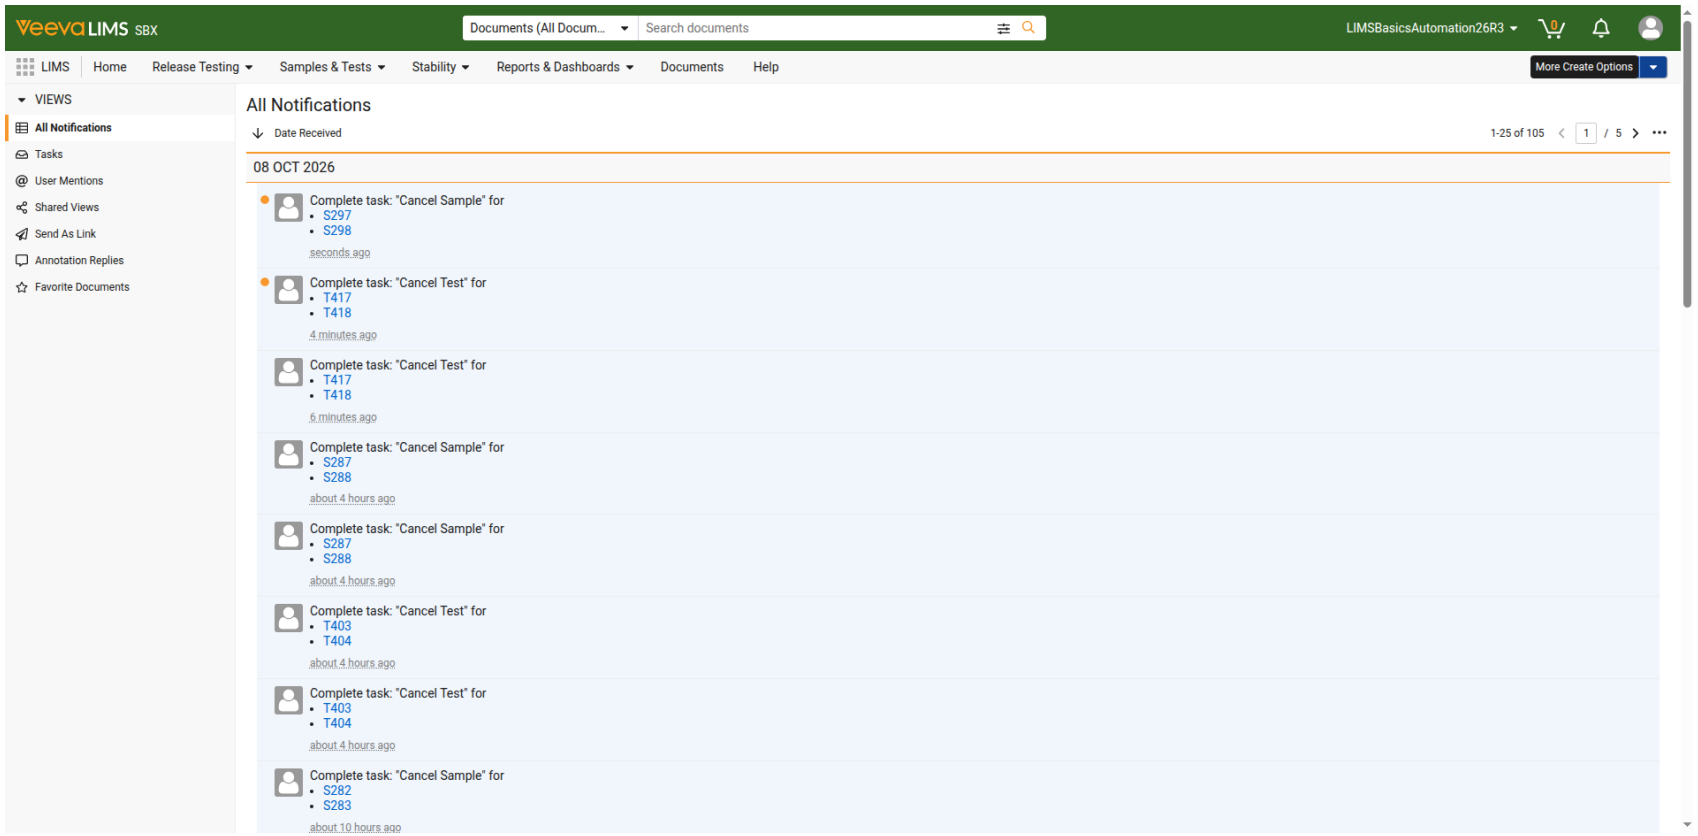

Step #10 Screenshot #1 Screenshot Time: 08-OCT-2026 08:53:44 GMT-07:00

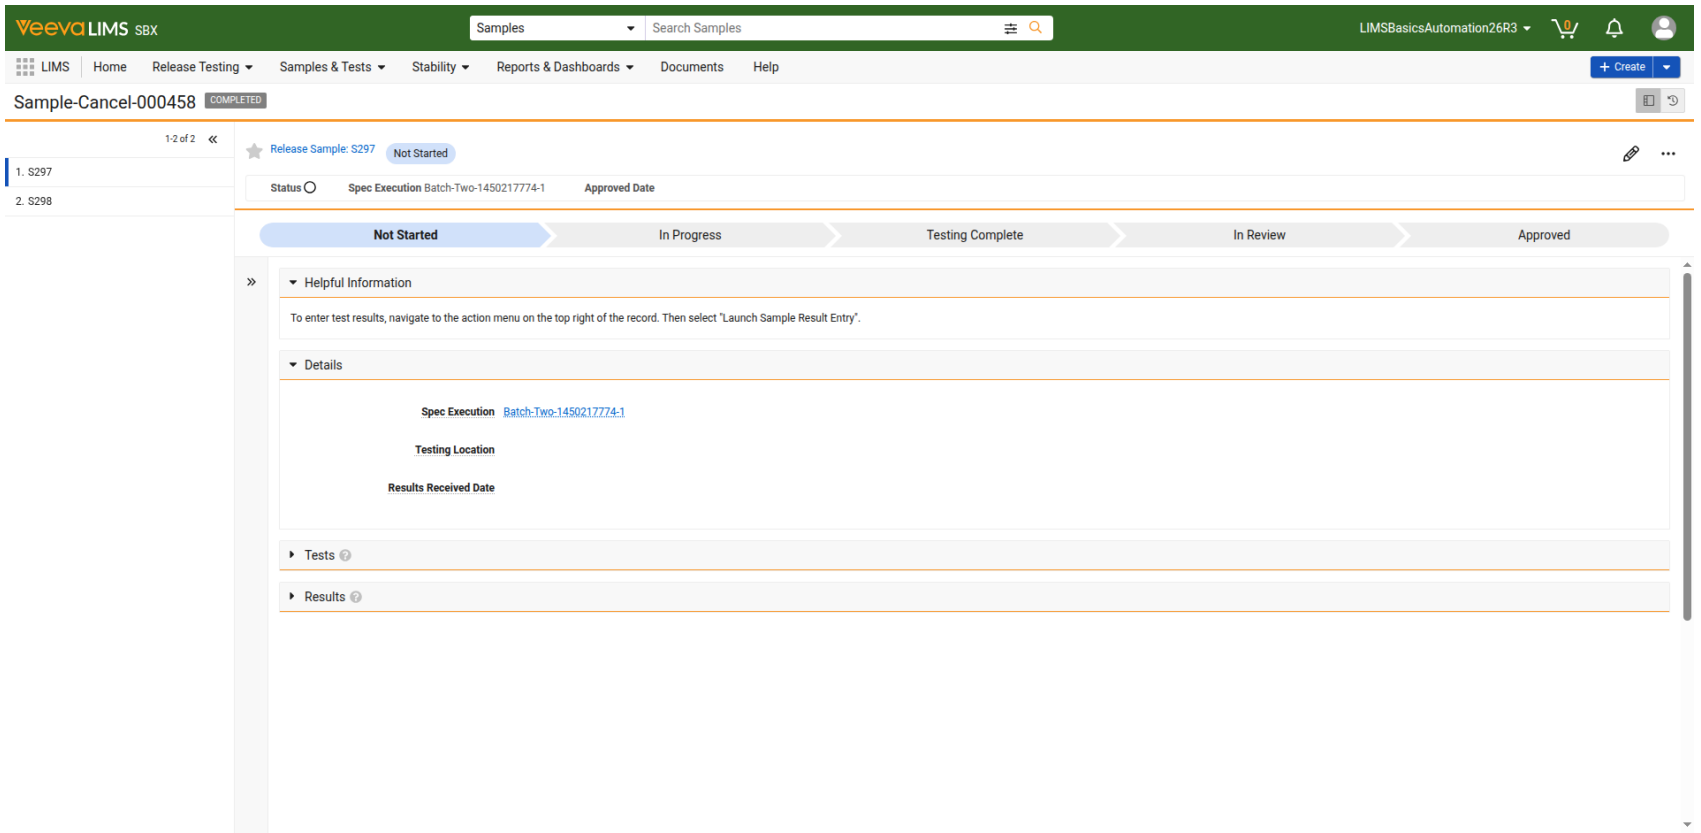


Step #10 Screenshot #2 Screenshot Time: 08-OCT-2026 08:53:52 GMT-07:00

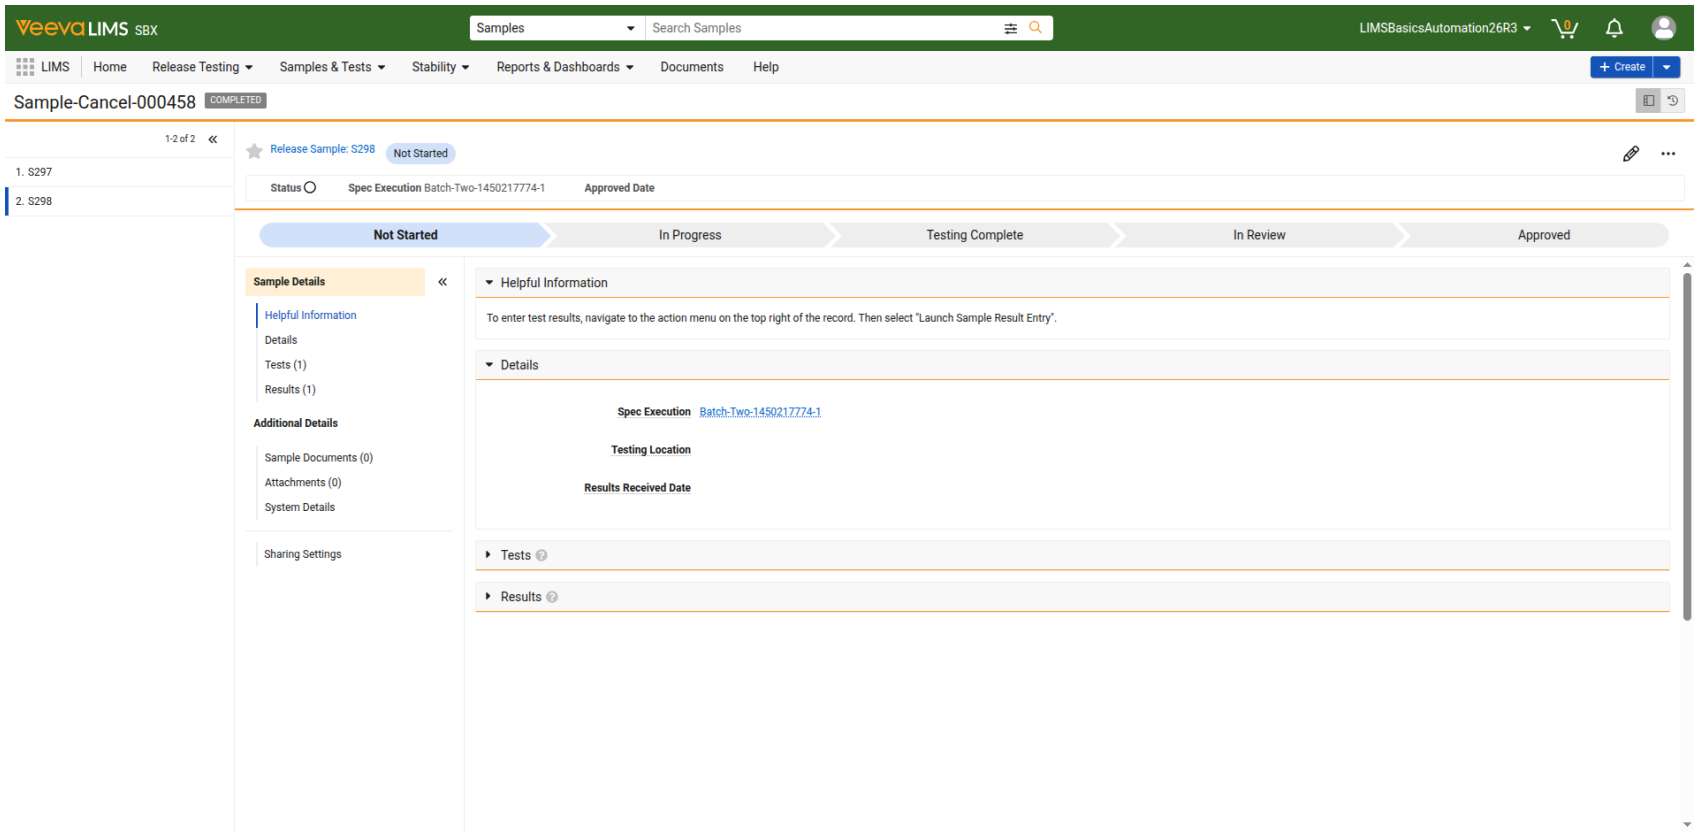


Executed Test Script

Step #11 Screenshot Screenshot Time: 08-OCT-2026 08:54:38 GMT-07:00

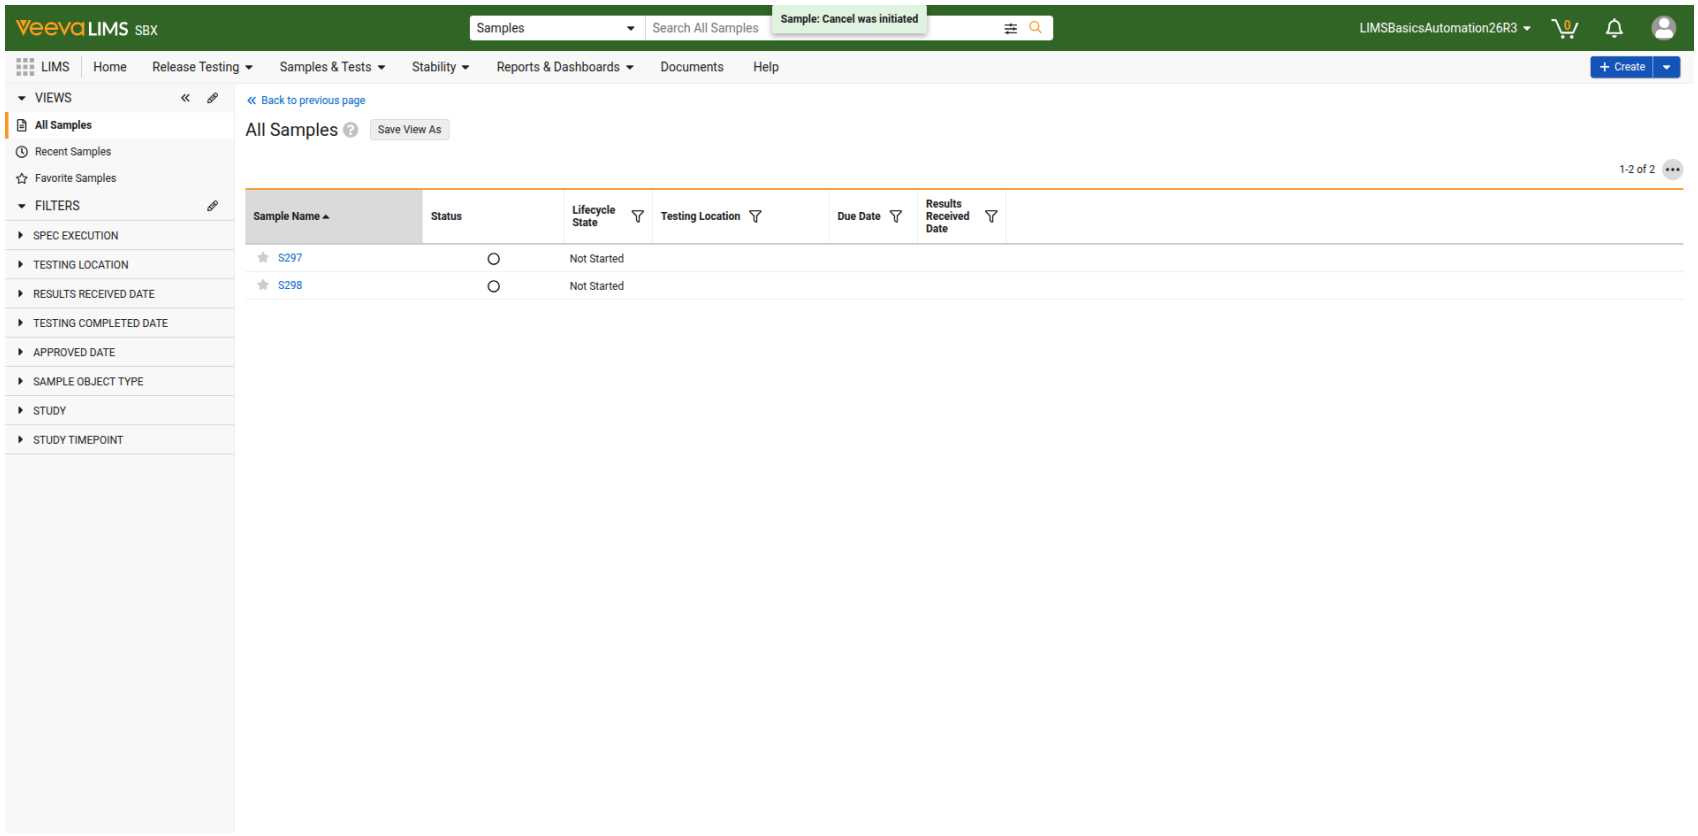


Executed Test Script


Step #12 Screenshot #1 Screenshot Time: 08-OCT-2026 09:02:16 GMT-07:00

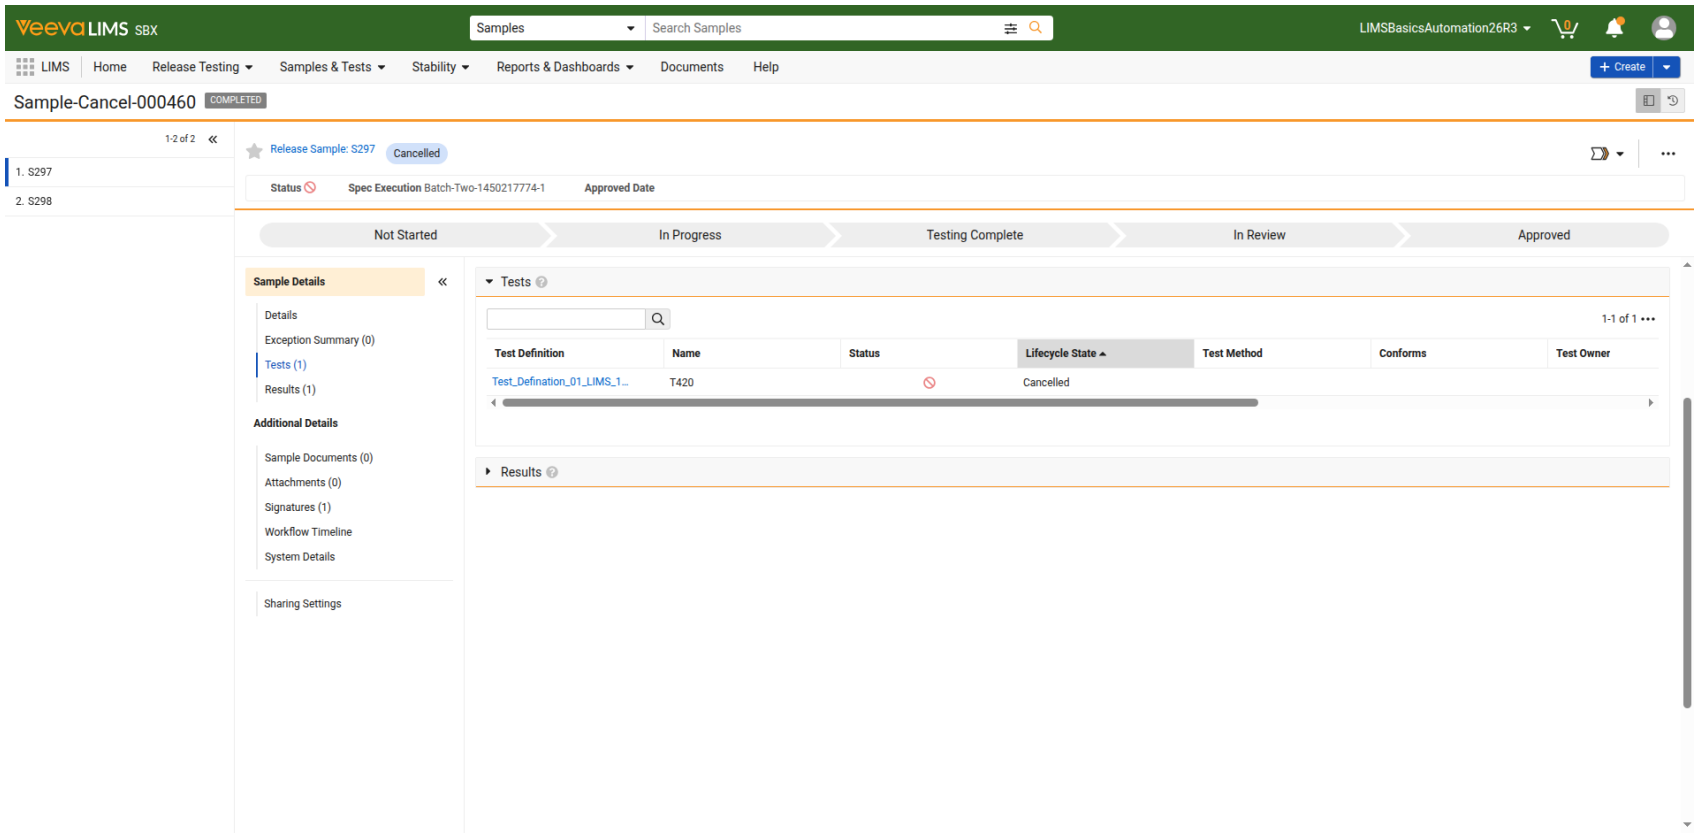


Step #12 Screenshot #2 Screenshot Time: 08-OCT-2026 09:02:31 GMT-07:00

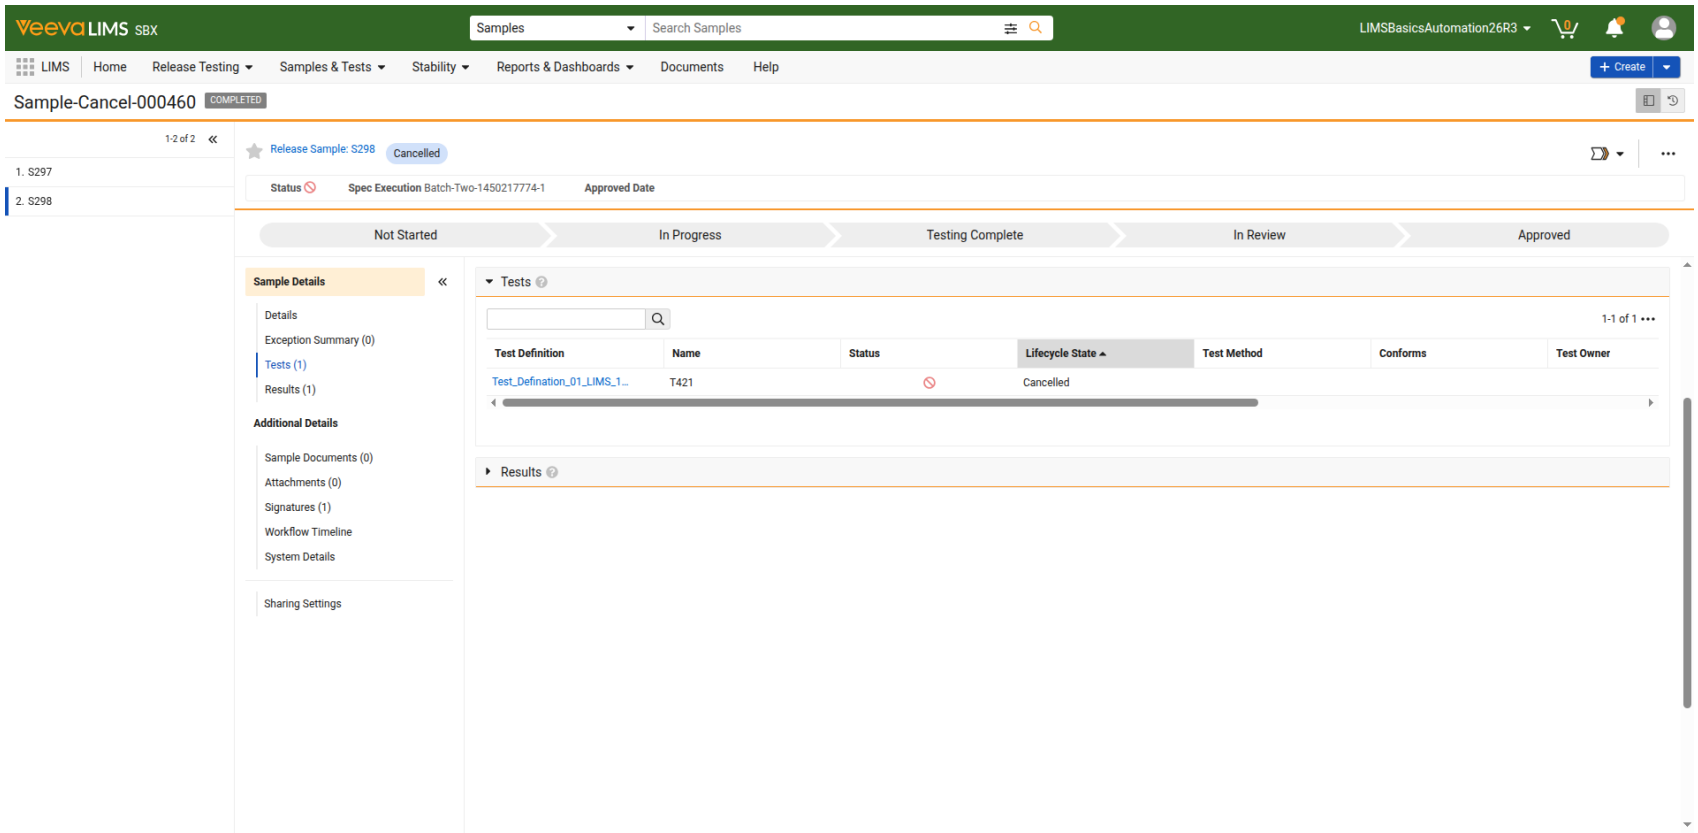


Step #12 Screenshot #3 Screenshot Time: 08-OCT-2026 09:08:22 GMT-07:00

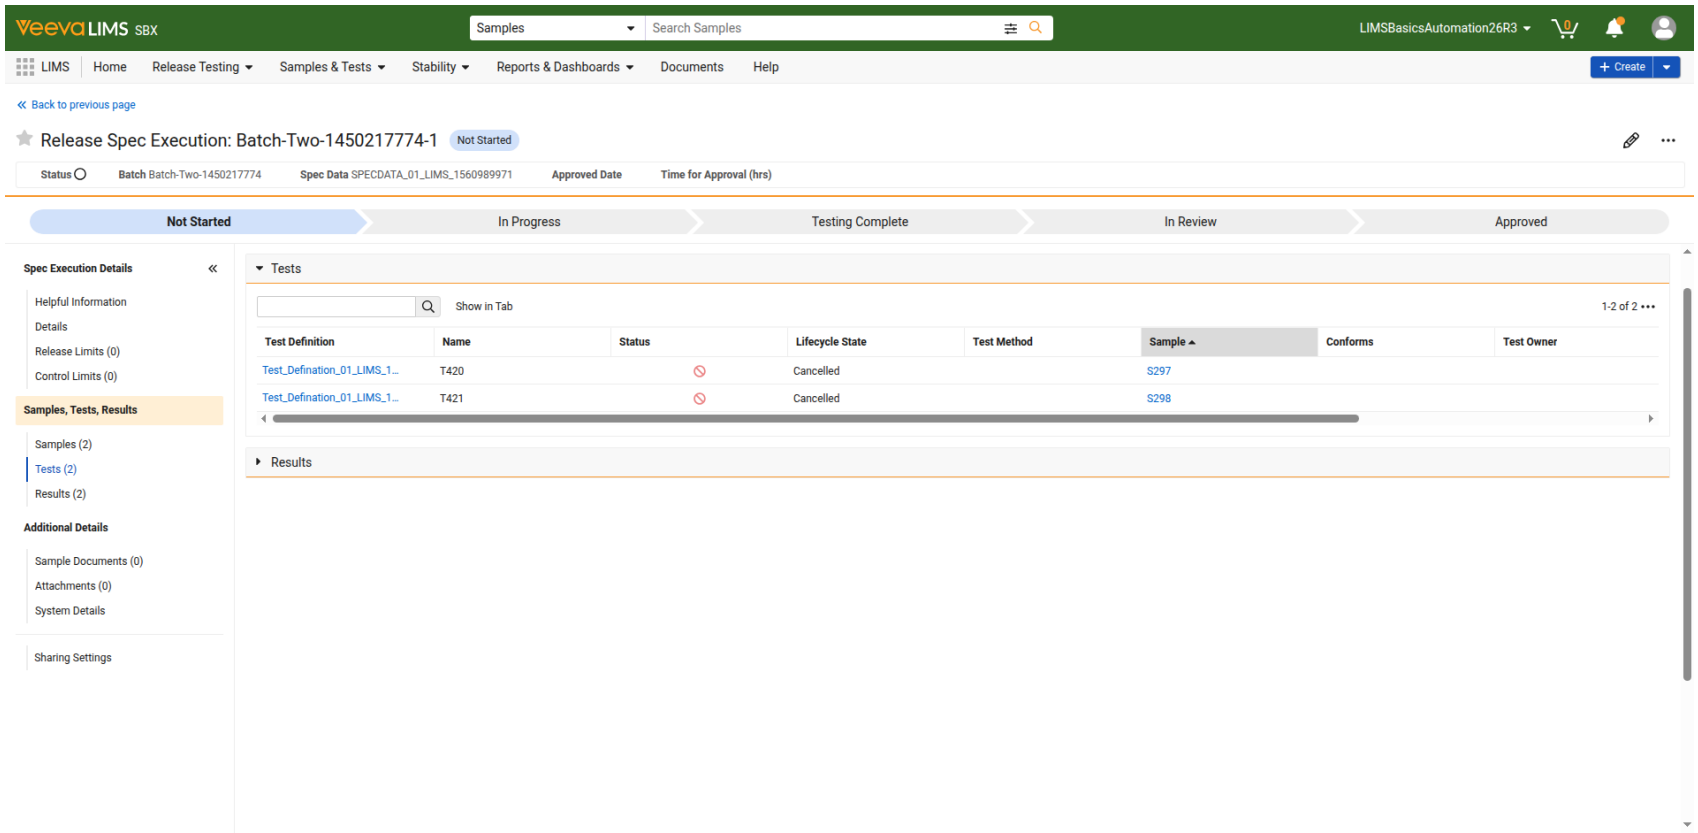


Step #13 Screenshot Screenshot Time: 08-OCT-2026 09:11:09 GMT-07:00

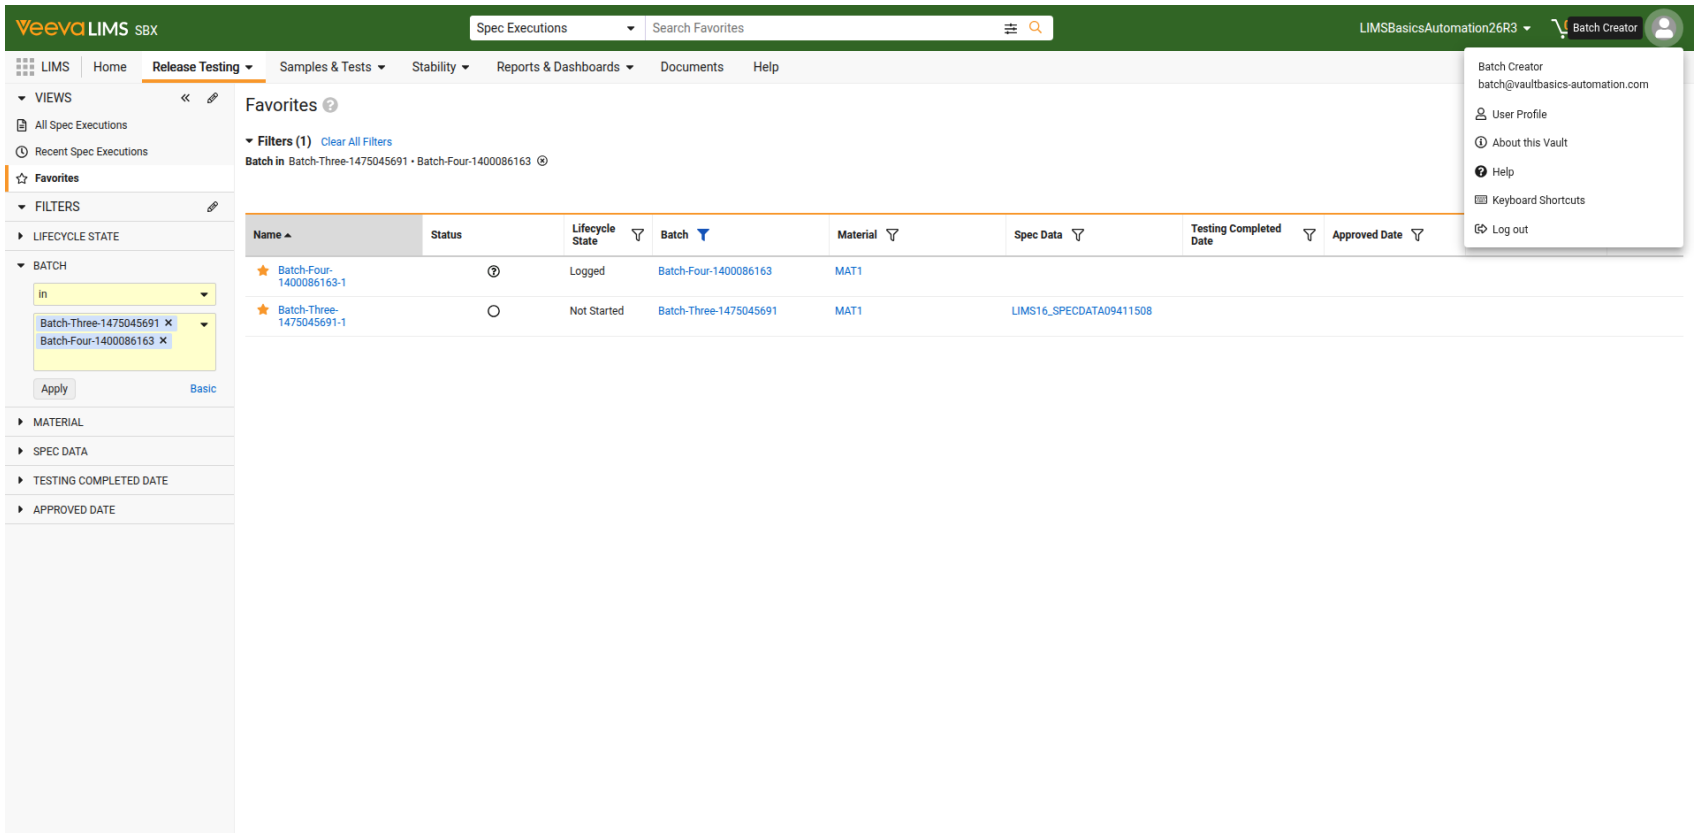


Step #14 Screenshot Screenshot Time: 08-OCT-2026 09:11:41 GMT-07:00

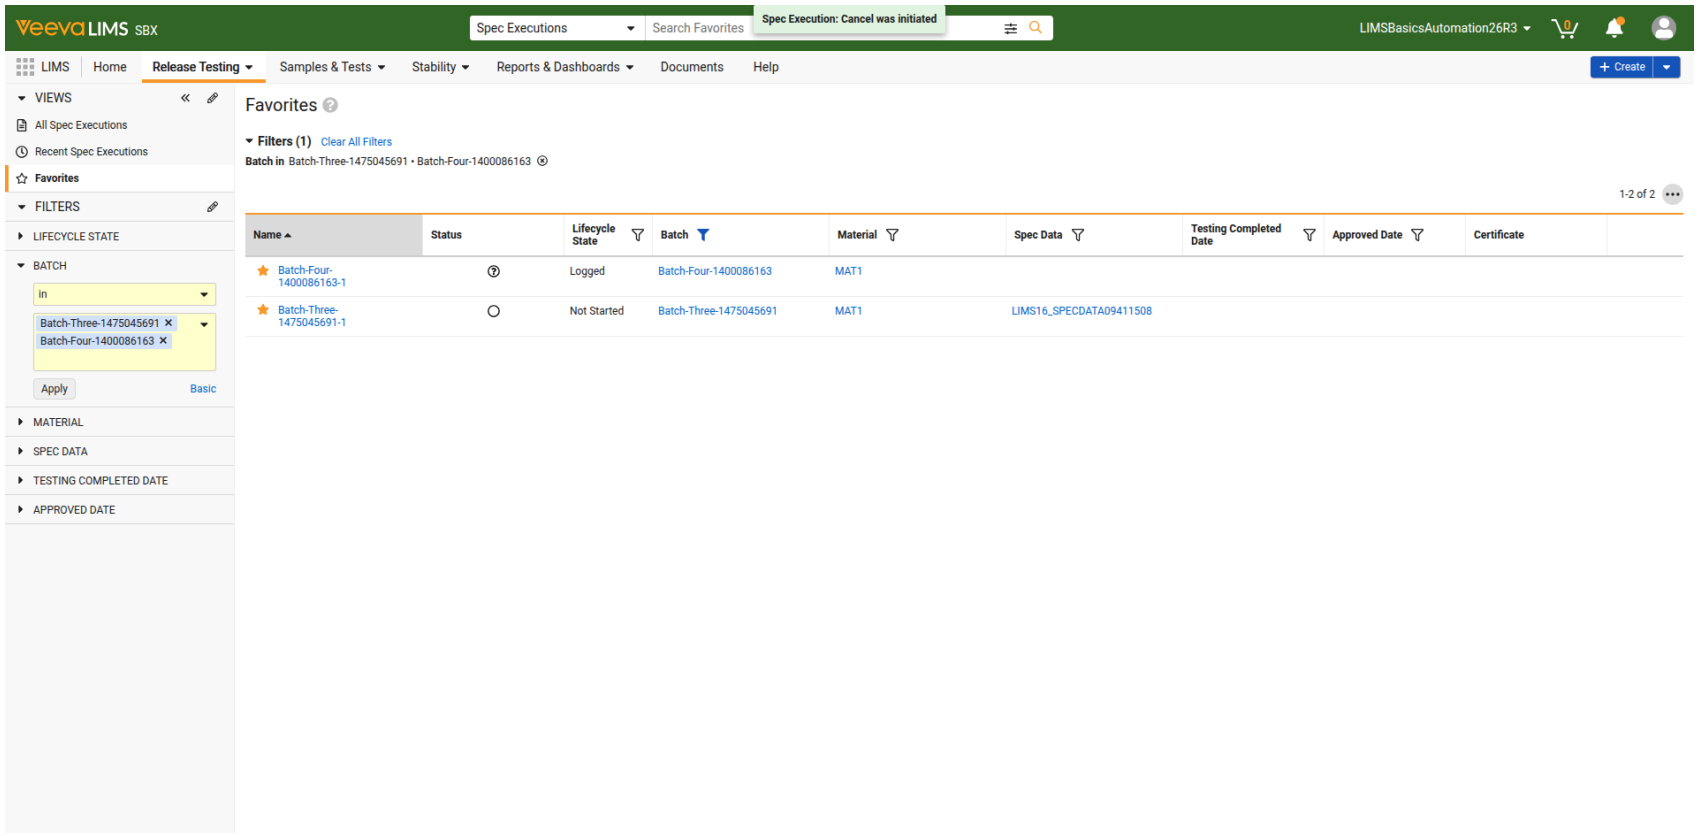


Step #15 Screenshot Screenshot Time: 08-OCT-2026 09:11:48 GMT-07:00

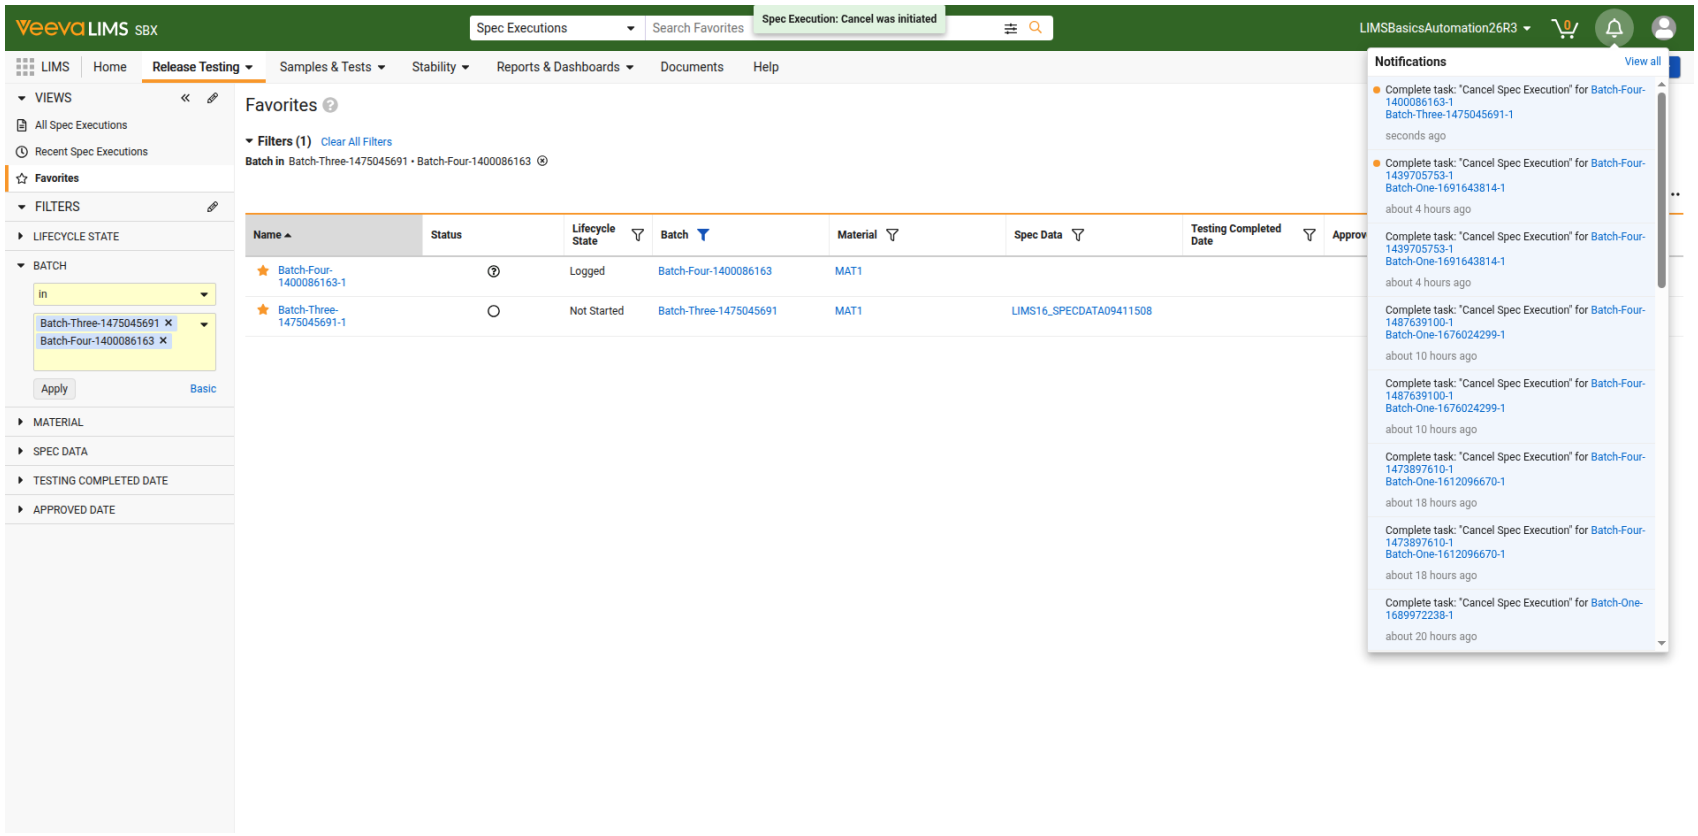


Step #16 Screenshot #1 Screenshot Time: 08-OCT-2026 09:14:00 GMT-07:00

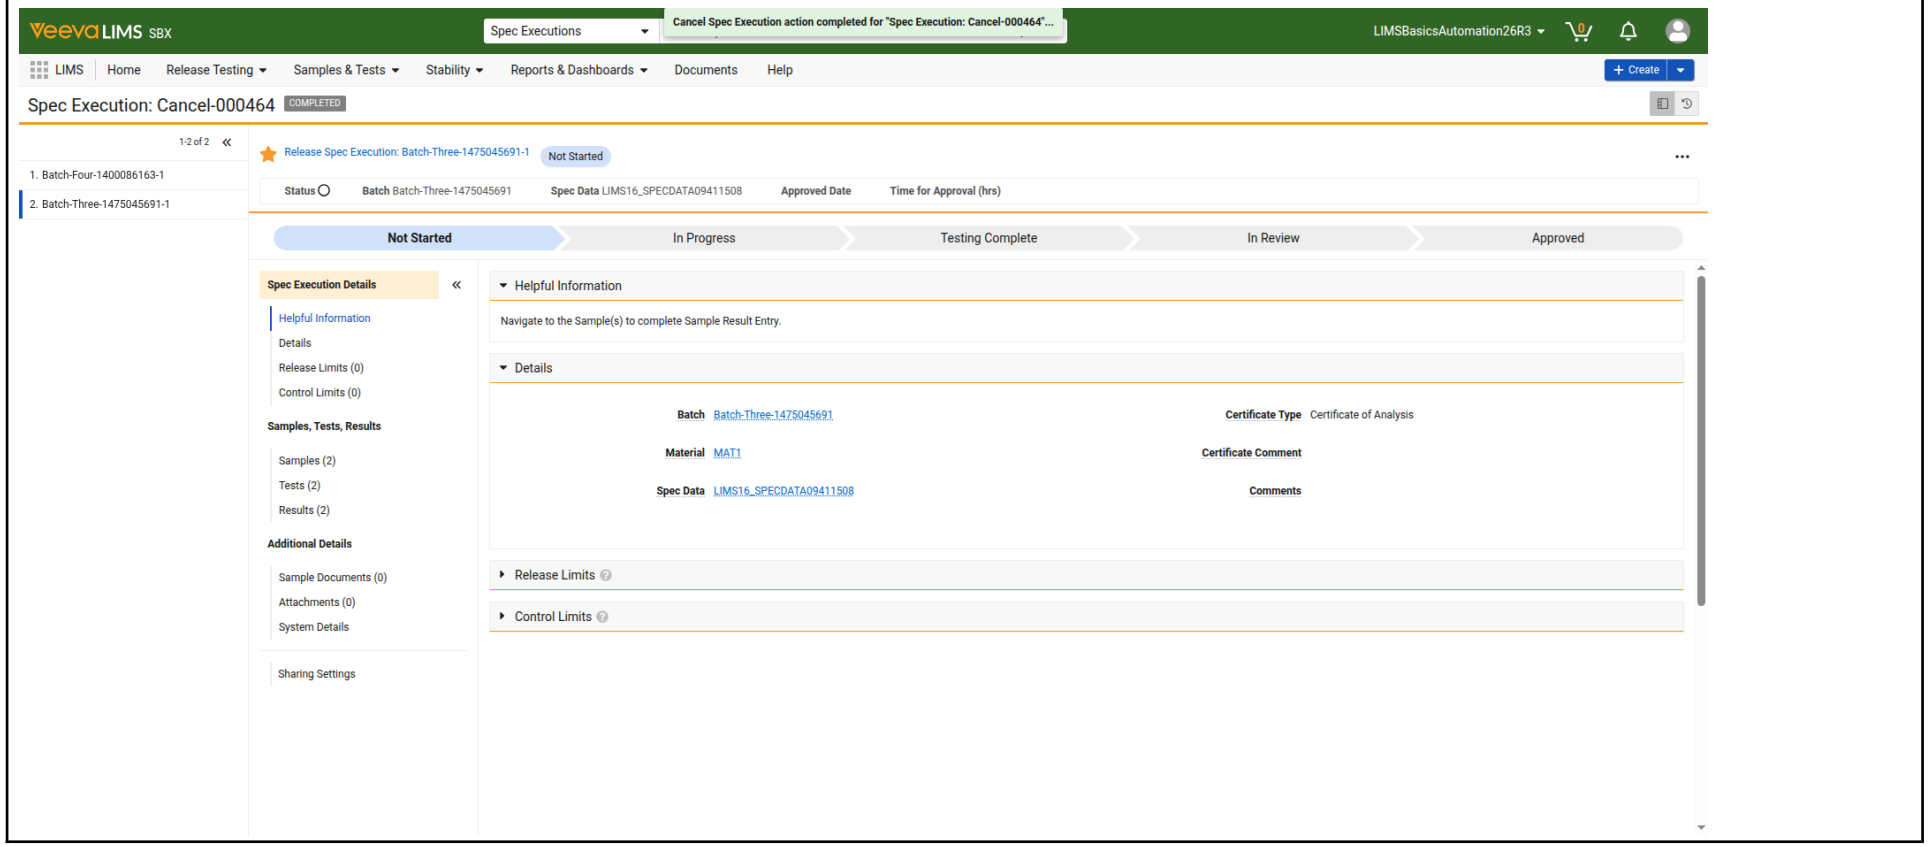


Step #16 Screenshot #2 Screenshot Time: 08-OCT-2026 09:14:08 GMT-07:00

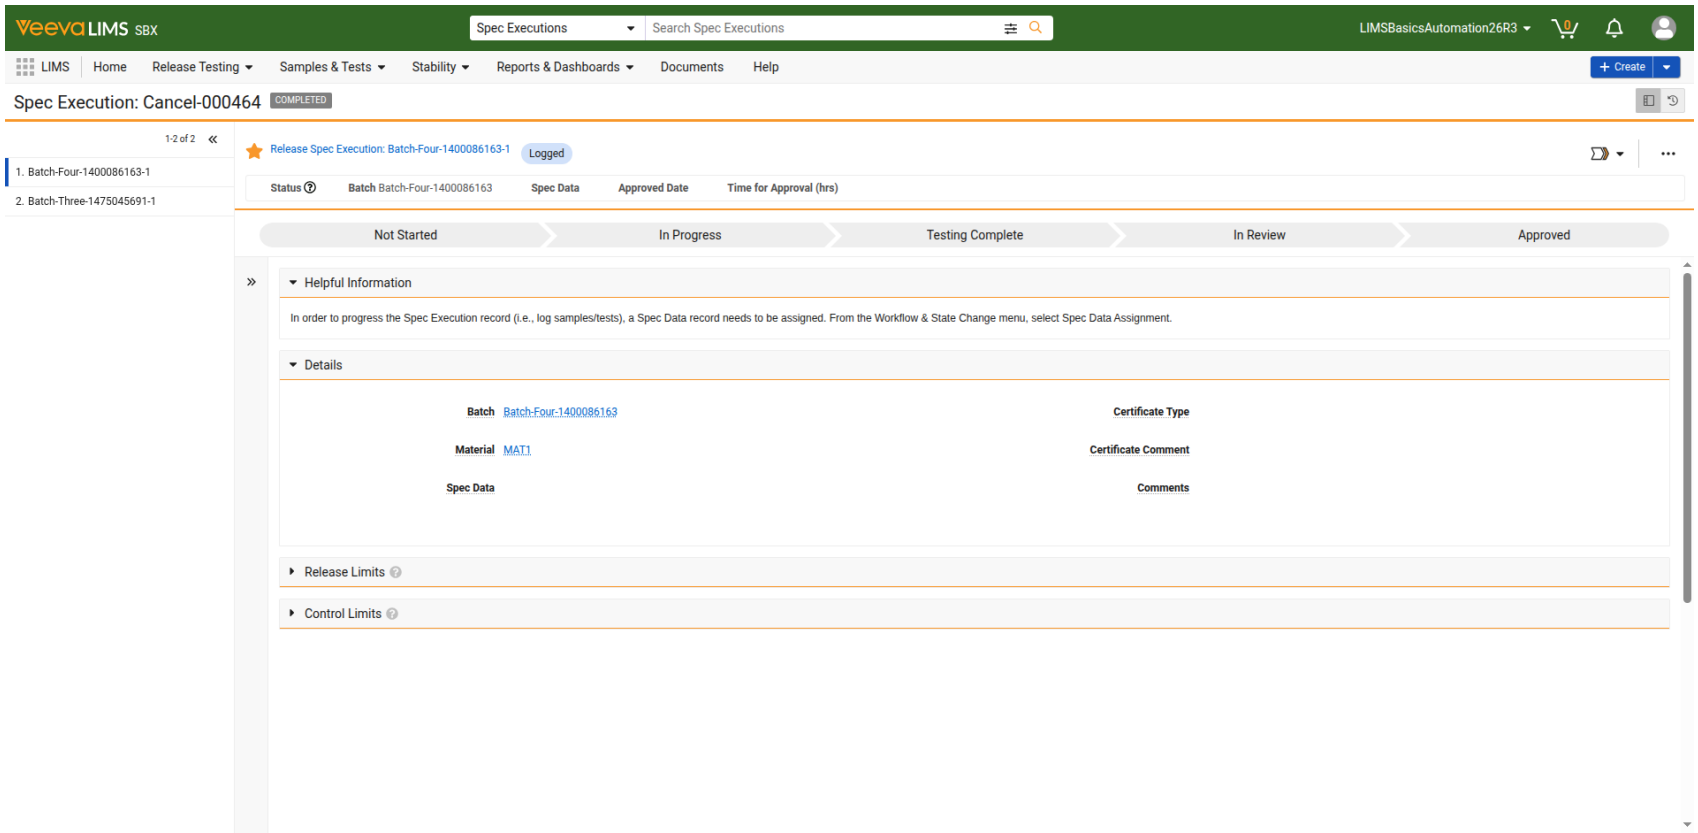

Step #17 Screenshot Screenshot Time: 08-OCT-2026 09:16:45 GMT-07:00

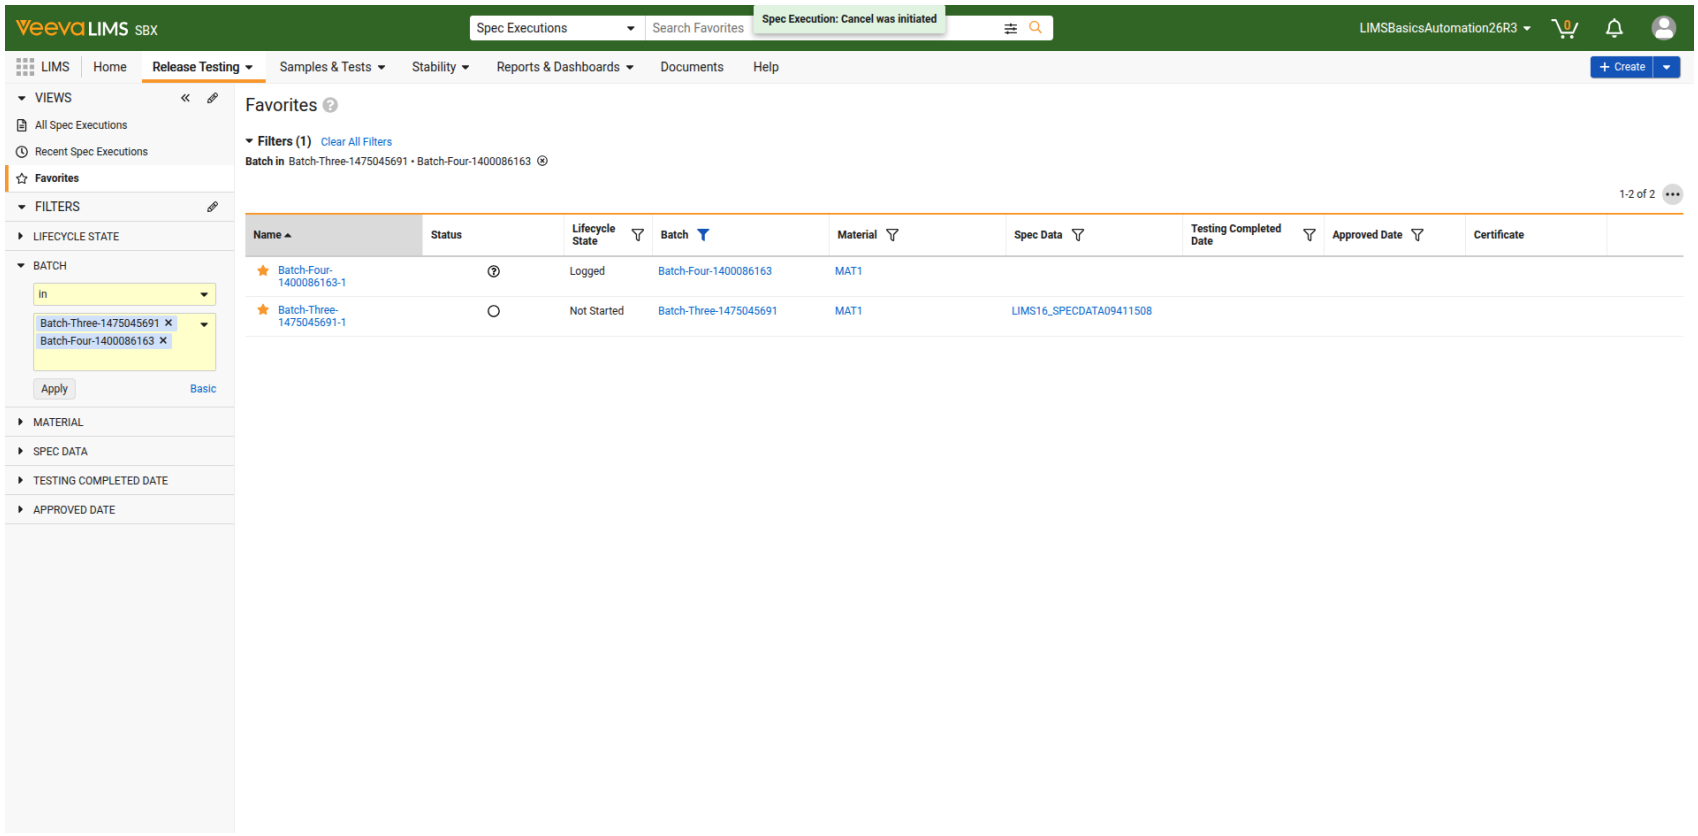


Step #18 Screenshot #1 Screenshot Time: 08-OCT-2026 09:19:19 GMT-07:00

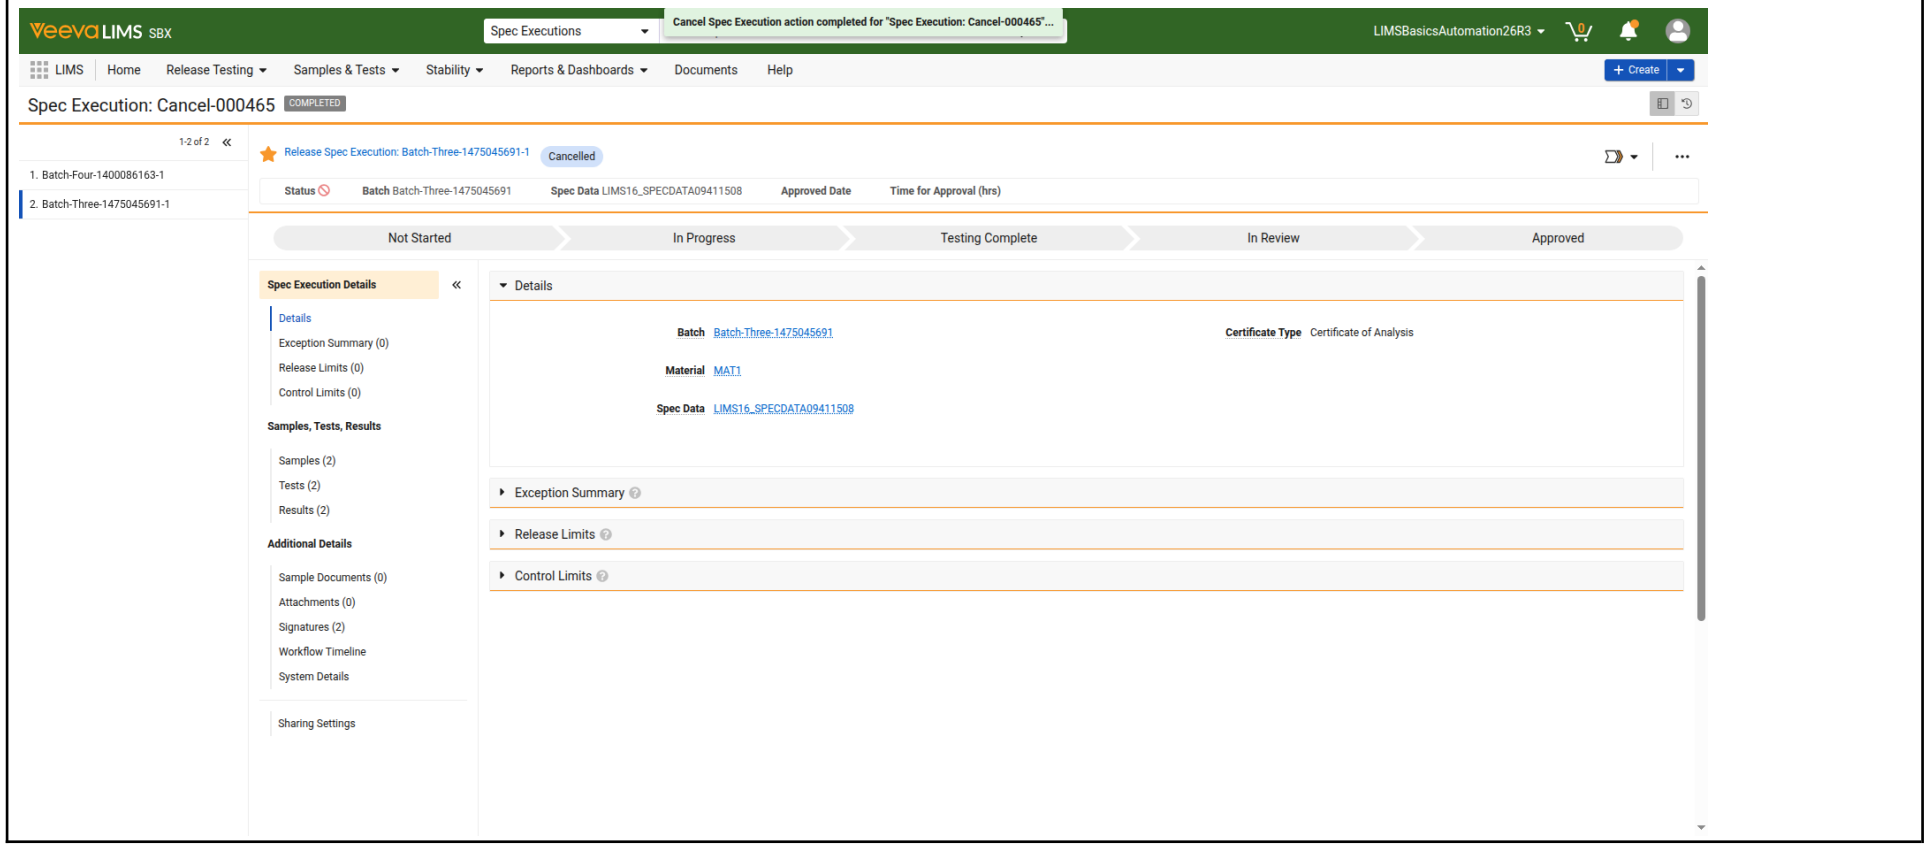


Executed Test Script


Step #18 Screenshot #2 Screenshot Time: 08-OCT-2026 09:19:27 GMT-07:00

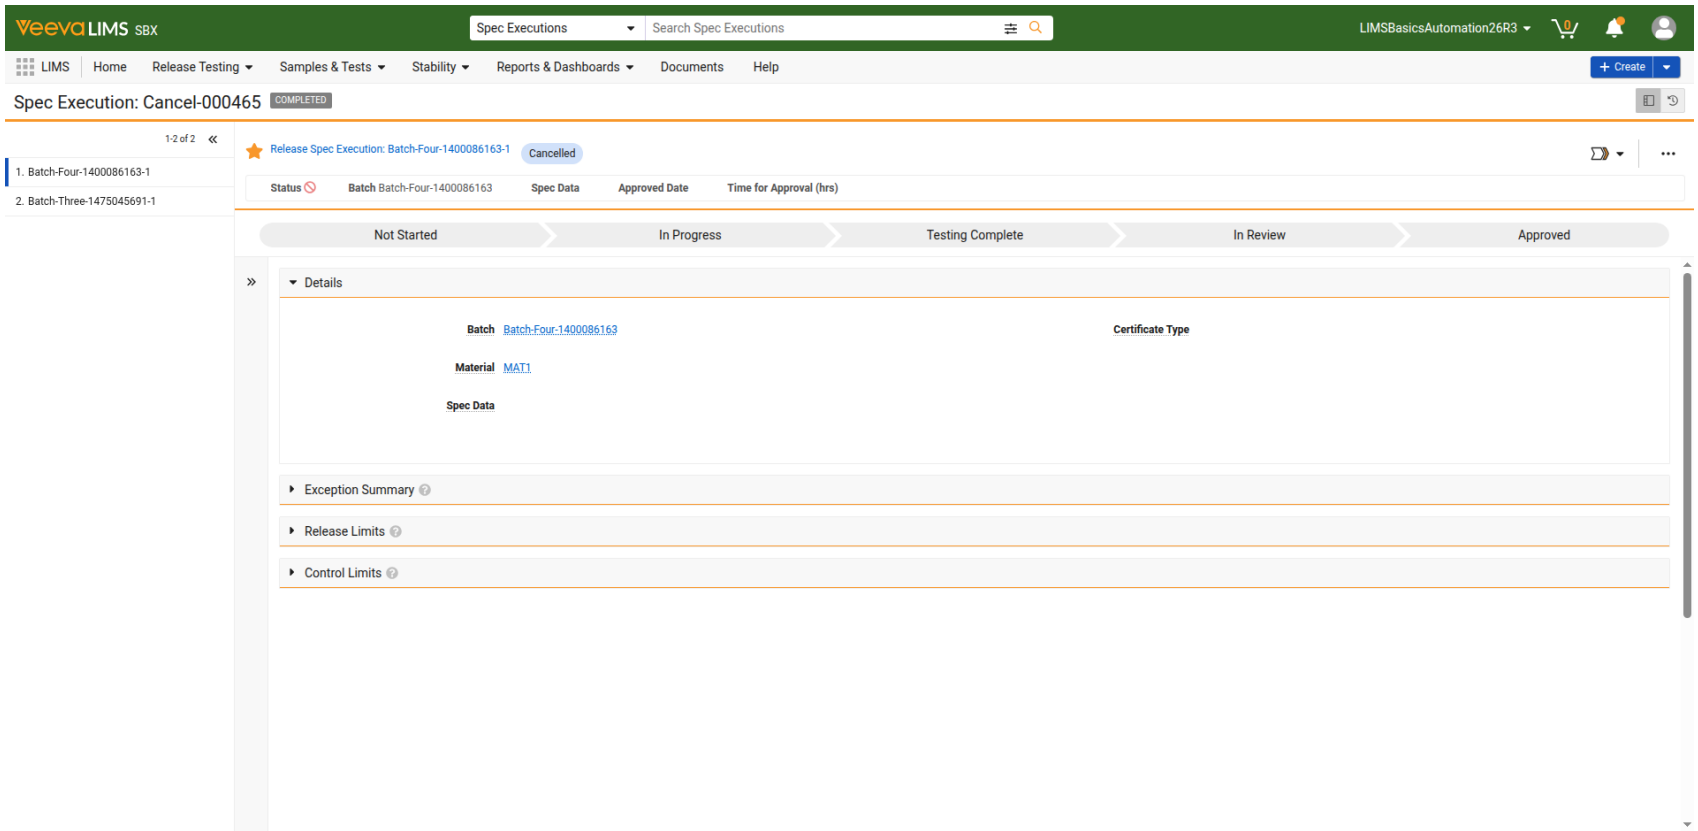


Step #18 Screenshot #3 Screenshot Time: 08-OCT-2026 09:21:05 GMT-07:00

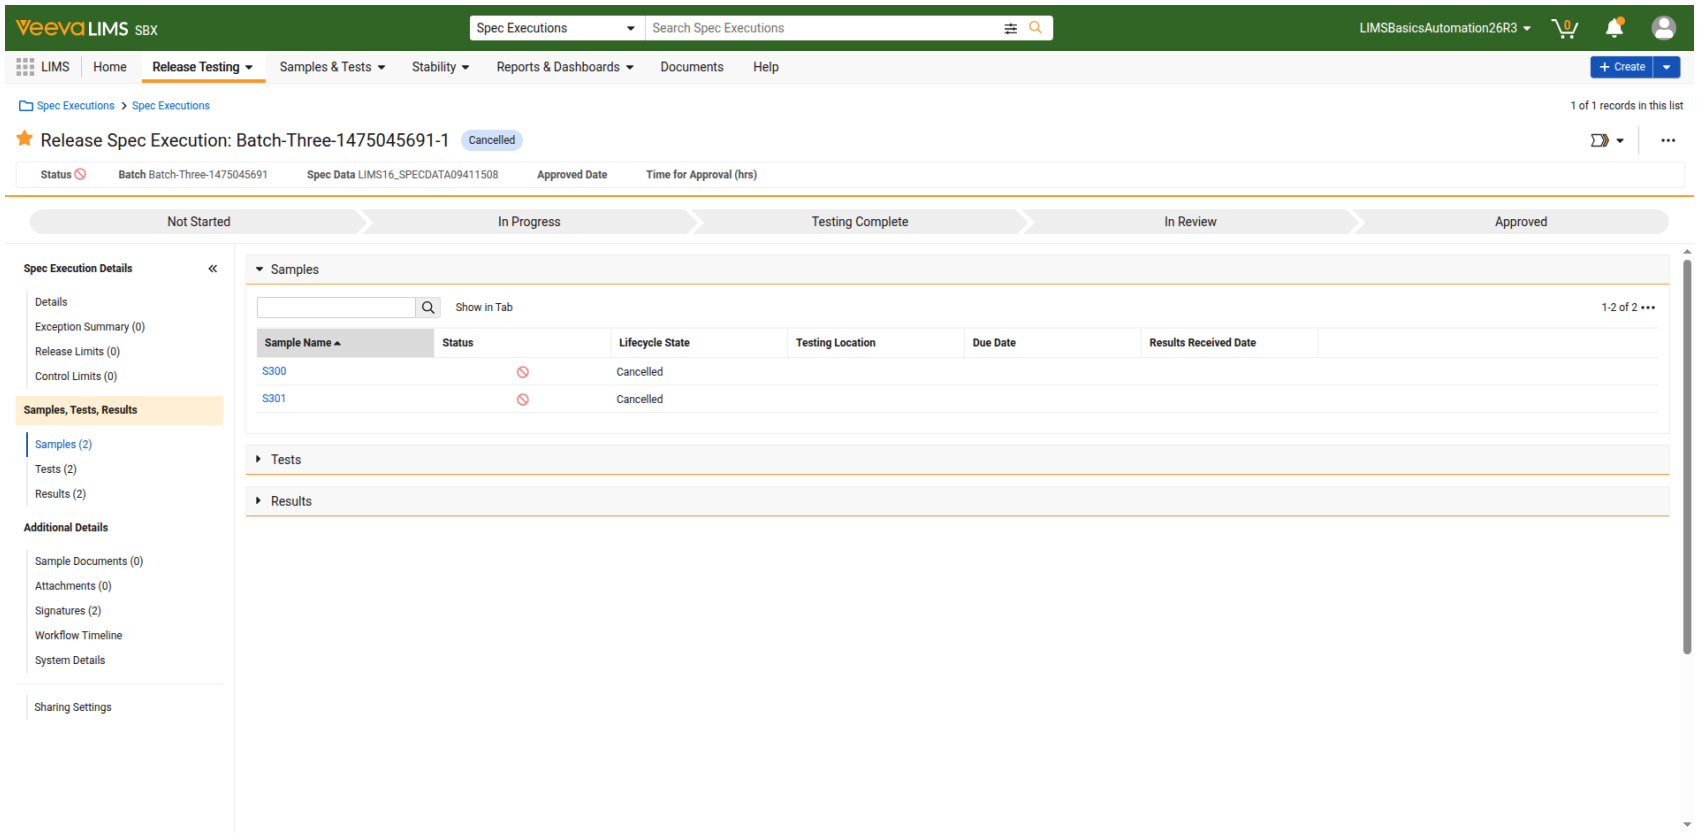


Step #18 Screenshot #4 Screenshot Time: 08-OCT-2026 09:26:48 GMT-07:00

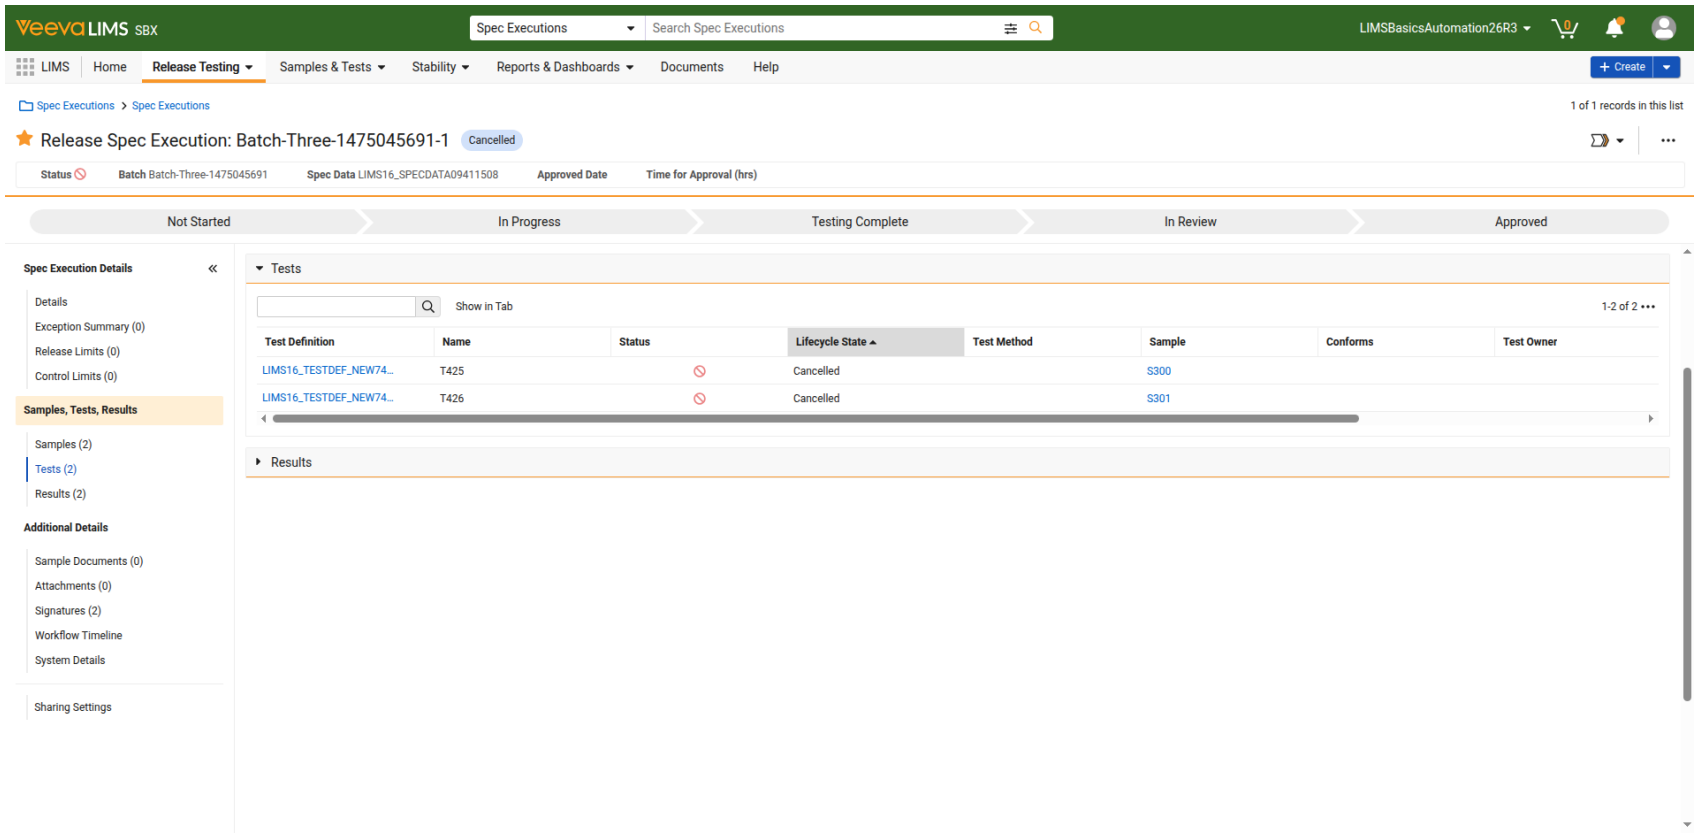

Step #18 Screenshot #5 Screenshot Time: 08-OCT-2026 09:28:25 GMT-07:00

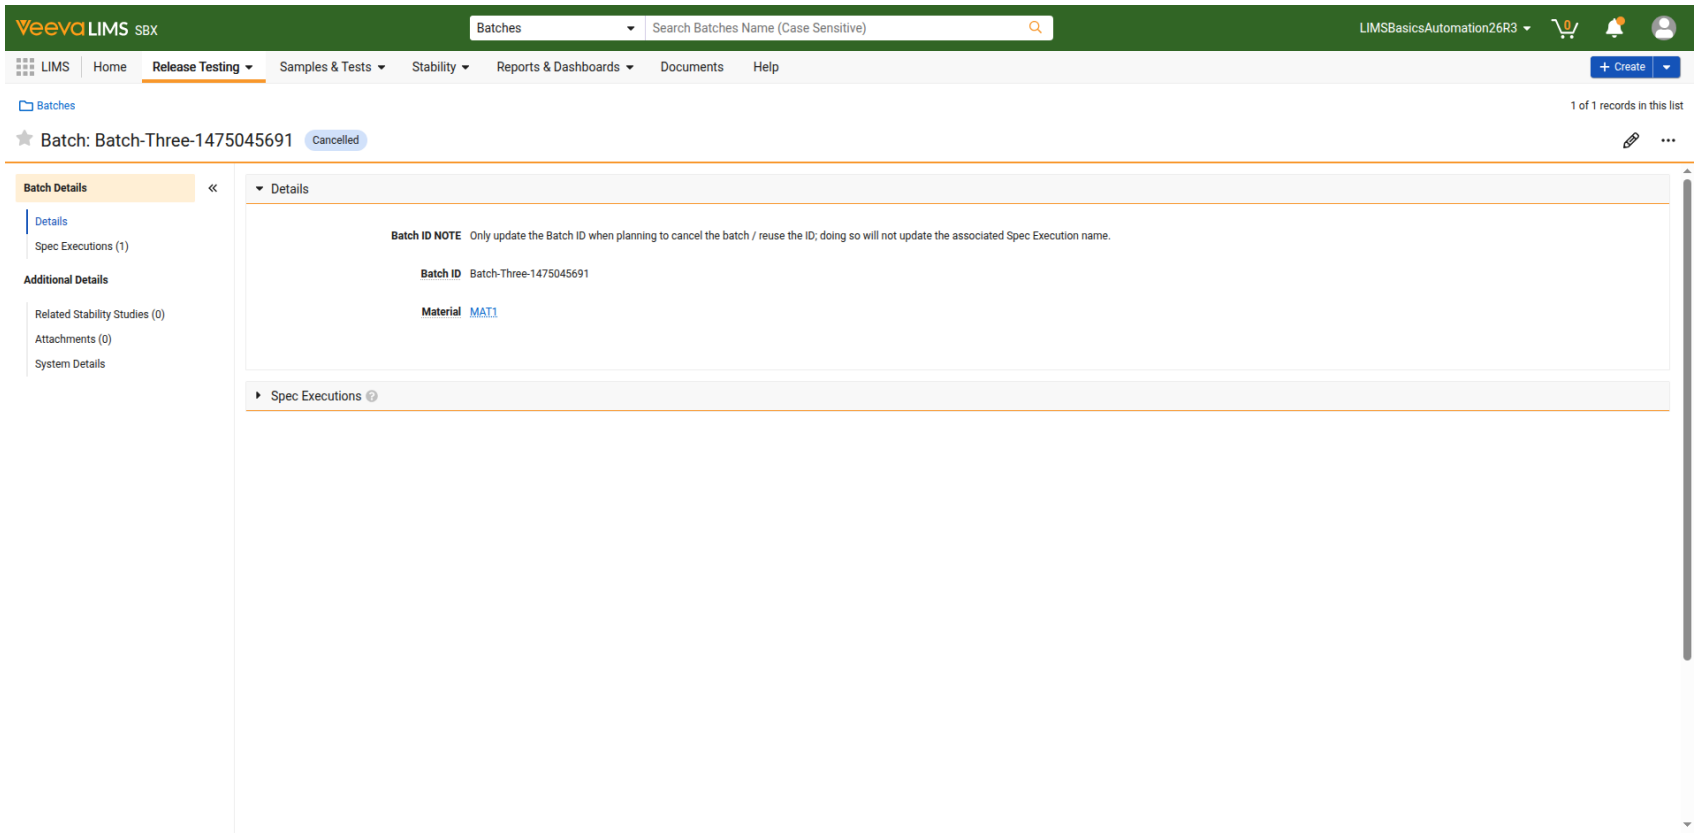

Step #18 Screenshot #6 Screenshot Time: 08-OCT-2026 09:30:01 GMT-07:00

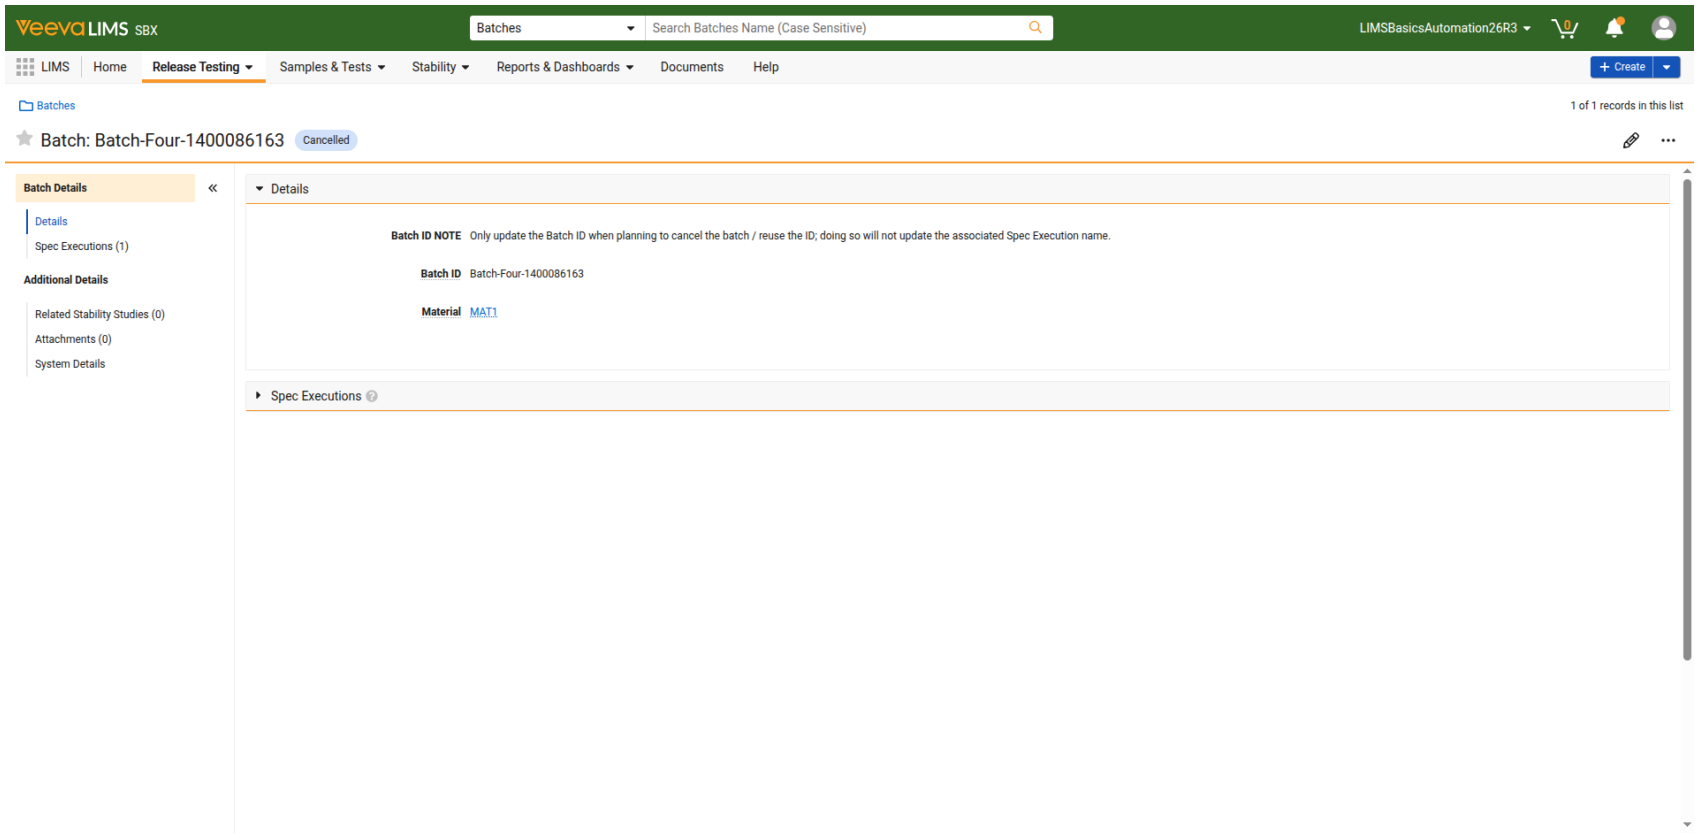

Script Execution Approval	
Status Pass/Fail:	PASS
Executed by	*Executed through automation*
Validation Specialist	Molly Baechler *Approval by Electronic Signature*
Business/Technical Approver	Alice Approver *Approval by Electronic Signature*
Quality Approver	Bob Quality *Approval by Electronic Signature*