


Figure 4: Ablation Study Results (200 frames)

(a) Rotation Error by Configuration



(b) Component Contribution

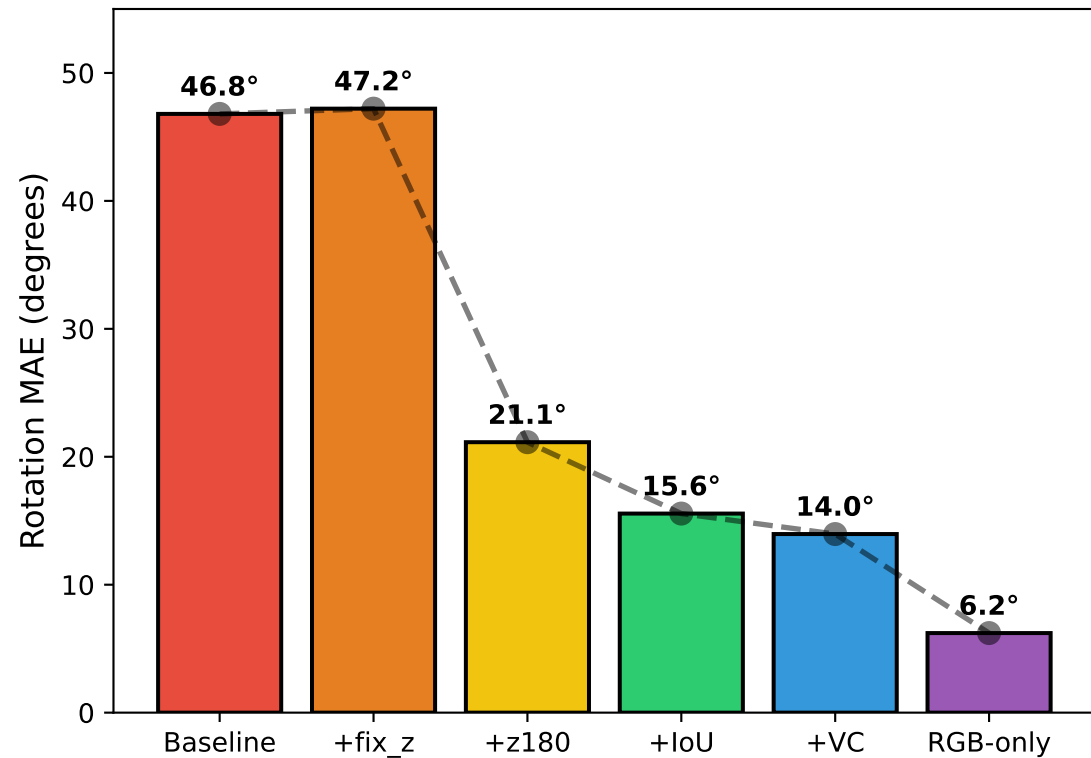