

# Uninterruptible Power Supply (UPS)

S8BA

Backup Power for 24-VDC Devices in Control Panels for  
Instantaneous Voltage Drops or Power Interruptions



- Smallest DIN rail-mounted UPS in its class
- The S8BA solves problems with power supply
- DC-DC UPS for efficient backup

# New Value For Control Panels

Control Panels: The Heart of Manufacturing Sites.

Evolution in control panels results in large evolution in production facilities.

And if control panel design, control panel manufacturing processes, and human interaction with them are innovated, control panel manufacturing becomes simpler and takes a leap forward.


OMRON will continue to achieve a control panel evolution and process innovation through many undertakings starting with the shared Value Design for Panel <sup>\*1</sup> concept for the specifications of products used in control panels.

## \*1 Value Design for Panel



Our shared Value Design for Panel (herein after referred to as "Value Design") concept for the specifications of products used in control panels will create new value to our customer's control panels.

Combining multiple products that share the Value Design concept will further increase the value provided to control panels.

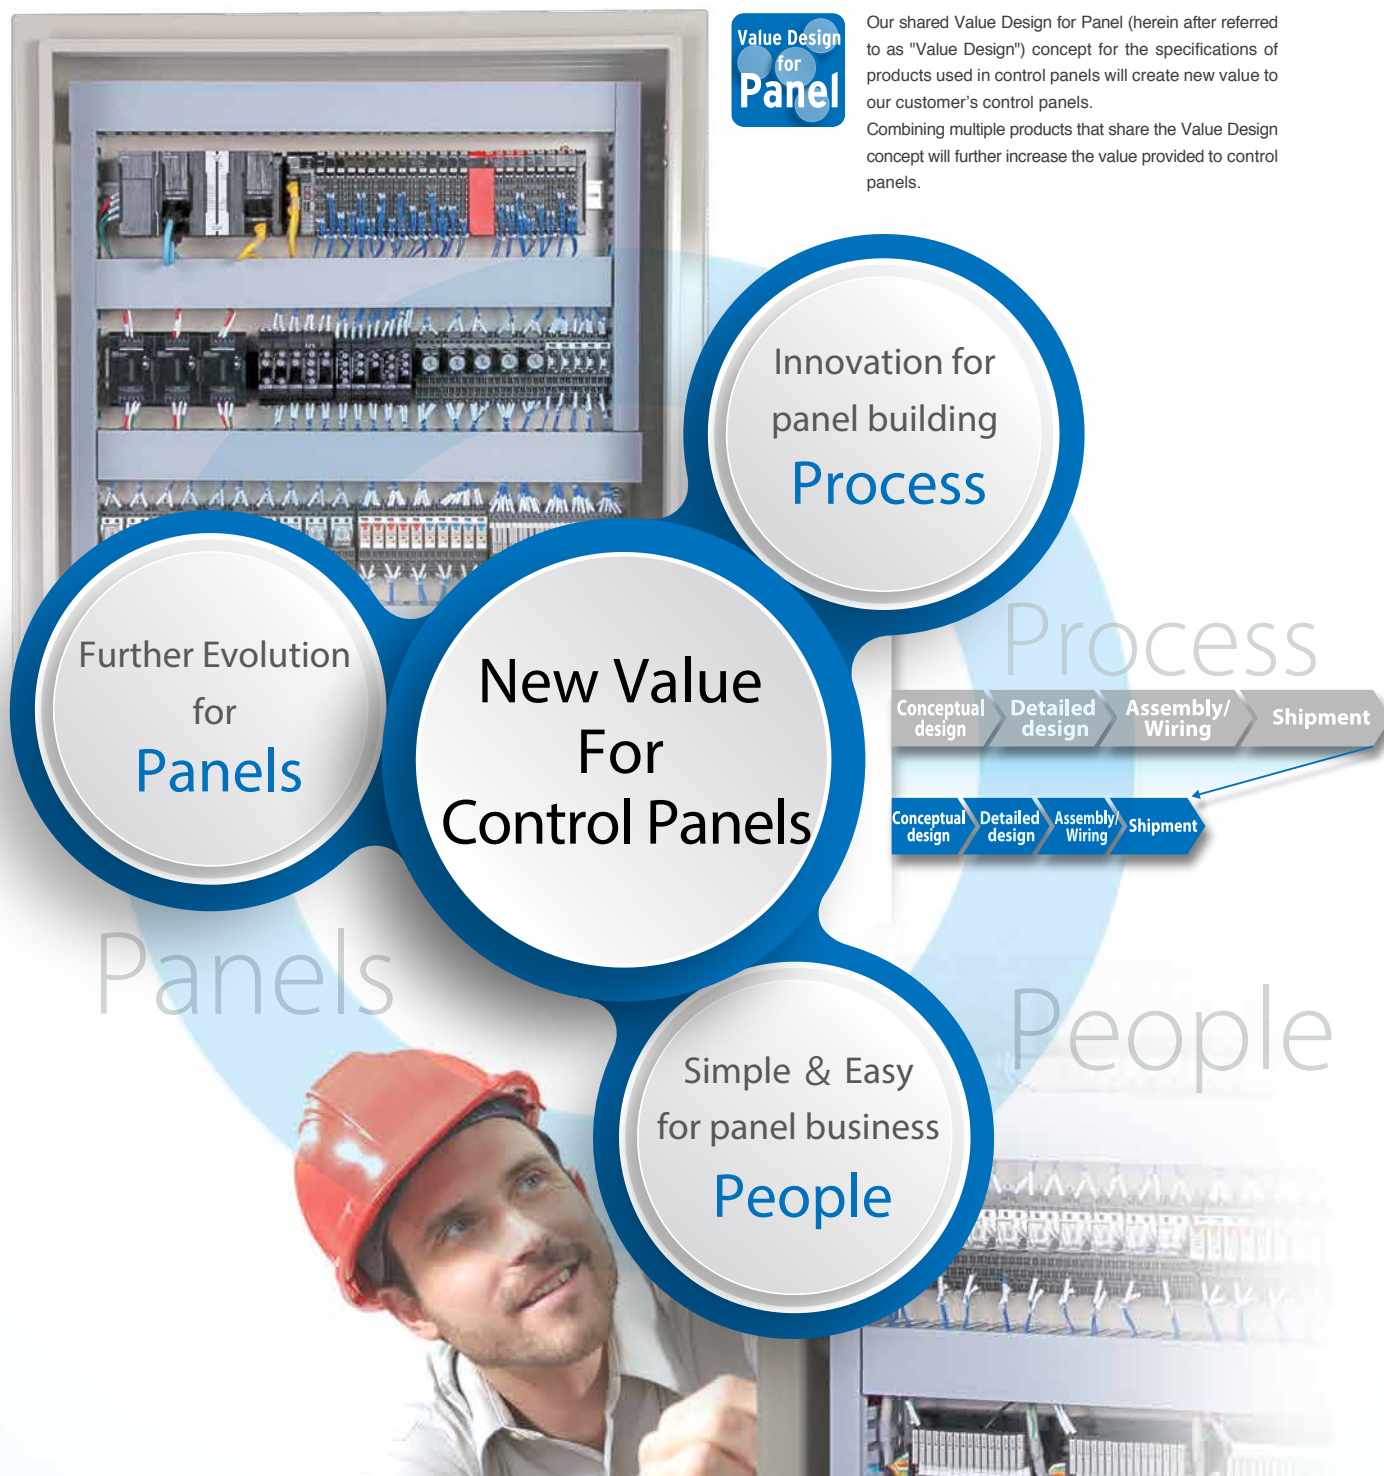

# Backup Power for 24-VDC Devices in Control Panels for Instantaneous Voltage Drops or Power Interruptions

## Smallest<sup>\*1</sup> DIN Rail-mounted UPS in Its Class

Impressive Space Saving. Downsize Panels Even Further by Also Using Slim Power Supplies.

Easy installation and wiring let you reduce assembly work.

**Smallest  
in  
its class<sup>\*1</sup>**

Uninterruptible Power Supply (UPS)  
S8BA-24D24D120LF  
(120 W)

Lightweight at Only 800 g<sup>\*2</sup>

**Light enough to mount dependably to DIN Rail.**



**CE LR**

**Support Exporting Overseas.**

Lithium-ion Batteries<sup>\*3</sup>

**Life Expectancy: 10 yrs.**  
(replaceable battery)

Switch Mode Power Supply  
S8VK-S (120 W)



Life Size

100 mm



Plug-in Terminal Block

**Just press bar terminals in for easy wiring**

<sup>\*1</sup>. In comparison of S8BA to products of the same class from other companies. According to OMRON investigation in April 2016.

<sup>\*2</sup>. For the S8BA-24D24D120LF (120 W).

<sup>\*3</sup>. Replacement Battery Pack sold separately.

<sup>\*4</sup>. Refer to page 6.

Connections through USB, RS-232C, and I/O ports enable interlock shutdown with an industrial PC (IPC) or controller.

**Use any of 3 connection methods.<sup>\*4</sup>**

# The S8BA Solves Problems with Power Supply

## Power Supply Problems Are All Too Familiar

### Instantaneous Voltage Drops or Power Interruptions Caused by Lightning Strikes

Lightning strikes occur more frequently than you might imagine.

Yearly Average Number of Days with Lightning Strikes Over the Past 10 Years

Source: Japan Meteorological Agency

Region	Hokkaido	Tohoku	Hokuriku	Koshin'etsu	Kanto	Tokai	Kinki	Chugoku	Shikoku	Kyushu and Okinawa
Days	11.5	19.0	46.3	23.4	20.6	18.6	19.4	22.9	16.5	24.8

### Momentary Power Interruptions or Power Interruptions Due to Natural Disasters or Local Conditions

Power interruptions can be caused by wind, rain, ice, snow, problems with power lines, accidents in factories, etc.

Voltage drops in factories can be caused by deterioration of facilities, high-volume motor operations in factories with expanded lines, etc.

### Customer Problem


#### Line Stop Due to Lost Process Data

Problems with power lines caused instantaneous voltage drops in a factory, which reset the power supply to the Wireless Communications Unit that connects the PLC with the production management system and interrupted communications. This in turn caused the production management system to miss data, which resulted in line stops until the data could be recovered.

### Solution

#### Interruptions in Communications Prevented with the S8BA

The S8BA was used to back up the power supply to the Wireless Communications Unit and PLC. This let process data be reliably communicated to the production management system, and lowered the risk of line stops.

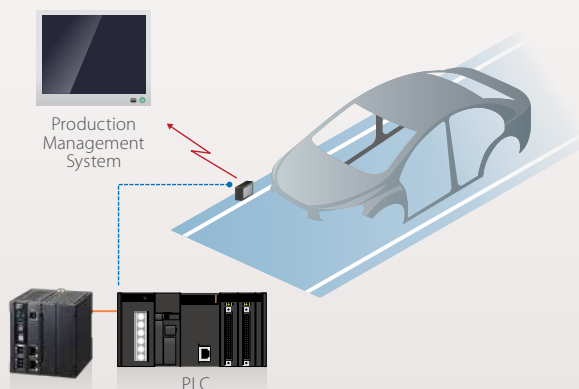

#### Example of S8BA Application

Location: Automobile factory  
Equipment: Production management system  
Connected devices: Wireless Communications Unit and PLC

### Customer Problem


#### Loss of PC Data Due to Operating Errors

Maintenance technicians in a semiconductor manufacturing plant made procedural errors when stopping a device during equipment maintenance, causing the main power supply to suddenly turn OFF. The power supply to the PC used for SECS communications was turned OFF without shutting down the PC normally. This caused important data to be lost, and the factory suffered a long production stop.

### Solution

#### S8BA Used to Enable Normal PC Shutdown

The S8BA was used to back up the power supply to the PC used for communications, and then the Simple Shutdown Software was installed on that PC. This prevented data losses during unexpected power interruptions by enabling the PC to shut down normally when power is lost. Also, the combination of a compact embedded PC with a compact UPS promoted device downsizing.

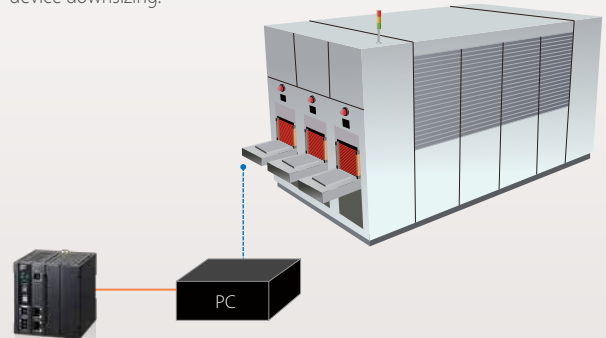

#### Example of S8BA Application

Location: Semiconductor manufacturing plant (post-process)  
Equipment: Semiconductor manufacturing device  
Connected device: PC



Problems with power supplies can also cause customers to lose confidence in you.

- System stoppages
- Damage to devices
- Data corruption

A UPS increases equipment stability and system reliability.



### Customer Problem


#### Image Data Lost Due to Momentary Power Interruptions

Image data is saved through a network to a host system to ensure traceability during printing inspection processes in a food factory, but an momentary power interruption due to a lightning strike reset the power supply to the image sensor and communications device, which prevented the image data from being saved to the host system.

### Solution

#### Traceability Ensured with the S8BA

The S8BA was used to back up the power supplies to the image sensor and communications device. This allowed the system to continue to operate until the data is saved in the host system, which provided more-reliable traceability.

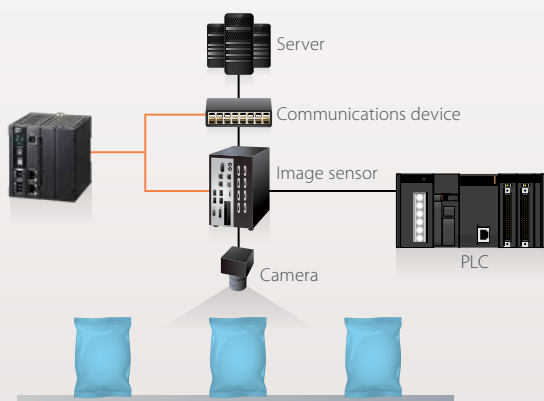

#### Example of S8BA Application

Location: Food factory  
Equipment: Image inspection devices  
Connected devices: Image sensor and communications device

### Customer Problem


#### Loss of Valve Control Due to Power Interruption Caused by Lightning Strike

A lightning strike during a summer storm caused a power interruption at a factory. Due to the power interruption, it became impossible to control the valve that maintains sterile conditions in pharmaceutical manufacturing equipment that requires maintenance of sterile conditions. During recovery from the power interruption, the valve opened before the clean fans started normal operation. Sterile conditions were lost, and production stopped for a long time until the sterile conditions could be restored.

### Solution

#### Control Continued before and after a Power Interruption with the S8BA

The S8BA was used to back up the power supply to the valve. An I/O signal from the S8BA was used to communicate with the PLC valve open/close control after reaching a specific state during a power interruption or recovery to enable rapidly restarting production when recovering from a power interruption.

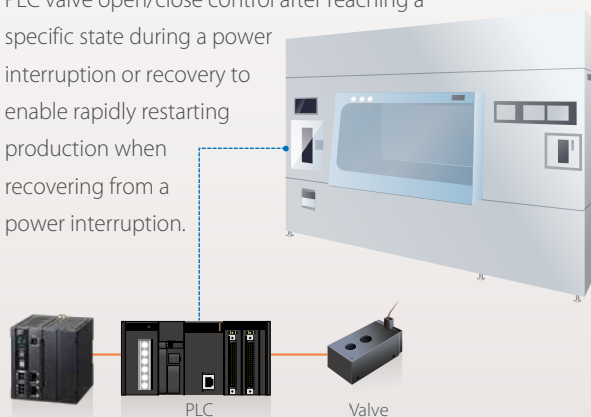

#### Example of S8BA Application

Location: Pharmaceuticals factory  
Equipment: Pharmaceutical manufacturing devices  
Connected devices: PLC and valve

# DC-DC UPS for Efficient Backup

## Three Features of the S8BA

### Device Safety

Using a DC control section and building in the power section improves equipment safety.

### Cost Reductions and Control Panel Downsizing

The use of a compact UPS allows you to downsize and build in the power section, which eliminates the need for a separate panel or wiring rack.

### Reduced Work in Design and Management

All models are for 24 VDC to facilitate design, management, and maintenance.

Flexibly design your control panels and equipment.

Select the UPS with the optimum output capacity.

## Greater Design Flexibility/Select the Optimum Output Capacity


### AC-AC UPS

- This type of UPS is large, so it must be installed outside the control panel or it requires excessive space inside the control panel.


- All of the equipment connected to the Switch Mode Power Supply must be backed up, so you must install a UPS with a large output capacity.



Installation outside the control panel

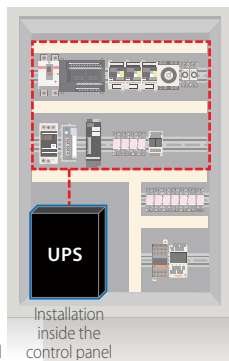

Installation inside the control panel

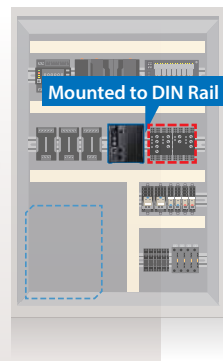

Mounted to DIN Rail

### DC-DC UPS


- The compact body mounts to DIN Rail to save space. This increases design flexibility.
- With a DC-DC UPS, efficiency is increased because you can back up only the required equipment. You can select the UPS with the optimum output capacity.

## Use Any of Three Connection Methods

### USB/RS-232C



### I/O Port

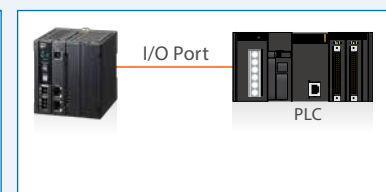

Automatic shutdown software for UPS: Simple Shutdown Software	Install the Simple Shutdown Software on a PC (Windows, Linux, or other OS) that is connected to the UPS with a USB or RS-232C connection to automatically and safely shut down the PC when normal power is interrupted.
UPS Setting Utility Software	The UPS Setting Utility is a software application used to set up the UPS. You can use this software to easily change UPS settings.

## Ordering Information

### Uninterruptible Power Supplies (UPSs)

Input voltage	Output voltage	Output current / Power rating	Model
24 VDC	24 V	5 A/120 W	S8BA-24D24D120LF
		10 A/240 W	S8BA-24D24D240LF
		15 A/360 W	S8BA-24D24D360LF
		20 A/480 W*	S8BA-24D24D480LF

\* The values are 16.7 A/400 W for use under UL standards.


### Connection Cable

Specifications	Type	Length	Model
For RS-232C port	RJ45/D-sub 9-pin	2 m	S8BW-C01
For CONTACT port	RJ45/Discrete wire		S8BW-C02

### Replacement battery pack

Rated voltage	Rated capacity	Weight	Model
14.4 VDC	1600 mAh	0.3 kg	S8BA-B120L

## Dimensions (Unit: mm)

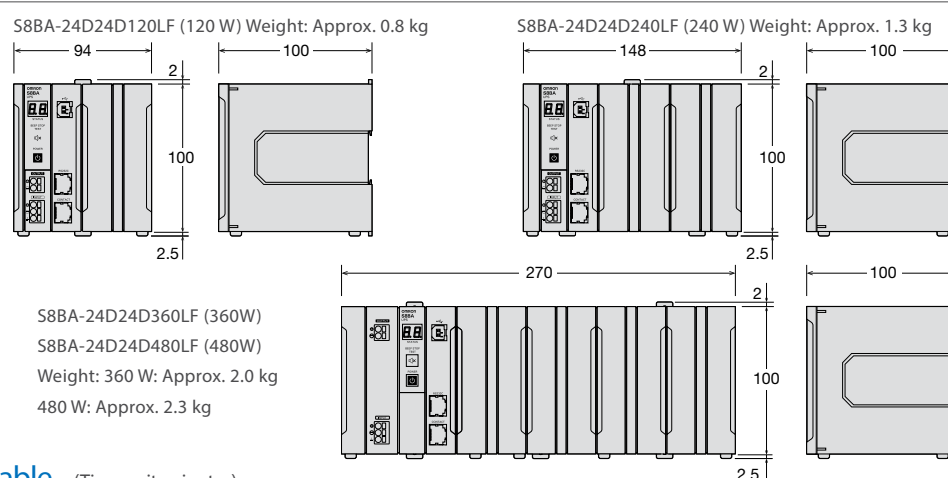

## Backup time table (Time unit: minutes)

	Capacity (W)									
	30	60	90	120	180	240	300	360	420	480
S8BA-24D24D120LF	29	14	9	6	—	—	—	—	—	—
S8BA-24D24D240LF	58	29	19	15	9	6	—	—	—	—
S8BA-24D24D360LF	87	43	28	22	14	10	8	6	—	—
S8BA-24D24D480LF	119	59	39	29	19	15	11	9	8	6

Note: The above backup times are for reference only. They may change depending on the battery life and external environment (such as temperature).

## I/O signal functions

### Type of output signals

Signal	Description
Backup signal output (BU)	Stays ON during backup operation at a power failure.
Battery LOW signal output (BL)	Goes ON when the battery becomes weak during backup operation at a power failure.
Trouble signal output (TR)	Goes ON when an internal failure of the UPS occurs or when the battery life counter expires.
Battery replacement signal output (WB)	Goes ON when the test determines that battery replacement is necessary due to deterioration or when the battery life counter goes off-scale.

### Type of input signals

Signal	Description
Backup stop signal input (BS)	When the BS signal is ON (High), the output of the UPS is stopped after the time period specified in advance has elapsed. *
Remote ON/OFF signal	Remote ON/OFF signals can be used to start and stop the UPS, by using either an externally connected contact or the ON/OFF status of the open collector circuit. When signal is OFF, the UPS will be turned on. When signal is ON, the UPS will be turned off. In the factory settings, the UPS stops operation when this is short-circuited. In addition, it is necessary to turn on the "Power" switch of UPS to use this function.

\* BS signal delay time: It is possible to set the period of time from when a BS signal is received until the output of the UPS is stopped. The output of the UPS can be stopped by inputting the voltage signal (High).

### I/O signal port (RJ45 connector)

Outlook of the connector	Pin number	Item	Pin number	Item
	1	Backup signal output (BU)	5	Battery LOW signal output (BL)
	2	Remote ON/OFF input (-)	6	Backup stop signal input (BS)
	3	Trouble signal output (TR)	7	Battery replacement signal output (WB)
	4	COMMON (COM)	8	Remote ON/OFF input (+)

# Products That Create New Value in Control Panels



Switch Mode  
Power Supplies  
S8VK-S



Uninterruptible  
Power Supply  
(UPS)  
S8BA



Power Monitors  
KM-N2



Digital Temperature Controllers  
E5CC-B/E5EC-B



Measuring and  
Monitoring  
Relays  
K8DT



Solid-state Timers  
H3DT



Solid-state Timers  
H3Y-□-B/H3YN-B



Solid-state Timers  
H3RN-□-B



Liquid Leakage Sensor Amplifiers  
K7L-□□B



Sockets for MY series,  
H3Y-□-B and H3YN-B  
PYF-PU-□



Sockets for G2R-S,  
H3RN-□-B and K7L-□□B  
P2RF-PU



Slim I/O Relays  
G2RV-SR



Slim I/O Relays  
G3RV-SR



I/O Relay Terminals  
G70V



Solid State Relays  
for Heaters  
G3PJ



DIN Track Terminal Blocks  
XW5T

Panel Assist Web

[www.ia.omron.com/solution/panel/](http://www.ia.omron.com/solution/panel/)



Proposal for Innovation of Control Panel Building  
Cat. No. Y218

Refer to the S8BA Uninterruptible Power Supply (UPS) Datasheet (Cat. No. U701) for details.

Before you place an order, please read and understand "Agreement for Using the Product" available on Omron's latest "Best control devices Omron", "General Brochure" or Omron's website.

**OMRON Corporation** Industrial Automation Company  
Kyoto, JAPAN

Contact: [www.ia.omron.com](http://www.ia.omron.com)

## Regional Headquarters

### OMRON EUROPE B.V.

Wegalaan 67-69, 2132 JD Hoofddorp  
The Netherlands  
Tel: (31)2356-81-300/Fax: (31)2356-81-388

### OMRON ASIA PACIFIC PTE. LTD.

No. 438A Alexandra Road # 05-05/08 (Lobby 2),  
Alexandra Technopark,  
Singapore 119967  
Tel: (65) 6835-3011/Fax: (65) 6835-2711

### OMRON ELECTRONICS LLC

2895 Greenspoint Parkway, Suite 200  
Hoffman Estates, IL 60169 U.S.A.  
Tel: (1) 847-843-7900/Fax: (1) 847-843-7787

### OMRON (CHINA) CO., LTD.

Room 2211, Bank of China Tower,  
200 Yin Cheng Zhong Road,  
PuDong New Area, Shanghai, 200120, China  
Tel: (86) 21-5037-2222/Fax: (86) 21-5037-2200

## Authorized Distributor:

© OMRON Corporation 2015-2016 All Rights Reserved.  
In the interest of product improvement,  
specifications are subject to change without notice.

CSM\_2\_1\_0516  
Cat. No. U700-E1-03

0516 (0415)