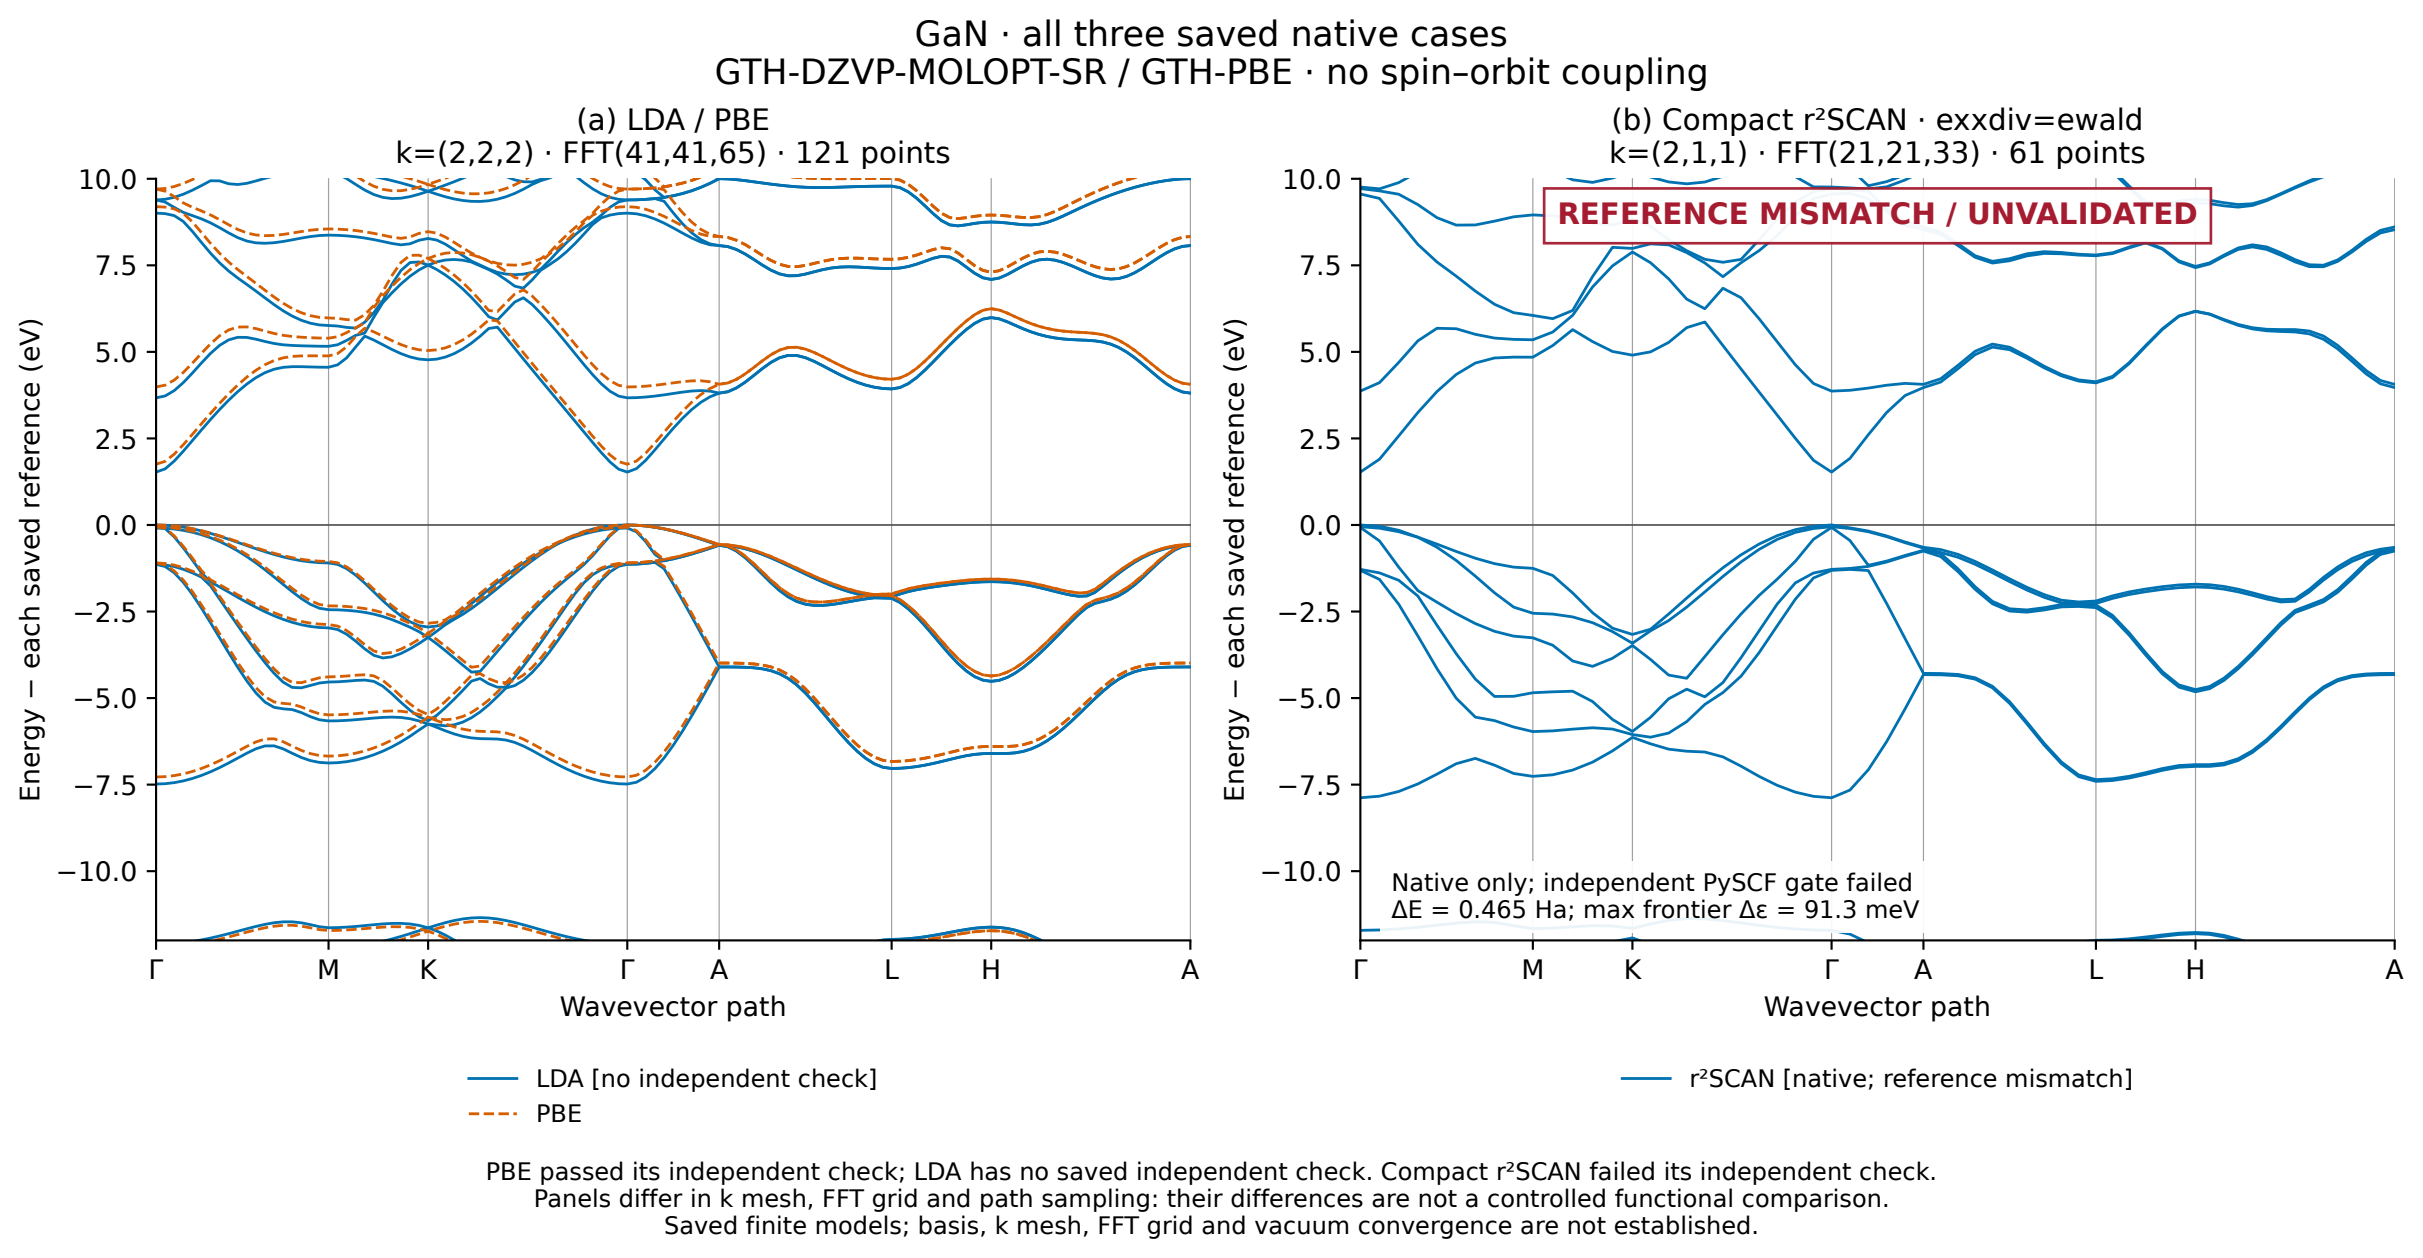


PBE passed its independent check; LDA has no saved independent check. Compact r²SCAN failed its independent check.
Panels differ in k mesh, FFT grid and path sampling: their differences are not a controlled functional comparison.
Saved finite models; basis, k mesh, FFT grid and vacuum convergence are not established.