Subclass of

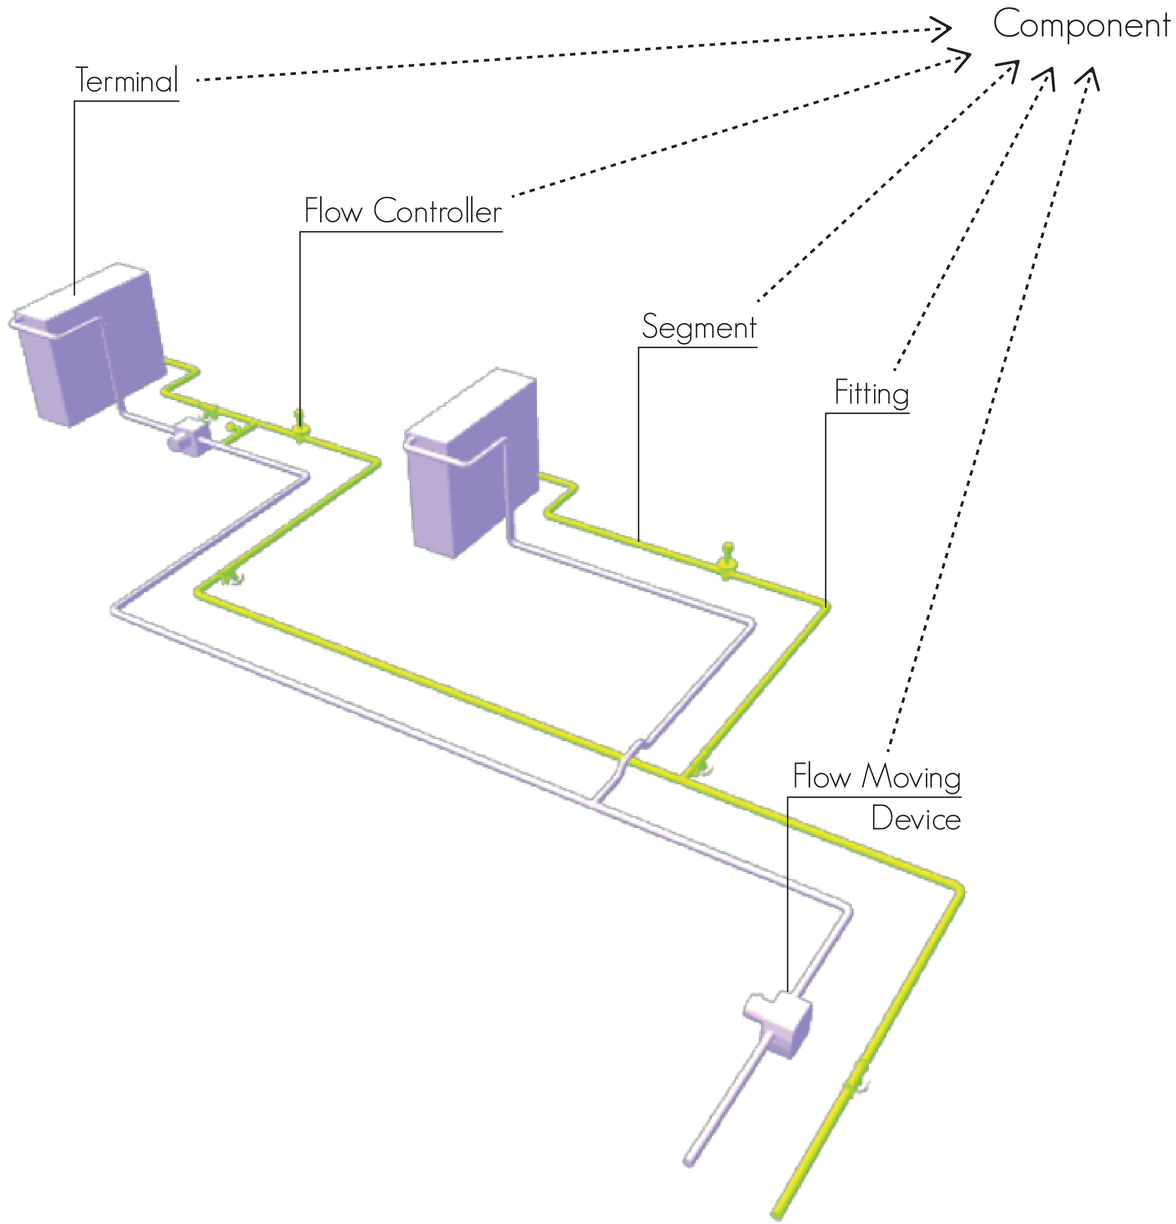

System
Return System
Heating flow
Supply System
Heating return

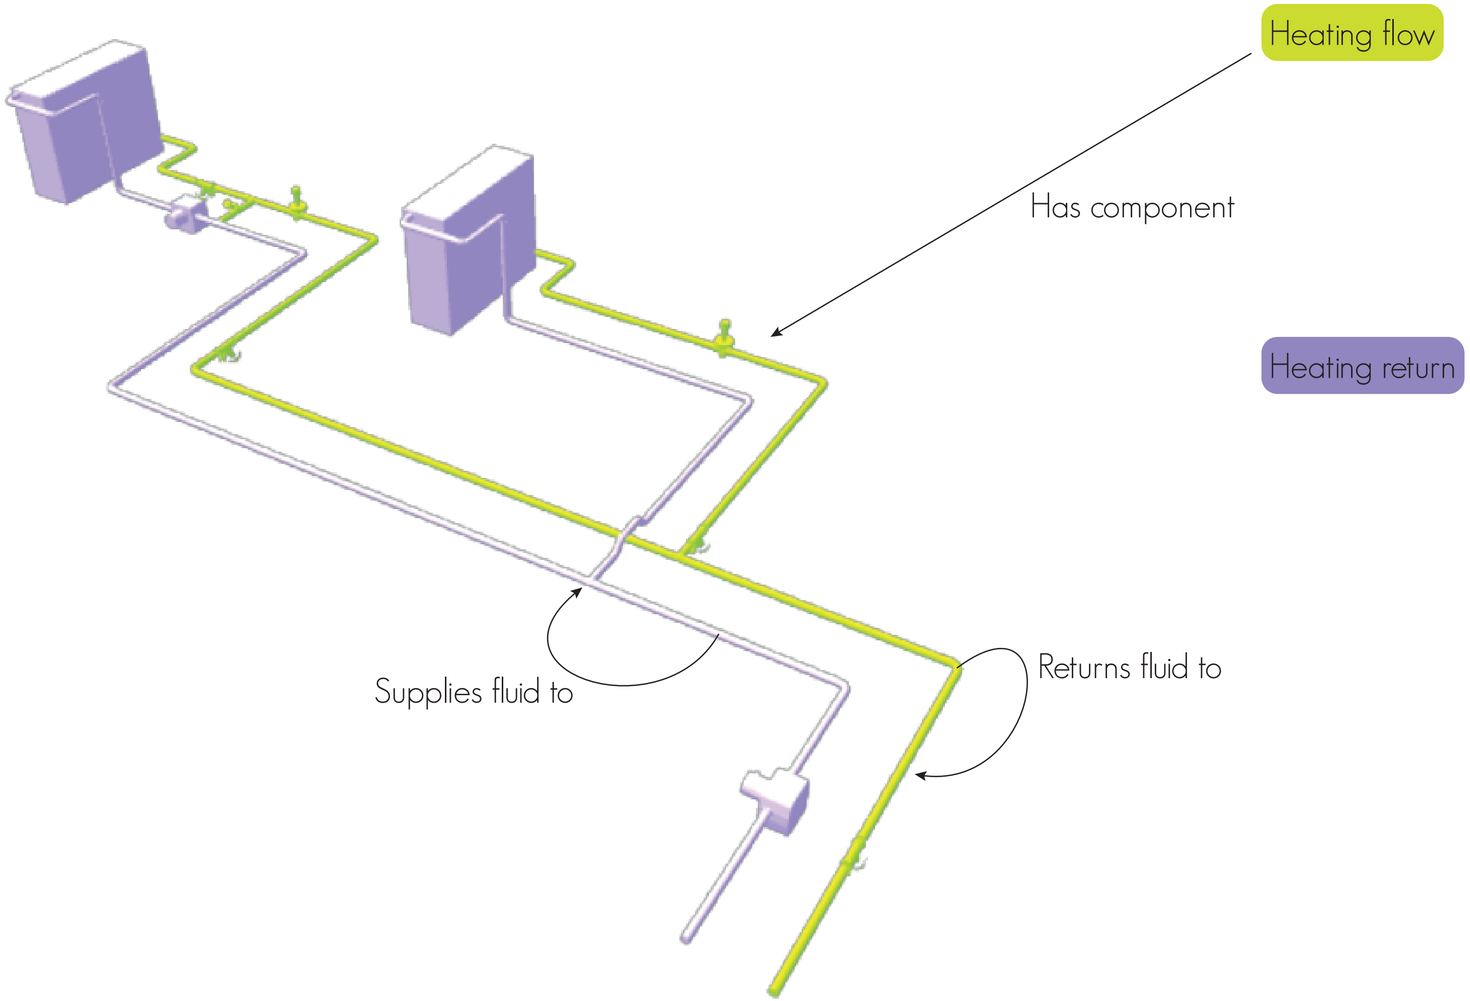
Heating flow
Has component
Heating return
Supplies fluid to
Returns fluid to

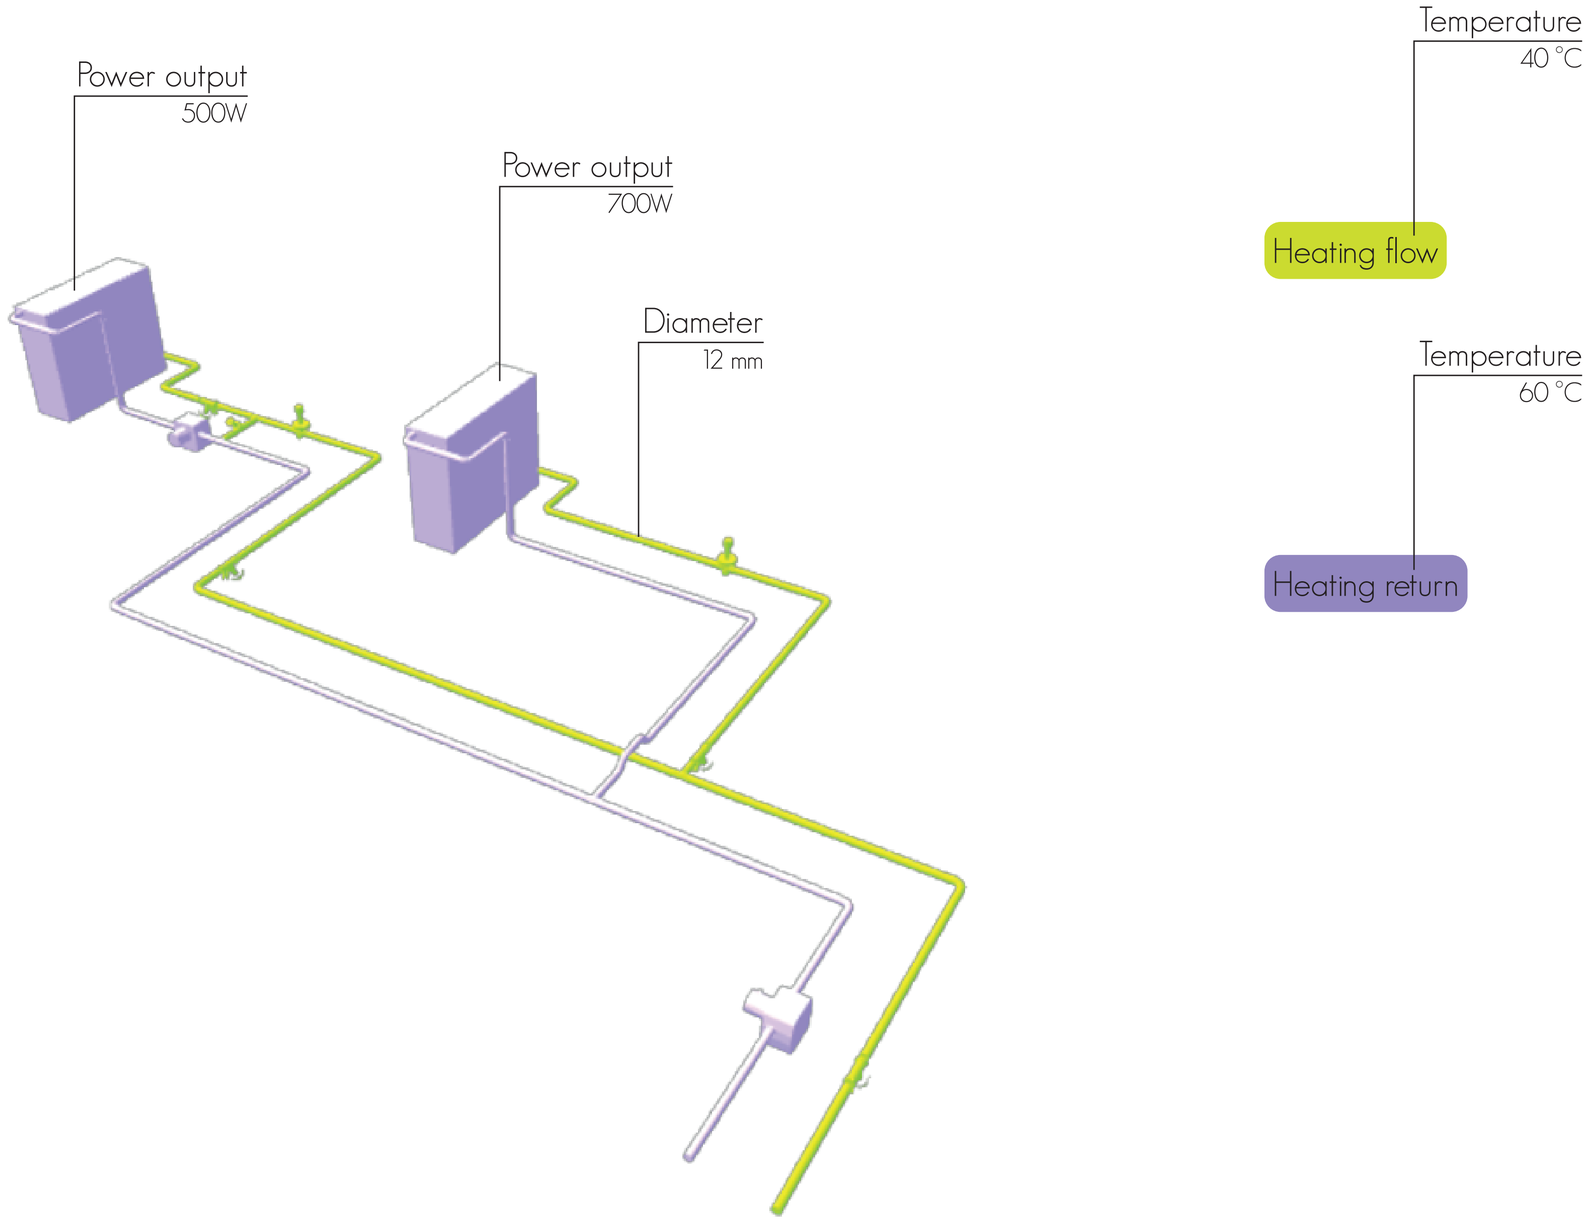
Power output
500W
Power output
700W
Diameter
12 mm
Temperature
40 °C
Heating flow
Temperature
60 °C
Heating return

Infer

Δtemperature → dt

Where

type → Terminal

has component →

has component →

type → Return System

type → Supply System

temperature → tR

temperature → tS

BIND tR - tS AS dt

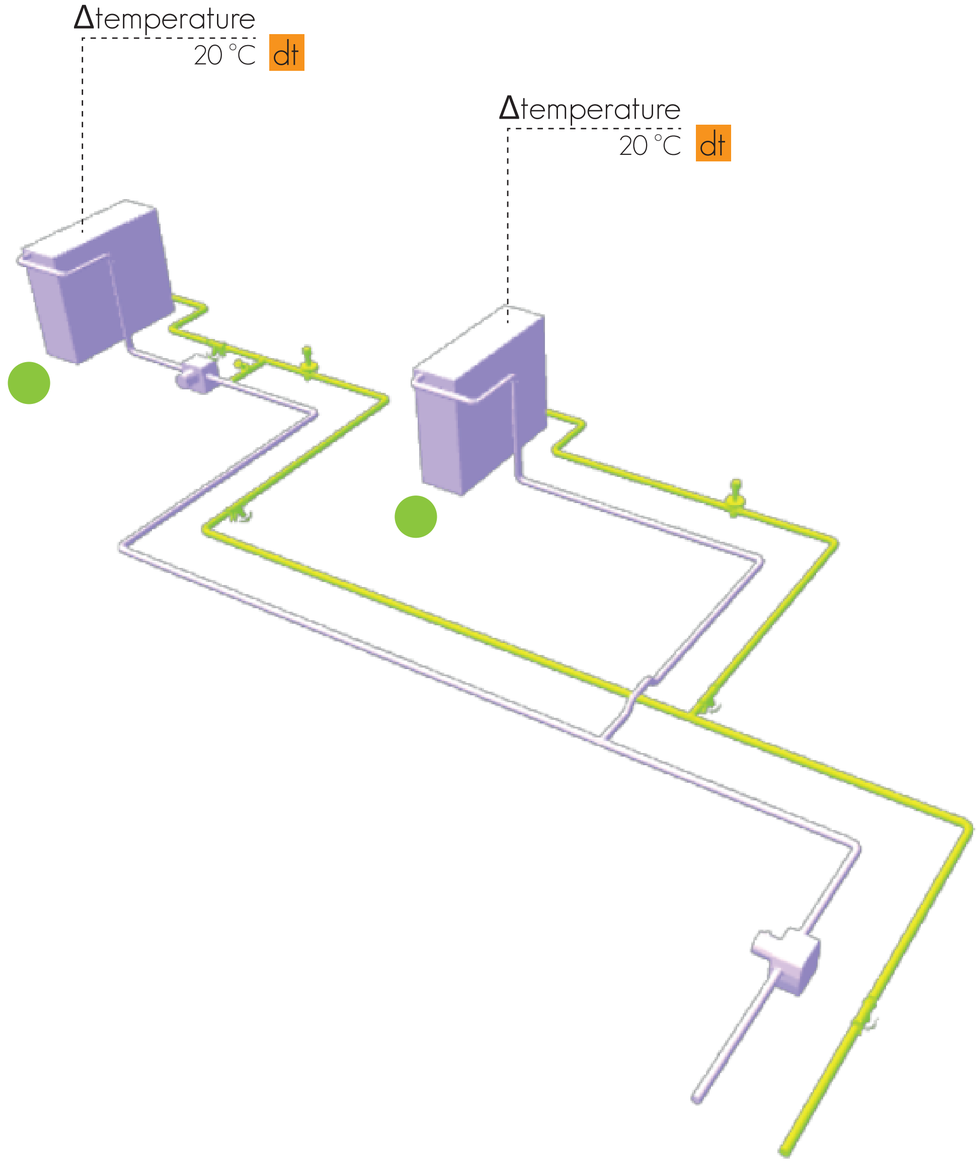

Temperature
40 °C tR

Heating flow

Temperature
60 °C tS

Heating return

```
[ ?t , ex:fluidTemperatureDifference, ?dt ]
:-
[ ?t , a, fso:Terminal ],
[ ?sysR , fso:hasComponent, ?t ],
[ ?sysF , fso:hasComponent, ?t ],
[ ?sysR , a, fso:ReturnSystem ],
[ ?sysF , a, fso:SupplySystem ],
[ ?sysR , ex:temp, ?tR ],
[ ?sysF , ex:temp, ?tF ],
BIND( (?tF-?tR) AS ?dt).
```

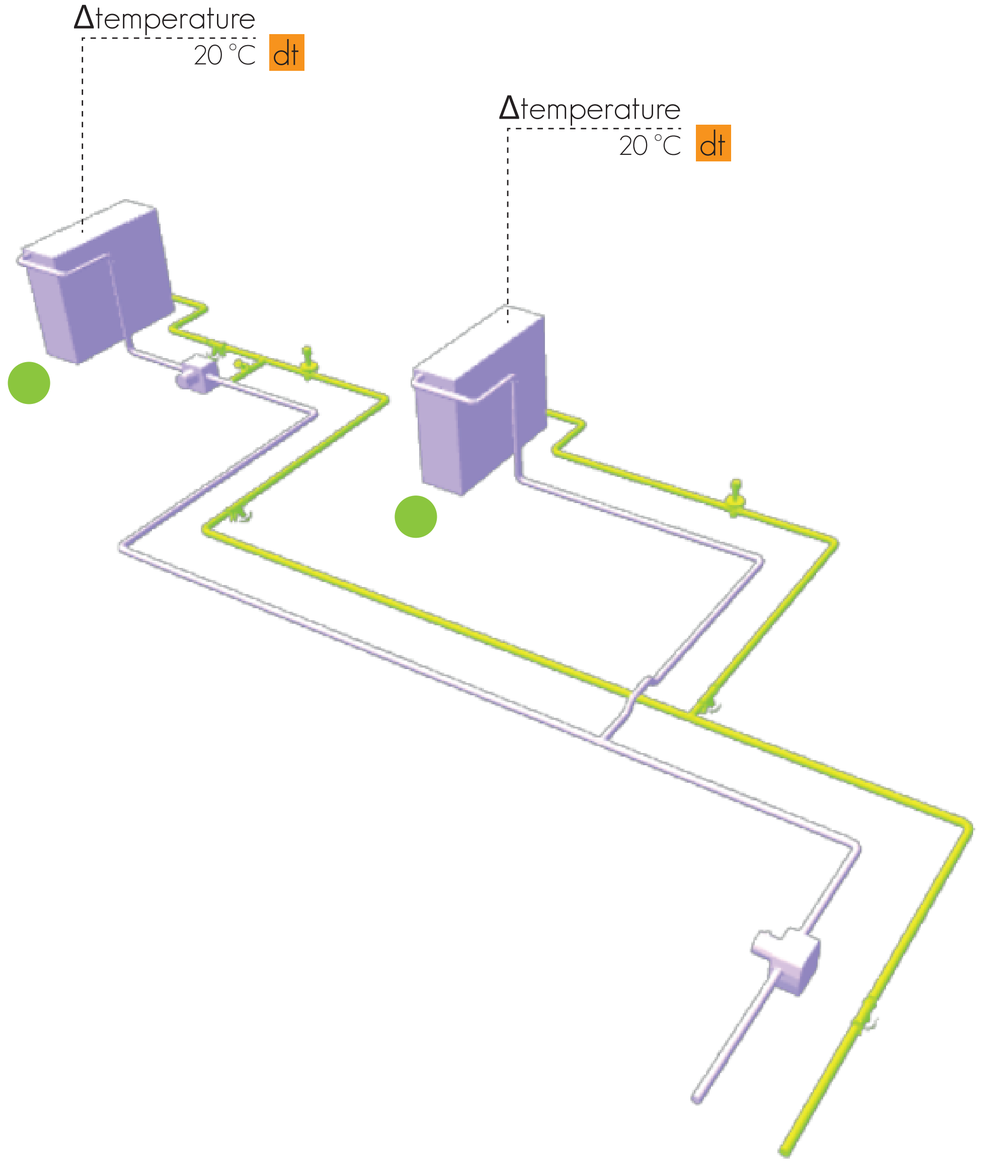

Temperature
40 °C tR

Heating flow

Temperature
60 °C tS

Heating return

```
[ ?t , ex:terminalVolumeFlow, ?q ]
:-
[ ?t , a, fso:Terminal ],
[ ?t , ex:fluidTemperatureDifference, ?dt ],
[ ?t , ex:powerOutput, ?Q ],
BIND( (0.86 *(?Q/?dt)/1000/3600) AS ?q ).
```

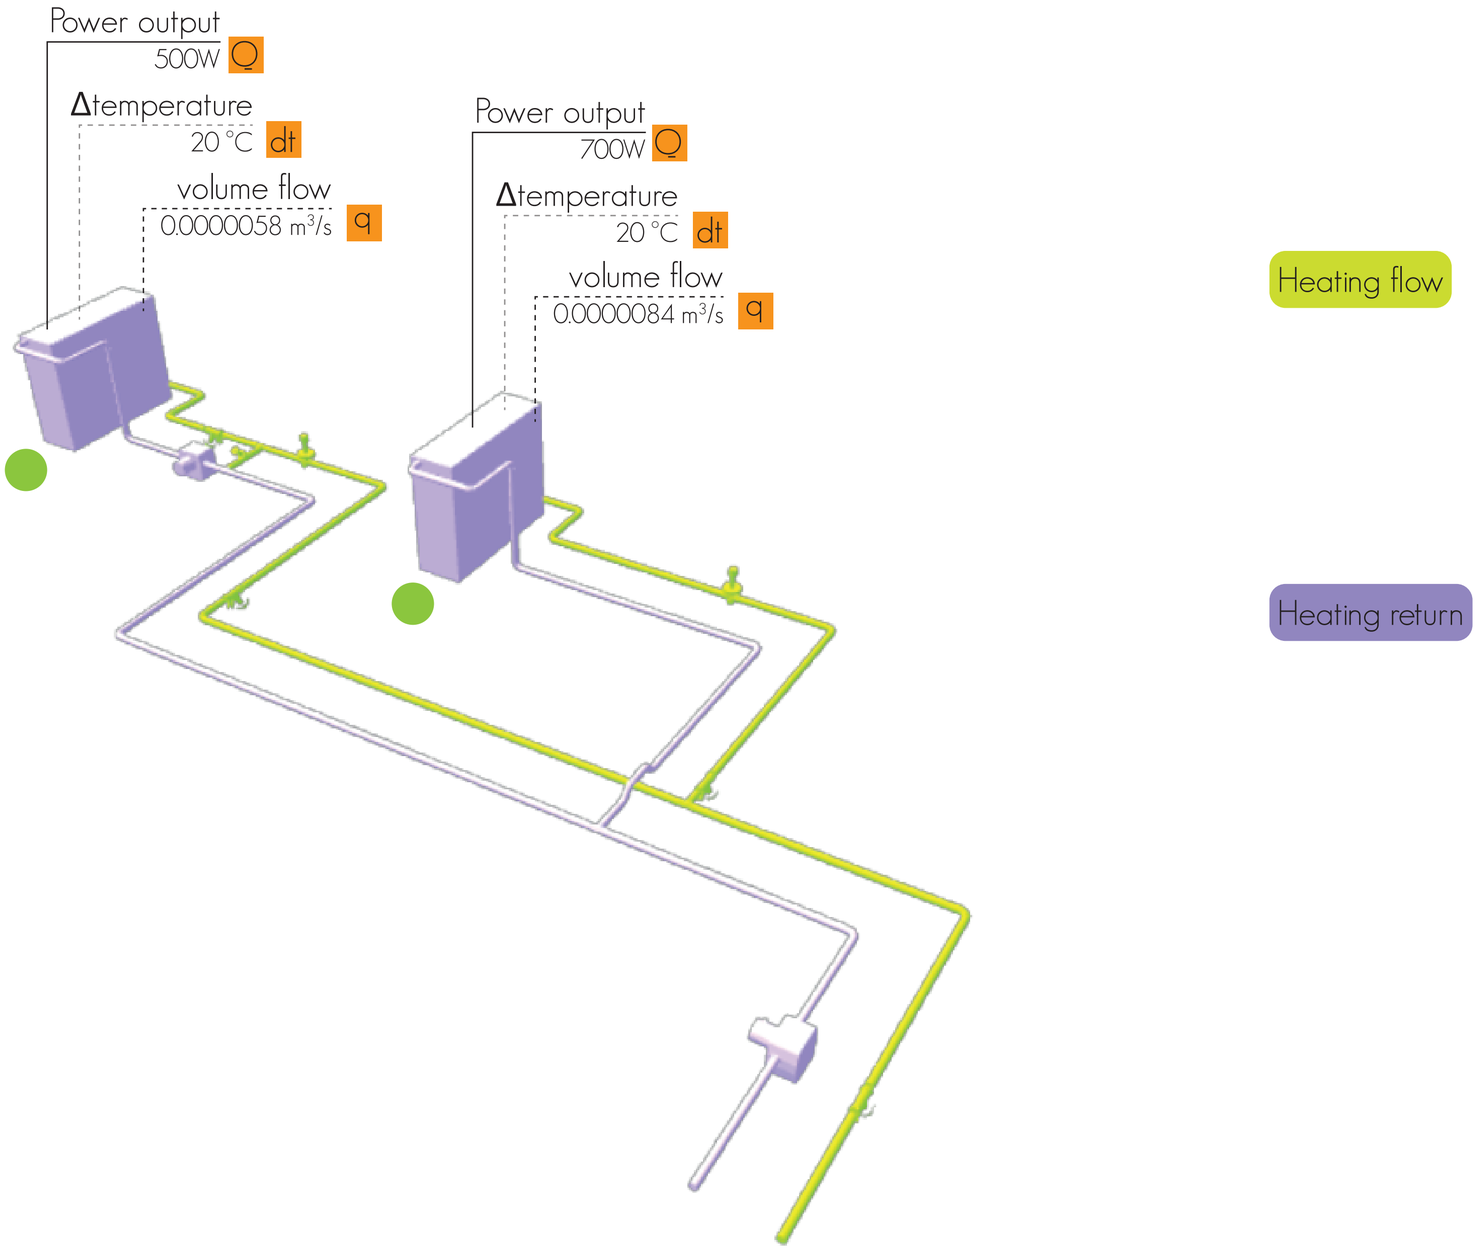

```
[?x, ex:indirectlySuppliesFluidTo, ?y]
:-
[?x, fso:suppliesFluidTo, ?y] .
```

```
[?x, ex:indirectlySuppliesFluidTo, ?z]
:-
[?x, fso:suppliesFluidTo, ?y],
[?y, ex:indirectlySuppliesFluidTo, ?z].
```

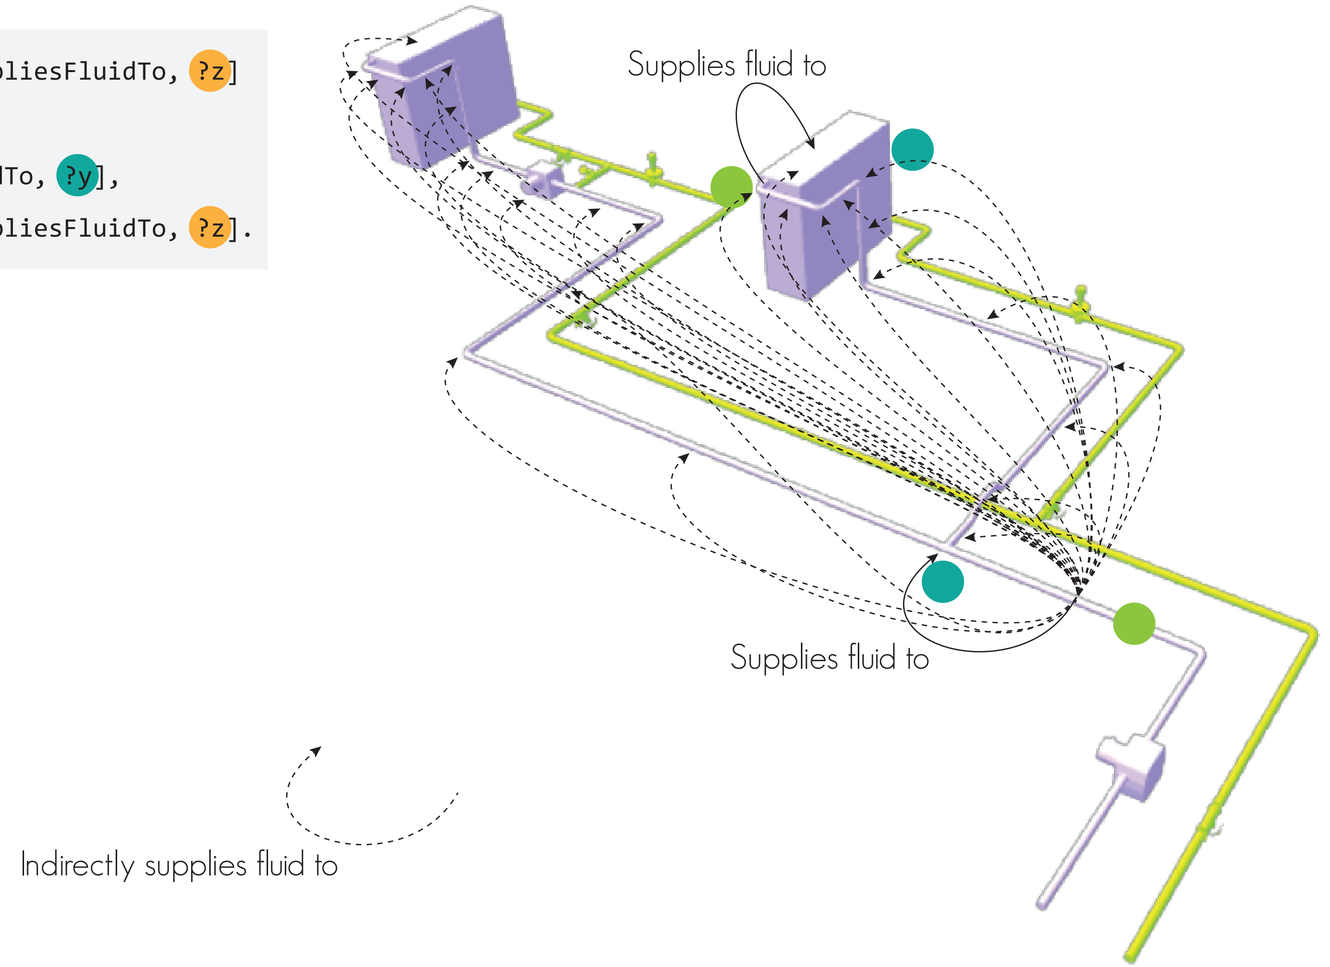

Heating flow

Heating return

```
[?s, ex:segmentVolumeFlow, ?qTot]
:-
[?s, a, fso:Segment],
AGGREGATE(
    [?s, ex:indirectlySuppliesFluidTo, ?t],
    [?t, a, fso:Terminal],
    [?t, ex:terminalVolumeFlow, ?q]
    ON ?s
    BIND SUM(?q) AS ?qTot
) .
```

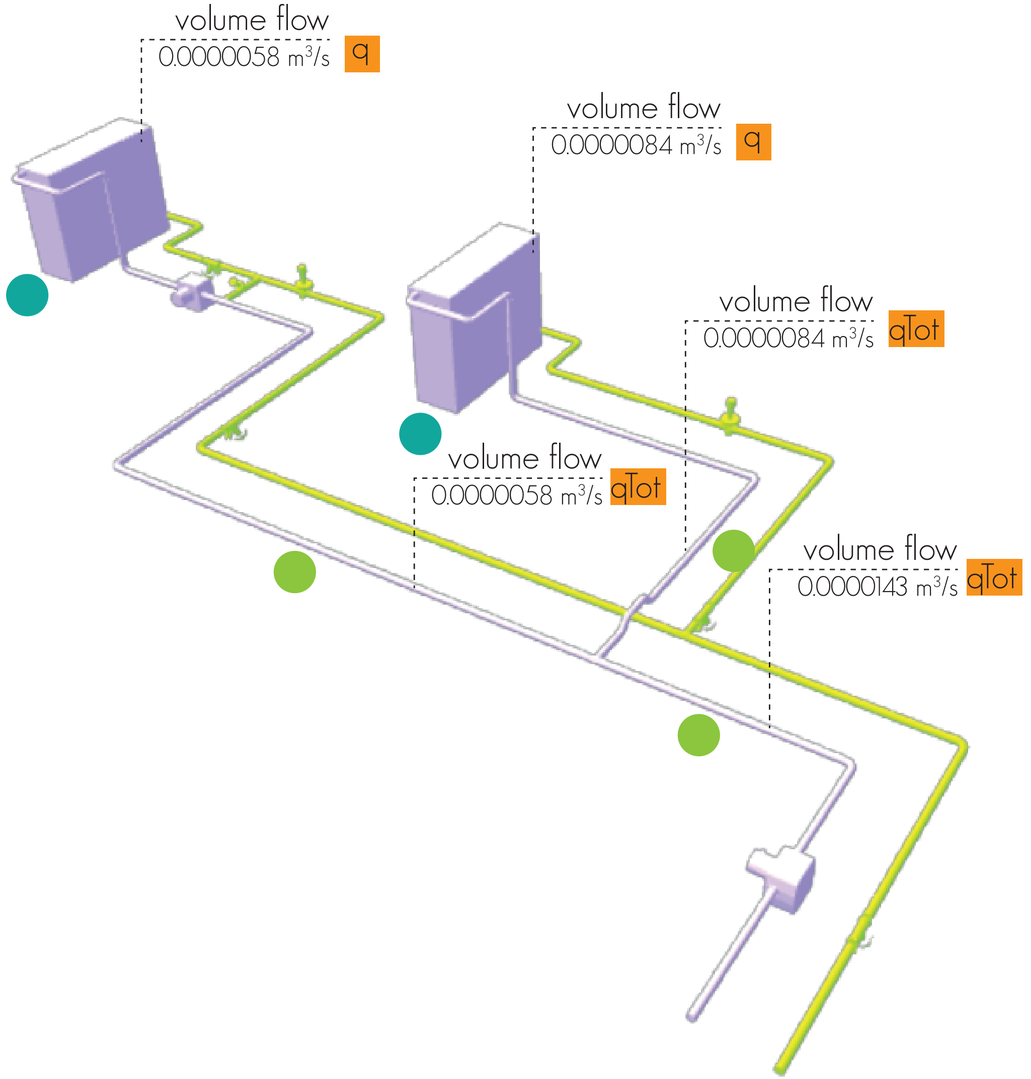

Heating flow

Heating return

```
[?s, ex:innerCrossSectionalArea, ?a]
:-
[?s, a, fso:Segment],
[?s, ex:innerDiameter, ?d],
BIND(PI() * POW((?d/2), 2) AS ?a).
```

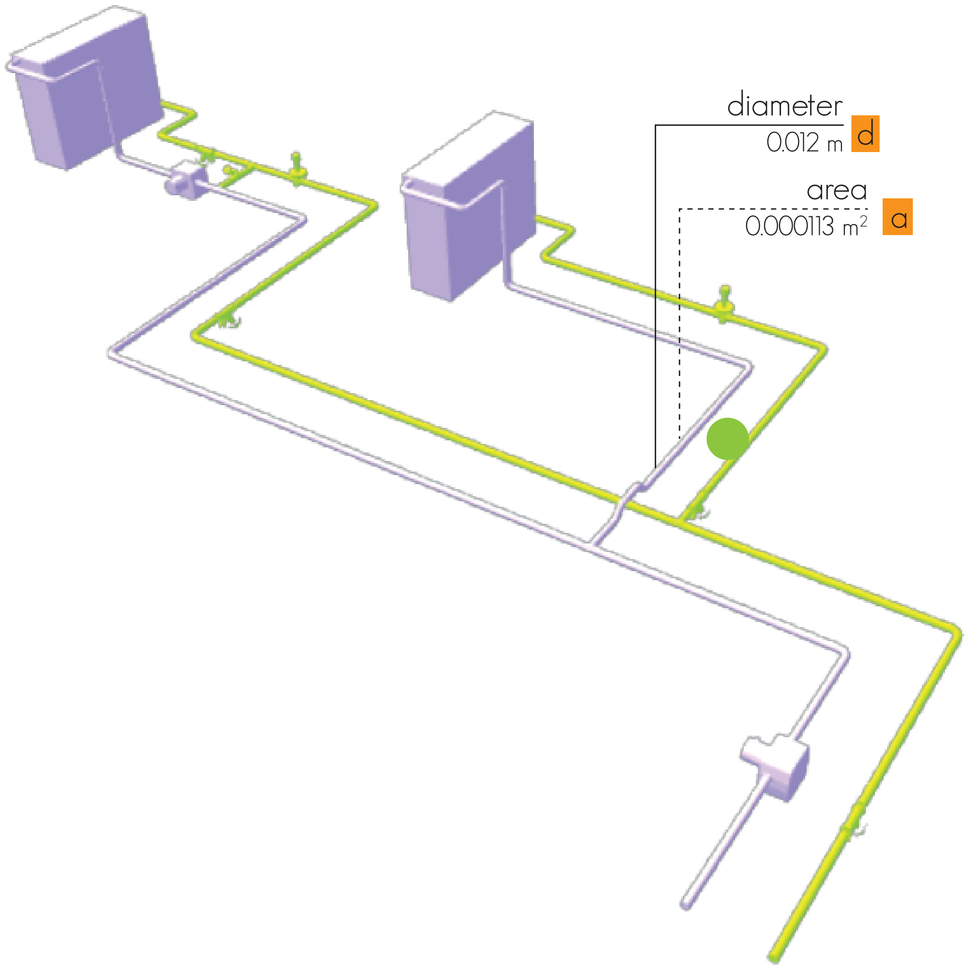

Heating flow

Heating return

```
[?s, ex:fluidVelocity, ?v]
:-
[?s, a, fso:Segment],
[?s, ex:innerCrossSectionalArea, ?a],
[?s, ex:segmentVolumeFlow, ?q],
BIND(?q/?a AS ?v).
```

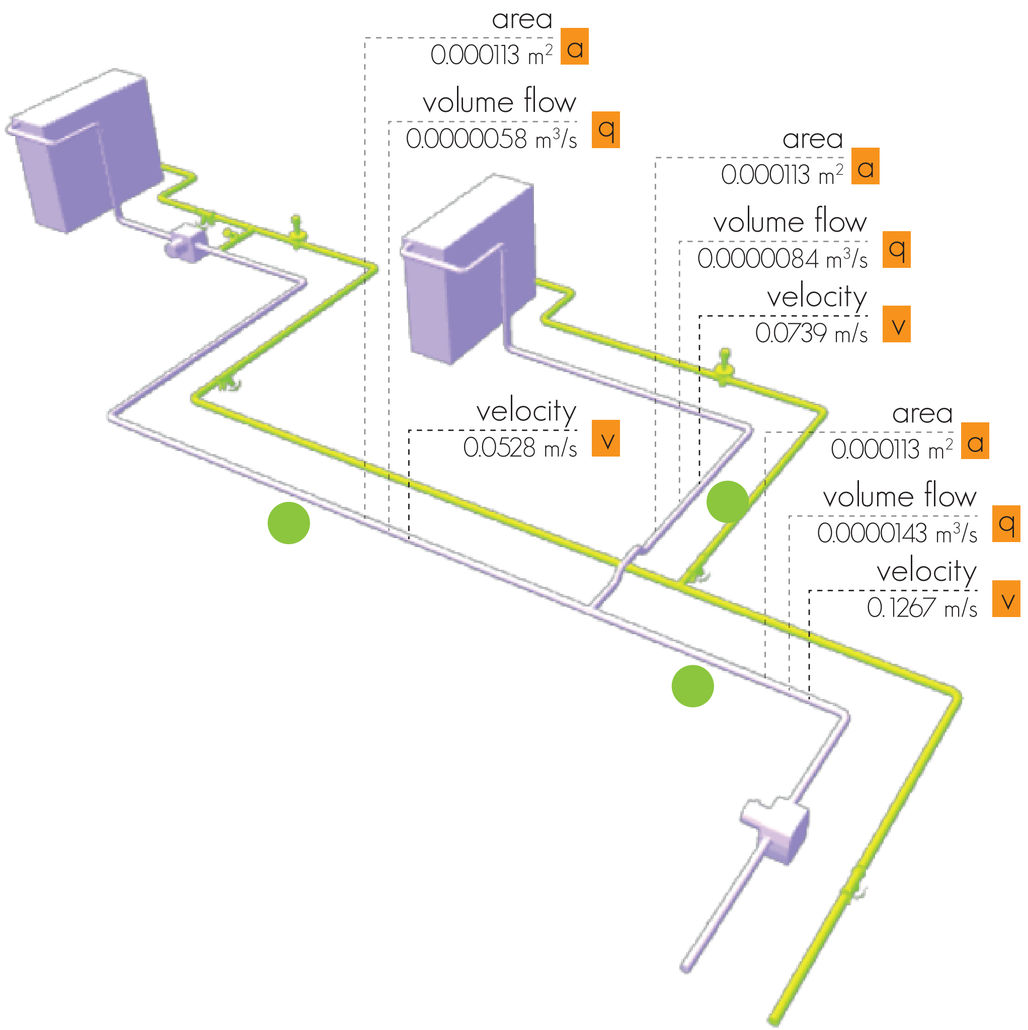

Heating flow

Heating return

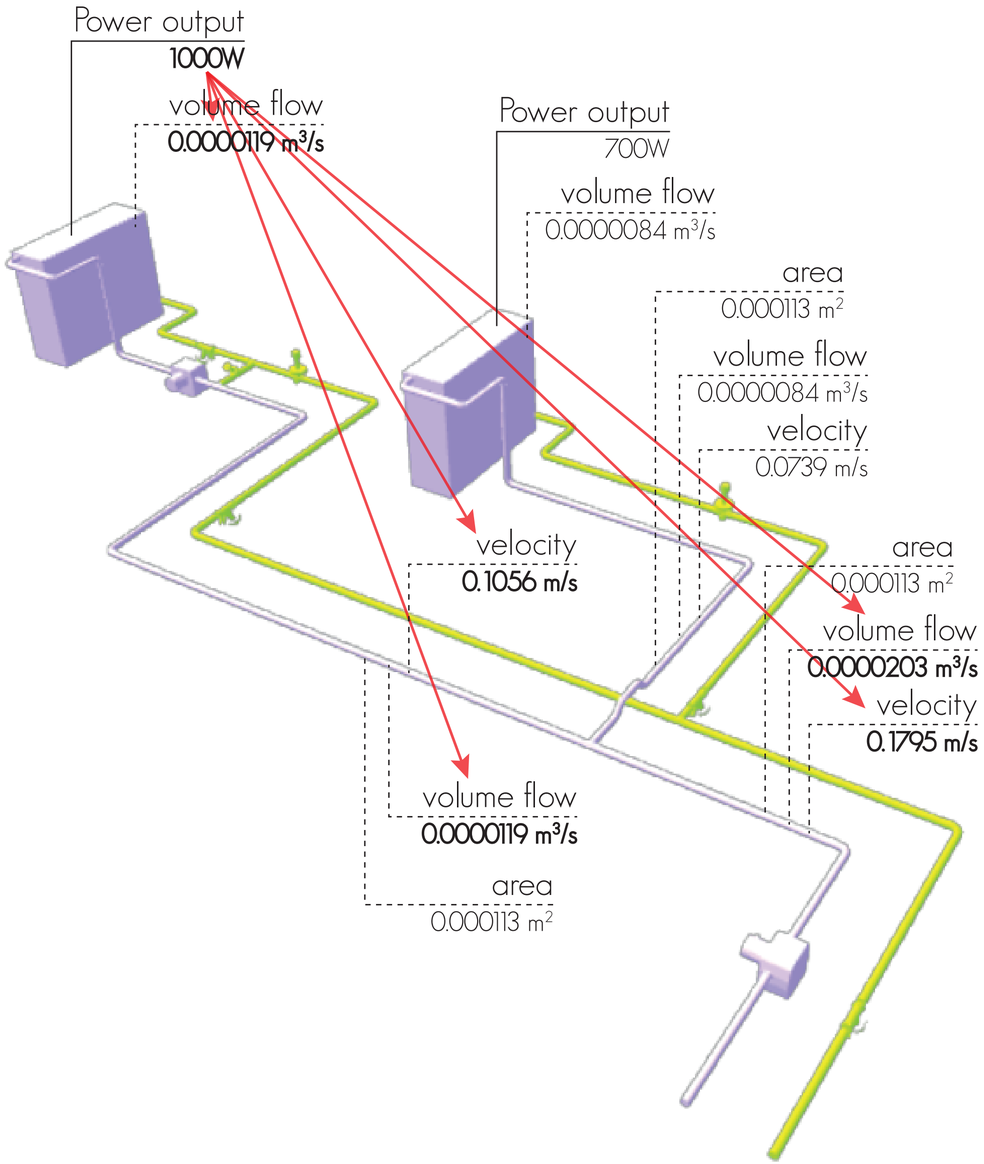

Heating flow

Heating return

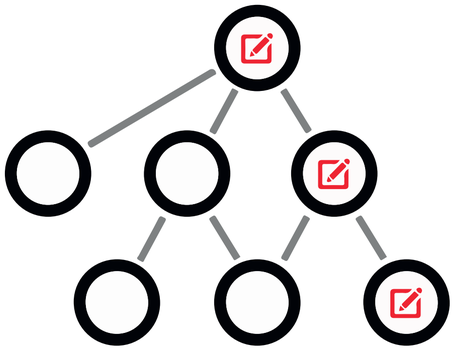

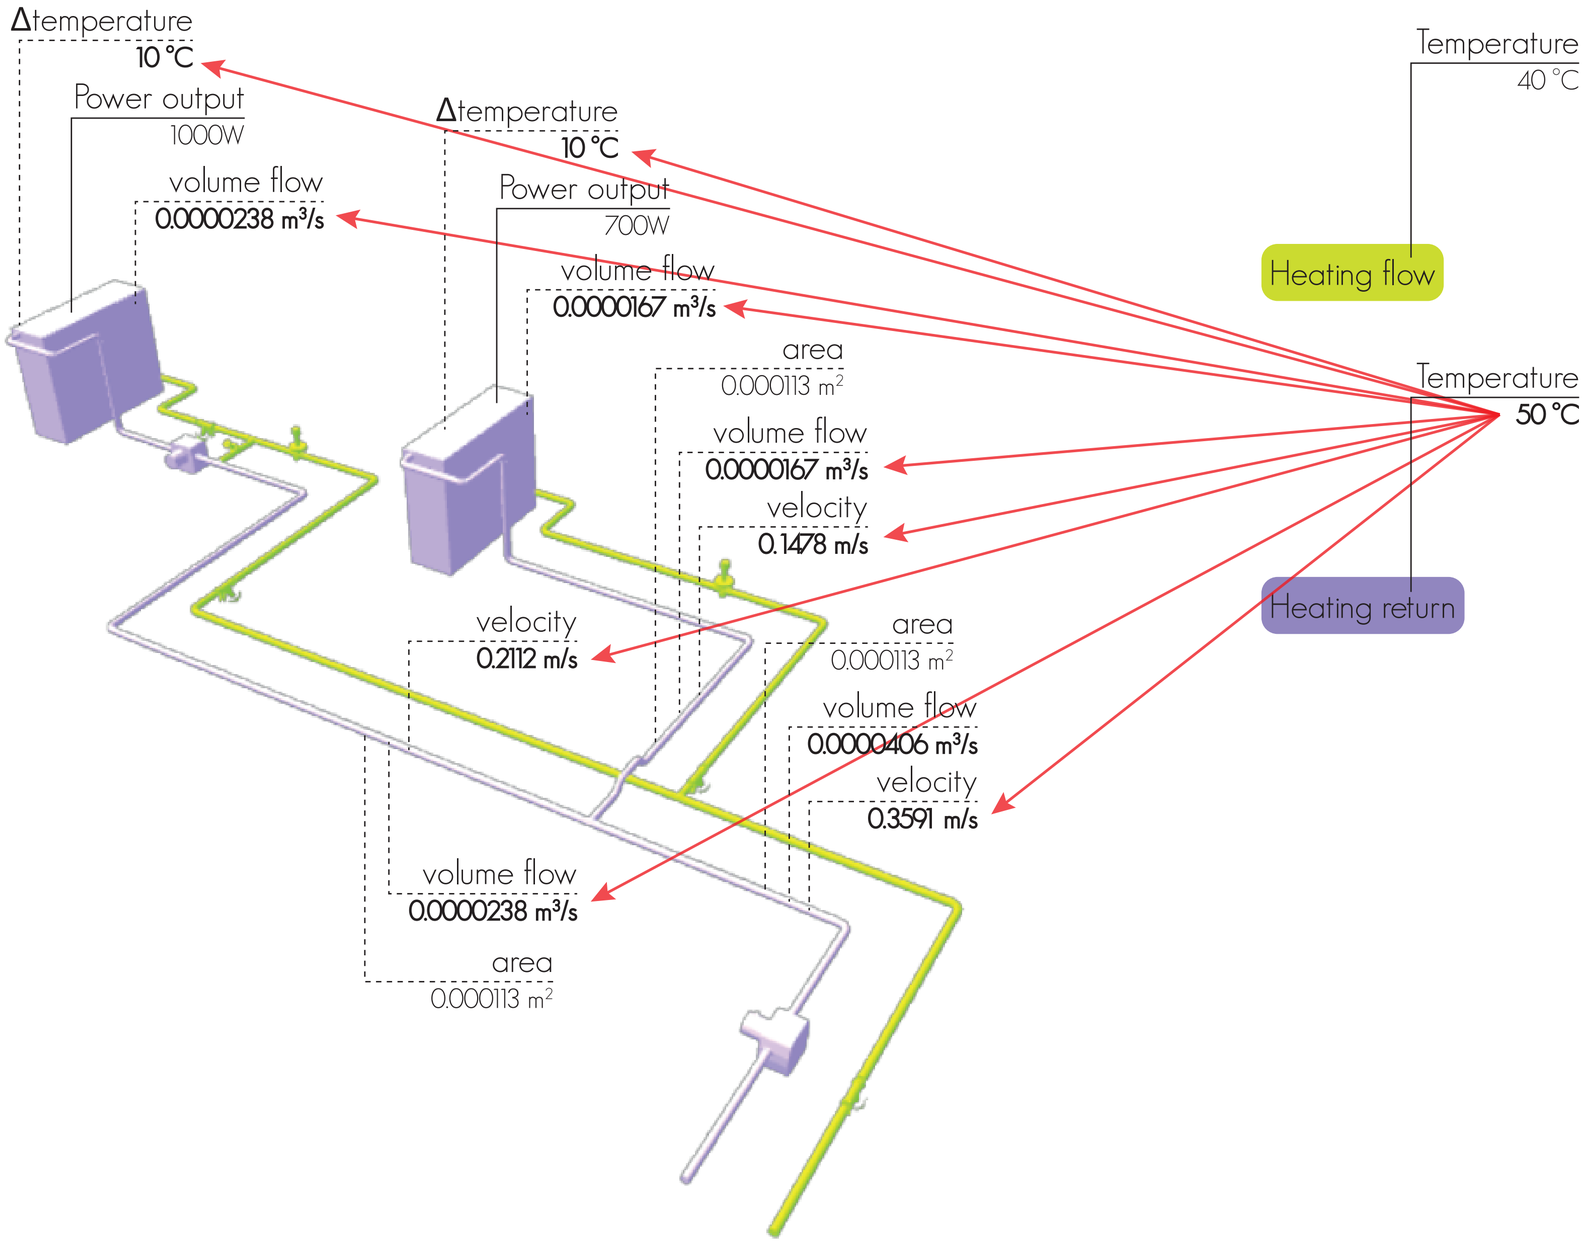
Δtemperature
10 °C
Power output
1000W
volume flow
0.0000238 m³/s
Δtemperature
10 °C
Power output
700W
volume flow
0.0000167 m³/s
Temperature
40 °C
Heating flow
Temperature
50 °C
area
0.000113 m²
volume flow
0.0000167 m³/s
velocity
0.1478 m/s
Heating return
velocity
0.2112 m/s
area
0.000113 m²
volume flow
0.0000406 m³/s
velocity
0.3591 m/s
volume flow
0.0000238 m³/s
area
0.000113 m²