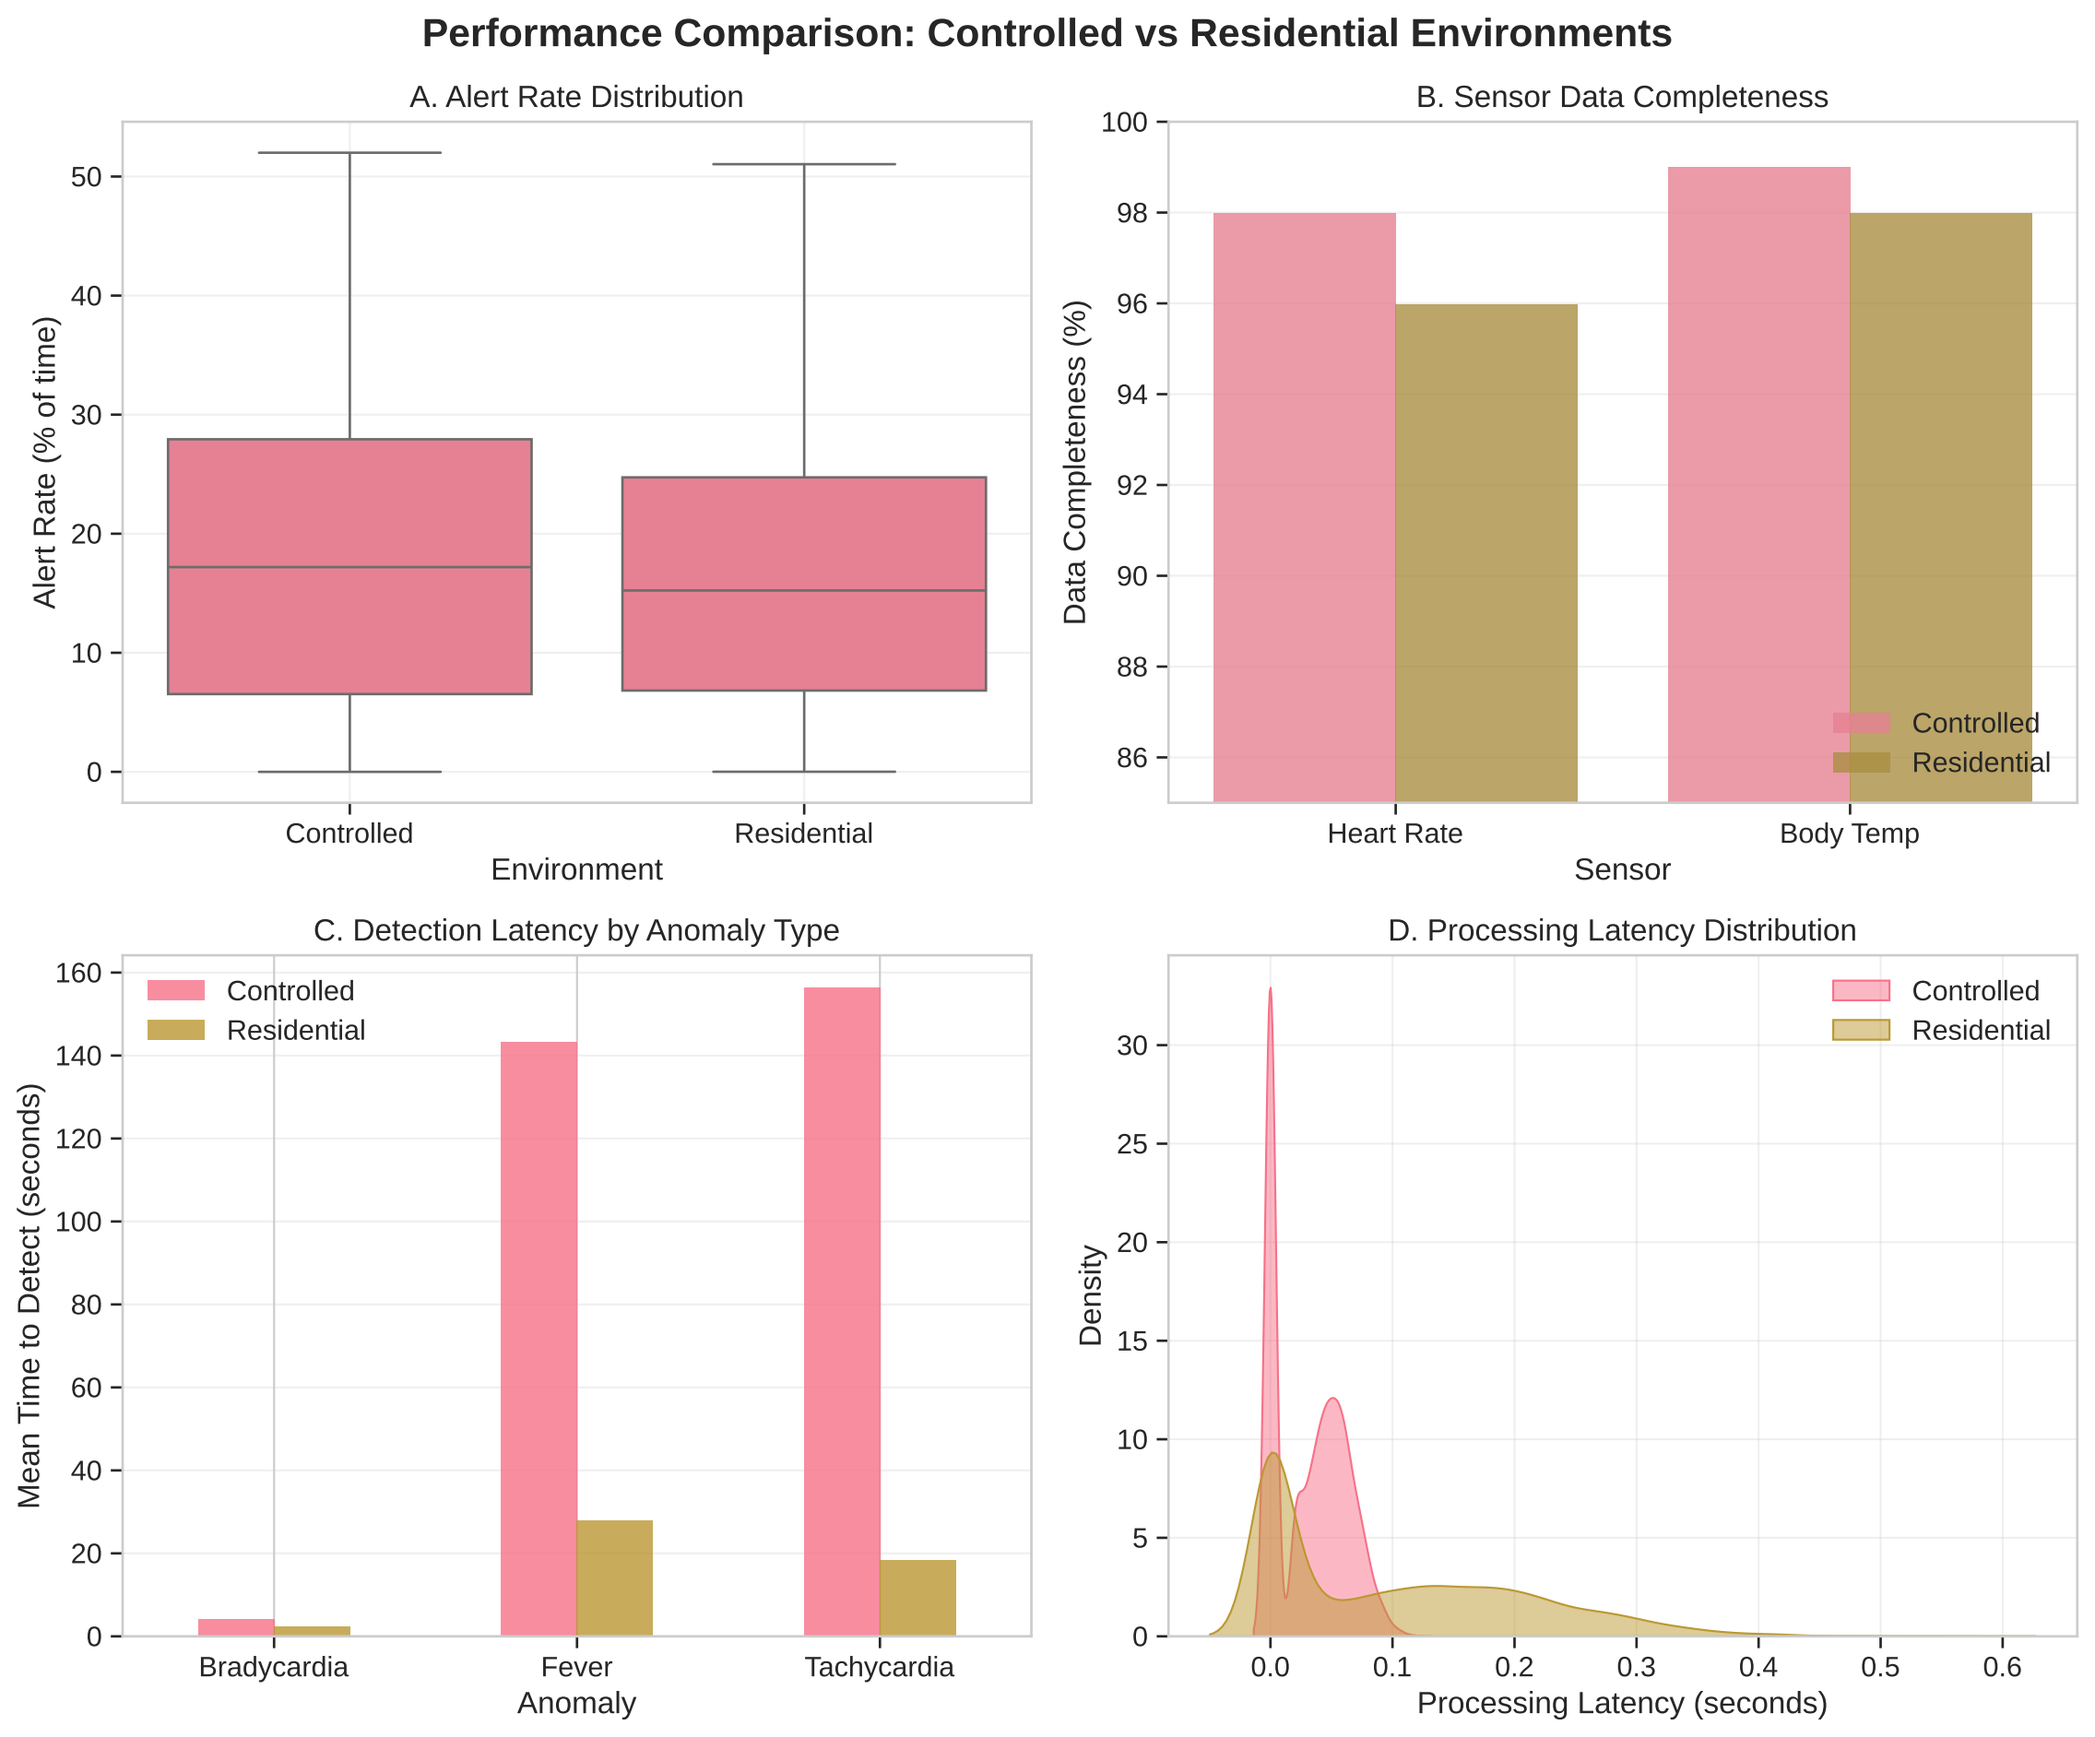
Performance Comparison: Controlled vs Residential Environments
A. Alert Rate Distribution
Alert Rate (% of time)
0
10
20
30
40
50
Controlled
Residential
Environment
B. Sensor Data Completeness
Data Completeness (%)
86
88
90
92
94
96
98
100
Heart Rate
Body Temp
Sensor
Controlled
Residential
C. Detection Latency by Anomaly Type
Mean Time to Detect (seconds)
0
20
40
60
80
100
120
140
160
Bradycardia
Fever
Tachycardia
Anomaly
Controlled
Residential
D. Processing Latency Distribution
Density
0
5
10
15
20
25
30
0.0
0.1
0.2
0.3
0.4
0.5
0.6
Processing Latency (seconds)
Controlled
Residential