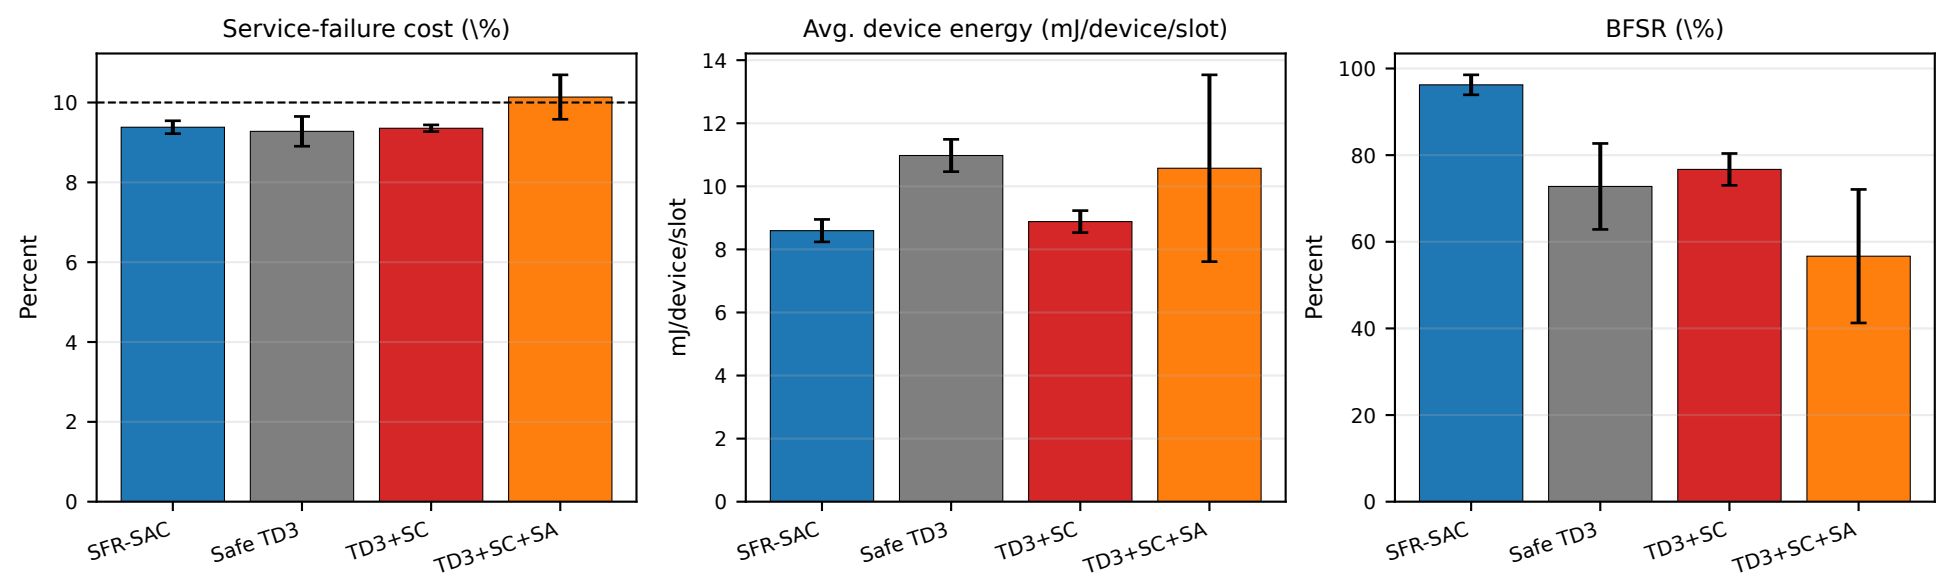
Service-failure cost (\%)
Percent
0
2
4
6
8
10
SFR-SAC
Safe TD3
TD3+SC
TD3+SC+SA
Avg. device energy (mJ/device/slot)
mJ/device/slot
0
2
4
6
8
10
12
14
SFR-SAC
Safe TD3
TD3+SC
TD3+SC+SA
BFSR (\%)
Percent
0
20
40
60
80
100
SFR-SAC
Safe TD3
TD3+SC
TD3+SC+SA